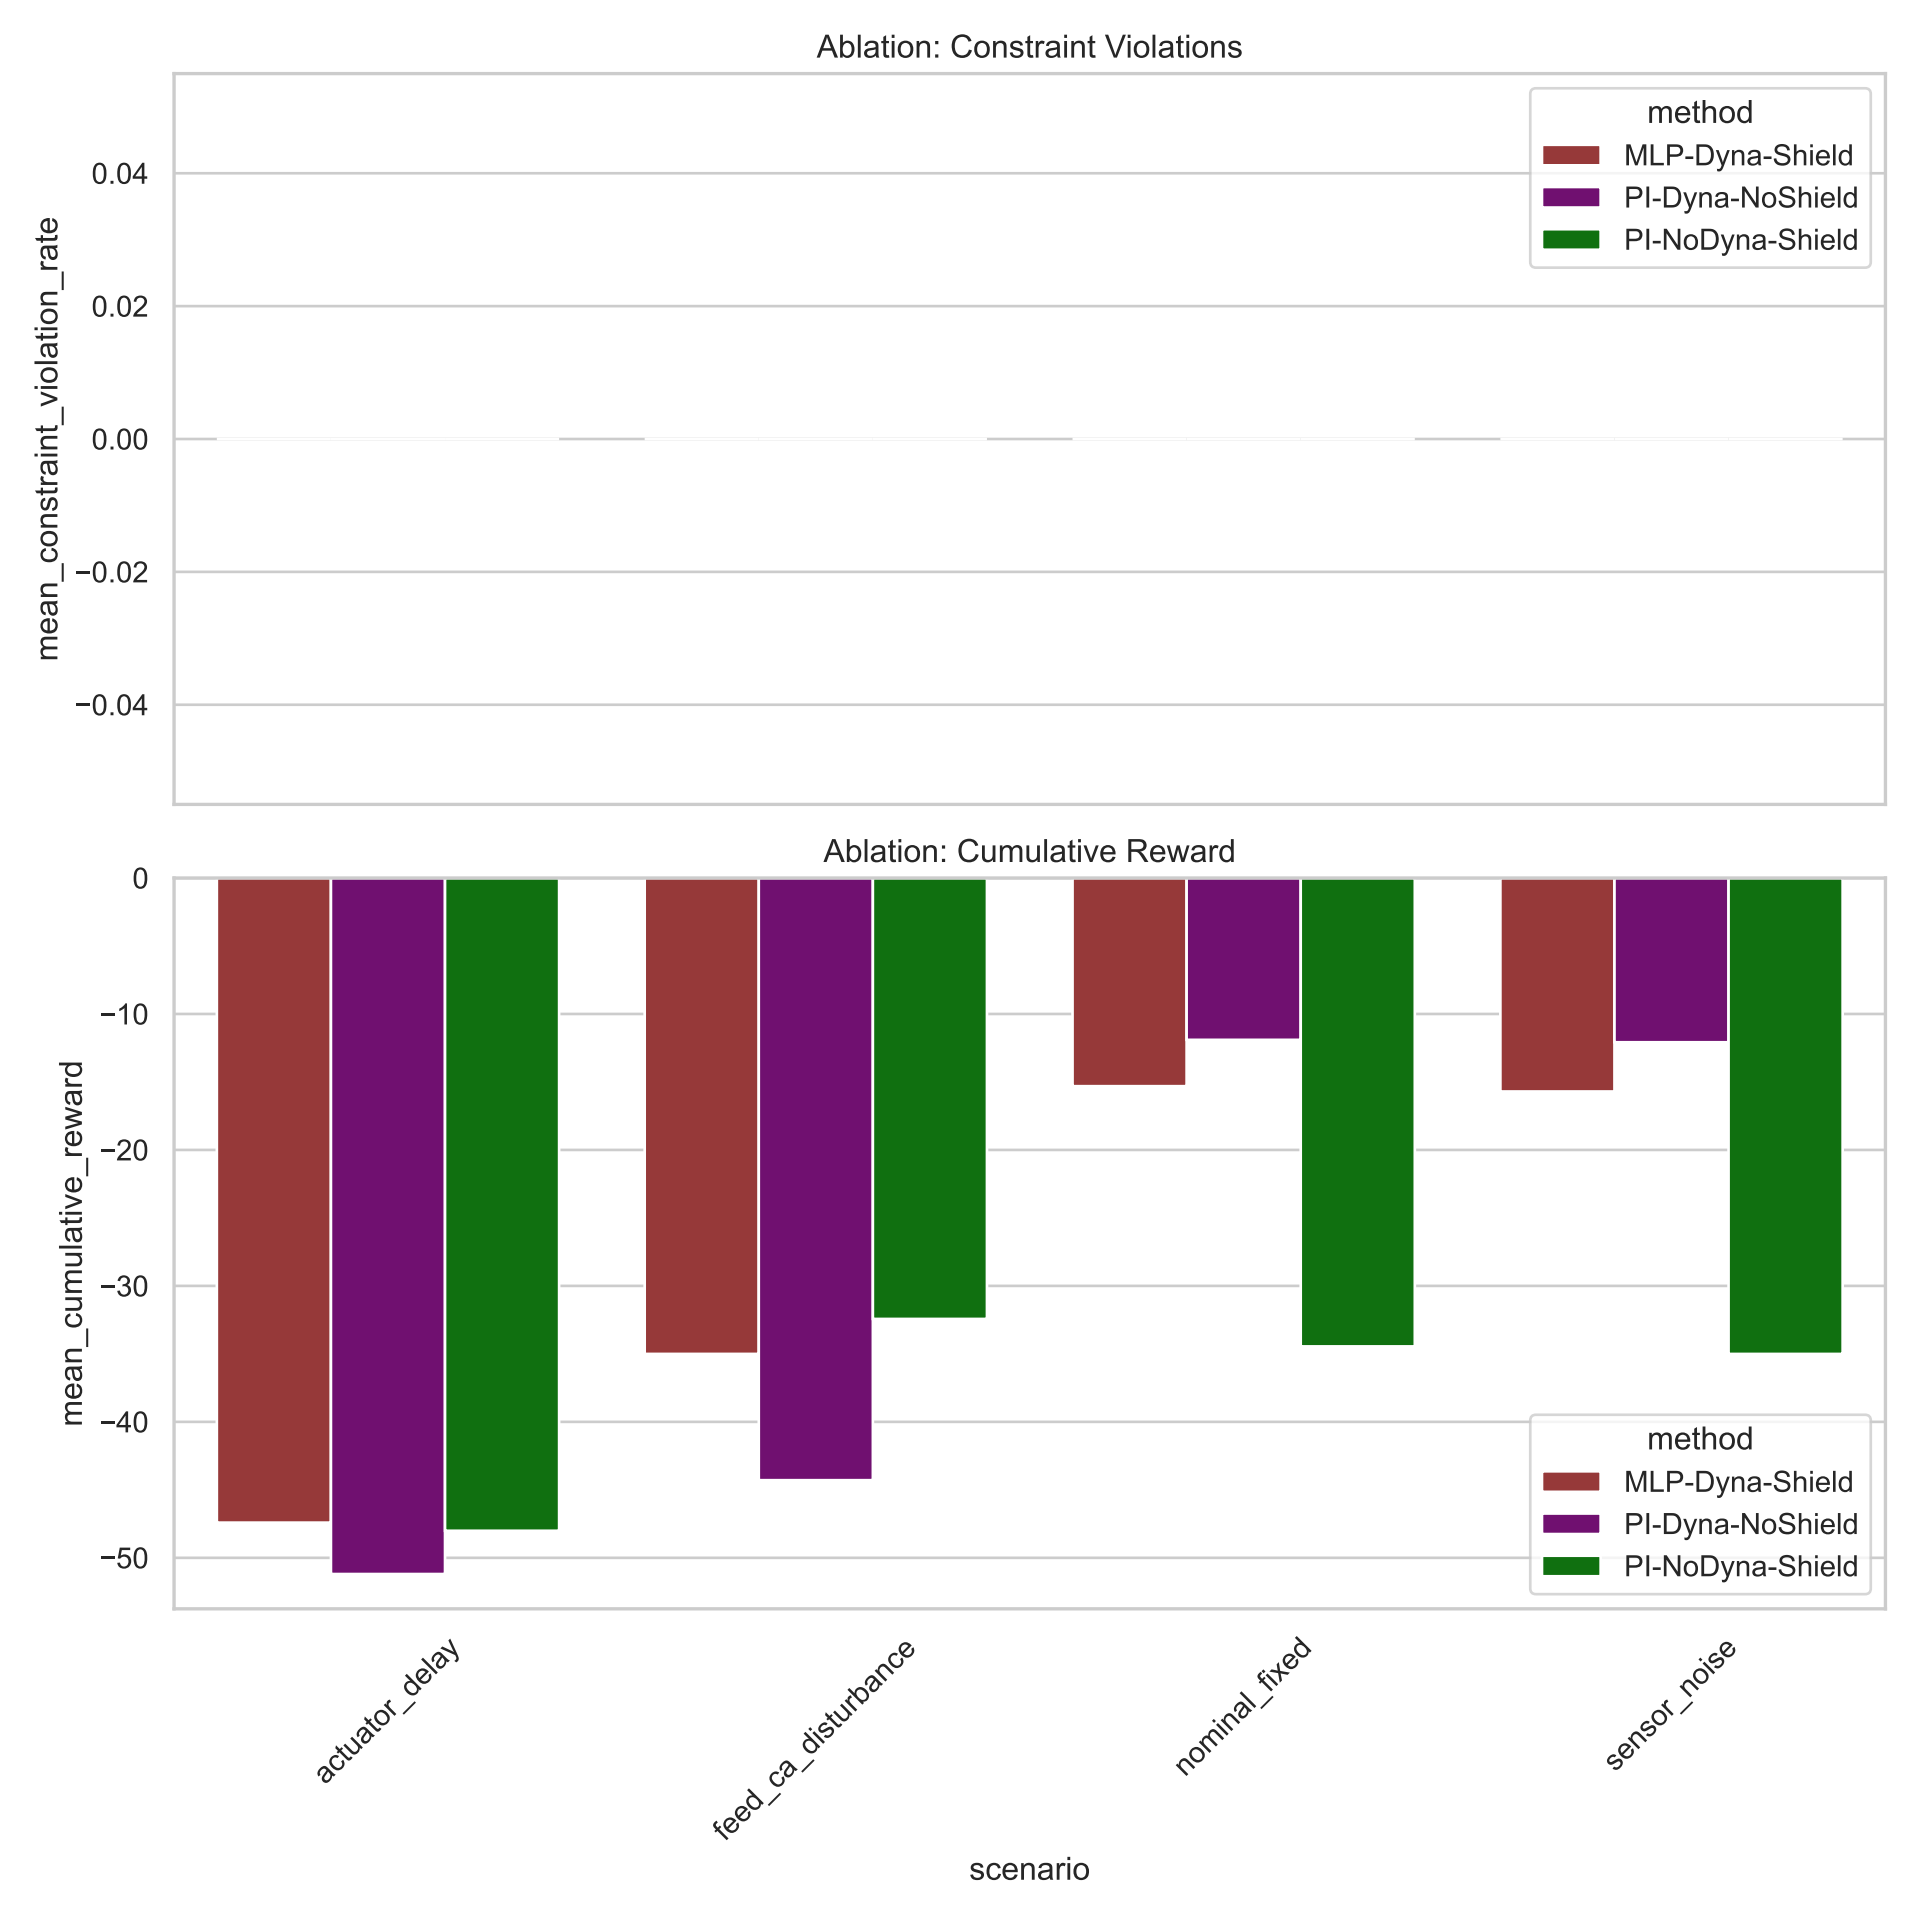
Ablation: Constraint Violations
mean_constraint_violation_rate
0.04
0.02
0.00
−0.02
−0.04
method
MLP-Dyna-Shield
PI-Dyna-NoShield
PI-NoDyna-Shield
Ablation: Cumulative Reward
mean_cumulative_reward
0
−10
−20
−30
−40
−50
method
MLP-Dyna-Shield
PI-Dyna-NoShield
PI-NoDyna-Shield
actuator_delay
feed_ca_disturbance
nominal_fixed
sensor_noise
scenario