

	MANATEE COUNTY
BLD2602-3162	3/3/2026
REVIEWED FOR CONCRETE & FOUNDATION DESIGN:	
This set of plans for ALL CONCRETE AND FOUNDATIONS ATTACHED TO THE job site at all times. Host Structure shall have a pre inspection. make changes to the drawings. SOIL BEARING PRESSURE SHALL BE A MINIMUM OF 1500 PSF. THE BEARING CAPACITY OF THE SOIL TO BE VERIFIED BY A LICENSED CONTRACTOR PRIOR TO ANY POURING OF CONCRETE. 3. ALL CONCRETE GRADE BEAMS AND FOOTINGS SHALL BE 3000 PSI MINIMUM. 4. ALL SLABS ON GRADE SHALL BE A MINIMUM OF 4" THICK WITH FIBERMESH OR WIREMESH REINFORCING. 5. ALL OTHER FLOOR CONCRETE FILLED SUPPORTED SLABS SHALL BE 3000 PSI MIN., 2" MIN. THICKNESS WITH EPOXY.	

Zoning Review: Jalran Hejazifar Heitz
- Approved 3/3/2026

GENERAL NOTES SECTIONS

1. ALL CONCRETE AND FOUNDATIONS ATTACHED TO THE HOST STRUCTURE SHALL HAVE A PRE INSPECTION.
2. SOIL BEARING PRESSURE SHALL BE A MINIMUM OF 1500 PSF. THE BEARING CAPACITY OF THE SOIL TO BE VERIFIED BY A LICENSED CONTRACTOR PRIOR TO ANY POURING OF CONCRETE.
3. ALL CONCRETE GRADE BEAMS AND FOOTINGS SHALL BE 3000 PSI MINIMUM.
4. ALL SLABS ON GRADE SHALL BE A MINIMUM OF 4" THICK WITH FIBERMESH OR WIREMESH REINFORCING.
5. ALL OTHER FLOOR CONCRETE FILLED SUPPORTED SLABS SHALL BE 3000 PSI MIN., 2" MIN. THICKNESS WITH EPOXY.
6. THE CONCRETE SHALL CONFORM TO ASTM C94 FOR THE FOLLOWING:
- OPC (PORTLAND CEMENT TYPE 1,- ASTM C 150).
 - AGGREGATES - #6 STONE , ASTM C 33 SIZE NO. 67 LESS THAN 3/4".
 - AIR ENTRAINING +/- 1% - ASTM C 260.
 - WATER REDUCING AGENT - ASTM C 494.
 - CLEAN POTABLE WATER.
 - OTHER ADMIXTURES SHALL NOT BE PERMITTED.
7. FIBERMESH REINFORCEMENT TO BE 3000 PSI (3/4" PER CUBIC YARD MIN.) AND MEET APPROPRIATE ACI AND ASTM REQUIREMENTS.
8. METAL BARS SHALL CONFORM TO ASTM A 185.
9. ALL REINFORCING SHALL CONFORM TO ASTM A615,BE GRADE 60 (60 KSI MIN.) DEFORMED BARS, #3 BARS MAY BE GRADE 40.
10. PREPARE & PLACE CONCRETE ACCORDING TO AMERICAN CONCRETE INSTITUTE MANUAL STANDARD PRACTICE, PART 1, 2, & 3 ALONG WITH HOT WEATHER CONDITIONS RECOMMENDATIONS.
11. IF UTILIZING EXISTING CONCRETE FOR FOUNDATION, CONCRETE SHALL BE A MINIMUM OF 4" IN THICKNESS, VISIBLY FREE OF ANY STRUCTURAL EXCESSIVE CRACKING, SPALLING OR OTHER DETERIORATION.
12. CONTRACTOR TO FIELD VERIFY ANY EXISTING FOUNDATIONS NOTED ON SHEET S-1, DESIGN DATA: NOTE 10.
13. DRY PACKING/POURING IS NOT PERMITTED
- B. MASONRY:**
- CONCRETE MASONRY UNITS (CMU) SHALL BE STANDARD HOLLOW UNITS AND SHALL BE 2000 PSI MINIMUM BASED ON TYPE M OR S MORTAR.
 - ALL MORTAR SHALL BE OF TYPE M OR S.
 - ALL GROUT SHALL BE 2000 PSI MINIMUM AND HAVE MAXIMUM COARSE AGGREGATE SIZE OF 3/8".
 - PROVIDE CLEAN-OUTS FOR REINFORCED CELLS CONTAINING REINFORCEMENT WHEN GROUT POUR EXCEEDS 5'-0" IN HEIGHT.
- C. ALUMINUM:**
- ALL STRUCTURAL ALUMINUM SHALL CONFORM TO THE MINIMUM REQUIREMENTS OF 6005-T5 FOR ALLOY WITH A MINIMUM THICKNESS OF 0.040" FOR SUPPORTING MEMBERS.
 - ALL PLATES, ANGLES, AND CHANNELS SHALL BE 6005 T5 OR T6 ALLOY.
 - WHERE KICK PLATES ARE USED A MINIMUM THICKNESS OF 0.024" SHALL APPLY.
 - STRUCTURAL ALUMINUM DESIGN CONFORMS TO "PART 1-A - SPECIFICATIONS FOR ALUMINUM STRUCTURES - ALLOWABLE STRESS DESIGN" OR "PART 1-B - SPECIFICATIONS FOR ALUMINUM STRUCTURES - BUILDING LOAD AND RESISTANCE FACTOR DESIGN" OF THE ALUMINUM DESIGN MANUAL PREPARED BY THE ALUMINUM ASSOCIATION, INC.WASHINGTON D.C. FLORIDA BUILDING CODE EIGHTH EDITION (2023), BUILDING (CHAPTER 16 STRUCTURAL DESIGN & CHAPTER 20 ALUMINUM).
 - WHERE ALUMINUM COMES INTO CONTACT WITH STEEL, OR PRESSURE TREATED LUMBER PROVIDE DIELECTRIC SEPARATION.
 - ALUMINUM SELF MATING BEAM MEMBERS SHALL BE STITCHED WITH NO LESS THAN #10 SMS 6" FROM THE ENDS AND 12" ON CENTER, IF USING #12 SPACING MAY BE 24" ON CENTER.
 - VINYL AND ACRYLIC PANELS SHALL BE REMOVABLE. THEY SHALL BE IDENTIFIED WITH A DECAL ESSENTIALLY STATING "REMOVABLE PANEL SHALL BE REMOVED WHEN WIND SPEEDS EXCEED 75 MPH" .

- DECAL SHALL BE PLACED SO IT IS VISIBLE WHEN PANEL IS INSTALLED. VINYL AND ACRYLIC PANELS MAY NOT BE USED IN FLOOD ZONE A.
- 1"X2"X0.040" NON-STRUCTURAL MEMBERS SHALL BE ATTACHED TO HOST WITH 1/4"Ø X 1-3/4" EMBEDMENT & 24" O.C. MASONRY SCREW FOR CONCRETE & EQUIVALENT SIZE WOOD SCREW WHEN IN WOOD & #10X 1/2" EMBEDMENT SMS OR TEK SCREWS IN ALUMINUM MEMBERS TYPICAL.
 - ALL 5",7", AND 9" GUTTERS SHALL BE STRUCTURAL GUTTERS
- D. FASTENERS:**
- ALL LAG BOLTS SHALL CONFORM TO STAINLESS STEEL TYPE 300 18-8, WITH STANDARD FLAT WASHER UNLESS MANUFACTURER GALVANIZES BOLTS SPECIFIES FOR USE WITH ACQ PRESSURE TREATED WOOD.
 - HEX BOLTS HAS TO BE ASTM A 325, PLATED WITH STANDARD FLAT WASHERS AND NUTS.
 - ALL CONCRETE SCREWS SHALL BE, SIMPSON, HILTI, RAWL, TAPCON, REDHEAD, DYNABOLT, PORTECT OR APPROVED EQUAL.
 - ALL METAL TIES AND ASSOCIATED ACCESSORIES SHALL BE HOT DIPPED GALVANIZED.
 - ALL LAG BOLTS SHALL HAVE A MINIMUM EMBEDMENT OF 8X BOLT DIAMETER INTO STRUCTURAL FRAMING (G=42 MIN.).
 - LAG BOLTS AND SCREWS INTO WOOD FRAMING SHALL BE PROVIDED WITH PILOT HOLES HAVING A DIAMETER NOT GREATER THAN 70 PERCENT OF THE THREAD DIAMETER OF THE BOLT OR SCREW. ALL LAG BOLTS AND SCREWS SHALL BE INSERTED IN PILOT HOLES BY TURNING AND UNDER NO CIRCUMSTANCES BY DRIVING WITH A HAMMER.
 - ALL EXPANSION ANCHORS SHALL BE DESIGNED IN ACCORDANCE WITH THE SPECIFIC MANUFACTURER'S REQUIREMENTS AND ALLOWABLE LOADS AND SHALL ONLY BE APPLIED IN CONDITIONS ACCEPTABLE TO MANUFACTURER. FASTENERS SHALL BE A MINIMUM OF SAE GRADE #5 OR BETTER ZINC PLATED.
 - ALL FASTENERS CONNECTING ALUMINUM COMPONENTS OR PRESSURE TREATED LUMBER ARE STAINLESS STEEL TYPE 300 18-8, UNLESS MANUFACTURER GALVANIZED BOLTS SPECIFIES FOR USE WITH ACQ PRESSURE TREATED WOOD, OR OTHERWISE NOTED ON PLANS.
 - ALL FASTENERS SHALL COMPLY WITH ASTM A153.
 - ALL CONNECTORS SHALL COMPLY WITH ASTM A653 CLASS G-185.
 - FOR SMS, THE MINIMUM CENTER-TO-CENTER SPACING SHALL BE 3/4" AND MINIMUM CENTER-TO-EDGE SHALL BE 1/2" UNLESS NOTED OTHER WISE.

E. REFERENCE STANDARDS: (CURRENT EDITIONS OF)

ASTM E 119
ASTM E 1300
ASCE 7
ALUMINUM DESIGN MANUAL-AA ASM35, AND SPEC. FOR ALUMINUM PART 1-A, & 1-B
ASTM C94
ASTM C150
ASTM C33
ASTM C260
ASTM C494
ASTM A615
ASTM A185
FLORIDA BUILDING CODE EIGHTH EDITION (2023), BUILDING
FLORIDA BUILDING CODE EIGHTH EDITION (2023), RESIDENTIAL
FLORIDA BUILDING CODE EIGHTH EDITION (2023), EXISTING
HUD CODE

F. ABBREVIATIONS:

- THE FOLLOWING LIST OF ABBREVIATIONS IS NOT INTENDED TO REPRESENT ALL THOSE USED ON THESE DRAWINGS, BUT TO SUPPLEMENT THE MORE COMMON ABBREVIATIONS.
- TYP -- TYPICAL
 - SIM -- SIMILAR
 - UON -- UNLESS OTHERWISE NOTED
 - CONT -- CONTINUOUS
 - VIF -- VERIFY IN FIELD
 - SMB -- SELF MATING BEAM
 - FSM -- FLORIDA SALES AND MARKETING
 - REC -- RECEIVING CHANNEL

G. RESPONSIBILITY:

- ALL SITE WORK SHALL BE PERFORMED BY A LICENSED CONTRACTOR IN ACCORDANCE WITH APPLICABLE BUILDING CODES, LOCAL ORDINANCES, ETC.
- CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND DETAILS, NOTIFYING ENGINEER OF ANY DISCREPANCIES BETWEEN DRAWINGS, FABRICATED ITEMS, OR ACTUAL FIELD CONDITIONS.
- ALL DETAILS ON THESE DRAWINGS ARE ENGINEERED BASED ON INFORMATION PROVIDED BY THE CONTRACTOR AND/OR MANUFACTURER.
- ANY DETAILS NOT SHOWN ARE TO BE ENGINEERED BY A LICENSED P.E. IN ACCORDANCE WITH STANDARD ENGINEERING PRACTICES.
- WHEN ATTACHING TO FASCIA, THE HOST STRUCTURE SHALL HAVE AT LEAST A 2"X4" FASCIA AND ROOF TRUSS SYSTEM. CONTRACTOR SHALL VERIFY THIS AND IF SMALLER, CONTRACTOR SHALL BRING STRUCTURE UP TO A 2"X4" FASCIA AND ENSURE LESS THAN A 2'-0" OVERHANG.
- FBC PLANS & ENGINEERING SERVICES INC. DOES NOT WARRANT, EITHER EXPRESSLY OR IMPLIED, THE QUALITY OF THE CONSTRUCTION, AND IS NOT RESPONSIBLE FOR THE INTERPRETATION OF DESIGNS AND END USE BY THE CLIENT/CONTRACTOR.
- CONTRACTOR TO VERIFY FEMA FLOOD ZONE OF THE PROPOSED STRUCTURE LOCATION TO ENSURE STRUCTURE IS NOT WITHIN SPECIAL FLOOD HAZARD AREAS.
- H. MISCELLANEOUS:**
 - ALUMINUM ADDITIONS ARE NOT TO BE INSTALLED ON A MANUFACTURED HOME, TRAILER HOME, OR PRE-FAB HOME. IF NO HOST BEAM IS PRESENT, A SEPARATE 4TH WALL SUPPORT SYSTEM MUST BE ENGINEERED TO ENSURE NO ADDITIONAL LOADING IS PLACED ON THE MANUFACTURED HOME.
 - IF ENCLOSURE CONTAINS A SWIMMING POOL OR SPA, THE ENCLOSURE SHALL COMPLY WITH RESIDENTIAL SWIMMING BARRIER REQUIREMENTS OF FLORIDA BUILDING CODE EIGHTH EDITION (2023), RESIDENTIAL R 4501.17 IN ITS ENTIRETY.
 - DOOR LOCATIONS MAY BE DETERMINED IN THE FIELD BY CONTRACTOR.
 - IF PAVERS ARE UNDER ALUMINUM MEMBERS THEY SHALL HAVE EPOXY ADHESIVE TO CONCRETE OR IF USING GROUT, ENSURE BONDING AGENT IS USED FIRST AND ADHERED WITH MINIMUM 3000 PSI GROUT.
 - SCREENING MATERIAL SHALL BE 18X14X0.013 OR EQUIVALENT DENSITY SCREEN MESH ONLY UNLESS NOTED ON DRAWING S-2.
 - ALL STRUCTURAL POST SHALL BE ANCHORED TO AN EXISTING/PROPOSED CONCRETE FOUNDATION FOR UPLIFT PURPOSES.
 - CONTRACTOR TO ENSURE ALL PROPOSED GUTTERS HAVE A POSITIVE FLOW.
 - EMERGENCY ESCAPE & RESCUE OPENING PER FBC R310.1 SHALL BE VERIFIED BY CONTRACTOR & BUILDING OFFICIAL.
 - ENCLOSED ADDITIONS TO MANUFACTURED HOMES SHALL NOT CHANGE THE EXIT FACILITIES FOR EGRESS PER HUD 3280.105, (A) THROUGH (A)(2)(IV), SO THAT THE DISTANCE TO EXIT DIRECTLY OUTSIDE FROM ALL BEDROOMS IS LESS THAN 35', AND, SO THAT TWO EXITS DIRECTLY OUTSIDE ARE STILL MAINTAINED. A CARPORT OR SCREEN ROOM SHALL BE CONSIDERED AS OUTSIDE. NON-HABITABLE SUNROOMS OR HABITABLE LIVING SPACE MAY BE ADDED WHERE AN EXIT DOOR WAS LOCATED AS LONG AS A NEW EXIT DOOR IS ADDED AND MEETS THE REQUIREMENTS OF HUD 3280.105.
 - AWS CERTIFIED WELDER REQUIRED FOR ALL WELDING.

ALUMINUM STRUCTURAL MEMBERS

HOLLOW SECTIONS

2 X 2:-----2" X 2" X 0.044"
2 X 3:-----2" X 3" X 0.050"
2 X 4:-----2" X 4" X 0.050"
2 X 5:-----2" X 5" X 0.050"
3 X 3:-----3" X 3" X 0.125"

OPEN BACK SECTIONS

1 X 2:-----1" X 2" X 0.040"
1 X 3:-----1" X 3" X 0.045"

SNAP SECTIONS

2 X 2 SMS:-----2" X 2" X 0.045"
2 X 3 SMS:-----2" X 3" X 0.072"
2 X 4 SMS:-----2" X 4" X 0.045"
3 X 3 SMS:-----3" X 3" X 0.090"

SELF MATING (SMB)

2 X 4 SMB:-----2" X 4" X 0.044" X 0.100"
2 X 5 SMB:-----2" X 5" X 0.050" X 0.118"
2 X 6 SMB:-----2" X 6" X 0.050" X 0.120"
2 X 7 SMB:-----2" X 7" X 0.057" X 0.120"
2 X 8 SMB:-----2" X 8" X 0.072" X 0.224"
2 X 9 SMB:-----2" X 9" X 0.072" X 0.224"
2 X 10 SMB:-----2" X 10" X 0.092" X 0.374"

TUBE SECTIONS

2 X 2:-----2" X 2" X 0.090"

SUNROOM CAT. 1 (SCREEN ROOM W/ SCREEN ENCLOSURE)

DESIGN DATA: (SITE SPECIFIC DESIGN INFORMATION)

- ULTIMATE DESIGN WIND SPEED Vult, (3 SECOND GUST): 140 MPH
NOMINAL DESIGN WIND SPEED Vasd: 108 MPH
- RISK CATEGORY: 1
- WIND EXPOSURE: C
- WIND LOADS:

SCREEN ROOF:	11 PSF
SCREEN WALLS (WINDWARD):	38 PSF
SCREEN WALLS (LEEWARD):	29 PSF
SOLID ROOF:	39 PSF
- FACTOR APPLIED TO SCREEN WIND LOADS FOR 18/14: 0.88
FACTOR APPLIED TO SCREEN WIND LOADS FOR 20/20: 1.0
MESH TYPE AND LOCATION SHOWN ON S-2
FACTORS FOR OTHER SCREEN MESHES TO BE DETERMINED BY THE ENGINEER
- FACTOR APPLIED TO SCREEN WIND LOADS FOR ALLOWABLE STRESS DESIGN: 0.6
- LIVE LOAD:

300 lb. VERTICAL DOWNLOAD ON PRIMARY SCREEN ENCLOSURE MEMBERS.
200 lb. VERTICAL DOWNLOAD ON SCREEN ENCLOSURE PURLINS.
- SCREEN ROOF TYPE: MANSARD
- NON-SCREEN ROOF TYPE: ELITE EPS COMPOSITE PANEL ROOF, FLORIDA PRODUCT APPROVAL, FL 7561-R7.
- EXISTING FOOTING (MIN. 12"X 12" LINEAL FOOTING) MEETS THE REQUIREMENTS TO RESIST THE UPLOADS FOR THE PROPOSED STRUCTURE.

ALUMINUM STRUCTURAL MEMBERS

HOLLOW SECTIONS

2 X 2:-----2" X 2" X 0.044"
2 X 3:-----2" X 3" X 0.050"
2 X 4:-----2" X 4" X 0.050"
2 X 5:-----2" X 5" X 0.050"
3 X 3:-----3" X 3" X 0.125"

OPEN BACK SECTIONS

1 X 2:-----1" X 2" X 0.040"
1 X 3:-----1" X 3" X 0.045"

SNAP SECTIONS

2 X 2 SMS:-----2" X 2" X 0.045"
2 X 3 SMS:-----2" X 3" X 0.072"
2 X 4 SMS:-----2" X 4" X 0.045"
3 X 3 SMS:-----3" X 3" X 0.090"


SELF MATING (SMB)

2 X 4 SMB:-----2" X 4" X 0.044" X 0.100"
2 X 5 SMB:-----2" X 5" X 0.050" X 0.118"
2 X 6 SMB:-----2" X 6" X 0.050" X 0.120"
2 X 7 SMB:-----2" X 7" X 0.057" X 0.120"
2 X 8 SMB:-----2" X 8" X 0.072" X 0.224"
2 X 9 SMB:-----2" X 9" X 0.072" X 0.224"
2 X 10 SMB:-----2" X 10" X 0.092" X 0.374"

TUBE SECTIONS

2 X 2:-----2" X 2" X 0.090"

This item has been digitally signed and sealed by Ian J. Foster. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



Digitally signed by
Ian J Foster


Date: 2026.02.04

13:59:29 -05'00'

PROFESSIONAL ENGINEER SEAL		 	
---------------------------------------	--	---	--

A circular professional engineer seal for Ian J. Foster. The outer ring contains the text "IAN J. FOSTER" at the top and "PROFESSIONAL ENGINEER" at the bottom, separated by two stars. Inside the ring, the word "LICENSE" is at the top, "No. 93654" is in the center, and "STATE OF FLORIDA" is at the bottom, also separated by two stars.

Digitally signed by
Ian J Foster
Date: 2026.02.04
13:59:36 -05'00'

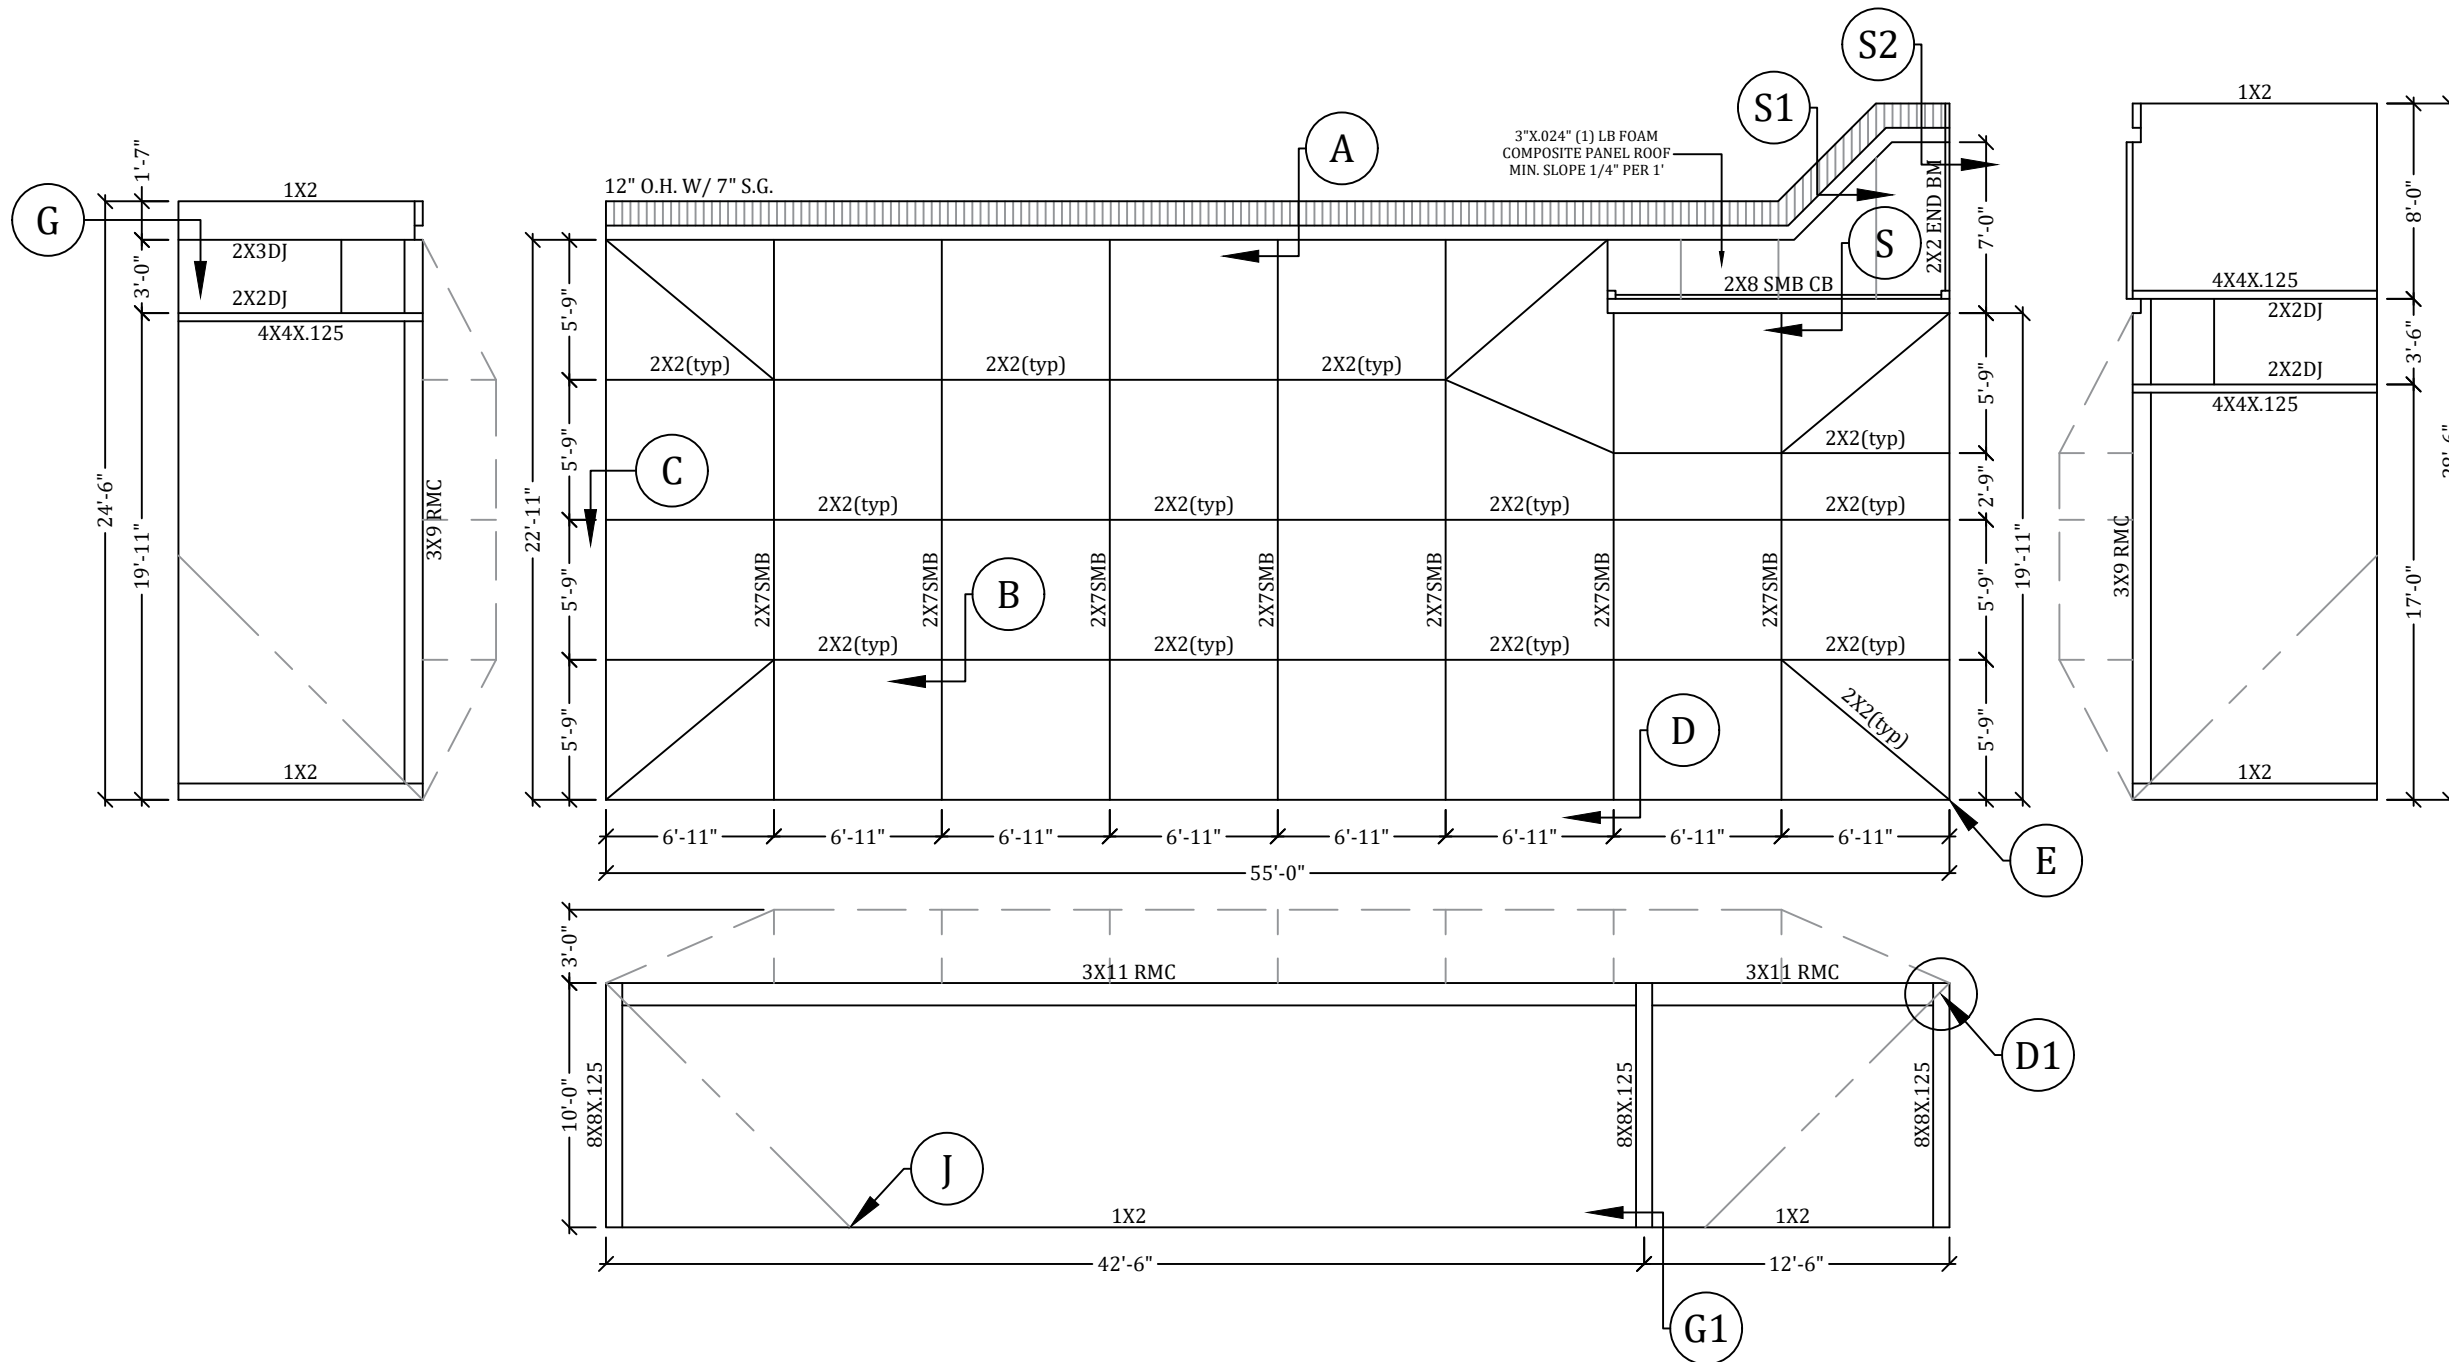

F


DOOR LOCATION MAY BE DETERMINED IN THE FIELD BY THE CONTRACTOR.

S-2A		DRAWING		JOB NUMBER: 26_0202_730_HAMBORG, REPLACEMENTC DRAW DATE: 02/02/2026 REVISION 1: 6301 PORTER ROAD UNIT 12 SARASOTA, FL 34240 REVISION 2: REVISION 3:		PROJECT HAMBORG 7014 REMINGTON CT. MANATEE, FL 34201		 FLORIDA BUILDING CODE PLANS & ENGINEERING SERVICES, INC		FBC PLANS & ENGINEERING SERVICES, INC.		P.E. OF RECORD	
												DAVID W. SMITH FL 53608	
								ADDRESS: 5344 9th Street Zephyrhills, FL 33542		THOMAS L. HANSON FL 38654			
								PHONE: (813)838-0735		IAN J. FOSTER FL 93654			
								FAX: 1-(866)824-7894					
								E-MAIL: erb@fbcpplans.com		JOEL FALARDEAU FL 70667			
								WEBSITE: www.fbcpplans.com					
								C.O.A.: #29054		ERIK STUART FL 77605			

MANATEE COUNTY
BUILDING & DEVELOPMENT SERVICES
APPROVED

BLD2602-3162 3/3/2026

REVIEWED FOR CODE COMPLIANCE
This set of plans must be kept on the job site at all times. It is unlawful to make changes without written approval from Manatee County Building & Development Services. The approval of these documents does not grant authority to violate any current Local, State or Federal Codes.

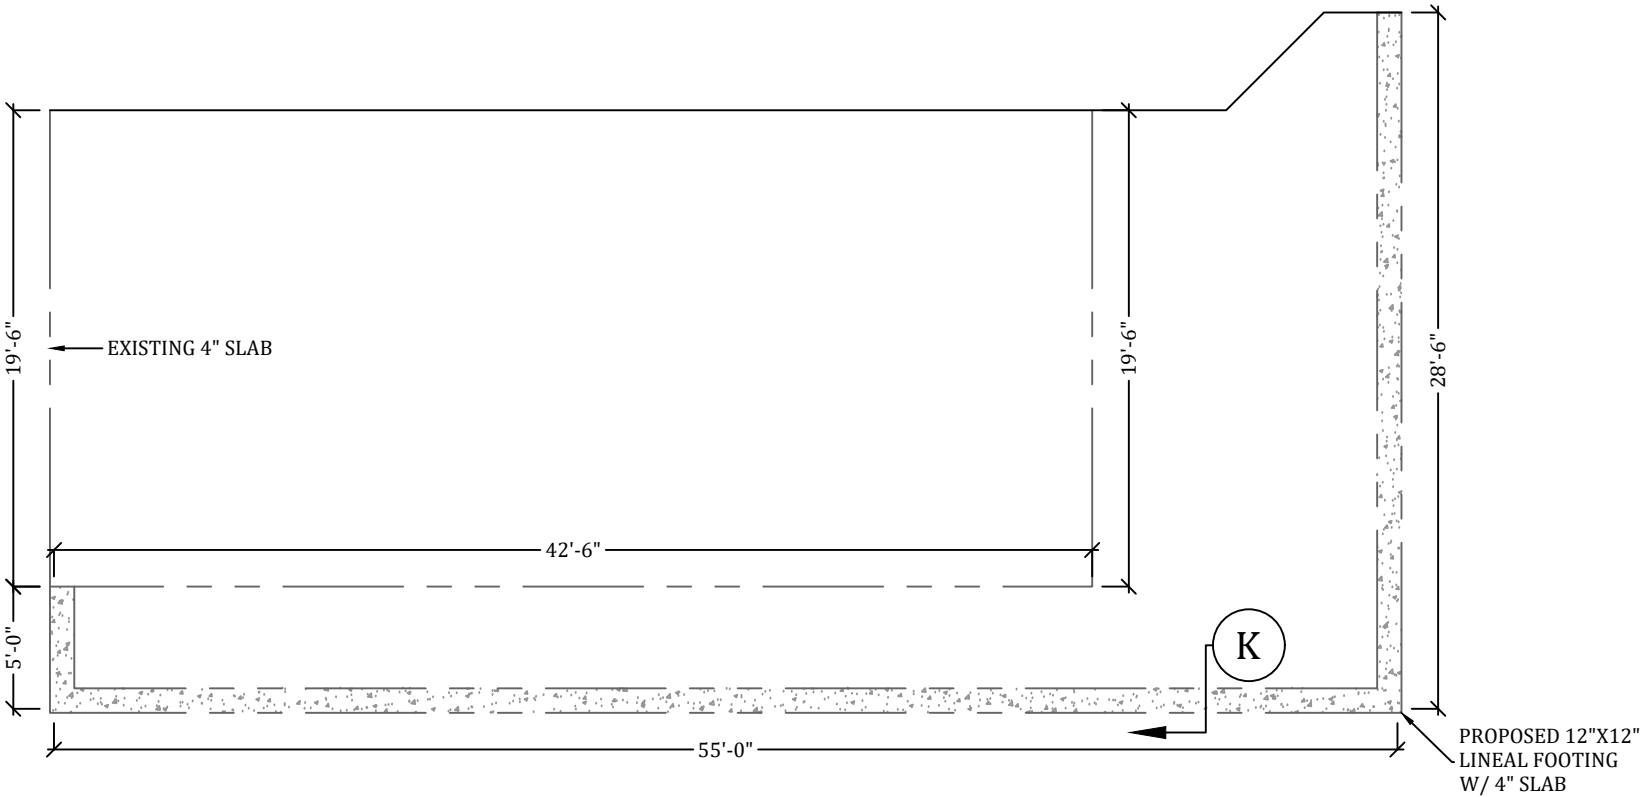

FOUNDATION PLAN

This item has been digitally signed and sealed by Ian J. Foster. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

IAN J. FOSTER
LICENSE
No. 93654
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

Digitally signed by
Ian J Foster
Date: 2026.02.04
13:59:42 -05'00'

PROFESSIONAL ENGINEER SEAL

JOB NUMBER: 26_0202_730_HAMBORG_REPLACEMENT	P. E. OF RECORD	
	DAVID W. SMITH	FL 53608
	THOMAS L. HANSON	FL 38654
	IAN J. FOSTER	FL 93654
	JOEL FALARDEAU	FL 70667
	ERIK STUART	FL 77605

FBC PLANS & ENGINEERING SERVICES, INC.

ADDRESS: 5344 9th Street
Zephyrhills, FL 33542
PHONE: (813)838-0735
FAX: 1-(866)824-7894
E-MAIL: erb@bcplans.com
WEBSITE: www.bcpplans.com
C.O.A.: #29054

Florida Building Code
PLANS & ENGINEERING SERVICES, INC.

PROJECT
HAMBORG
7014 REMINGTON CT.
MANATEE, FL 34201

CONTRACTOR
REPLACE MY CAGE
6301 PORTER ROAD UNIT 12
SARASOTA, FL 34240

DRAW DATE: 02/02/2026
REVISION 1:
REVISION 2:
REVISION 3:

DRAWING

S-2B

MANATEE COUNTY
BUILDING & DEVELOPMENT SERVICES

APPROVED

BLD2602-3162 3/3/2026

REVIEWED FOR CODE COMPLIANCE

This set of plans must be approved by the Building & Development Department. It is unlawful to make changes without written approval from Manatee County Building & Development Department. The approval of these documents does not grant authority to alter the current Local, State or Federal

FOR WOOD:
(4) 1/4" LAG SCREWS @ 1-1/2" SPACING @ EA. GUTTER BRACKET & (1)1/4" LAG SCREWS @ 12" O.C. MAX. MINIMUM EMBEDMENT SHALL BE 2"

FOR CONCRETE:
(3)3/8" CONCRETE SCREWS @ 2" SPACING @ EA. GUTTER BRACKET & (1) 3/8" CONCRETE SCREWS @ 24" O.C. MAX. MINIMUM EMBEDMENT SHALL BE 2"

(1) 5", 7", OR 9"X6" WIDTH X 0.072" MIN. EXTRUDED GUTTER BRACKET @ EA. BEAM & (1) GUTTER BRACKET BETWEEN BEAMS.

OPTIONAL 1" X 2" X 0.045" OPEN BACK W/ (2)#12 X 1-1/2" @ BEAM & AT GUTTER @ 24" O.C. (MAY USE 2X2 IN LIEU OF 1X2, USE #12 X 2-1/2" TEKS, SAME PATTERN APPLIES)

2" X 2" X 1/8" X ALUMINUM ANGLE w/ (4) #12 X 3/4" SMS INTO BEAM ON EA SIDE EA. LEG

2"X2"X0.062" RECEIVING CHANNEL W/ A MINIMUM OF (2) AND UP TO (4) #10X 3/4" EA SIDE TO COVER EXPOSED BEAM (NO MORE THAN 6" MAY BE CUT HORIZONTALLY)

2"X2" OR 2"X3"PURLIN (SEE S-2 FOR SIZE)

2" X 2" X 1/8" ALUMINUM ANGLE W/ (4) #12 X 3/4" SMS INTO PURLIN ON EA SIDE

5",7" OR 9" SUPER GUTTER

(4) #12 X 3/4" SMS INTO GUTTER EA SIDE

OPTIONAL Z-BRACKET 0.250"

OPTIONAL 1" X 2" X 0.045" OPEN BACK W/ (2)#12 X 1-1/2" @ BEAM & AT GUTTER @ 24" O.C. (MAY USE 2X2 IN LIEU OF 1X2, USE #12 X 2-1/2" TEKS, SAME PATTERN APPLIES)

NOTES:

1. 2X4 SMB BEAM ONLY REQUIRES 4" WIDTH GUTTER BRACKET W/ (2) 3/8" LAGS

2. FOR 9" SUPER GUTTER, AT THE PURLIN CONNECTION: USE 4" WIDTH GUTTER BRACKETS TYP

A

GUTTER BRACKET & BEAM ATTACHMENT DETAIL
SCALE: N.T.S.

2" X _PURLINS (SEE S-2 FOR SIZE) ATTACHED TO BEAM w/MIN (4) #10 X 1 1/2" SMS

ALUMINUM GUSSET PLATE (SEE CHARTS FOR SMS SIZE, QTY, AND PATTERN)

QTY. (B) #SMS

1/2" TYP

1/2" TYP

1/2" TYP

S3 PLATE WIDTH (SEE TABLE)

PLATE DEPTH (1" LESS BEAM DEPTD)

NOTES:

1. TOTAL NUMBER OF SCREWS PER JOINT EQUALS 4 TIMES "B".

2. PLATE WIDTH SHALL BE DETERMINED FROM ANGLE OF BEAM AND MINIMUM SPACE REQUIRED."S3" IS MINIMUM PLATE WIDTH.

3. GUSSET PLATES CAN EXTERNAL OR INTERNAL.

4. INTERNAL SCREWS FOR PURLIN CONNECTION MAY BE INCLUDED IN TOTAL NUMBER OF SCREWS.

5. **ALL** SPLICES WILL HAVE THE SAME PATTERN.

6. **ALL** SCREWS SHALL BE SPACED EQUALLY.

7. DETAIL SHOWS 2X6SMB WITH 1/8" ALUMINUM GUSSET PLATE AS AN EXAMPLE.

BEAM	GUSSET PLATE	SMS	"B"	"S3"
2X4	1/8"	#12	9/18/36	16"
2X5	1/8"	#12	9/18/36	16"
2X6	3/16"	#12	9/18/36	16"
2X7	3/16"	#12	10/20/40	18"
2X8	3/16"	#12	14/28/56	18"
2X8	3/16"	#14	12/24/48	18"
2X9	3/16"	#14	14/28/56	20"
2X10	3/16"	#14	15/30/60	20"

B

BEAM SPLICE GUSSET DETAIL
SCALE: N.T.S.

2"X2"X0.62" RECEIVING CHANNEL W/ (4) #10X3/4" SMS EACH SIDE OF PURLIN & INTO CARRIER BEAM (MAY USE ANGLES EA SIDE)

PURLIN

2" X _SMB EAVE RAIL MEMBER (UNLESS OTHERWISE NOTED ON S-2) ATTACHED TO PURLIN W/ (2) #10 X 4" SMS THRU SCREW BOSS

1"X2"X0.045" OPEN BACK ATTACHED TO EAVE RAIL MEMBER #10X1-1/2" SMS @ 12" O.C

C

SLOPED OR FLAT PURLIN CONNECTION DETAIL
SCALE: N.T.S.

CARRIER BEAM

ROOF BEAM (SLOPED OR FLAT)

2" X 2" X 0.125" ANGLE EA SIDE

SEE TABLE BELOW FOR SCREW SIZE & AMOUNT (TYP EACH SIDE, EACH LEG)

1" X 2" MEMBER FOR SCREENING

#10 X 1-1/2" SMS @ 12" O.C. (MAX) CONNECTING 1" X 2" TO CARRIER BEAM

ROOF BEAM SIZE	3/4" SMS PER SIDE PER LEG OF ANGLE	QTY.
2X4	#12	4
2X5	#12	5
2X6	#12	5
2X7	#14	6
2X8	#14	7
2X9	#14	8
2X10	#14	9

D

BEAM TO CARRIER BEAM CONNECTION DETAIL
SCALE: N.T.S.

BOTH ENDS SIMILAR

1 1/2" x 8" x 1/8" ALUMINUM PLATE W/ (4) #14X 3/4" IN EAVE RAIL / CORNER BRACKET& BRACE

1 3/4"

STRAP INSIDE ROOF BRACE

CORNER PIECE MADE FROM 2X2X0.044 MATERIAL W/#12X2" EA SIDE

(4) #14 @ EAVE RAIL (2) @ CORNER PIECE (4)@ BRACE

E

ROOF BRACING CONNECTION DETAIL
SCALE: N.T.S.

HINGE LOCATION

2" X 2" EXTRUSION

HINGE LOCATION

DOOR

2" X 2" EXTRUSION

HINGE LOCATION

NOTES:

1. HINGES SHALL BE ATTACHED TO STRUCTURE W/ (3) #10 X 5/8" SMS MINIMUM.

2. DOOR SHALL BE ATTACHED TO ENCLOSURE W/(2) HINGES MINIMUM.

3. HINGES SHALL BE ATTACHED TO DOOR WITH (3)#10 X 5/8" SMS. FASTEN A 1" X 2" X 0.044" TO UPRIGHT W/#12 X 1" SMS @ 12" O.C. AND WITHIN 3" FROM END OF THE UPRIGHT(IF APPLICABLE).

F

TYPICAL SCREEN DOOR CONNECTION DETAIL
SCALE: N.T.S.

This item has been digitally signed and sealed by Ian J. Foster. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

IAN J. FOSTER
LICENSE
No. 93654
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

Digitally signed by
Ian J Foster
Date: 2026.02.04
13:59:48 -05'00'

PROFESSIONAL ENGINEER SEAL

P.E. OF RECORD	FL 53608	FL 38654	FL 93654	FL 70667	FL 77605
DAVID W. SMITH	THOMAS L. HANSON	IAN J. FOSTER	JOEL FALARDEAU	ERIK STUART	

FBC PLANS & ENGINEERING SERVICES, INC.

ADDRESS: 5344 9th Street Zephyrhills, FL 33542

PHONE: (813)838-0735

FAX: 1-(866)824-7894

E-MAIL: erb@fbcplans.com

WEBSITE: www.fbcplans.com

C.O.A.: #29054

Florida Building Code

PLANS & ENGINEERING SERVICES, INC.

PROJECT

HAMBORG
7014 REMINGTON CT.
MANATEE, FL 34201

CONTRACTOR

REPLACE MY CAGE
6301 PORTER ROAD UNIT 12
SARASOTA, FL 34240

JOB NUMBER:

26_0202_730_HAMBORG_REPLACEMC

DRAW DATE: 02/02/2026

REVISION 1:


REVISION 2:

REVISION 3:

DETAILS

S-3

MANATEE COUNTY
BUILDING & DEVELOPMENT SERVICES
APPROVED
BLD2602-3162 3/3/2026
REVIEWED FOR CODE COMPLIANCE
This set of plans was reviewed for code compliance on the job site at all times. It is understood that the reviewer does not make changes without written approval from Manatee County Building & Development Services. The reviewer does not grant authority to violate any current Local, State or Federal Codes.

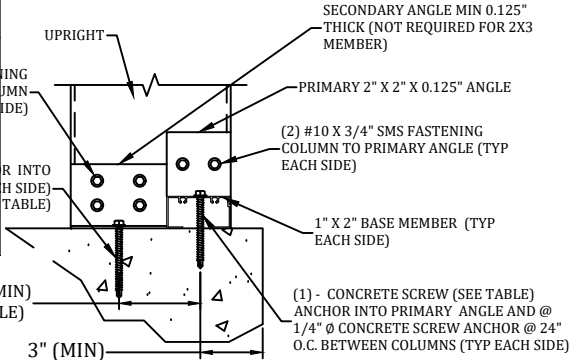

- NOTES:
1. NUMBER OF ANCHORS "B" IS EACH SIDE INTO THE SECONDARY ANGLE AND DOES NOT INCLUDE THE ANCHOR INTO THE 1X2.
2. MINIMUM EMBEDMENT OF ANCHORS INTO CONCRETE FOOTING SHALL BE 2-3/4" AT ALL UPRIGHT LOCATIONS. ALL SCREW LENGTHS AT UPRIGHT CONNECTIONS SHALL BE OF SUFFICIENT LENGTH FOR REQUIRED EMBEDMENT INTO CONCRETE FOOTING WHEN A PAVER DECK IS PRESENT.
3. CONCRETE SCREW ANCHOR DESIGNS ARE BASED ON THOSE LISTED ON S-1, D. FASTENERS, OTHER BRAND & TYPE SHALL BE APPROVED BY ENGINEER.
4. 2X3W/1X2 CORNER POST SHALL REQUIRE SAME BASE CONNECTIONS AS 2X4 SHOWN IN TABLE.
5. IF FOR AN IN-FILL, TOP OF COLUMN CONNECTION SIMILAR IF CONCRETE LINTEL.
6. IF WOOD LINTEL/DECK, DOUBLE LEDGE REQUIRED (MIN. 3 5/8") MAY SUBSTITUTE LAG SCREW FOR LDT FOR BOTH PRIMARY & SECONDARY ANGLES.
7. 2X2X.045 DOOR JAMB MEMBER SHALL CONNECT SIMILAR TO 2X3 MEMBER.
8. SEE S-1, DESIGN DATA: NOTE 10 FOR FOUNDATION INFORMATION.
- | COLUMN SIZE | 1/4" AND 3/8" Ø CONCRETE SCREW ANCHOR | |
|-------------|---------------------------------------|-----------------|
| | "B" | MINIMUM SPACING |
| 2X3-1/4" | 0 | 0" |
| 2X4-1/4" | 1 | 2" |
| 2X5-1/4" | 1 | 2 1/2" |
| 2X6-3/8" | 1 | 3" |
| 2X7-3/8" | 1 | 3 1/2" |
| 2X8-3/8" | 2 | 3" |
| 2X9-3/8" | 2 | 3 1/2" |
| 2X10-3/8" | 2 | 4" |


G

2" X 3" OR LARGER UPRIGHT TO CONCRETE W/WO PAVER

DETAILS
SCALE: N.T.S.

OPTION #1


OPTION #2

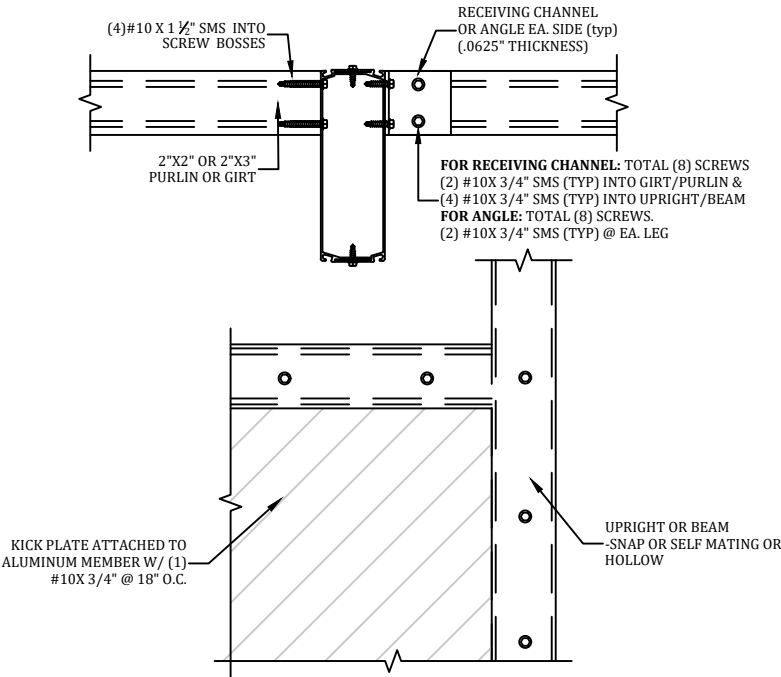

- NOTES:
1. KICK PLATE TO BE APPLIED TO UPRIGHT CHAIRRAIL OR GIRT IF APPLICABLE

PURLIN OR GIRT TO BEAM OR POST DETAIL

SCALE: N.T.S.

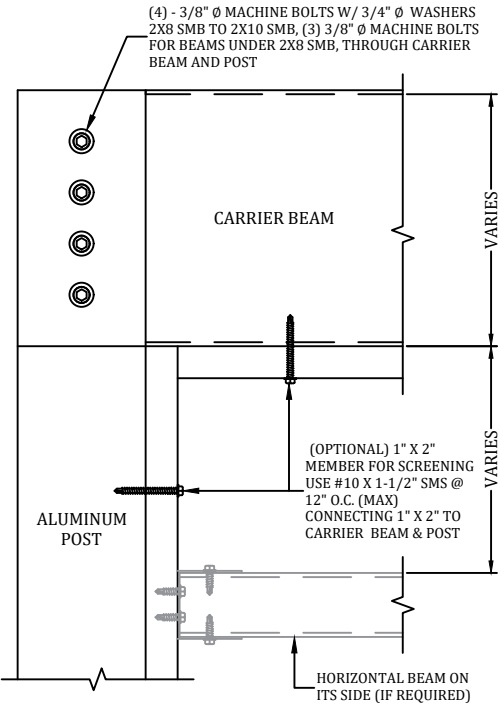


- NOTE:
1. PERPENDICULAR CARRIER BEAM: USE 0.125" RECEIVING CHANNEL WHICH WILL CONNECT TO THE POST W/(4) 3/8" THRU BOLTS USED FOR THE PRIMARY CARRIER BEAM, THEN USE (3) 3/8"Ø MACHINE BOLTS W/ 3/4"Ø WASHERS TO ATTACH THE PERPENDICULAR CARRIER BEAM TO THE RECEIVING CHANNEL.
2. HORIZONTAL BEAM DETAIL WILL BE PROVIDED IF NEEDED.

D1

BEAM TO POST DETAIL

SCALE: N.T.S.

This item has been digitally signed and sealed by Ian J. Foster. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



Digitally signed by
Ian J Foster
Date: 2026.02.04
13:59:55 -05'00'

PROFESSIONAL ENGINEER SEAL

P.E. OF RECORD	DAVID W. SMITH	FL 53608	THOMAS L. HANSON	FL 38654	IAN J. FOSTER	FL 93654	JOEL FALARDEAU	FL 70667	ERIK STUART	FL 77605
----------------	----------------	----------	------------------	----------	---------------	----------	----------------	----------	-------------	----------

FBC PLANS & ENGINEERING SERVICES, INC.

ADDRESS: 5344 9th Street
Zephyrhills, FL 33542
PHONE: (813)838-0735
FAX: 1-(866)824-7894
E-MAIL: erb@fbcplans.com
WEBSITE: www.fbcplans.com
C.O.A.: #29054



PROJECT
HAMBORG
7014 REMINGTON CT.
MANATEE, FL 34201

CONTRACTOR
REPLACE MY CAGE
6301 PORTER ROAD
SARASOTA, FL 34240
UNIT 12

JOB NUMBER:
26_0202_730_HAMBORG_REPLACEMENT

DRAW DATE: 02/02/2026


REVISION 1:

REVISION 2:


REVISION 3:

DETAILS


S-4

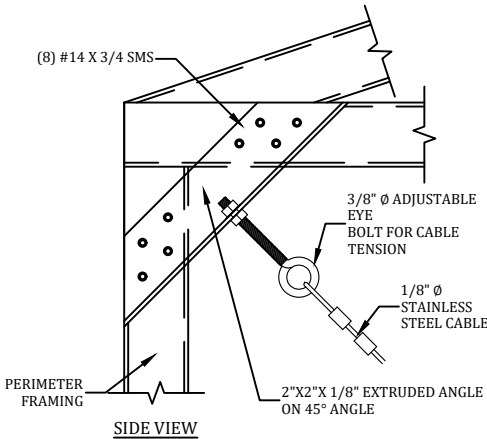


OPTION #1

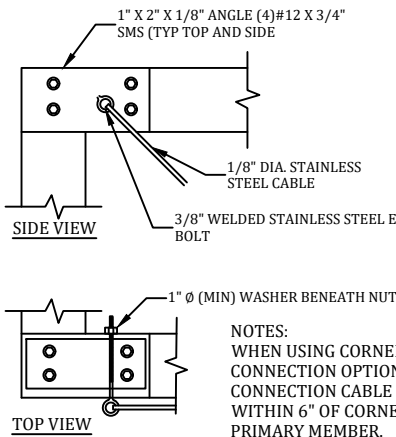

OPTION #2




OPTION #3

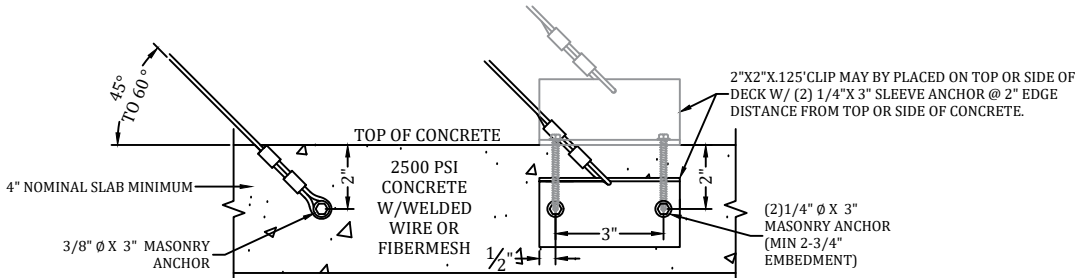


OPTION #1

OPTION #2

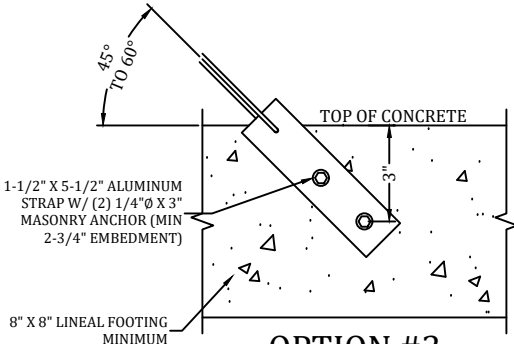

OPTION #3

(USE WITH FOOTING ONLY)

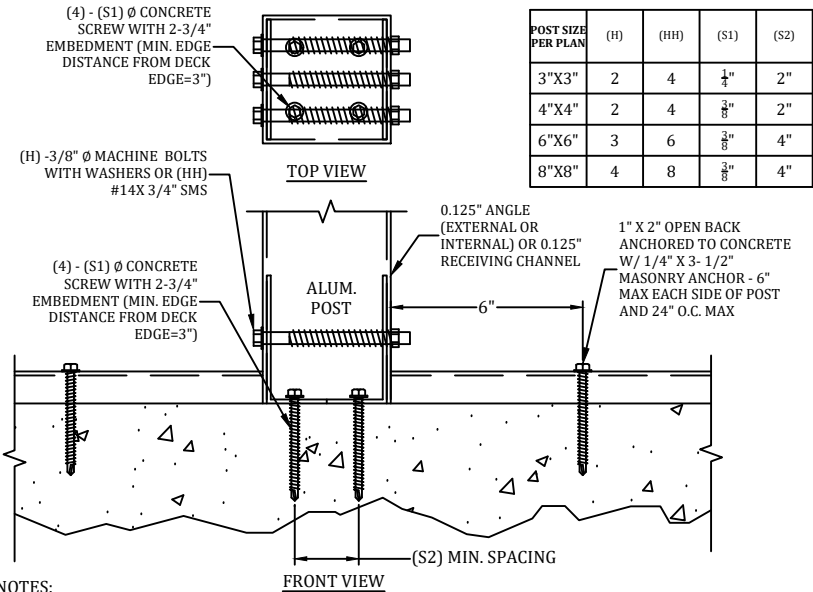




- NOTES:
1. CONCRETE SCREW ANCHOR DESIGNS ARE BASED ON TITEN HD (S1) Ø SCREW ANCHORS, OTHER SIZE OR TYPE OF ANCHORS SHALL NOT BE USED.
2. FOR PATIO COVERS AND CARPORTS: DISREGARD THE 1X2 OPEN BACK SCREEN MEMBER ON THE FOUNDATION TYP.
3. MINIMUM EMBEDMENT OF ANCHORS INTO CONCRETE FOOTING SHALL BE 2-3/4" AT ALL POST LOCATIONS. ALL SCREW LENGTHS AT POST CONNECTIONS SHALL BE OF SUFFICIENT LENGTH FOR REQUIRED EMBEDMENT INTO CONCRETE FOOTING WHEN A PAVER DECK IS PRESENT.
4. MINIMUM EMBEDMENT OF ANCHORS INTO CONCRETE FOOTING SHALL BE 2-3/4" AT AT ALL UPRIGHT LOCATIONS. ALL SCREW LENGTHS AT UPRIGHT CONNECTIONS SHALL BE OF SUFFICIENT LENGTH FOR REQUIRED EMBEDMENT INTO CONCRETE FOOTING WHEN A PAVER DECK IS PRESENT.
5. DETAIL MAY BE FLIPPED AS NEEDED
6. USE 1/4" X 3" LAG SCREWS IN LIEU OF CONCRETE SCREWS FOR WOOD HEADERS, JOISTS, AND GIRDERS
7. SEE S-1, DESIGN DATA: NOTE 10 FOR FOUNDATION INFORMATION.

G1

ALUM. POST CONNECTION DETAIL

SCALE: N.T.S.

MANATEE COUNTY
BUILDING & DEVELOPMENT SERVICES
CHART #1
CARRIER/EDGE BEAM SIZE
BOLT QTY. (H)
1/4" Ø 3/8" Ø
N/A
2
3
REVIEWED BY 2X3/2X4/2X5/2X6/2X7/2X8/2X9/2X10
This set of documents is to be kept on the job site at all times. No one is to make changes without written approval from Manatee County Building & Development Services. The approval of these documents does not grant authority to violate any current Local, State or Federal Codes.

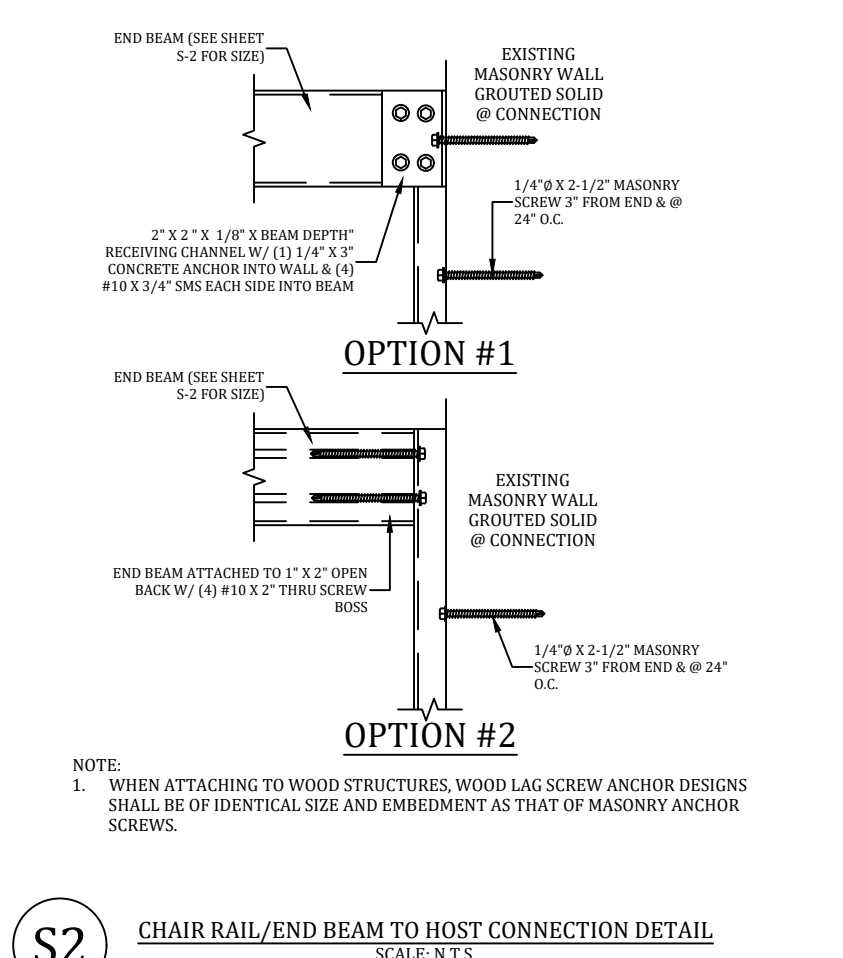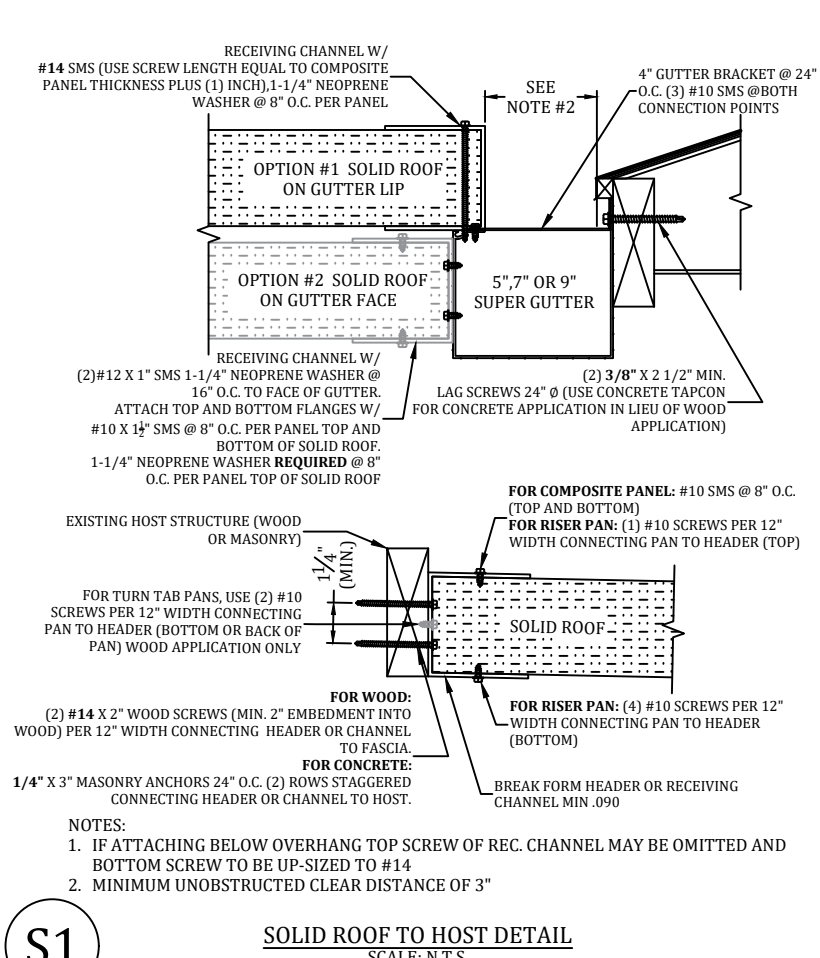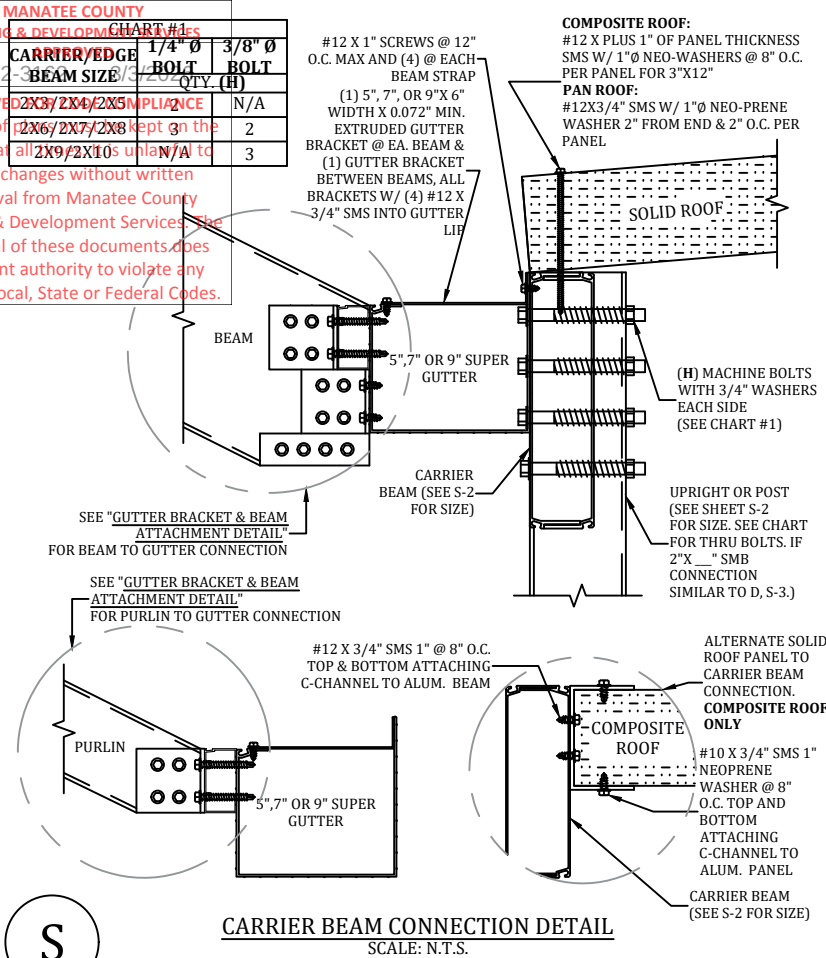

S2


CHAIR RAIL/END BEAM TO HOST CONNECTION DETAIL

SCALE: N.T.S.


K

FOUNDATION DETAIL

SCALE: N.T.S.

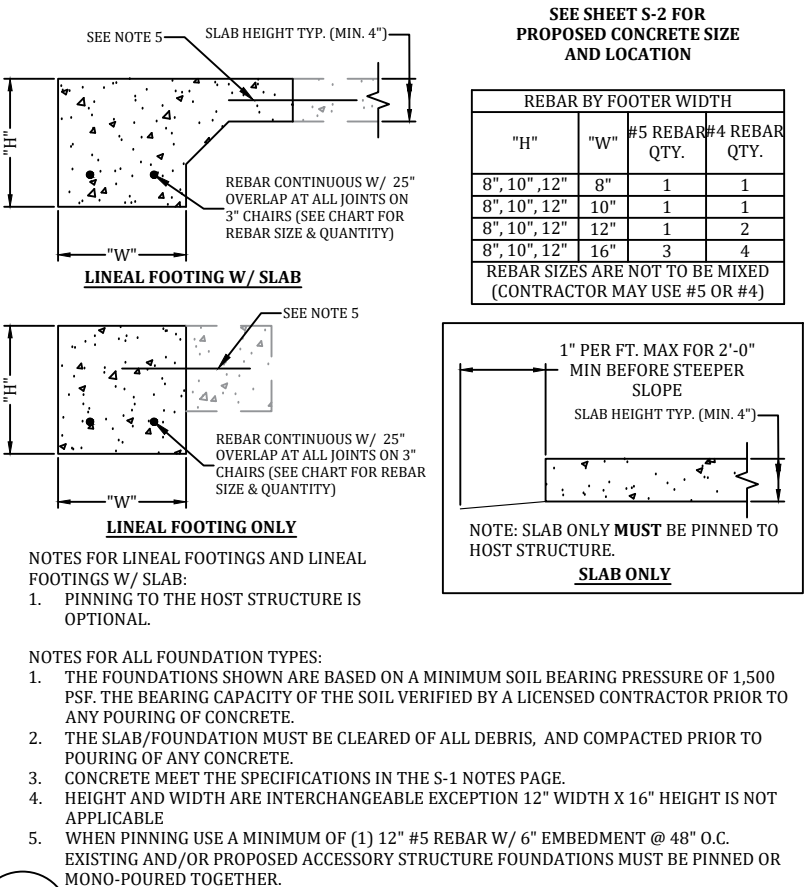

This item has been digitally signed and sealed by Ian J. Foster. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



Digitally signed by
Ian J Foster
Date: 2026.02.04
14:00:01 -05'00'

PROFESSIONAL ENGINEER SEAL					
S-5	DETAILS		JOB NUMBER:		
	26_0202_730_HAMBORG_REPLACEMENT		PROJECT HAMBORG 7014 REMINGTON CT. MANATEE, FL 34201		
	DRAW DATE: 02/02/2026		CONTRACTOR REPLACE MY CAGE 6301 PORTER ROAD UNIT 12 SARASOTA, FL 34240		
	REVISION 1:				
	REVISION 2:				
REVISION 3:		 FLORIDA Building Code PLANS & ENGINEERING SERVICES, INC			
FBC PLANS & ENGINEERING SERVICES, INC.					
ADDRESS: 5344 9th Street Zephyrhills, FL 33542					
PHONE: (813)838-0735 FAX: 1-(866)824-7894 E-MAIL: erb@fbcplans.com WEBSITE: www.fbcplans.com C.O.A.: #29054					
P.E. OF RECORD					
DAVID W. SMITH FL 53608		THOMAS L. HANSON FL 38654		IAN J. FOSTER FL 93654	
JOEL FALARDEAU FL 70667		ERIK STUART FL 77605			

MANATEE COUNTY
BUILDING & DEVELOPMENT SERVICES
APPROVED
BLD2602-3162 3/3/2026

REVIEWED FOR CODE COMPLIANCE
This set of plans must be kept on the job site at all times. It is unlawful to make changes without written approval from Manatee County Building & Development Services. The approval of these documents does not grant authority to violate any current Local, State or Federal Codes.

BOUNDARY SURVEY



L-1
S 00°40'00" W 80.00'(P)
S 00°59'40" W 79.84'(M)

L-2
N 89°20'00" W 25.00'(P&M)

L-3
S 00°40'00" W 122.60'(P)
S 00°45'26" W 122.67'(M)

L-4
N 00°07'13" E 80.00'(P)
N 00°05'39" E 79.92'(M)

L-5
S 89°20'00" E 30.00'(P)
S 89°18'54" E 29.95'(M)

Freedom Code Compliance
Private Provider Firm or Associated Only Authorized Representative
Firm required for compliance with Florida Building Code
Not including zoning, fire, or public works compliance
Firm not allowed to sign this




(P.C.P.)
FND NAIL AND DISK NO NUMBER

(P.C.P.)
FND NAIL AND DISK NO NUMBER


S 00°40'00" W 169.94'(P)
S 00°45'02" W 169.81'(M)

REVIEWED ZONING REVIEWED
By Jean Hager - Title 61.02(2)(b) 7/21/2020

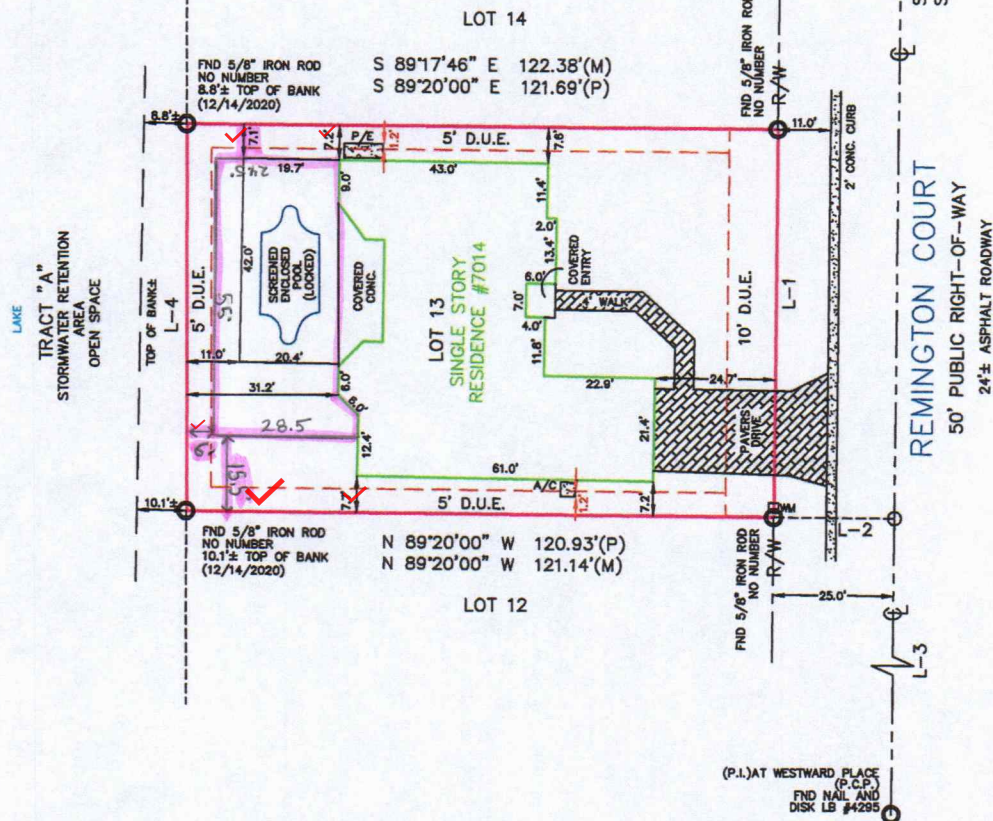


PROPERTY ADDRESS: 7014 REMINGTON COURT, BRADENTON, FLORIDA 34201

P.O.C.	LEGEND
P.O.B.	POINT OF BEGINNING
(P)	PLAT
(M)	MEASURE
(D)	DESCRIPTION
(C)	CALCULATED FROM FIELD DATA
(R)	CALCULATED FROM RECORDED DATA
P.C.P.	PERMANENT CONTROL POINT
P.R.M.	PERMANENT REFERENCE MONUMENT
P.R.C.	POINT OF REVERSE CURVATURE
P.C.C.	POINT OF COMPOUND CURVATURE
P.I.	POINT OF INTERSECTION
P.C.	POINT OF CURVATURE
P.T.	POINT OF TANGENCY
C	CENTER LINE
R/W	RIGHT OF WAY
R	RADIUS
L	ARC LENGTH
A	CENTRAL ANGLE
C	CHORD
C.B.	CHORD BEARING
D.U.E.	DRAINAGE UTILITY EASEMENT
P.U.E.	PUBLIC UTILITY EASEMENT
U.E.	UTILITY EASEMENT
D.E.	DRAINAGE EASEMENT
C.M.E.	CANAL MAINTENANCE EASEMENT



FLOOD ZONE
(FOR INFORMATIONAL PURPOSES ONLY)
SUBJECT PROPERTY SHOWN HEREON APPEARS TO BE LOCATED IN ZONE X(BFE N/A), PER F.I.R.M. MAP NUMBER 12081C0340E, DATED 03/17/2014.
THIS SURVEYOR MAKES NO GUARANTEES AS TO THE ACCURACY OF THE ABOVE INFORMATION. THE LOCAL F.E.M.A. AGENT SHOULD BE CONTACTED FOR VERIFICATION.

POINTS OF INTEREST:
P/E PAD EXTENDS INTO THE NORTH EASEMENT.
A/C PAD EXTENDS INTO THE SOUTH EASEMENT.



SURVEYOR'S NOTES:
1. THIS SURVEY WAS PREPARED WITH THE BENEFIT OF A COMMITMENT FOR TITLE ENDORSEMENT LEGAL DESCRIPTION PROVIDED BY OTHERS.
2. AND/OR ANY: UNDERGROUND UTILITIES, IMPROVEMENTS, FOUNDATIONS AND/OR SURFACE STRUCTURES WERE NOT LOCATED BY THIS SURVEY.
3. BEARINGS ARE BASED ON THE WESTERLY RIGHT OF WAY LINE OF REMINGTON COURSE AS BEING 5' 00" WIDE TO THE PLACE SHOWN.
4. THE PURPOSE OF THIS SURVEY IS FOR THE USE OF OBSERVING TITLE ENDORSEMENT AND FINANCING AND SHOULD NOT BE USED FOR CONSTRUCTION PURPOSES.
5. FENCE OR BOUNDARY NOT DETERMINED.
6. THE LANDS, WHEN HEAVY, WERE NOT ATTRACTED FOR EASEMENTS OR OTHER ADJACENT ENCUMBRANCES THAT MAY BE FOUND IN THE PUBLIC RECORDS OF THE COUNTY.

LEGAL DESCRIPTION:
LOT 13, MOTE RANCH, PHASE IV-A, ACCORDING TO THE MAP OR PLAT THEREOF, AS RECORDED IN PLAT BOOK 33, PAGES 111 THROUGH 115, INCLUSIVE, OF THE PUBLIC RECORDS OF MANATEE COUNTY, FLORIDA.

CERTIFIED TO:
ROBERTA MARY MONTAGUE AND RANDALL ARLEN HAMBORG, MSC TITLE, INC.; CHICAGO TITLE INSURANCE COMPANY; FIRST CENTENNIAL MORTGAGE CORP.; ITS SUCCESSORS AND/OR ASSIGNS, AS THEIR INTERESTS MAY APPEAR

CLIENT NO: 20201599
JOB NO: 47641
FIELD DATE: 12/14/2020
APPROVED BY: L.R.
CHECKED BY: L.R.
DRAWN BY: G.J.
DRAWN DATE: 12/15/20

I HEREBY CERTIFY THAT THE SURVEY OF THE HEREON DESCRIBED PROPERTY WAS PREPARED UNDER MY CLOSE SUPERVISION AND MEETS THE STANDARD OF PRACTICE SET FORTH BY THE FLORIDA BOARD OF PROFESSIONAL SURVEYORS AND MAPPERS IN CHAPTER 51-17.050 THROUGH 51-17.053, FLORIDA ADMINISTRATIVE CODE, PURSUANT TO CHAPTER 472.027, FLORIDA STATUTES.



CERTIFIED BY: LOUISA HAMBORG, PSM NO. 6304
FIRST CHOICE SURVEYING, INC.
P.O. 470978, LAKE MONROE, FL 32747
407.951.3425 (OFFICE); 407.520.5453 (FAX); LB 7564
NOT VALID WITHOUT SIGNATURE AND RAISED SEAL OR ELECTRONIC SEAL OF A FLORIDA LICENSED SURVEYOR AND MAPPER
DATE SIGNED: 12/15/20

Replace and extend screen enclosure, including footers, slab & partial composite roof

Hamborg