

HARBOUR, PRISCILLA

11503 Griffith Park Ter, Bradenton,
Florida, 34211

GENERAL NOTES

1. DESIGN CRITERIA

FLORIDA BUILDING CODE (FBC), 8TH EDITION (2023/2024).
ASCE 7-22: MINIMUM DESIGN LOADS AND ASSOCIATED CRITERIA FOR BUILDINGS AND OTHER STRUCTURES.
ACI 318-19: BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE.
ASTM STANDARDS AS SPECIFIED HEREIN.
ALUMINUM DESIGN MANUAL 2020 EDITION (AA ADM-2020).
AA ASM 35-30: ALUMINUM STANDARDS AND DATA.
NATIONAL ELECTRICAL CODE (NEC), 2023 EDITION.

2. DESIGN LOADS

WIND SPEED (FBC CHAPTER 16): 140 MPH
ULTIMATE WIND SPEED (VULT) = 136 MPH (PER ASCE 7-22, SECTION 26.5.1).
ALLOWABLE STRESS DESIGN WIND SPEED (VASD) = 106 MPH (VASD = VULT × √0.6).
RISK CATEGORY: I (LOW HAZARD TO HUMAN LIFE).
EXPOSURE CATEGORY: B (URBAN OR SUBURBAN TERRAIN WITH OBSTRUCTIONS).
DESIGN WIND PRESSURES INTERPOLATED FROM ASCE 7-22 AND REFERENCE TABLES FOR VULT = 140 MPH, EXPOSURE CATEGORY B.

WIND LOADS (MWFRS), BASED ON 140 MPH WIND SPEED AND EXPOSURE B:

- HORIZONTAL PRESSURE (WINDWARD): 25 PSF.
- HORIZONTAL PRESSURE (LEEWARD): 21 PSF.
- VERTICAL PRESSURE ON SCREEN SURFACE: 7 PSF.
- VERTICAL PRESSURE ON SOLID SURFACES: 26 PSF.

LOAD REDUCTION FACTORS:

- FOR 20x20x.011" MESH SCREEN: 0.88 (MANUFACTURER DATA, ASCE 7-22 SECTION 30.5).
- FOR ALLOWABLE STRESS DESIGN PRESSURES: 0.6 (ASCE 7-22 SECTION 2.4).

3. CONTRACTOR RESPONSIBILITIES

- ALL WORK SHALL BE PERFORMED BY A LICENSED CONTRACTOR IN ACCORDANCE WITH APPLICABLE CODES, REGULATIONS, AND LOCAL ORDINANCES.
- CONTRACTOR MUST FIELD-VERIFY ALL DIMENSIONS PRIOR TO FABRICATION OR CONSTRUCTION. WRITTEN DIMENSIONS SHALL GOVERN OVER SCALED DRAWINGS.
- ANY DISCREPANCIES, ERRORS, OR OMISSIONS SHALL BE REPORTED TO THE ENGINEER IN WRITING WITHIN 10 DAYS OF PLAN RECEIPT AND PRIOR TO CONSTRUCTION.
- CONTRACTOR IS RESPONSIBLE FOR VERIFYING EXISTING SITE CONDITIONS, INCLUDING STRUCTURE AND FOUNDATION INTEGRITY, PRIOR TO COMMENCEMENT.
- CONTRACTOR SHALL PROVIDE ALL REQUIRED TEMPORARY SHORING, BRACING, AND SAFETY MEASURES DURING CONSTRUCTION.
- CONTRACTOR SHALL PROTECT EXISTING STRUCTURES, UTILITIES, AND LANDSCAPING OUTSIDE THE SCOPE OF THIS PROJECT.
- INSTALLATION PRACTICES MUST COMPLY WITH MANUFACTURER RECOMMENDATIONS, INCLUDING FLASHING AND WATERPROOFING DETAILS.
- CONTRACTOR SHALL COORDINATE SITE ACCESS FOR INSPECTIONS AND MAINTAIN CLEAN AND SAFE WORKING CONDITIONS.
- ALL UNDERGROUND UTILITIES SHALL BE LOCATED AND PROTECTED PRIOR TO EXCAVATION.
- SHOP DRAWINGS AND MATERIAL CERTIFICATIONS SHALL BE PROVIDED UPON REQUEST.
- CONTRACTOR SHALL MAINTAIN RECORDS OF INSPECTIONS AND TESTING.
- FASTENER TORQUE AND EMBEDMENT TESTING RESULTS SHALL BE PROVIDED IF REQUESTED.

4. MATERIALS

FOUNDATION

- ASSUMED SOIL BEARING CAPACITY: 2,000 PSF (VERIFY IN FIELD).
- NOTIFY ENGINEER IF UNSUITABLE SOILS ARE ENCOUNTERED.
- APPLY TERMITE TREATMENT AS REQUIRED BY FBC.
- PLACE CONCRETE OVER VAPOR BARRIER WHERE APPLICABLE.

CONCRETE

- MINIMUM COMPRESSIVE STRENGTH: 3,000 PSI @ 28 DAYS.
- PORTLAND CEMENT: ASTM C150, TYPE I.

- AGGREGATE: 3/4" MAXIMUM, ASTM C33.
- AIR ENTRAINMENT: 4–7%, ASTM C260.
- WATER-REDUCING AGENT: ASTM C494.
- WATER: CLEAN, POTABLE.
- MINIMUM SLAB THICKNESS: 4 INCHES.
- CURE CONCRETE FOR A MINIMUM OF 7 DAYS.

STEEL REINFORCEMENT

- REINFORCING STEEL: ASTM A615, GRADE 60.
- MINIMUM COVER FOR FOOTINGS: 2 INCHES.
- LAP SPLICES: 40 TIMES BAR DIAMETER.
- WELDED WIRE MESH PER ASTM A185.
- FIBERMESH MAY BE SUBSTITUTED IF ASTM AND ACI REQUIREMENTS ARE MET.

ALUMINUM

- STRUCTURAL ALUMINUM ALLOY: 6005-T5 MINIMUM.
- DESIGN PER AA ADM-2020 SPECIFICATIONS.
- MINIMUM WALL THICKNESS FOR EXTRUDED MEMBERS: 0.040 INCHES.
- SELF-MATING BEAMS TO BE STITCHED WITH #12 SMS SCREWS:
 - 6" O.C. AT ENDS.
 - 18" O.C. ALONG SPANS.
- KICK PLATES (FORMED PANELS) MINIMUM THICKNESS: 0.024 INCHES.
- 18X14X0.013" MESH SCREEN IS STANDARD UNLESS OTHERWISE APPROVED.
- ROOF BRACING: 2" X 2" X 0.050" WALL THICKNESS MINIMUM.
- ALL ALUMINUM IN CONTACT WITH STEEL OR PRESSURE-TREATED LUMBER SHALL HAVE DIELECTRIC ISOLATION.
- ALUMINUM ROOF SYSTEMS SHALL BE SELECTED PER MANUFACTURER SPAN TABLES CERTIFIED BY A LICENSED FLORIDA ENGINEER.
- METAL STRUCTURES WITHIN 5 FEET OF POOLS SHALL BE BONDED PER NEC 680.26.

FASTENERS

- ALL FASTENERS SHALL COMPLY WITH ASTM A153 FOR ZINC COATING.
- CONCRETE SCREWS: TAPCON, SIMPSON, HILTI, REDHEAD, OR APPROVED EQUAL.
- LAG BOLTS SHALL HAVE MINIMUM EMBEDMENT OF 8 TIMES BOLT DIAMETER.
- STAINLESS STEEL TYPE 300 (18-8) SHALL BE USED FOR CONNECTIONS TO PRESSURE-TREATED WOOD.
- MINIMUM FASTENER SPACING:
 - SMS: 3/4" CENTER-TO-CENTER, 1/2" EDGE DISTANCE.
 - 1X2 MEMBERS TO MASONRY: 1/4" X 2-3/4" TAPCONS @ 18" O.C.
 - 1X2 MEMBERS TO WOOD: #14 X 2-3/4" WOOD SCREWS @ 18" O.C.
 - 1X2 MEMBERS TO ALUMINUM: #10 X 1-1/2" SMS OR TEK SCREWS @ 18" O.C.
- FOR "OPEN VIEW" OR "PICTURE WINDOW" ASSEMBLIES, REDUCE FASTENER SPACING TO 12" O.C.

5. ELECTRICAL

- METAL STRUCTURES WITHIN 5 FEET OF SWIMMING POOLS MUST BE BONDED IN ACCORDANCE WITH NEC 680.26.
- PROVIDE EQUIPOTENTIAL BONDING FOR ALL CONDUCTIVE ELEMENTS WITHIN POOL AREA.
- ALL ELECTRICAL WORK SHALL COMPLY WITH NEC 2023 EDITION AND LOCAL AMENDMENTS.




6. GENERAL REQUIREMENTS

- DIMENSIONS ARE NOMINAL UNLESS OTHERWISE NOTED.
- DIMENSIONAL TOLERANCES: ±1/8" UNLESS SPECIFIED.
- NOTES APPLY TO THE ENTIRE DRAWING SET UNLESS OTHERWISE INDICATED.
- REPORT ANY CONFLICTS IN DRAWINGS TO THE ENGINEER IMMEDIATELY.
- PROVIDE SHOP DRAWINGS AND MATERIAL CERTIFICATIONS IF REQUESTED.
- ENSURE SITE ACCESS FOR REQUIRED INSPECTIONS.
- FINAL CLEANUP IS REQUIRED PRIOR TO PROJECT CLOSEOUT.

ALUMINUM EXTRUSION DIMENSIONS	
HOLLOW SECTIONS	
2 x 2	2" x 2" x 0.050"
2 x 3	2" x 3" x 0.050"
OPEN-BACK SECTIONS	
1 x 2	1" x 2" x 0.044"
SELF-MATING SECTIONS (SMB)	
2 x 4	2" x 4" x 0.044" x 0.100"
2 x 5CL	2" x 5" x 0.050" x 0.135"
2 x 6	2" x 6" x 0.050" x 0.120"
2 x 7	2" x 7" x 0.057" x 0.120"
2 x 8	2" x 8" x 0.072" x 0.224"
2 x 9	2" x 9" x0.072" x 0.224"
2 x 10	2" x 10" x 0.092" x 0.374"
REC-TUBE - 6005-T5 MINI.	
2 x 8	2" x 8" x 0.125" x 0.125"






						NOTICE: THE DATA IN THIS DOCUMENT INCORPORATES PROPRIETARY RIGHTS OF ACTIVE DESIGNS LLC. ANY PARTY ACCEPTING THIS DOCUMENT DOES SO IN CONFIDENCE AND AGREES THAT IT SHALL NOT BE DUPLICATED IN WHOLE OR PART, NOR DISCLOSED TO OTHERS WITHOUT THE CONSENT OF ACTIVE DESIGNS LLC. CONTRACTOR SHALL VERIFY ALL CONDITIONS ON JOB SITE & NOTIFY ENGINEER OF RECORD OF ANY VARIATIONS FROM DIMENSIONS SHOWN ON THESE DRAWINGS BEFORE PROCEEDING WITH ANY CONSTRUCTION.	AD Active Design LLC info@activedesigneng.com (310) 963-4514	DATE:	SHEET:
								5/19/2026	1
								DRAWING TITLE:	
1	INITIAL DESIGN	JDGV	AL	BC	5/19/2026			NOTES	
REV	DESCRIPTION	DRAWN	REVIEWED	APPR.	DATE			PROJECT NAME:	
								HARBOUR, PRISCILLA	

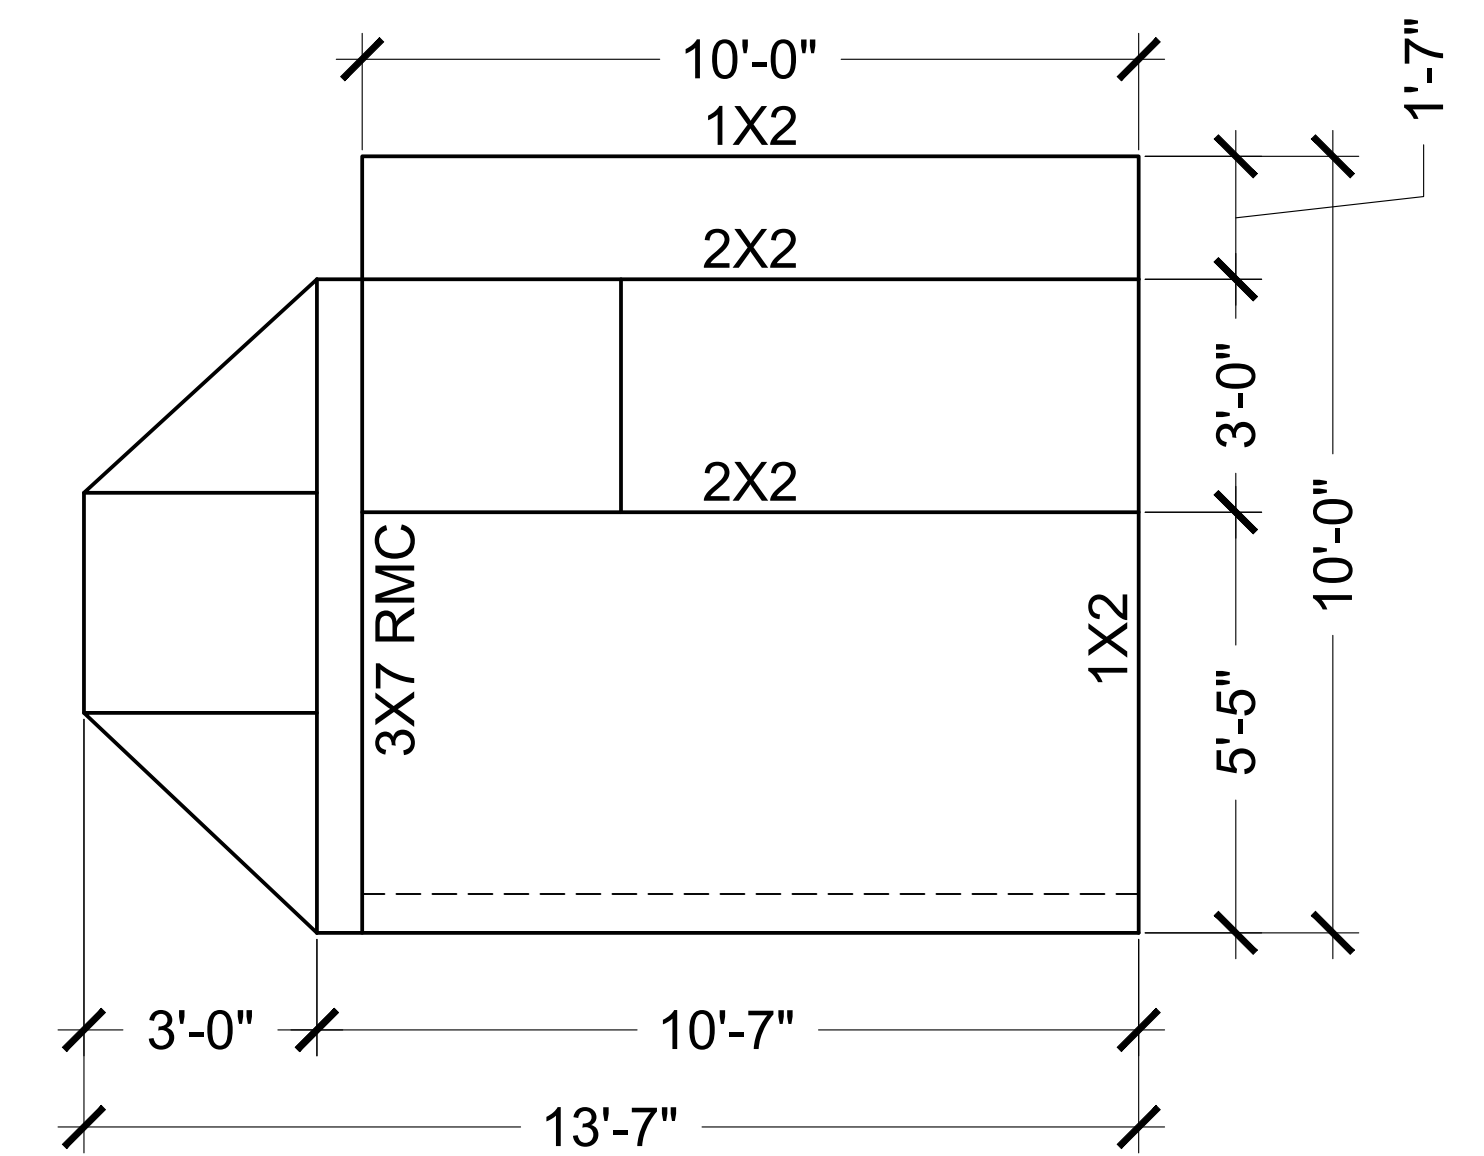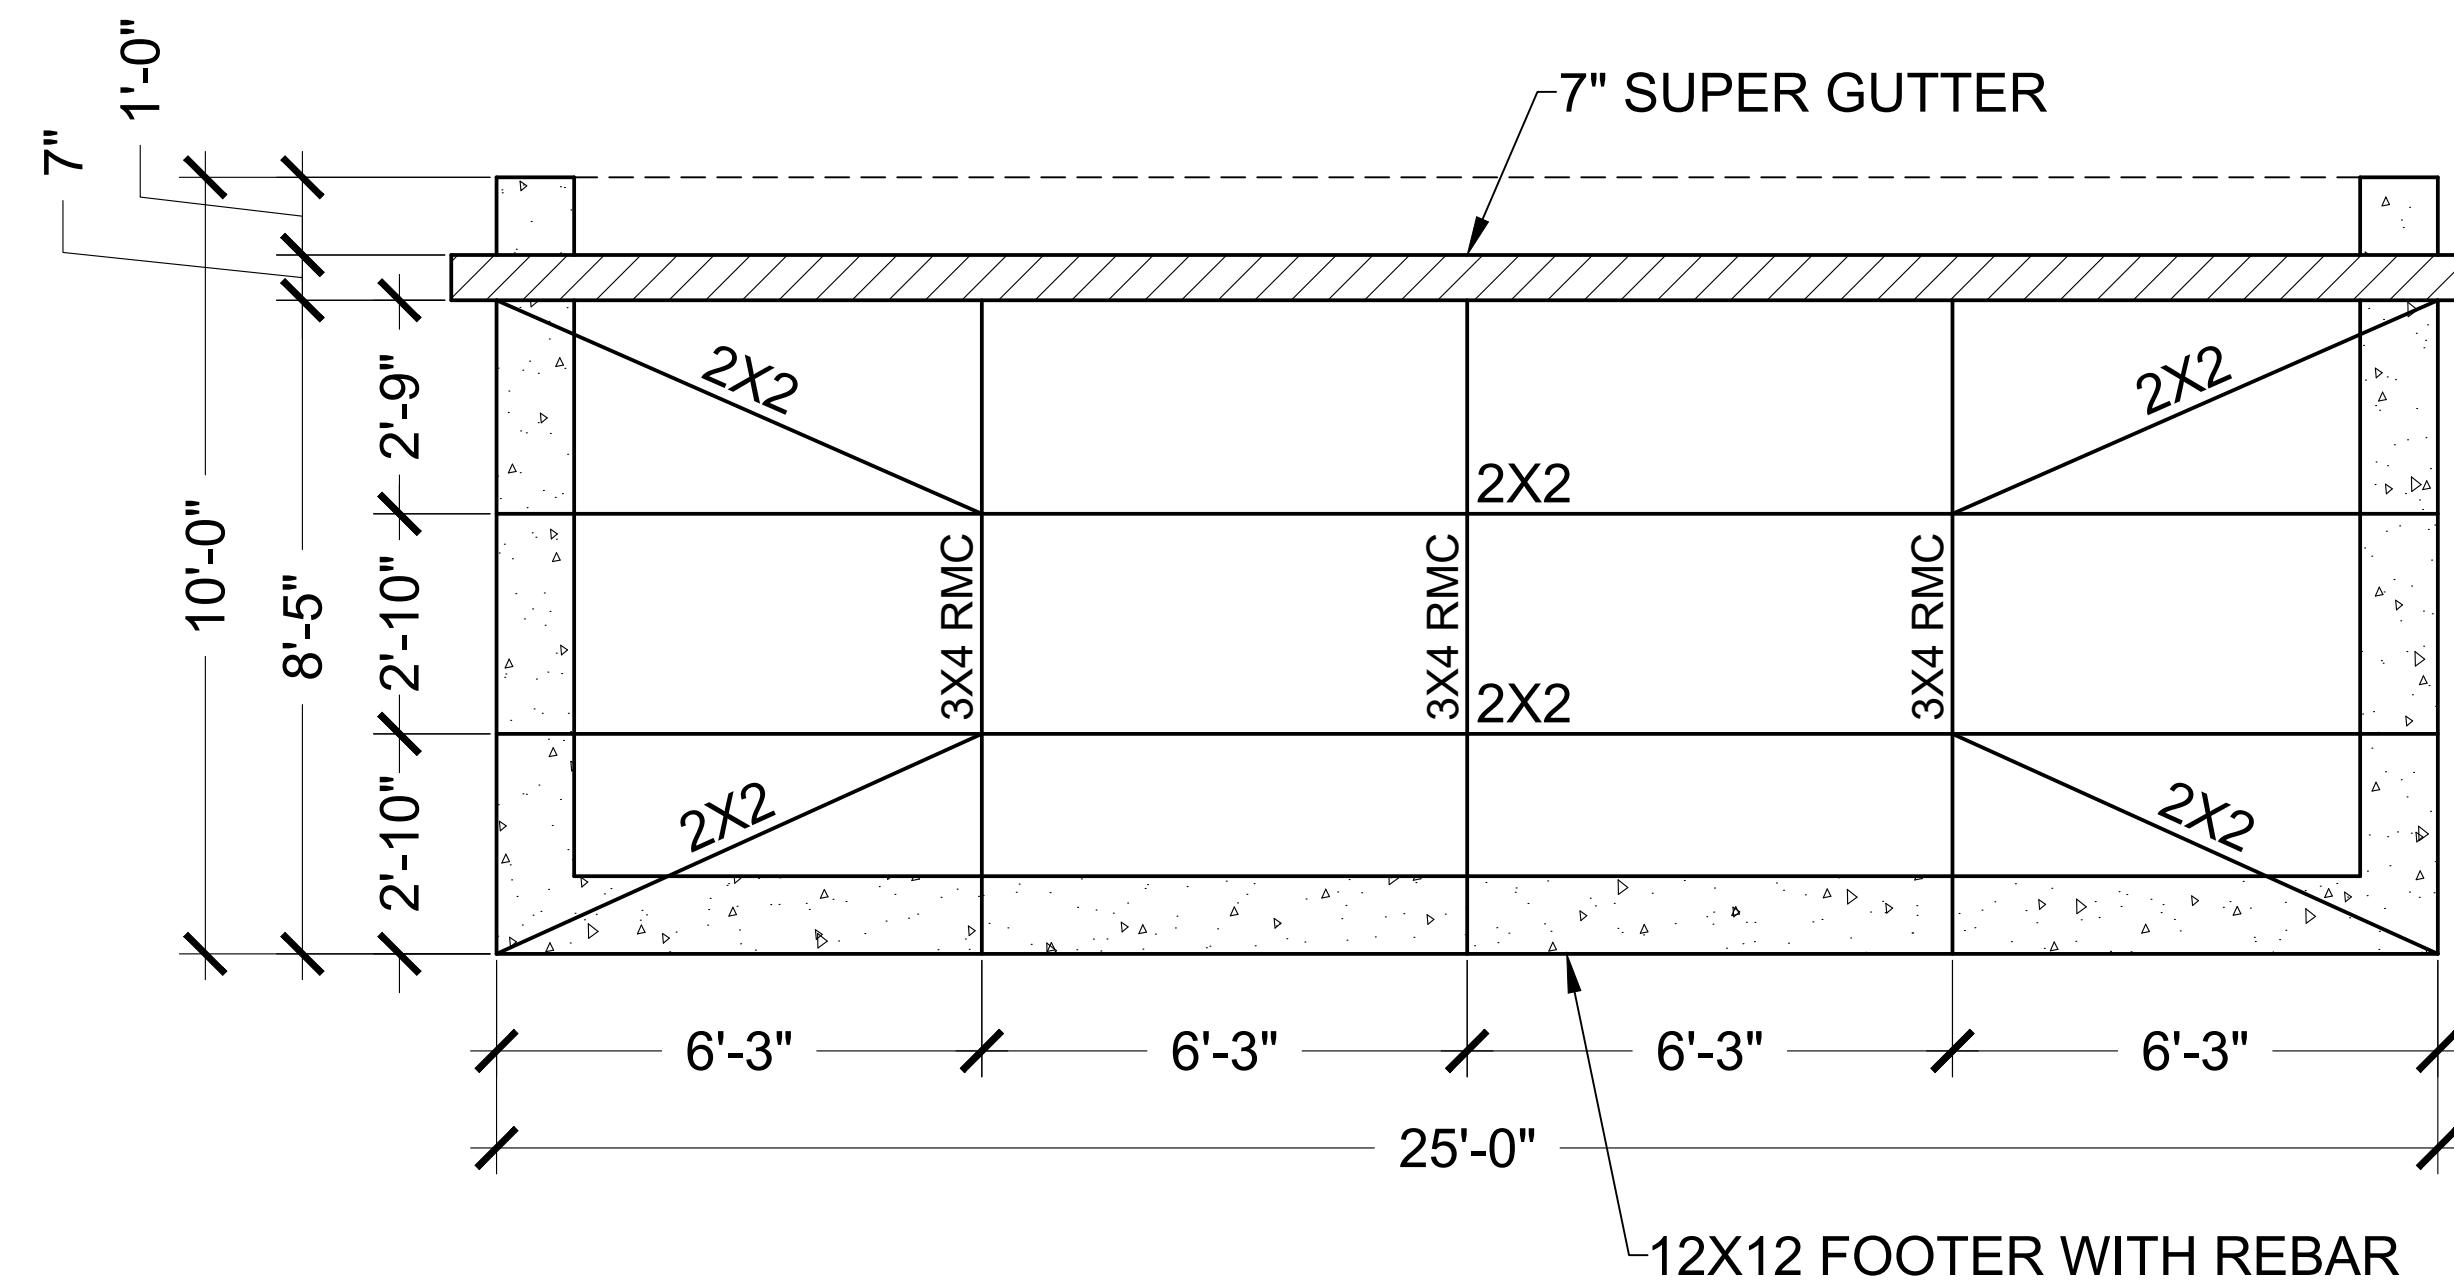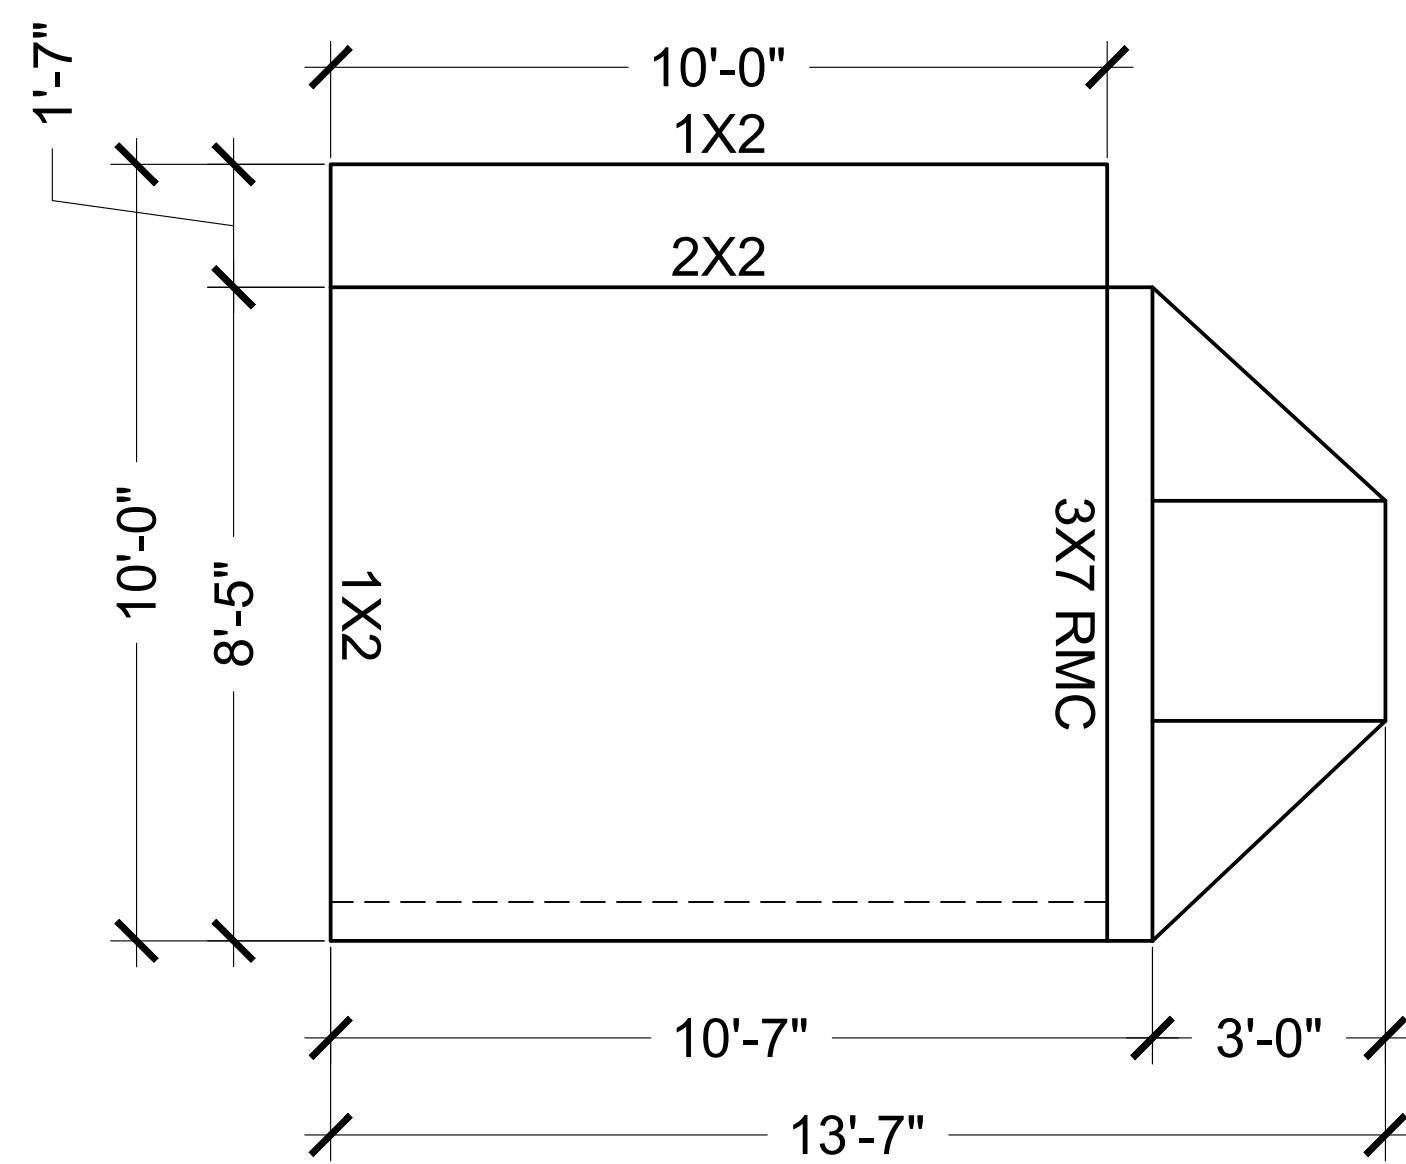


LEGEND:

----- Indicated cable bracing. See details on sheet 3.

NOTE: Door location and framing are not structural and can be moved, as necessary, per contractor and owner approval.

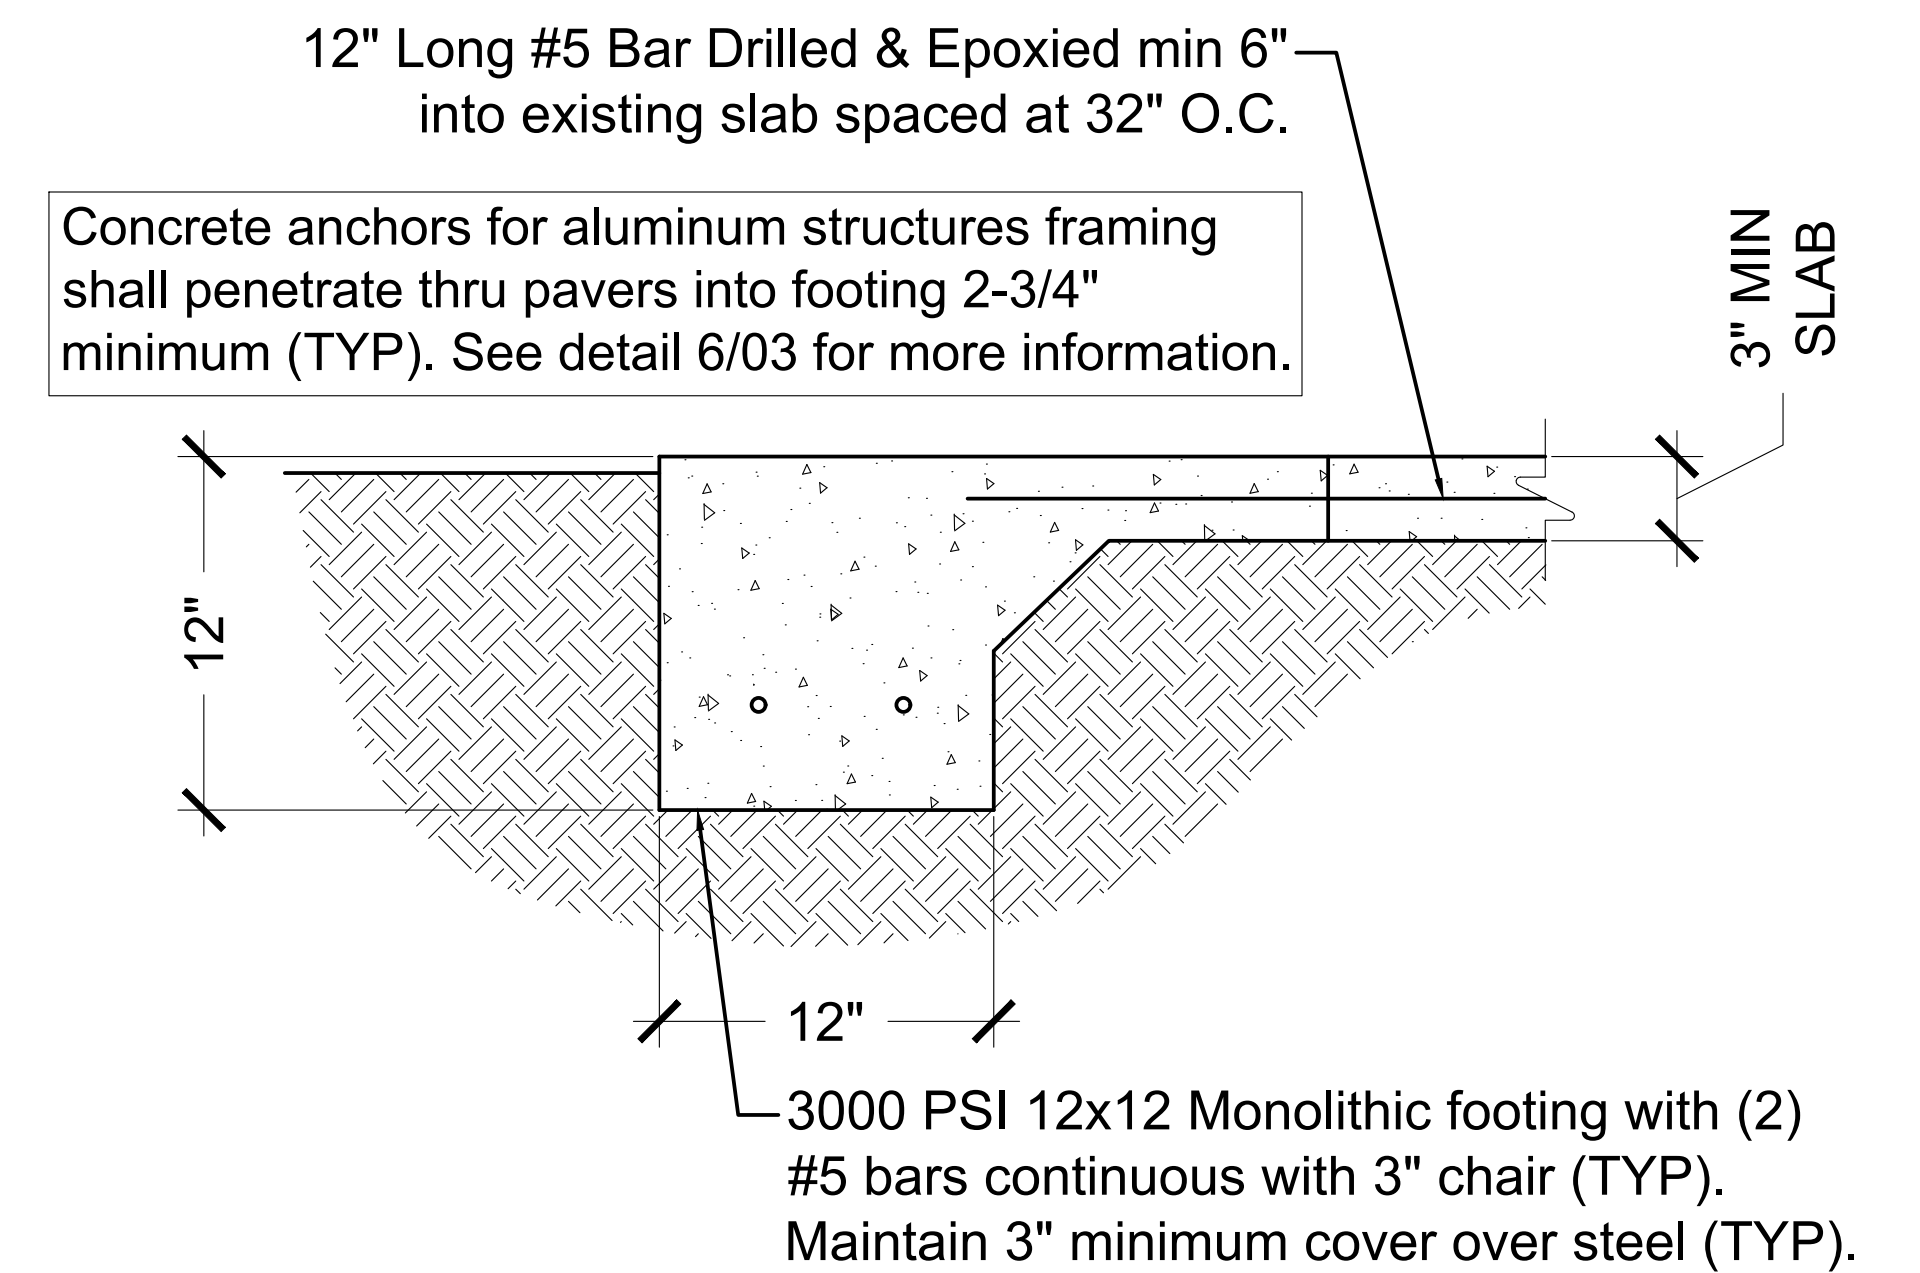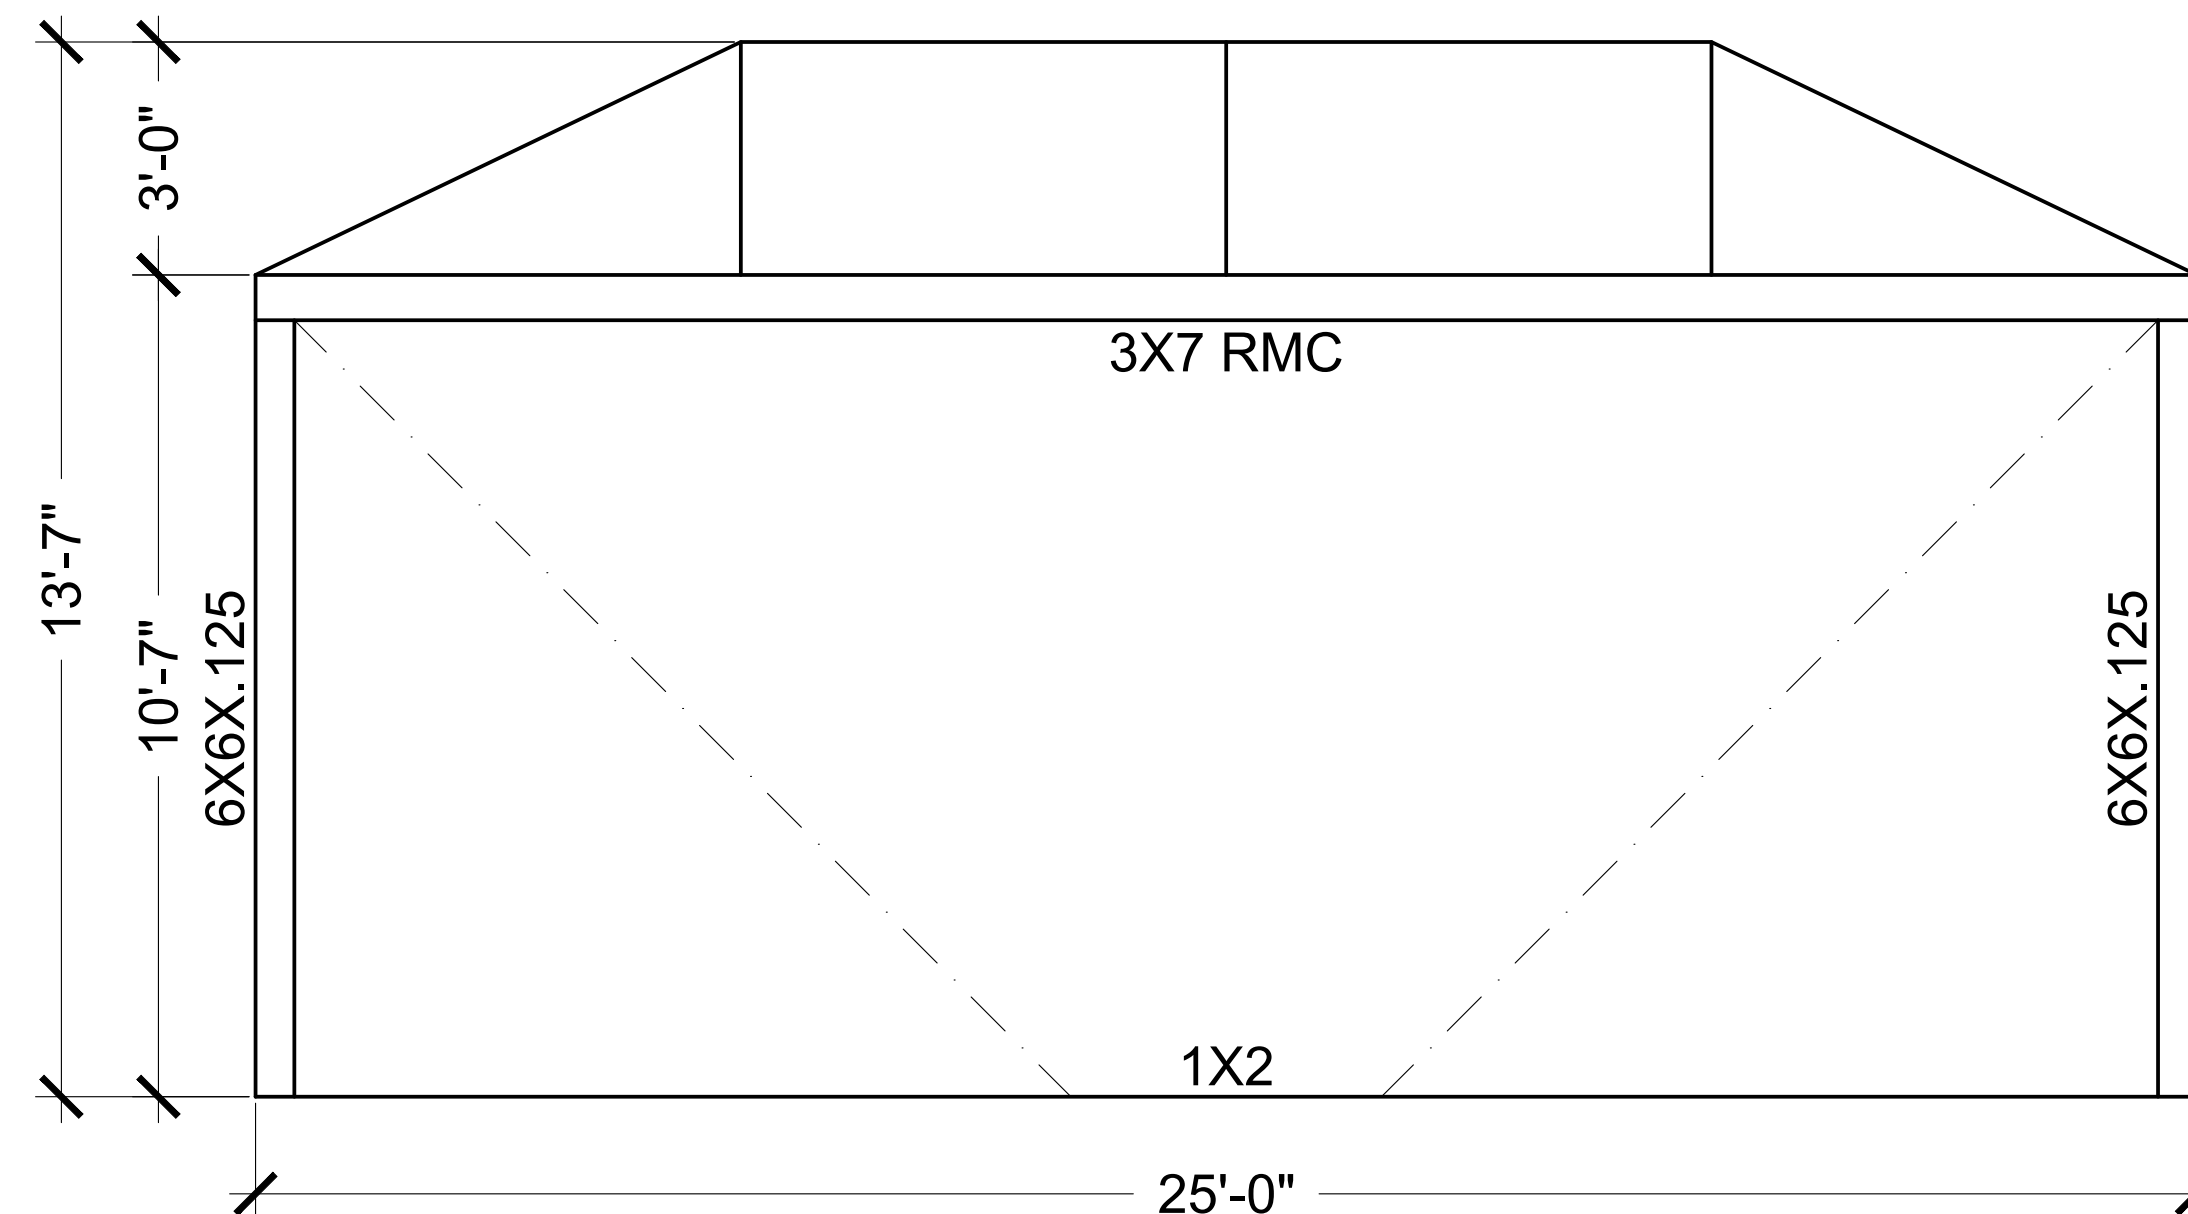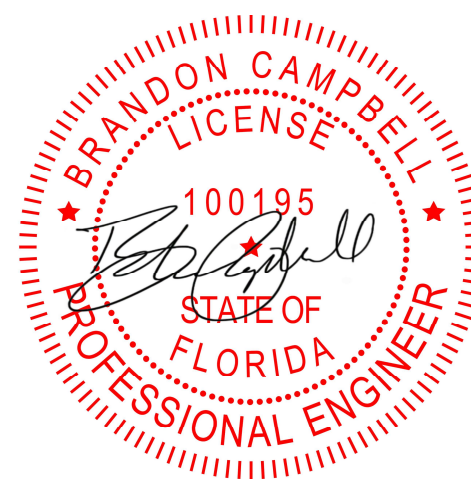

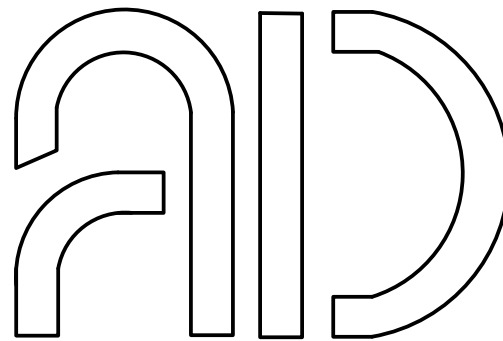						NOTICE: THE DATA IN THIS DOCUMENT INCORPORATES PROPRIETARY RIGHTS OF ACTIVE DESIGNS LLC. ANY PARTY ACCEPTING THIS DOCUMENT DOES SO IN CONFIDENCE AND AGREES THAT IT SHALL NOT BE DUPLICATED IN WHOLE OR PART, NOR DISCLOSED TO OTHERS WITHOUT THE CONSENT OF ACTIVE DESIGNS LLC. CONTRACTOR SHALL VERIFY ALL CONDITIONS ON JOB SITE & NOTIFY ENGINEER OF RECORD OF ANY VARIATIONS FROM DIMENSIONS SHOWN ON THESE DRAWINGS BEFORE PROCEEDING WITH ANY CONSTRUCTION.	 Active Design LLC info@activedesigneng.com (310) 963-4514	DATE:	SHEET:
								5/19/2026	2
								DRAWING TITLE:	
								STRUCTURAL DESIGN	
1	INITIAL DESIGN	JDGV	AL	BC	5/19/2026			PROJECT NAME:	
REV	DESCRIPTION	DRAWN	REVIEWED	APPR.	DATE			HARBOUR, PRISCILLA	

CABLE TO FRAME CONNECTION
SCALE: N.T.S.

SLOPED PURLIN TO COLUMN CONNECTION
SCALE: N.T.S.

COLUMN TO FND CONNECTION FOR 2 × 4 OR LARGER
SCALE: N.T.S.

BEAM TO GUTTER CONNECTION
SCALE: N.T.S.

CABLE TO FOUNDATION CONNECTION
SCALE: N.T.S.

ROOF BRACE CONNECTION
SCALE: N.T.S.

COLUMN TO BEAM CONNECTION
SCALE: N.T.S.

BEAM SIZE	QTY-SIZE SMS/SIDE
2X4 SMB	4 - #10
2X5 SMB	4 - #10
2X6 SMB	4 - #10
2X7 SMB	6 - #10
2X8 SMB	6 - #10
2X9 SMB	6 - #10
2X10 SMB	6 - #10
3X4 RMC	4 - #10
3X5 RMC	4 - #10
3X6 RMC	4 - #10
3X7 RMC	6 - #10
3X8 RMC	6 - #10
3X9 RMC	6 - #10
3X10 RMC	6 - #10
3X11 RMC	6 - #10
4X10 RMC	6 - #10

BEAM/POST TO GIRT/PURLIN CONNECTION
SCALE: N.T.S.

GUSSET CONNECTION
SCALE: N.T.S.

1	INITIAL DESIGN	JDGV	AL	BC	5/19/2026
REV	DESCRIPTION	DRAWN	REVIEWED	APPR.	DATE

NOTICE:

THE DATA IN THIS DOCUMENT INCORPORATES PROPRIETARY RIGHTS OF ACTIVE DESIGNS LLC. ANY PARTY ACCEPTING THIS DOCUMENT DOES SO IN CONFIDENCE AND AGREES THAT IT SHALL NOT BE DUPLICATED IN WHOLE OR PART, NOR DISCLOSED TO OTHERS WITHOUT THE CONSENT OF ACTIVE DESIGNS LLC.

CONTRACTOR SHALL VERIFY ALL CONDITIONS ON JOB SITE & NOTIFY ENGINEER OF RECORD OF ANY VARIATIONS FROM DIMENSIONS SHOWN ON THESE DRAWINGS BEFORE PROCEEDING WITH ANY CONSTRUCTION.

Active Design LLC
info@activedesigneng.com
(310) 963-4514

DATE: 5/19/2026	SHEET: 3
DRAWING TITLE: DETAILS 1	
PROJECT NAME: HARBOUR, PRISCILLA	

NOTCH COLUMN TO RECEIVE BEAM. FASTEN EDGE BEAM TO COLUMN WITH (3) 3/8" HEX BOLTS WITH NUT AND LOCK WASHER

EDGE BEAM PER PLAN

PROVIDE 1/8" x 1-1/2" x BEAM HEIGHT ALUMINUM CHANNEL (INTERNAL OR EXTERNAL). FASTEN TO COLUMN WITH (8) #14 x 5/8" SMS. FASTEN EACH SIDE WITH (6) #14 x 5/8" SMS

EDGE BEAM PER PLAN

NOTCH COLUMN TO RECEIVE BEAM. FASTEN EDGE BEAM TO COLUMN WITH (3) 3/8" HEX BOLTS WITH NUT AND LOCK WASHER

PROVIDE 2" x 2" x 1/8" ALUMINUM ANGLE, BEAM HEIGHT. FASTEN EACH LEG WITH (8) #14 x 5/8" SMS (TYP)

EDGE BEAM PER PLAN

BEAM TO COLUMN CONNECTION
SCALE: N.T.S.

PURLIN PER PLAN

0.044" RECEIVING CHANNEL; FASTEN CHANNEL TO SIDE OF BEAM WITH (4) #12 x 5/8" SMS (INTERNAL). FASTEN PURLIN TO CHANNEL WITH (2) #12 x 5/8" SMS EACH SIDE.

EDGE BEAM PER PLAN

PURLIN TO EDGE BEAM DETAIL
SCALE: N.T.S.

PROVIDE 1/8" INTERNAL CHANNEL, CUT TO FIT WITH NO SLIP TOLERANCE. FASTEN WITH (3) #14 x 9/16" SMS EACH SIDE. FASTEN TO CONCRETE WITH (4) 3/8" x 4" TAPCON OR EQUAL. FOR WOOD, USE 1/4" x 2-1/2" GALVANIZED LAG SCREWS IN LIEU OF MASONRY ANCHORS.

POST BASE CONNECTION
SCALE: N.T.S.

30" MIN

BEAM PER PLAN

BRACE PER PLAN

30" MIN

COLUMN PER PLAN

FASTEN BRACE TO COLUMN AND BEAM WITH 0.044 RECEIVING CHANNEL. FASTEN CHANNEL TO BEAM AND COLUMN WITH (3) #12 x 5/8" SMS (INTERNAL). FASTEN CHANNEL TO BRACE WITH #12 x 5/8" SMS (3) PER SIDE

K-BRACE DETAIL
SCALE: N.T.S.

3/16" 5052-H32 GUSSET, CUT TO FIT INSIDE BEAM WITH NO SLIP TOLERANCE

BEAM PER PLAN

BEAM SIZE PER PLAN

EXAMPLE SCREW PATTERN SHOWN: SCREW QUANTITY PER TABLE BELOW

MAINTAIN FASTENER EDGE DISTANCE OF 5/8" AND MINIMUM 3/8" SEPARATION BETWEEN FASTENERS. INSTALL FASTENERS AROUND THE PERIMETER OF THE CONNECTION FIRST, THEN COMPLETE THE REMAINDER IN THE FIELD.

BEAM SIZE	FASTENER SIZE	QTY PER FACE/SIDE/TOTAL
2X4 SMB	#12	6 / 12 / 24
2X5 SMB	#12	6 / 12 / 24
2X6 SMB	#12	10 / 20 / 40
2X7 SMB	#12	12 / 24 / 48
2X8 SMB	#14	12 / 24 / 48
2X9 SMB	#14	18 / 36 / 72
2X10 SMB	#14	18 / 36 / 72
3X4 RMC	#12	6 / 12 / 24
3X5 RMC	#12	6 / 12 / 24
3X6 RMC	#12	10 / 20 / 40
3X7 RMC	#12	12 / 24 / 48
3X8 RMC	#14	12 / 24 / 48
3X9 RMC	#14	18 / 36 / 72
3X10 RMC	#14	18 / 36 / 72
3X11 RMC	#14	18 / 36 / 72
4X10 RMC	#14	18 / 36 / 72

1. BEAM SPLICE LENGTH TO BE 2 x BEAM HEIGHT.
2. LOCATE BEAM SPLICE AT 1/3 POINTS, STAGGERED AT EACH END OF BEAM.
3. PROVIDE MINIMUM 1" CAMBER IN BEAM TO REDUCE SELF-WEIGHT DEFLECTION.

BEAM SPLICE DETAIL
SCALE: N.T.S.

1/8" x 2" x 2" ANGLE EACH SIDE OF BEAM (LENGTH = BEAM NOTCH SIZE). FASTEN WITH #12 x 5/8" SMS AT 1/2" O.C. FASTEN TO GUTTER FACE WITH #12 x 5/8" SMS AT 3/4" O.C.

STRUCTURE GUTTER

FASCIA

BEAM PER PLAN

CLOSE TOP OF BEAM WITH RECEIVER CHANNEL; FASTEN WITH #12 x 5/8" SMS, MINIMUM (3) EACH SIDE.

2" x 2" x 1/8" ANGLE EACH SIDE OF BEAM. FASTEN WITH #12 x 5/8" SMS AT 3/4" O.C. EACH SIDE. FASTEN TO MASONRY HOST WITH (2) 1/4" TAPCONS, PROVIDING MINIMUM 2-1/4" EMBEDMENT INTO HOST

1. FASCIA TO BE FASTENED TO RAFTER TAIL USING (1) 1/4" Ø x 4" LAG SCREW.
2. A 7" GUTTER MAY BE USED, PROVIDED STRAP LENGTH IS INCREASED BY 2".

BEAM UNDER OVERHANG DETAIL
SCALE: N.T.S.

1/8" THICK INTERNAL RECEIVING CHANNEL; FASTEN TO BEAM WITH (8) #14 SMS THROUGH CHANNEL INTO BEAM

BEAM PER PLAN

CAGE BEAM

TOP VIEW

SIDE VIEW

CAGE BEAM

BEAM PER PLAN

(INTERNAL). FASTEN EACH SIDE OF BEAM FACE TO CHANNEL WITH (8) #14 SMS. MAINTAIN 3/8" SEPARATION BETWEEN FASTENERS AND FROM EDGES OF MEMBERS

BEAM TO EDGE BEAM DETAIL
SCALE: N.T.S.

1	INITIAL DESIGN	JDGV	AL	BC	5/19/2026
REV	DESCRIPTION	DRAWN	REVIEWED	APPR.	DATE


NOTICE:

THE DATA IN THIS DOCUMENT INCORPORATES PROPRIETARY RIGHTS OF ACTIVE DESIGNS LLC. ANY PARTY ACCEPTING THIS DOCUMENT DOES SO IN CONFIDENCE AND AGREES THAT IT SHALL NOT BE DUPLICATED IN WHOLE OR PART, NOR DISCLOSED TO OTHERS WITHOUT THE CONSENT OF ACTIVE DESIGNS LLC.

CONTRACTOR SHALL VERIFY ALL CONDITIONS ON JOB SITE & NOTIFY ENGINEER OF RECORD OF ANY VARIATIONS FROM DIMENSIONS SHOWN ON THESE DRAWINGS BEFORE PROCEEDING WITH ANY CONSTRUCTION.


Active Design LLC
info@activedesigneng.com
(310) 963-4514

DATE: 5/19/2026	SHEET: 4
DRAWING TITLE: DETAILS CONT.	
PROJECT NAME: HARBOUR, PRISCILLA	

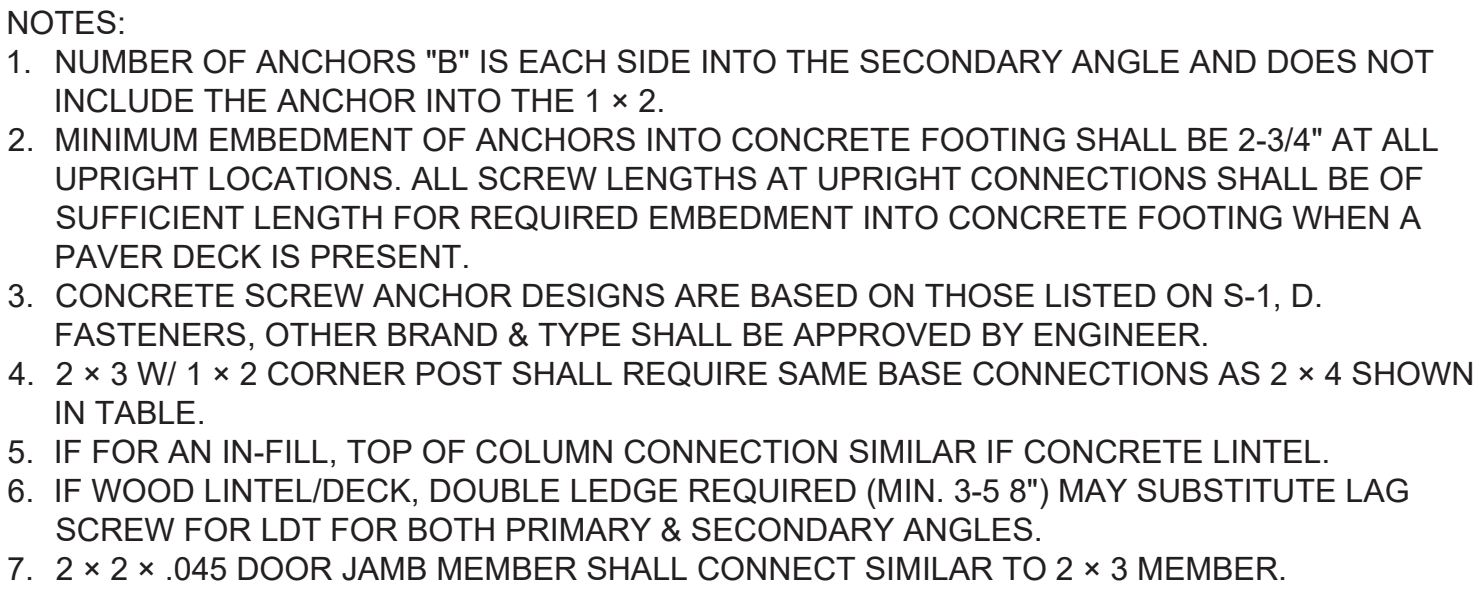

COLUMN SIZE	1/4" AND 3/8" Ø CONCRETE SCREW ANCHOR	
	"B"	MINIMUM SPACING
2X3 - 1/4"	0	0"
2X4 - 1/4"	1	3"
2X5 - 1/4"	1	3"
2X6 - 3/8"	1	4"
2X7 - 3/8"	1	5"
2X8 - 3/8"	2	3"
2X9 - 3/8"	2	4"
2X10 - 3/8"	2	4.5"
3X4 - 1/4"	1	3"
3X5 - 1/4"	1	3"
3X6 - 3/8"	1	4"
3X7 - 3/8"	1	5"
3X8 - 3/8"	2	3"
3X9 - 3/8"	2	4"
3X10 - 3/8"	2	4.5"
3X11 - 3/8"	2	4.5"
4X10 - 3/8"	2	4.5"

FOR RECEIVING CHANNEL: TOTAL (8) SCREWS
(2) #10 x 3/4" SMS (TYP) INTO GIRT/PURLIN &
(4) #10 x 3/4" SMS (TYP) INTO UPRIGHT/BREAM
FOR ANGLE: TOTAL (8) SCREWS
(2) #10 x 3/4" SMS (TYP) @ EA. LEG

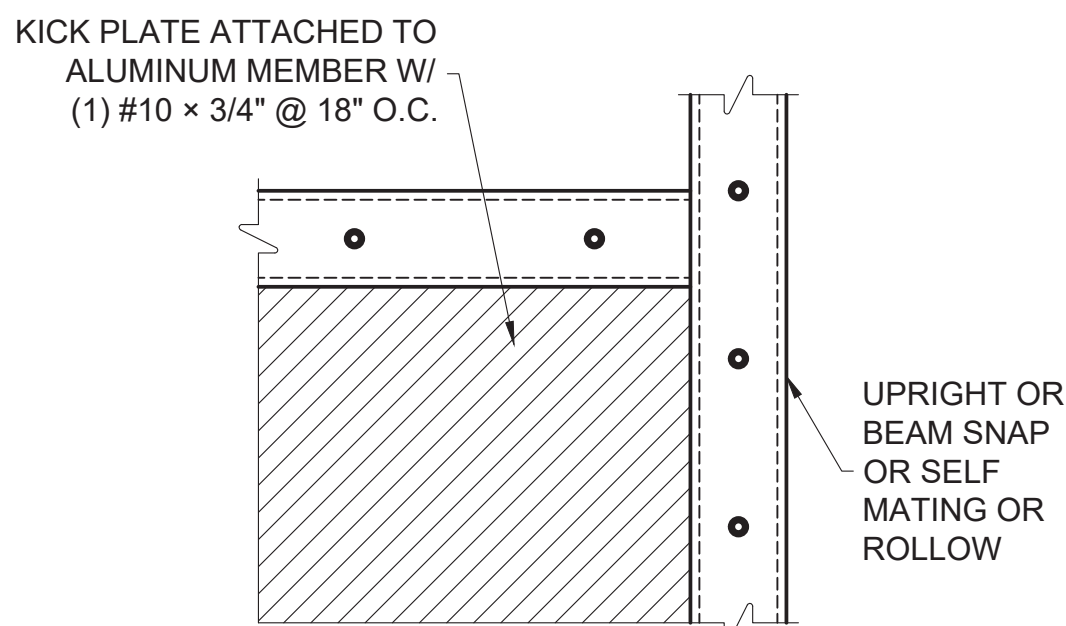

NOTES:
KICK PLATE TO BE APPLIED TO UPRIGHT
CHAIIRRAIL OR GIRT IF APPLICABLE

(4) 3/8" Ø MACHINE BOLTS W/ 3/4" Ø WASHERS 2 × 8 SMB TO 2 × 10 SMB,

(3) 3/8" Ø MACHINE BOLTS FOR BEAMS UNDER 2 × 8 SMB, THROUGH CARRIER BEAM AND POST

CARRIER BEAM

ALUMINUM POST

(OPTIONAL) 1" × 2" MEMBER FOR SCREENING USE #10 × 1-1/2" SMS @ 12" O.C. (MAX) CONNECTING 1" × 2" TO CARRIER BEAM & POST

HORIZONTAL BEAM ON ITS SIDE (IF REQUIRED)

NOTES:

1. PERPENDICULAR CARRIER BEAM: USE 0.125" RECEIVING CHANNEL WHICH WILL CONNECT TO THE POST W/(4) 3/8" THRU BOLTS USED FOR THE PRIMARY CARRIER BEAM, THEN USE (3) 3/8"Ø MACHINE BOLTS W/ 3/4"Ø WASHERS TO ATTACH THE PERPENDICULAR CARRIER BEAM TO THE RECEIVING CHANNEL.
2. HORIZONTAL BEAM DETAIL WILL BE PROVIDED IF NEEDED.

3" x 3" x .125" ANGLE
(EXTERNAL OR INTERNAL) OR
.125" RECEIVING CHANNEL

POST SIZE PER PLAN	(H)	(HH)	(S1)	(S2)
3"X3"	2	4	1/4"	2"
4"X4"	2	4	3/8"	2"
6"X6"	3	6	3/8"	4"
8"X8"	3	6	3/8"	4"

(H) 3/8" Ø MACHINE BOLTS WITH WASHERS OR (HH) #14 × 3/4" SMS

6"

ANCHORED TO CONCRETE W/ 1/4" × 3-1/2" MASONRY ANCHOR - 6" MAX EACH SIDE OF POST AND 24" O.C. MAX

(4) (S1) Ø CONCRETE SCREW WITH 2-3/4" EMBEDMENT (MIN. EDGE DISTANCE FROM DECK EDGE = 3")

NOTES:

1. CONCRETE SCREW ANCHOR DESIGNS ARE BASED ON TITEN HD (S1) Ø SCREW ANCHORS, OTHER SIZE OR TYPE OF ANCHORS SHALL NOT BE USED.
2. FOR PATIO COVERS AND CARPORTS: DISREGARD THE 1 × 2 OPEN BACK SCREEN MEMBER ON THE FOUNDATION TYP.
3. MINIMUM EMBEDMENT OF ANCHORS INTO CONCRETE FOOTING SHALL BE 2-3/4" AT ALL POST LOCATIONS. ALL SCREW LENGTHS AT POST CONNECTIONS SHALL BE OF SUFFICIENT LENGTH FOR REQUIRED EMBEDMENT INTO CONCRETE FOOTING WHEN A PAVER DECK IS PRESENT.
4. MINIMUM EMBEDMENT OF ANCHORS INTO CONCRETE FOOTING SHALL BE 2-3/4" AT ALL UPRIGHT LOCATIONS. ALL SCREW LENGTHS AT UPRIGHT CONNECTIONS SHALL BE OF SUFFICIENT LENGTH FOR REQUIRED EMBEDMENT INTO CONCRETE FOOTING WHEN A PAVER DECK IS PRESENT.
5. DETAIL MAY BE FLIPPED AS NEEDED
6. USE 1/4" × 3" LAG SCREWS IN LIEU OF CONCRETE SCREWS FOR WOOD HEADERS

(8) #14 x 3/4 SMS

2" x 2" x 1/8" EXTRUDED ANGLE ON 45° ANGLE

PERIMETER FRAMING

3/8" Ø ADJUSTABLE EYE BOLT FOR CABLE TENSION

1/8" Ø STAINLESS STEEL CABLE

SIDE VIEW

1" x 2" x 1/8" ANGLE (4) #12 x 3/4" SMS (TYP TOP AND SIDE)

Ø1/8" STAINLESS STEEL CABLE

TOP VIEW

1" Ø (MIN) WASHER BENEATH NUT

3/8" WELDED STAINLESS STEEL EYE BOLT

NOTES:
WHEN USING CORNER CONNECTION OPTION
#2 CONNECTION CABLE MUST BE WITHIN 6"
OF CORNER OR PRIMARY MEMBER.

Diagram illustrating the attachment of a 1/8" ALUMINUM PLATE @ 45° ANGLE W/ 1" BREAK @ 90° W/ 5/16" EYE BOLT W/ LOCK NUT & WASHER EA SIDE.

The plate is attached to a wall using (9) #14 x 3/4 SMS @ 1" O.C. (On Center).

Dimensions shown:

- 5" MIN (Minimum distance between attachment points)
- 1/2" (Minimum distance from wall to attachment point)

45° - 60°

TOP OF CONCRETE

4" NOMINAL SLAB MINIMUM

3/8" Ø x 3' MASONRY ANCHOR

2500 PSI CONCRETE W/WELDED WIRE OR FIBERMESH

1/2" 3"

2" x 2" x .125' CLIP MAX OF DECK W/ (2) 1/4" x 3" DISTANCE FROM TOP


(2) 1/4" Ø x 3" MASONRY ANCHOR (MIN 2-3/4" EMBEDMENT)

2" x 2" x .125' CLIP MAY BY PLACED ON TOP OR SIDE
OF DECK W/ (2) 1/4" x 3" SLEEVE ANCHOR @ 2" EDGE
DISTANCE FROM TOP OR SIDE OF CONCRETE.

1) 1/4" Ø x 3"
MASONRY ANCHOR
(MIN 2-3/4" EMBEDMENT)

1-1/2" x 5-1/2" ALUMINUM
STRAP W/ (2) 1/4" Ø x 3"
MASONRY ANCHOR (MIN
2-3/4" EMBEDMENT)

OPTION #3
USE WITH FOOTING ONLY

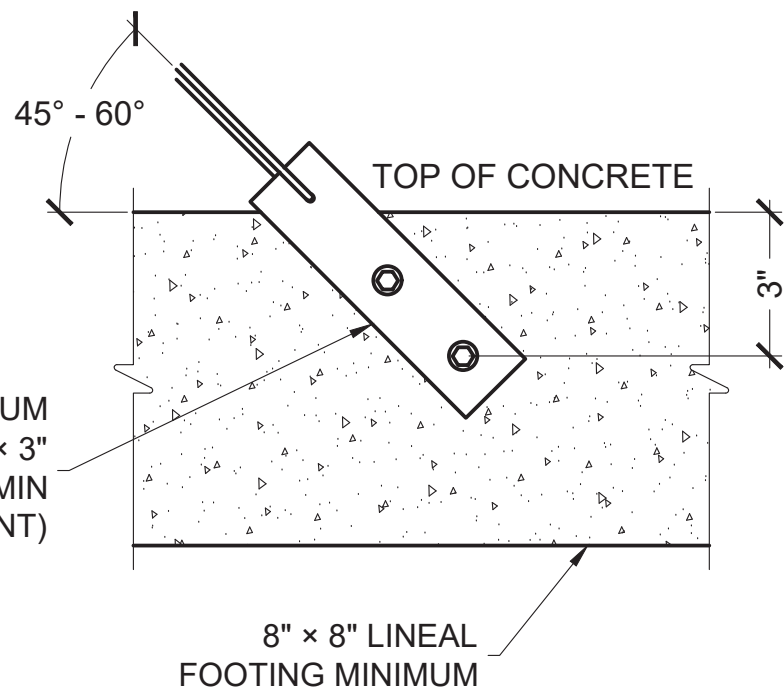

A circular red seal for a Professional Engineer in the State of Florida. The outer ring contains the text "BRANDON CAMPBELL" at the top and "PROFESSIONAL ENGINEER" at the bottom, separated by two stars. Inside the ring, the word "LICENSE" is at the top and "STATE OF FLORIDA" is at the bottom. In the center, the license number "100195" is printed above a handwritten signature in black ink.

1	INITIAL DESIGN	JDGV	AL	BC	5/19/2026
REV	DESCRIPTION	DRAWN	REVIEWED	APPR.	DATE

THE DATA IN THIS DOCUMENT INCORPORATES PROPRIETARY RIGHTS OF ACTIVE DESIGNS LLC. ANY PARTY ACCEPTING THIS DOCUMENT DOES SO IN CONFIDENCE AND AGREES THAT IT SHALL NOT BE DUPLICATED IN WHOLE OR PART, NOR DISCLOSED TO OTHERS WITHOUT THE CONSENT OF ACTIVE DESIGNS LLC.

CONTRACTOR SHALL VERIFY ALL CONDITIONS ON JOB SITE & NOTIFY
ENGINEER OF RECORD OF ANY VARIATIONS FROM DIMENSIONS
SHOWN ON THESE DRAWINGS BEFORE PROCEEDING WITH ANY
CONSTRUCTION.




Active Design LLC
info@activedesigneng.com
(310) 963-4514

DATE: 5/19/2026


SHEET: 5

DRAWING TITLE:
DETAILS CONT.



PROJECT NAME:
HARBOUR, PRISCILLA

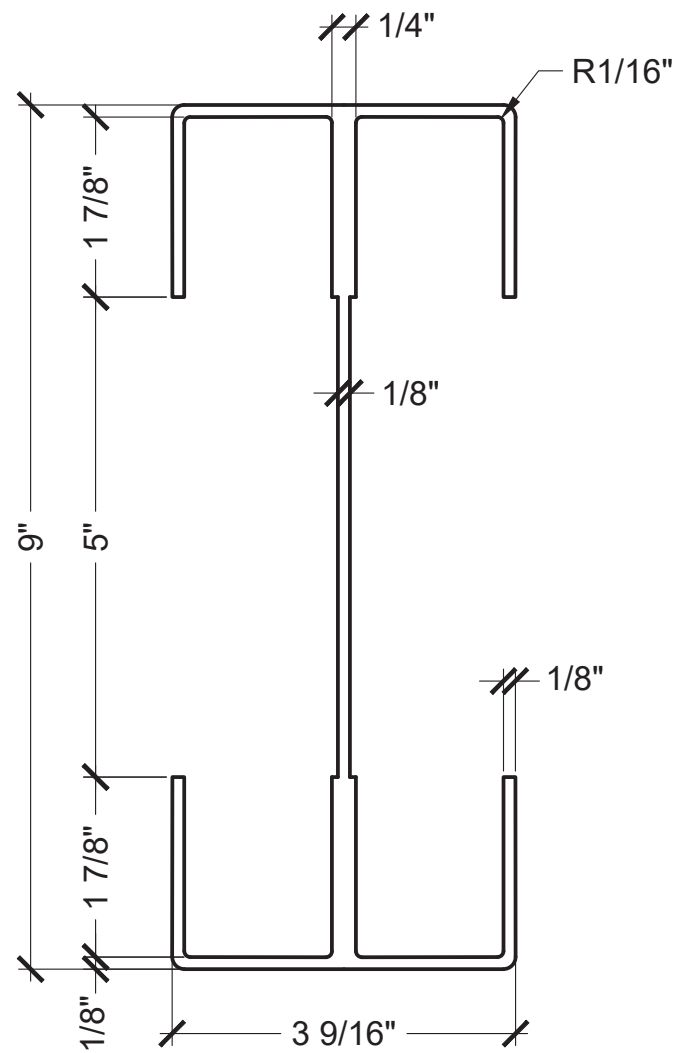


ULTIMATE VIEW GUSSET MATERIAL
SCALE: N.T.S.

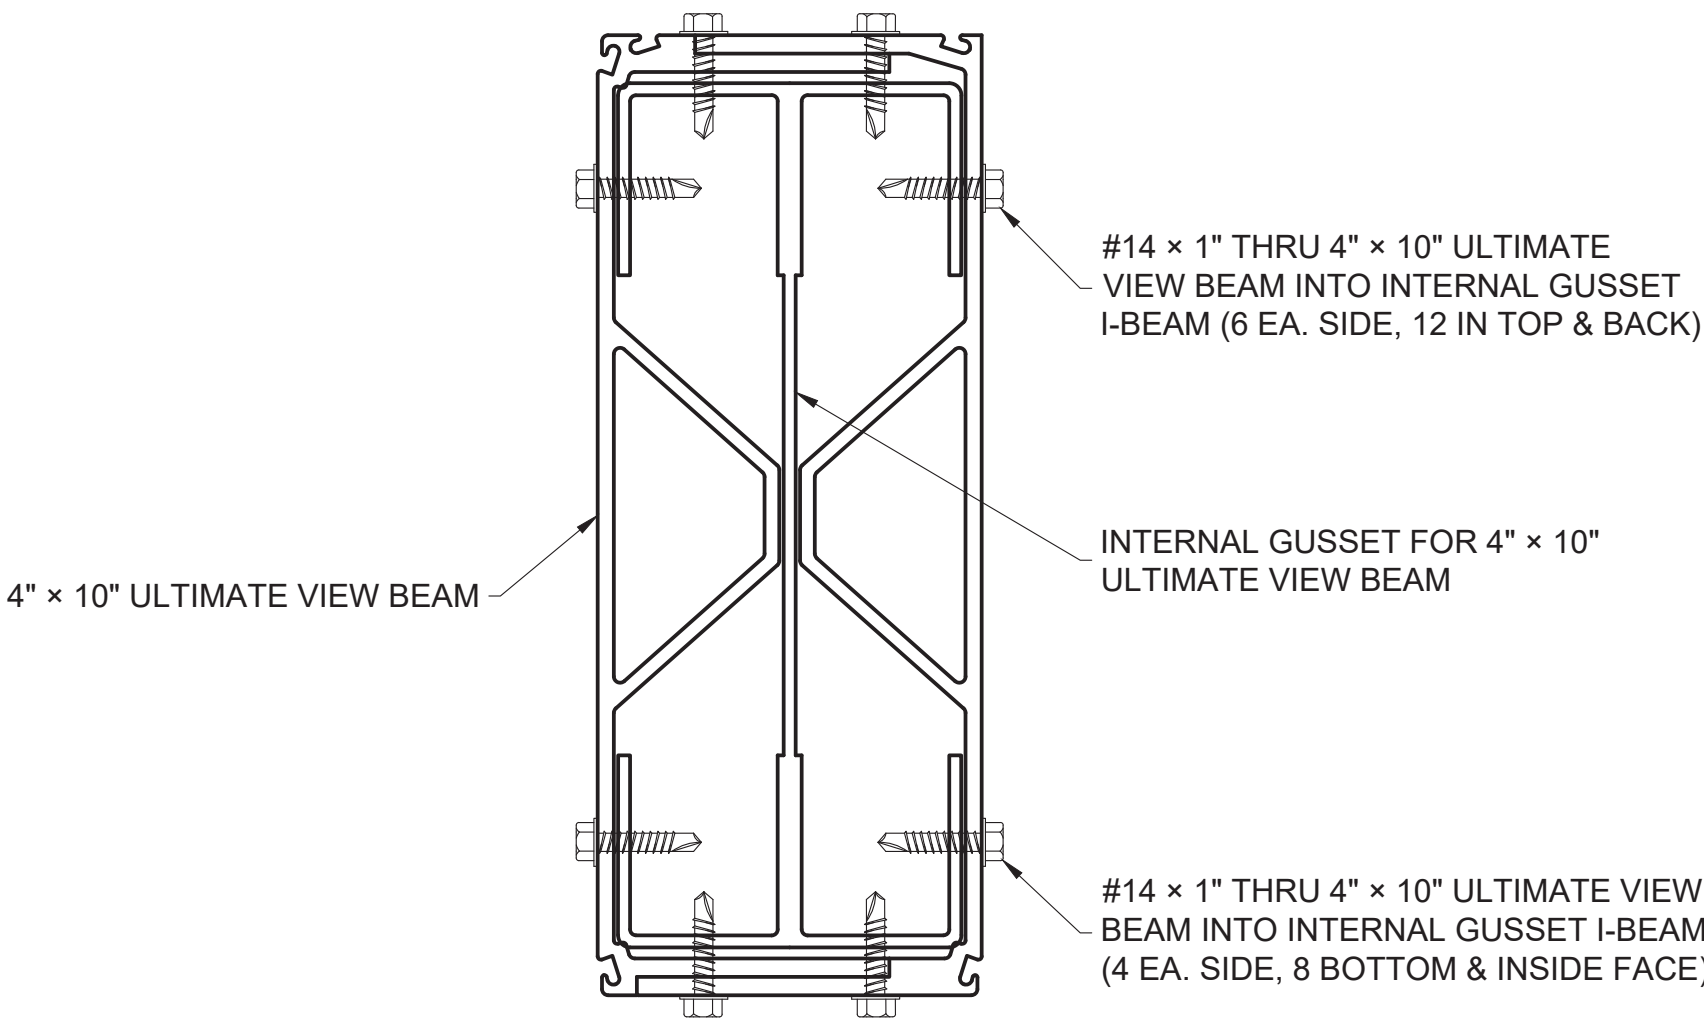


ULTIMATE VIEW UPRIGHT TO BEAM GUSSET MATERIAL
SCALE: N.T.S.

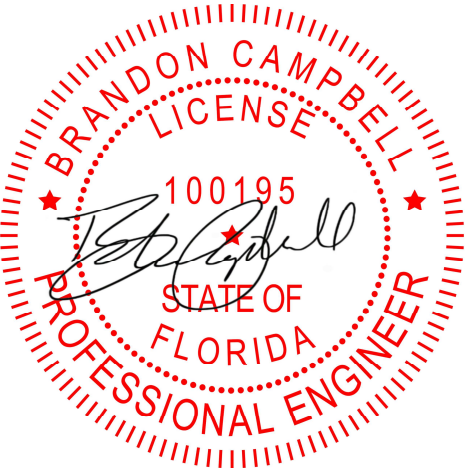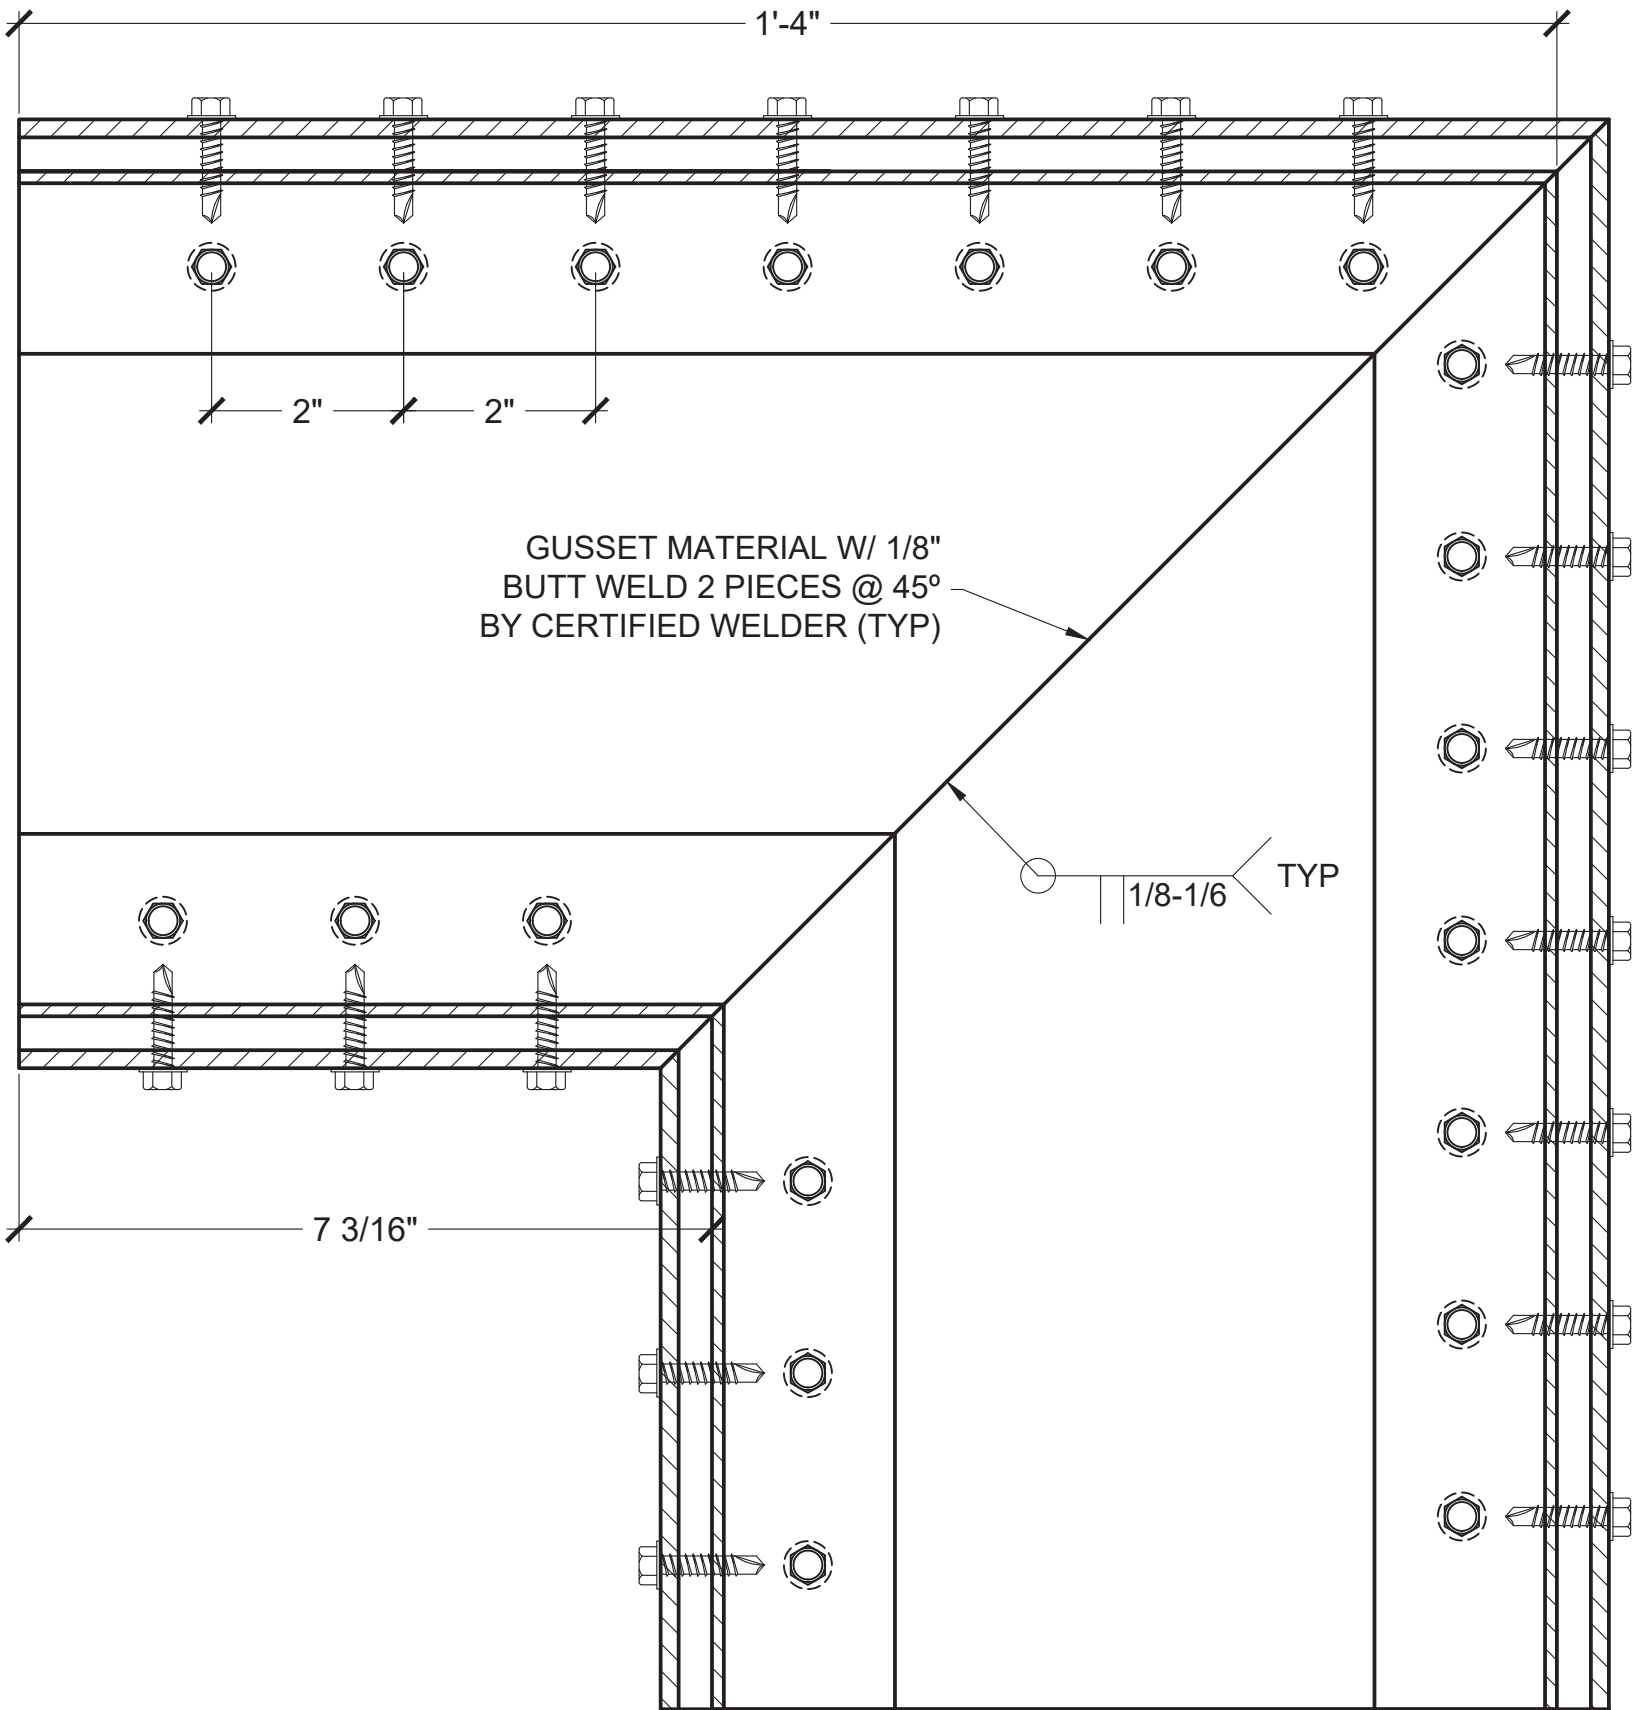

ULTIMATE VIEW UPRIGHT TO BEAM GUSSET MATERIAL
SCALE: N.T.S.

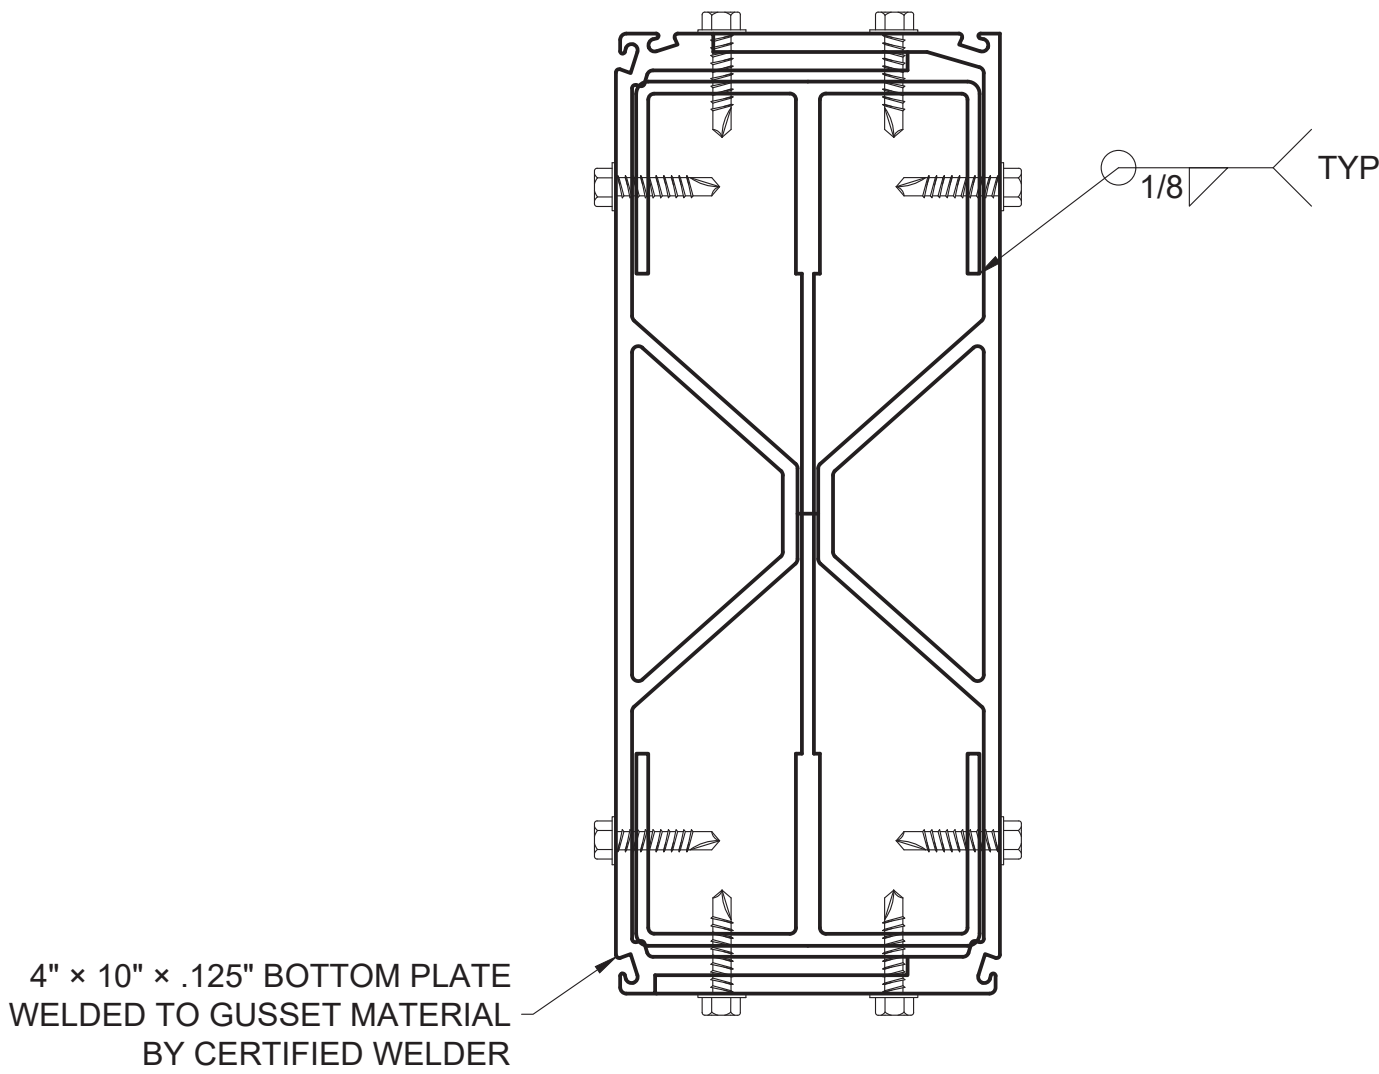

ULTIMATE VIEW UPRIGHT TO BEAM WELD GUSSET MATERIAL
SCALE: N.T.S.

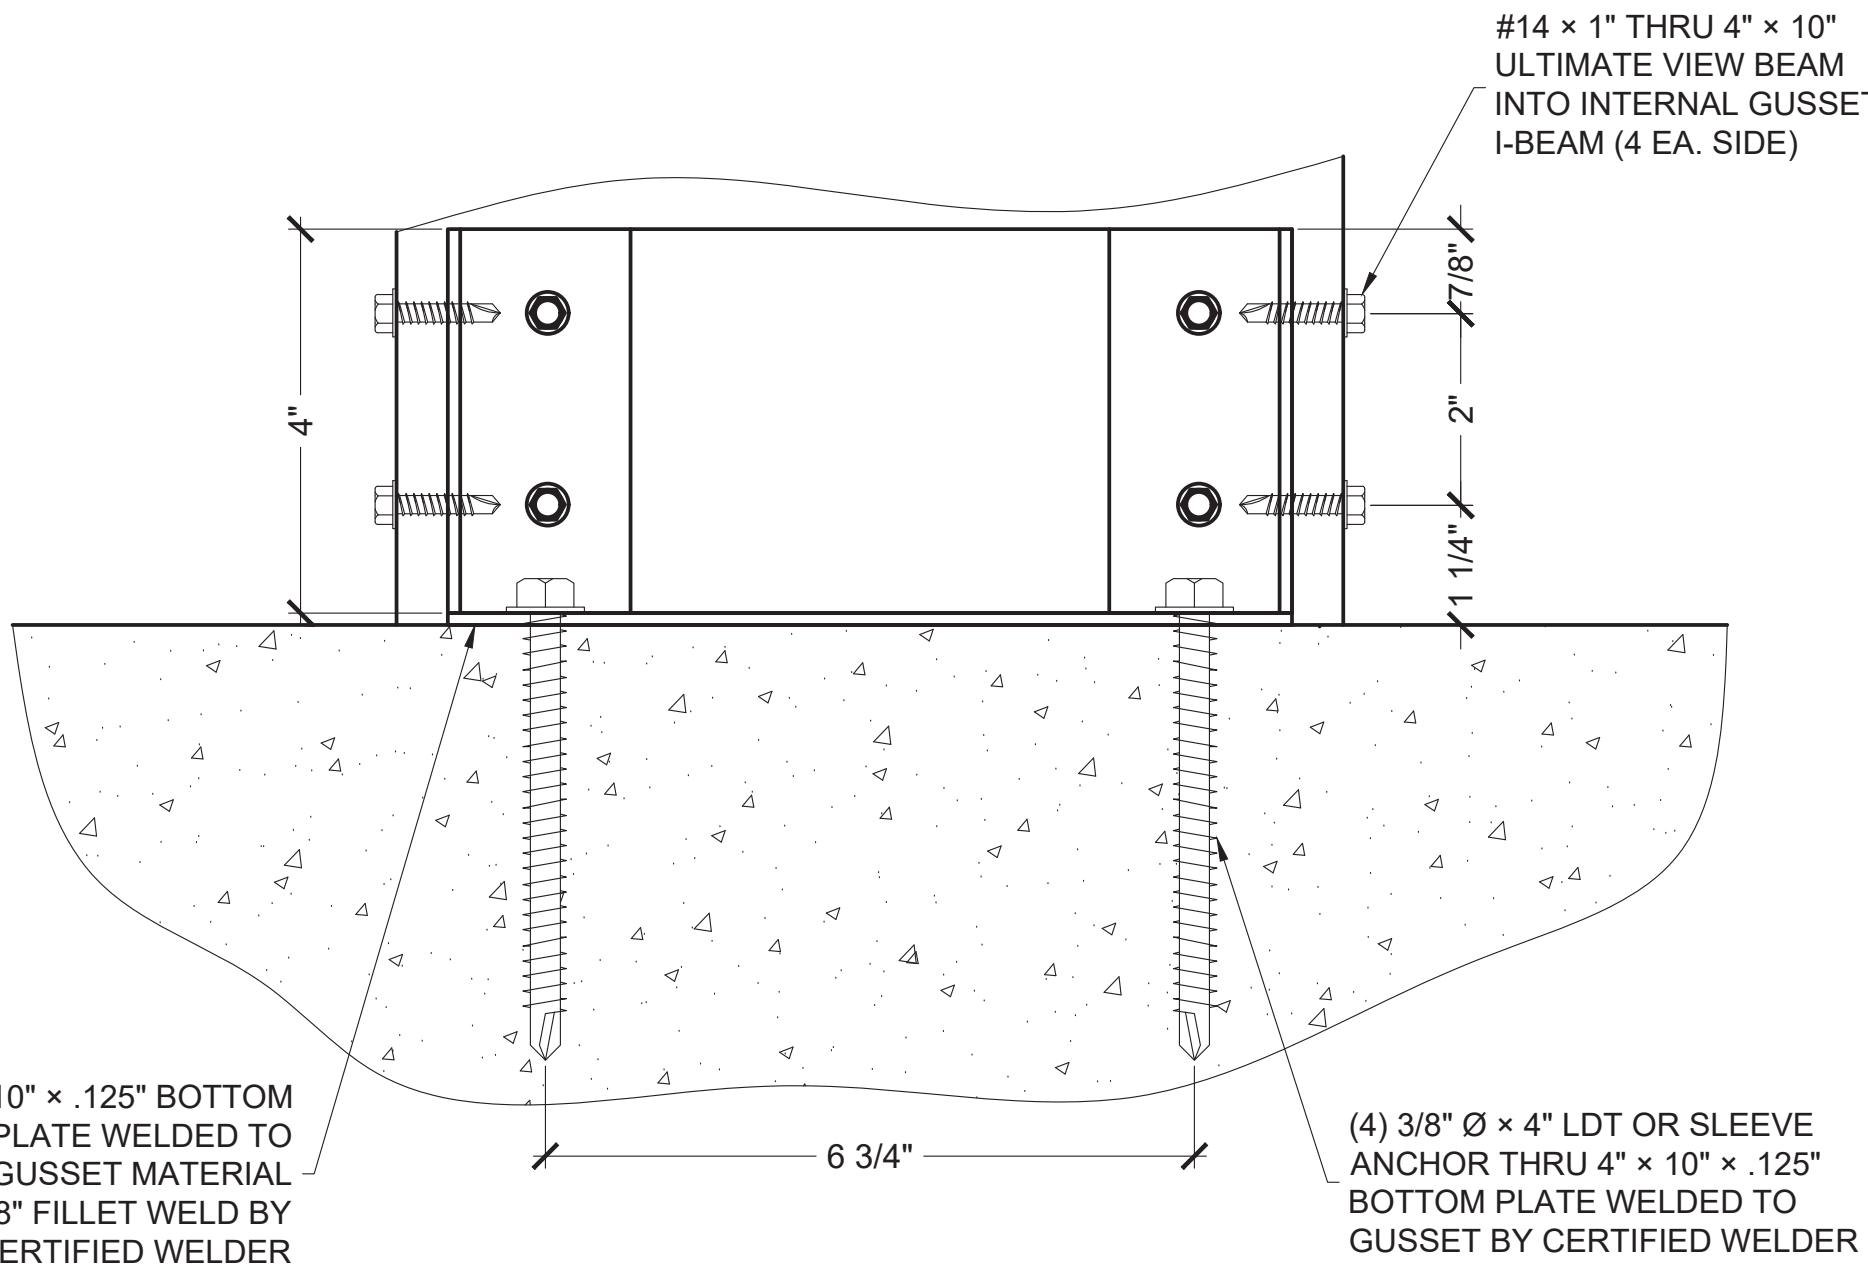

ULTIMATE VIEW BASE MATERIAL
SCALE: N.T.S.

1	INITIAL DESIGN	JDGV	AL	BC	5/19/2026
REV	DESCRIPTION	DRAWN	REVIEWED	APPR.	DATE


NOTICE:
THE DATA IN THIS DOCUMENT INCORPORATES PROPRIETARY RIGHTS OF ACTIVE DESIGNS LLC. ANY PARTY ACCEPTING THIS DOCUMENT DOES SO IN CONFIDENCE AND AGREES THAT IT SHALL NOT BE DUPLICATED IN WHOLE OR PART, NOR DISCLOSED TO OTHERS WITHOUT THE CONSENT OF ACTIVE DESIGNS LLC.

CONTRACTOR SHALL VERIFY ALL CONDITIONS ON JOB SITE & NOTIFY ENGINEER OF RECORD OF ANY VARIATIONS FROM DIMENSIONS SHOWN ON THESE DRAWINGS BEFORE PROCEEDING WITH ANY CONSTRUCTION.




Active Design LLC
info@activedesigneng.com
(310) 963-4514


DATE: 5/19/2026	SHEET: 6
DRAWING TITLE: DETAILS CONT.	
PROJECT NAME: HARBOUR, PRISCILLA	

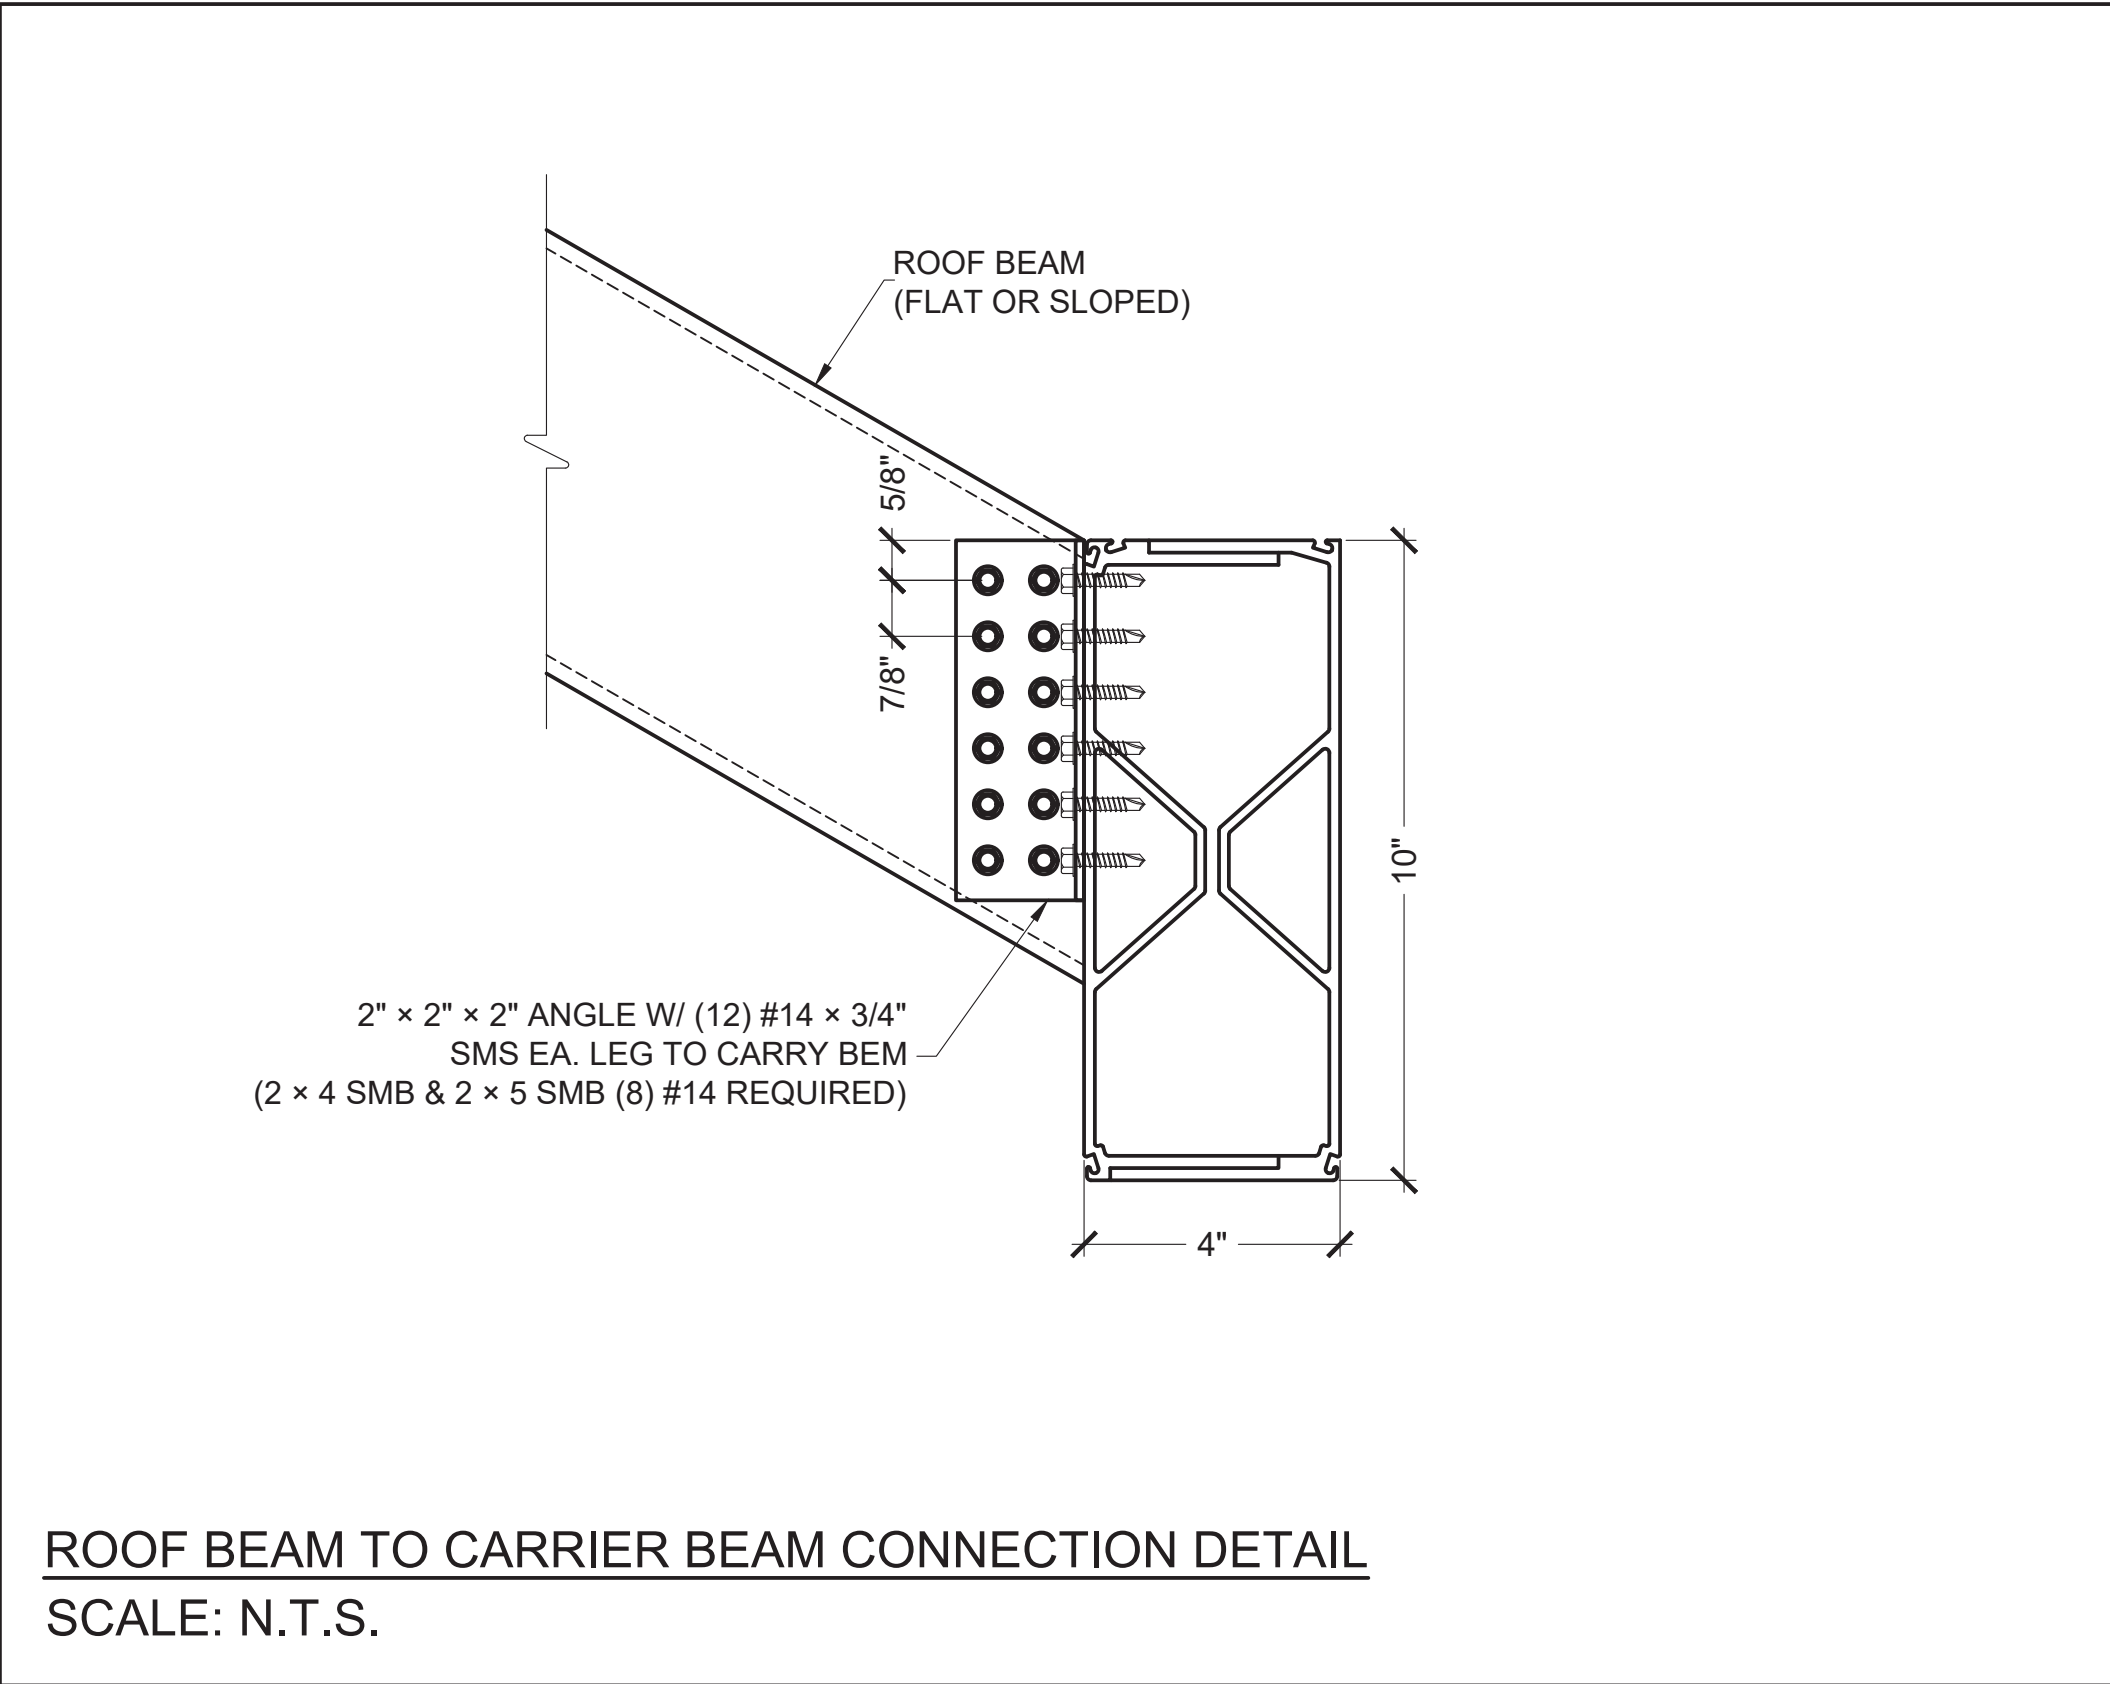


ROOF BEAM TO CARRIER BEAM CONNECTION DETAIL
SCALE: N.T.S.

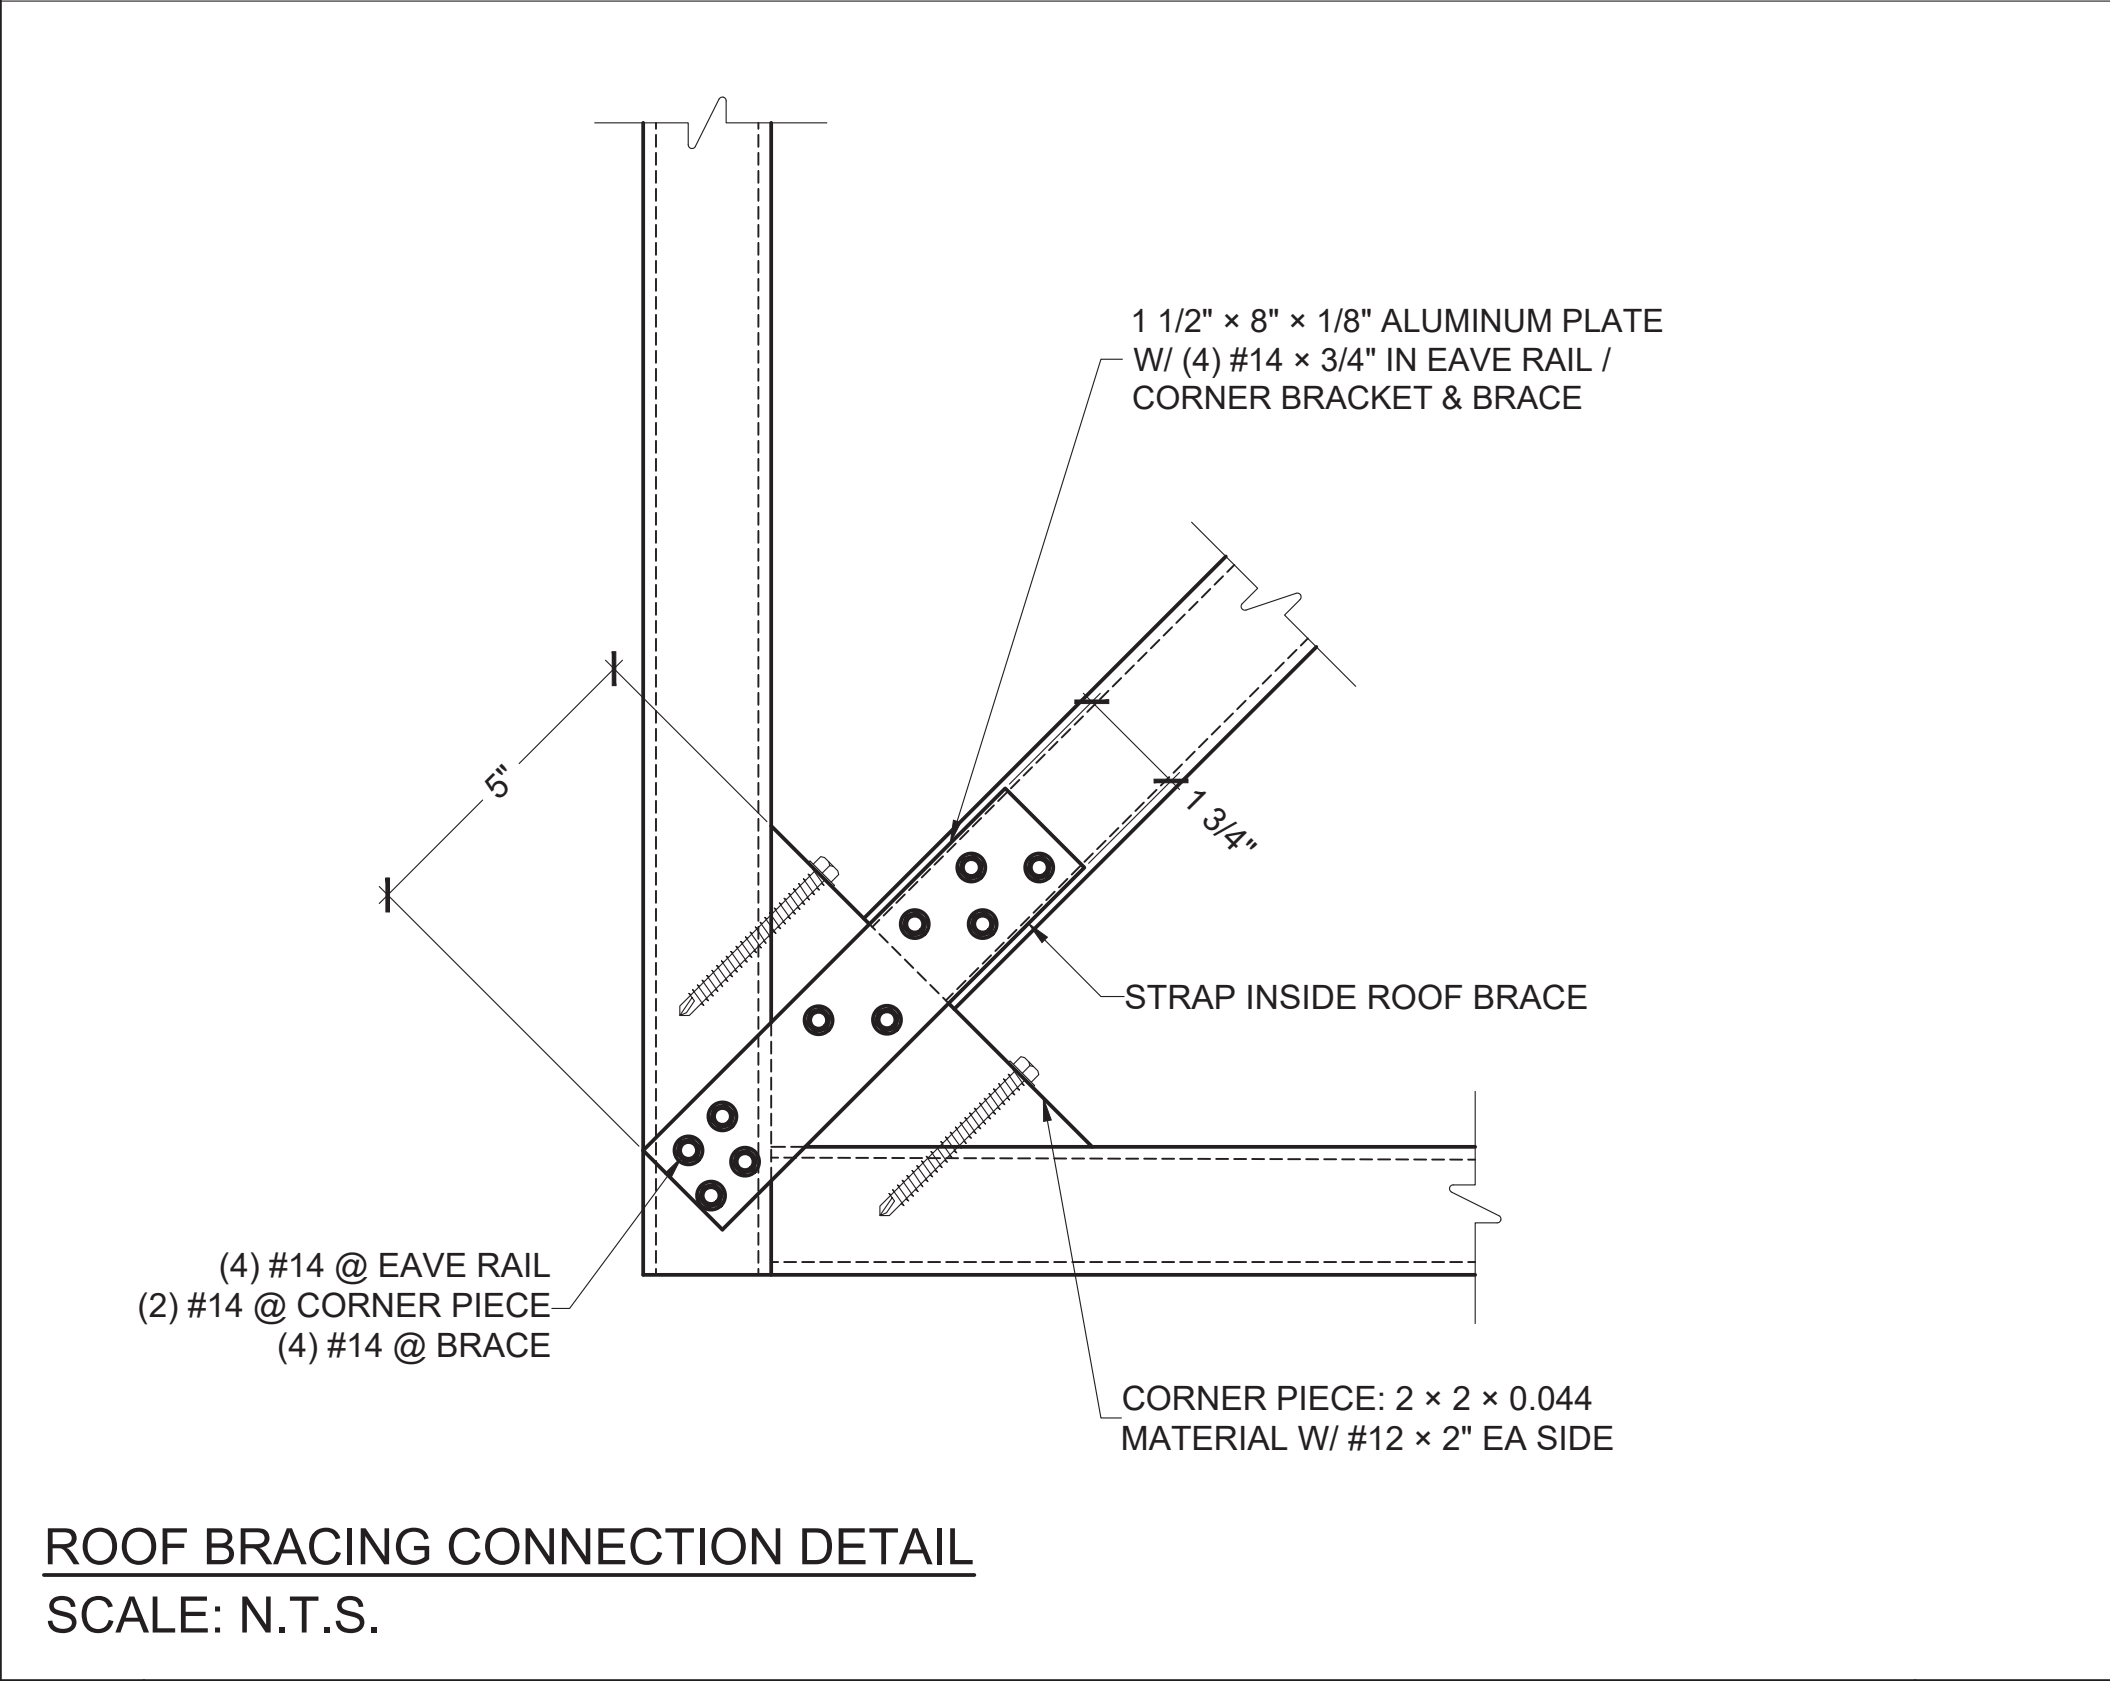


ROOF BRACING CONNECTION DETAIL
SCALE: N.T.S.

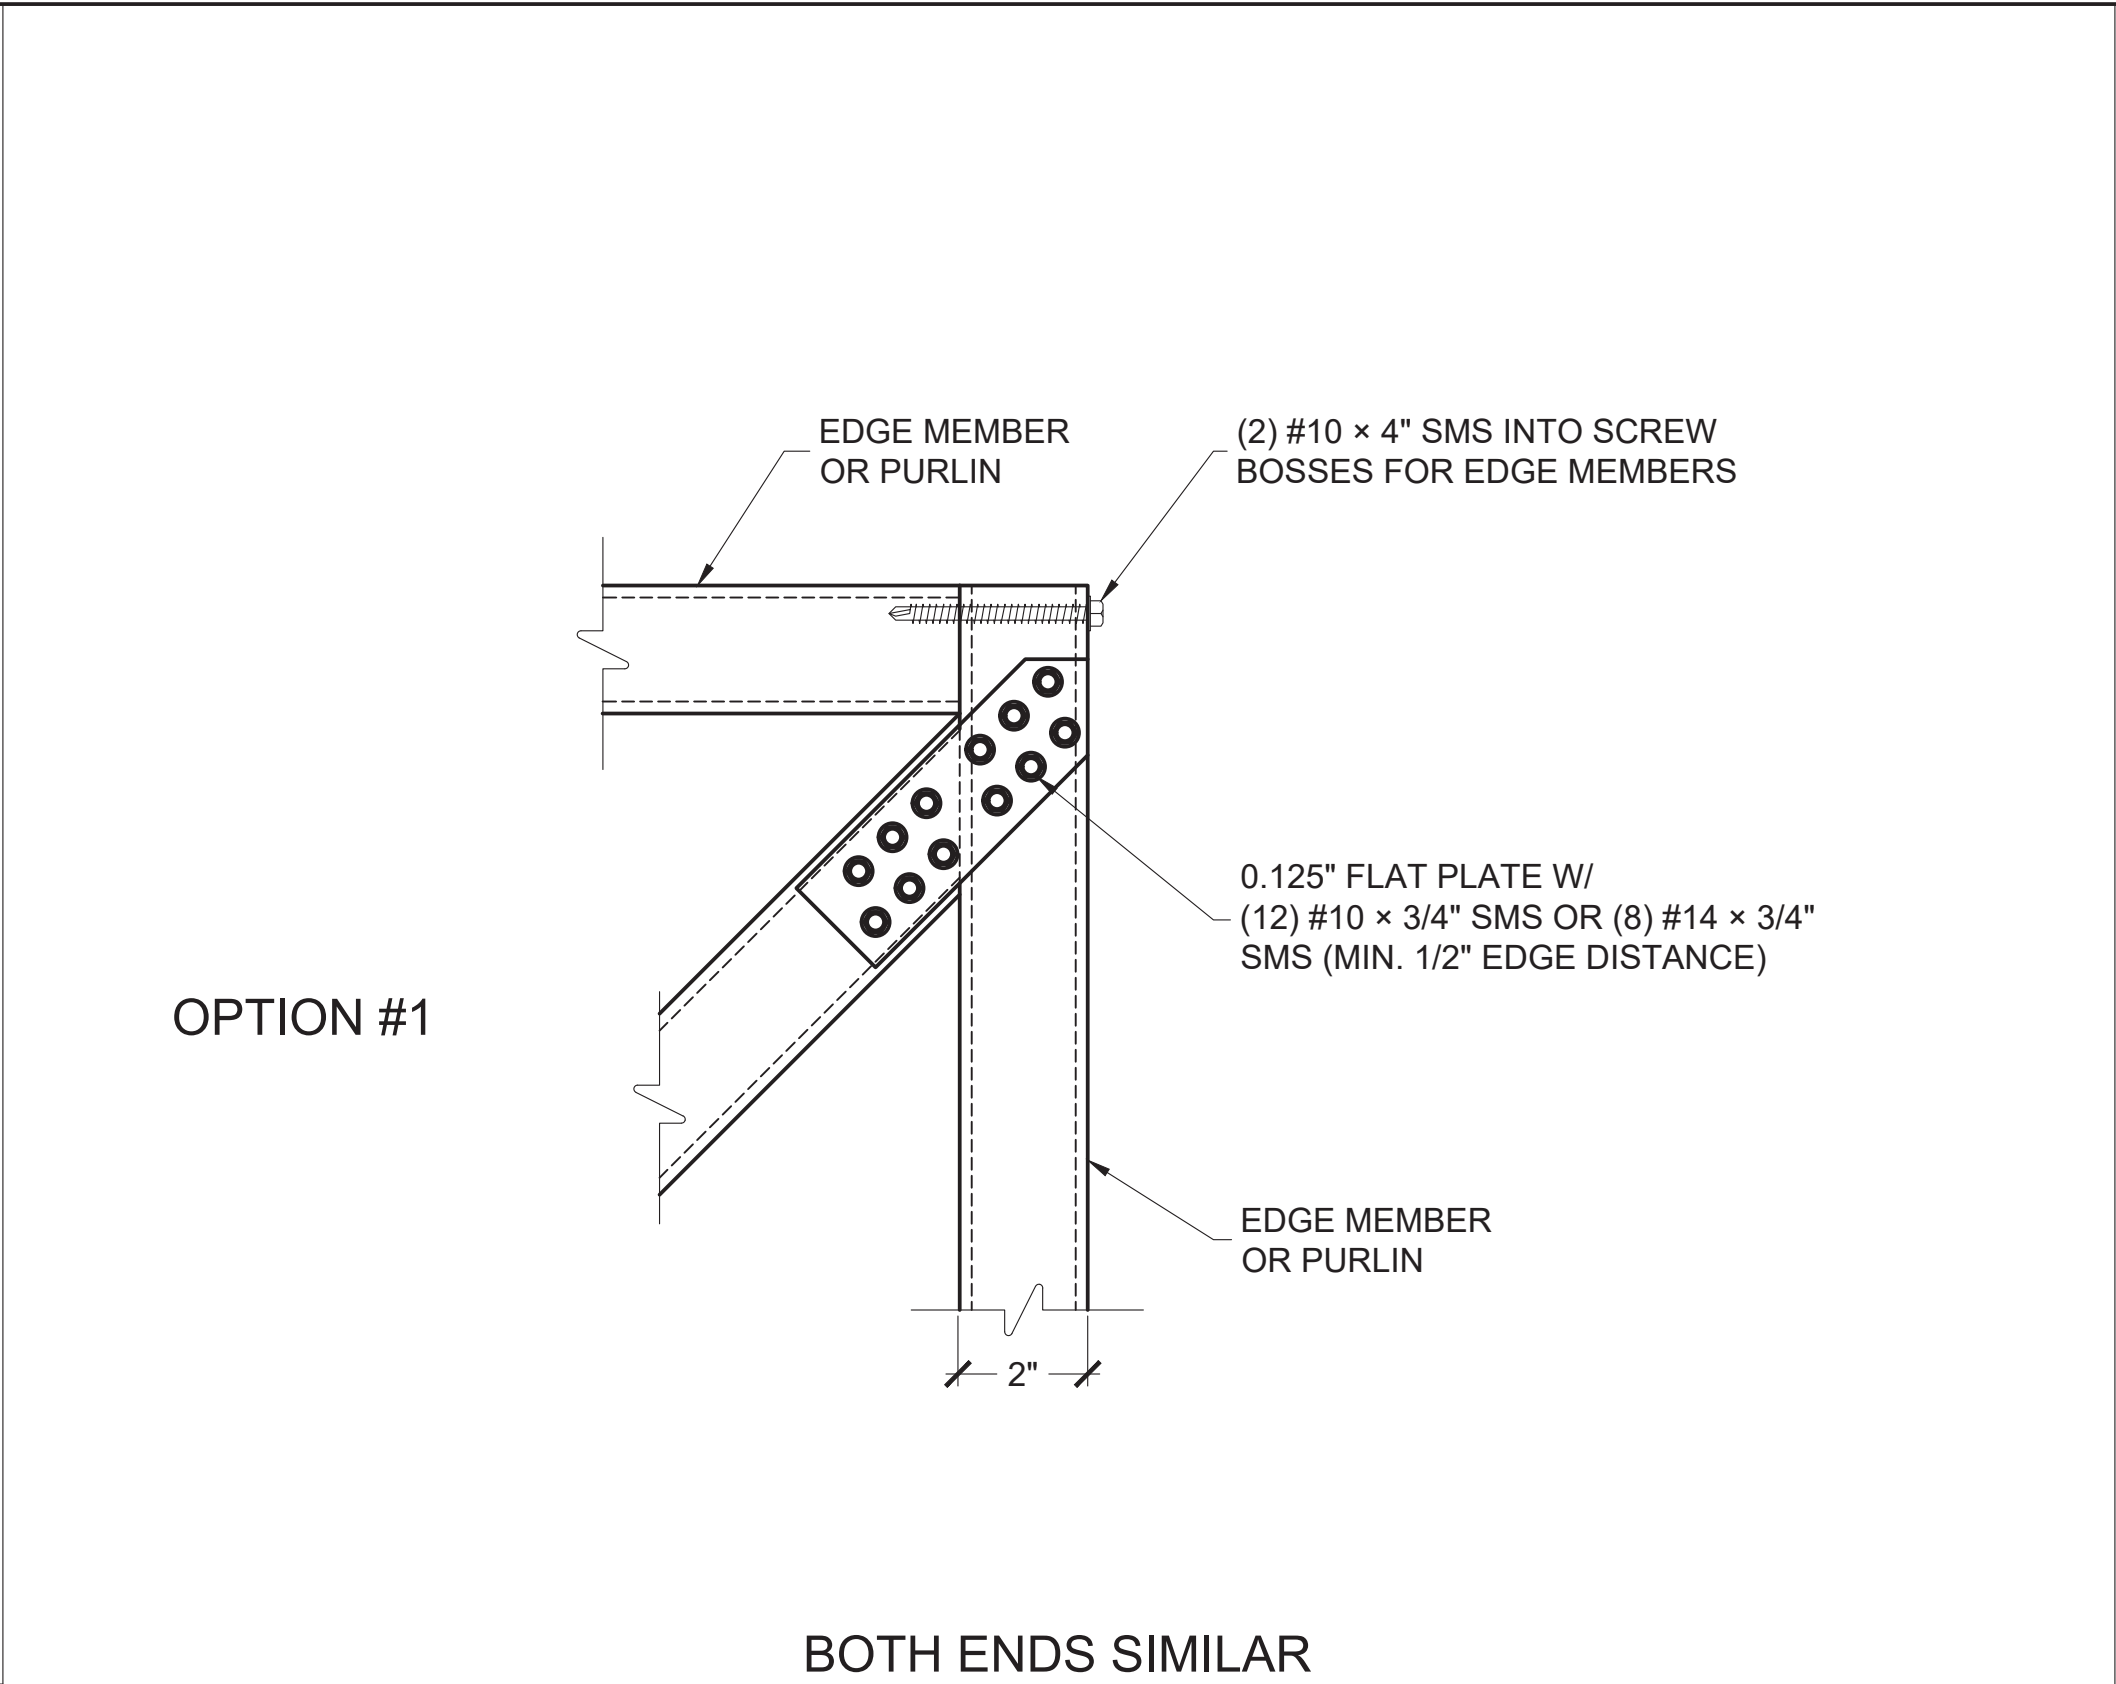


BOTH ENDS SIMILAR

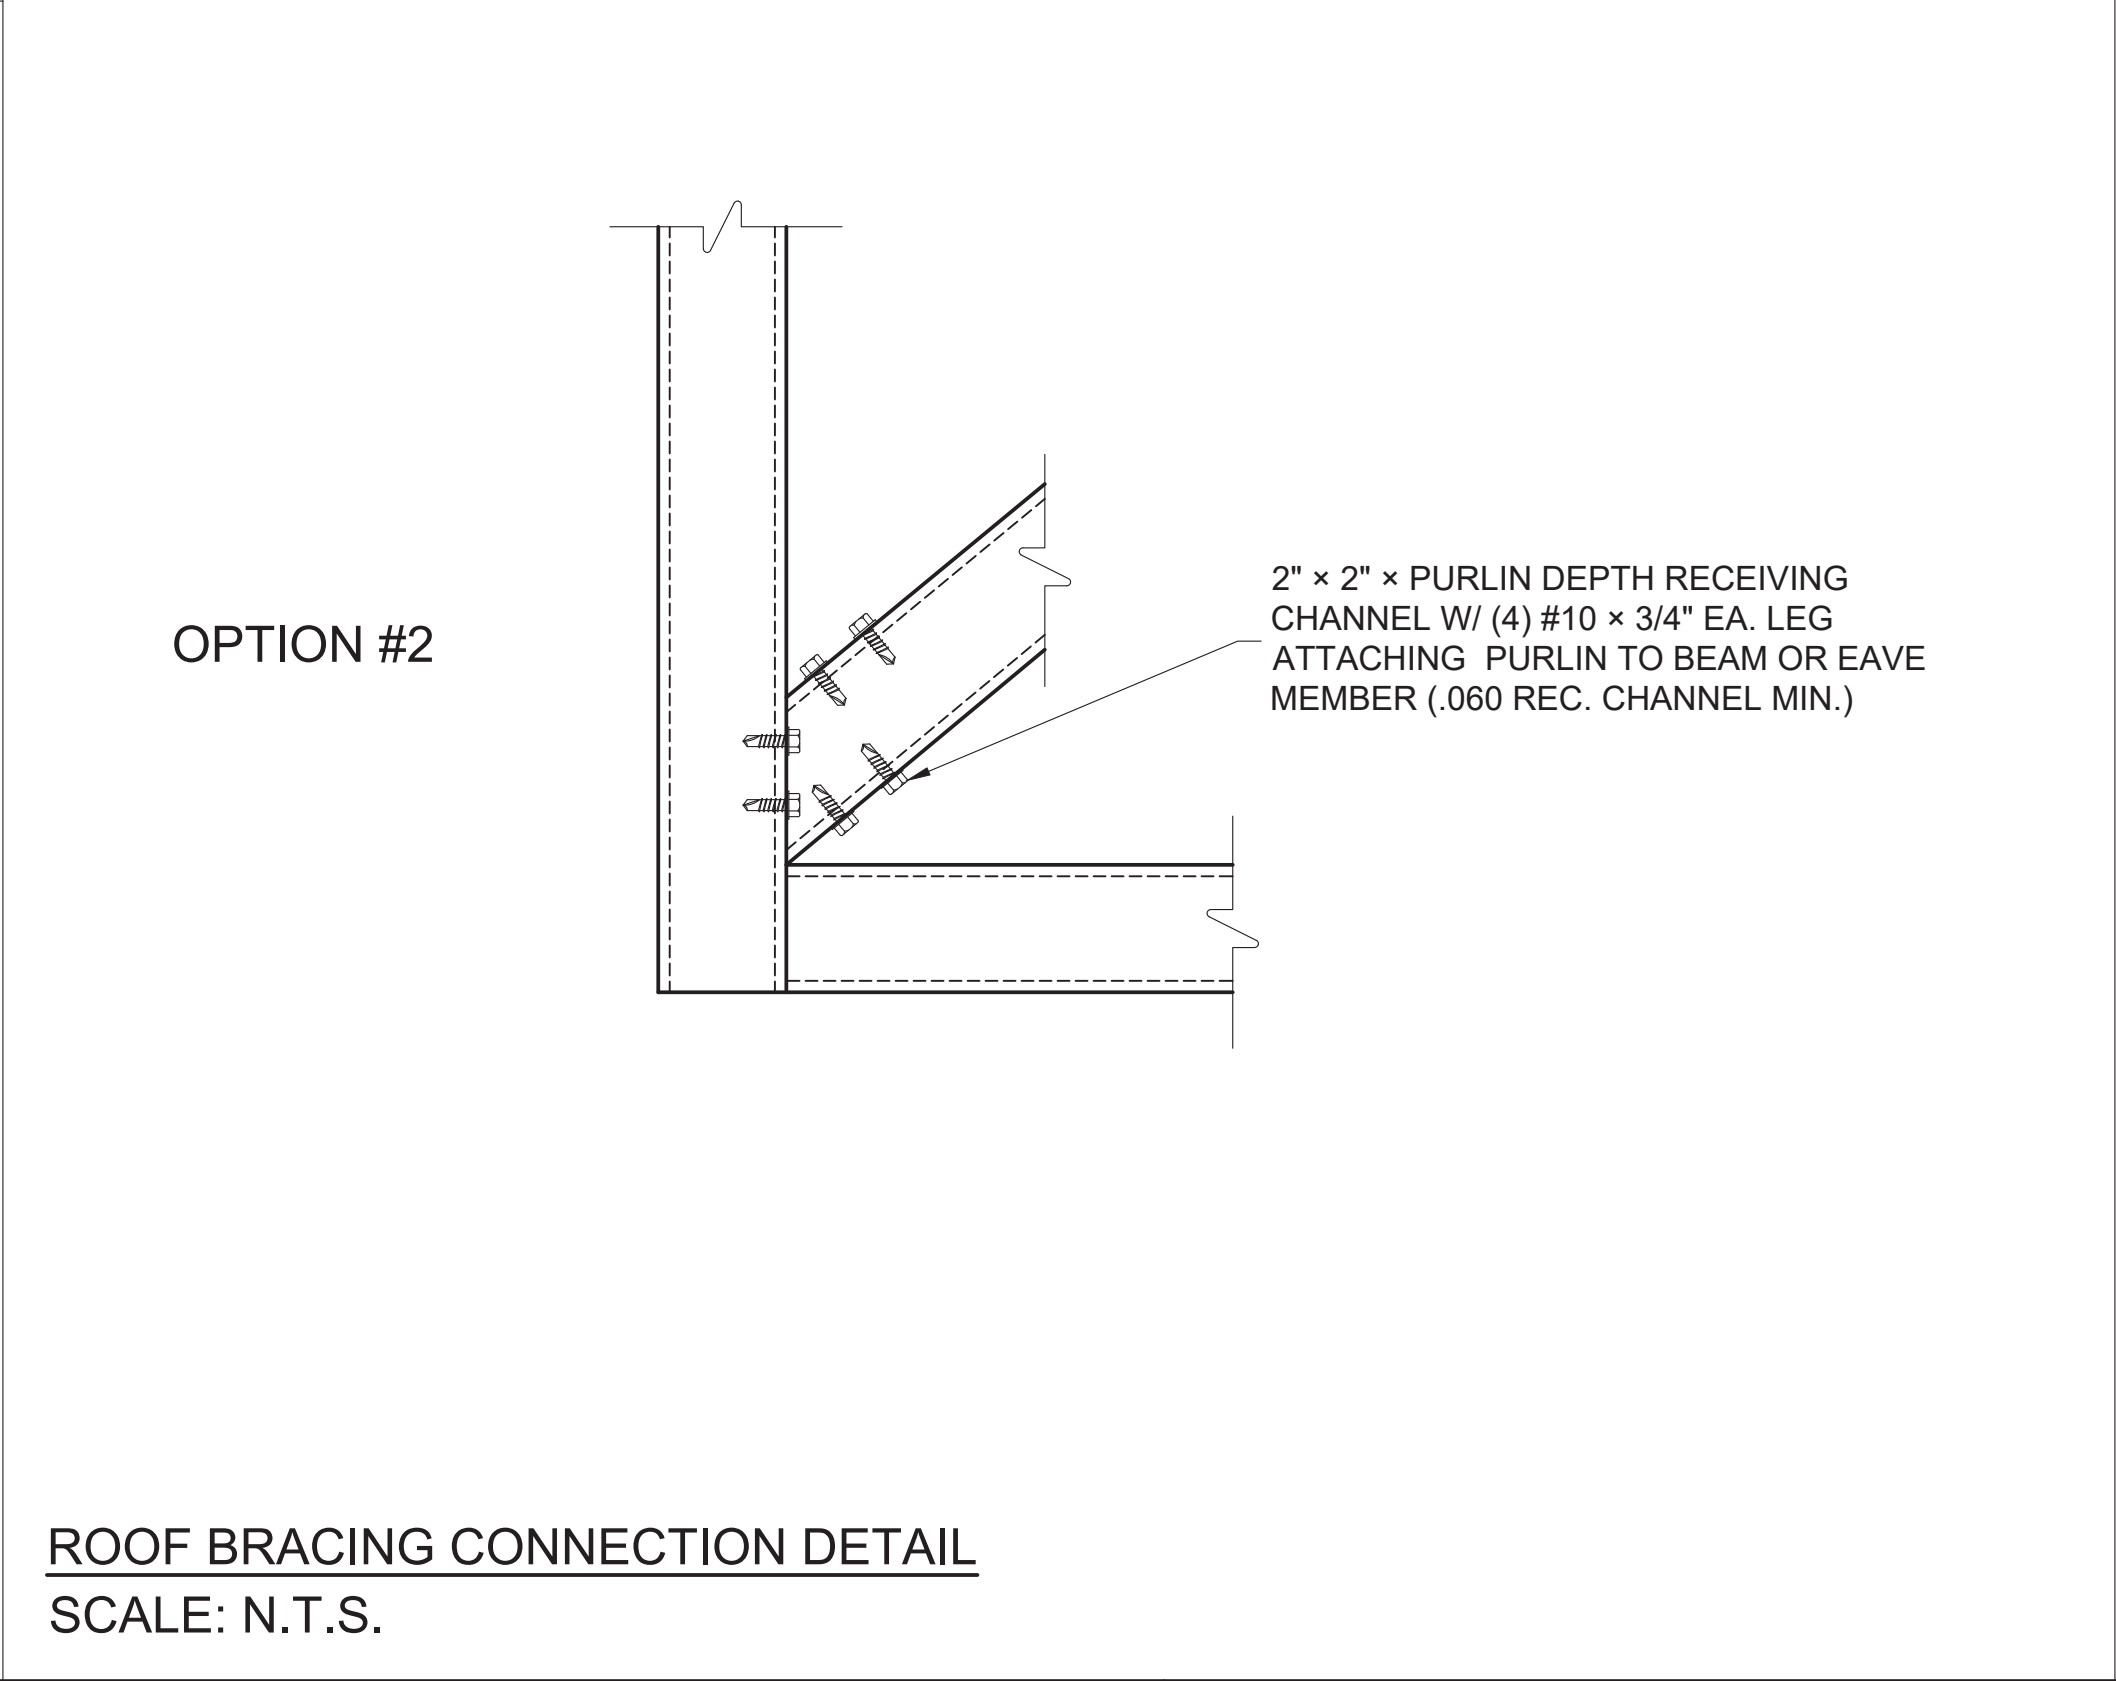

ROOF BRACING CONNECTION DETAIL
SCALE: N.T.S.

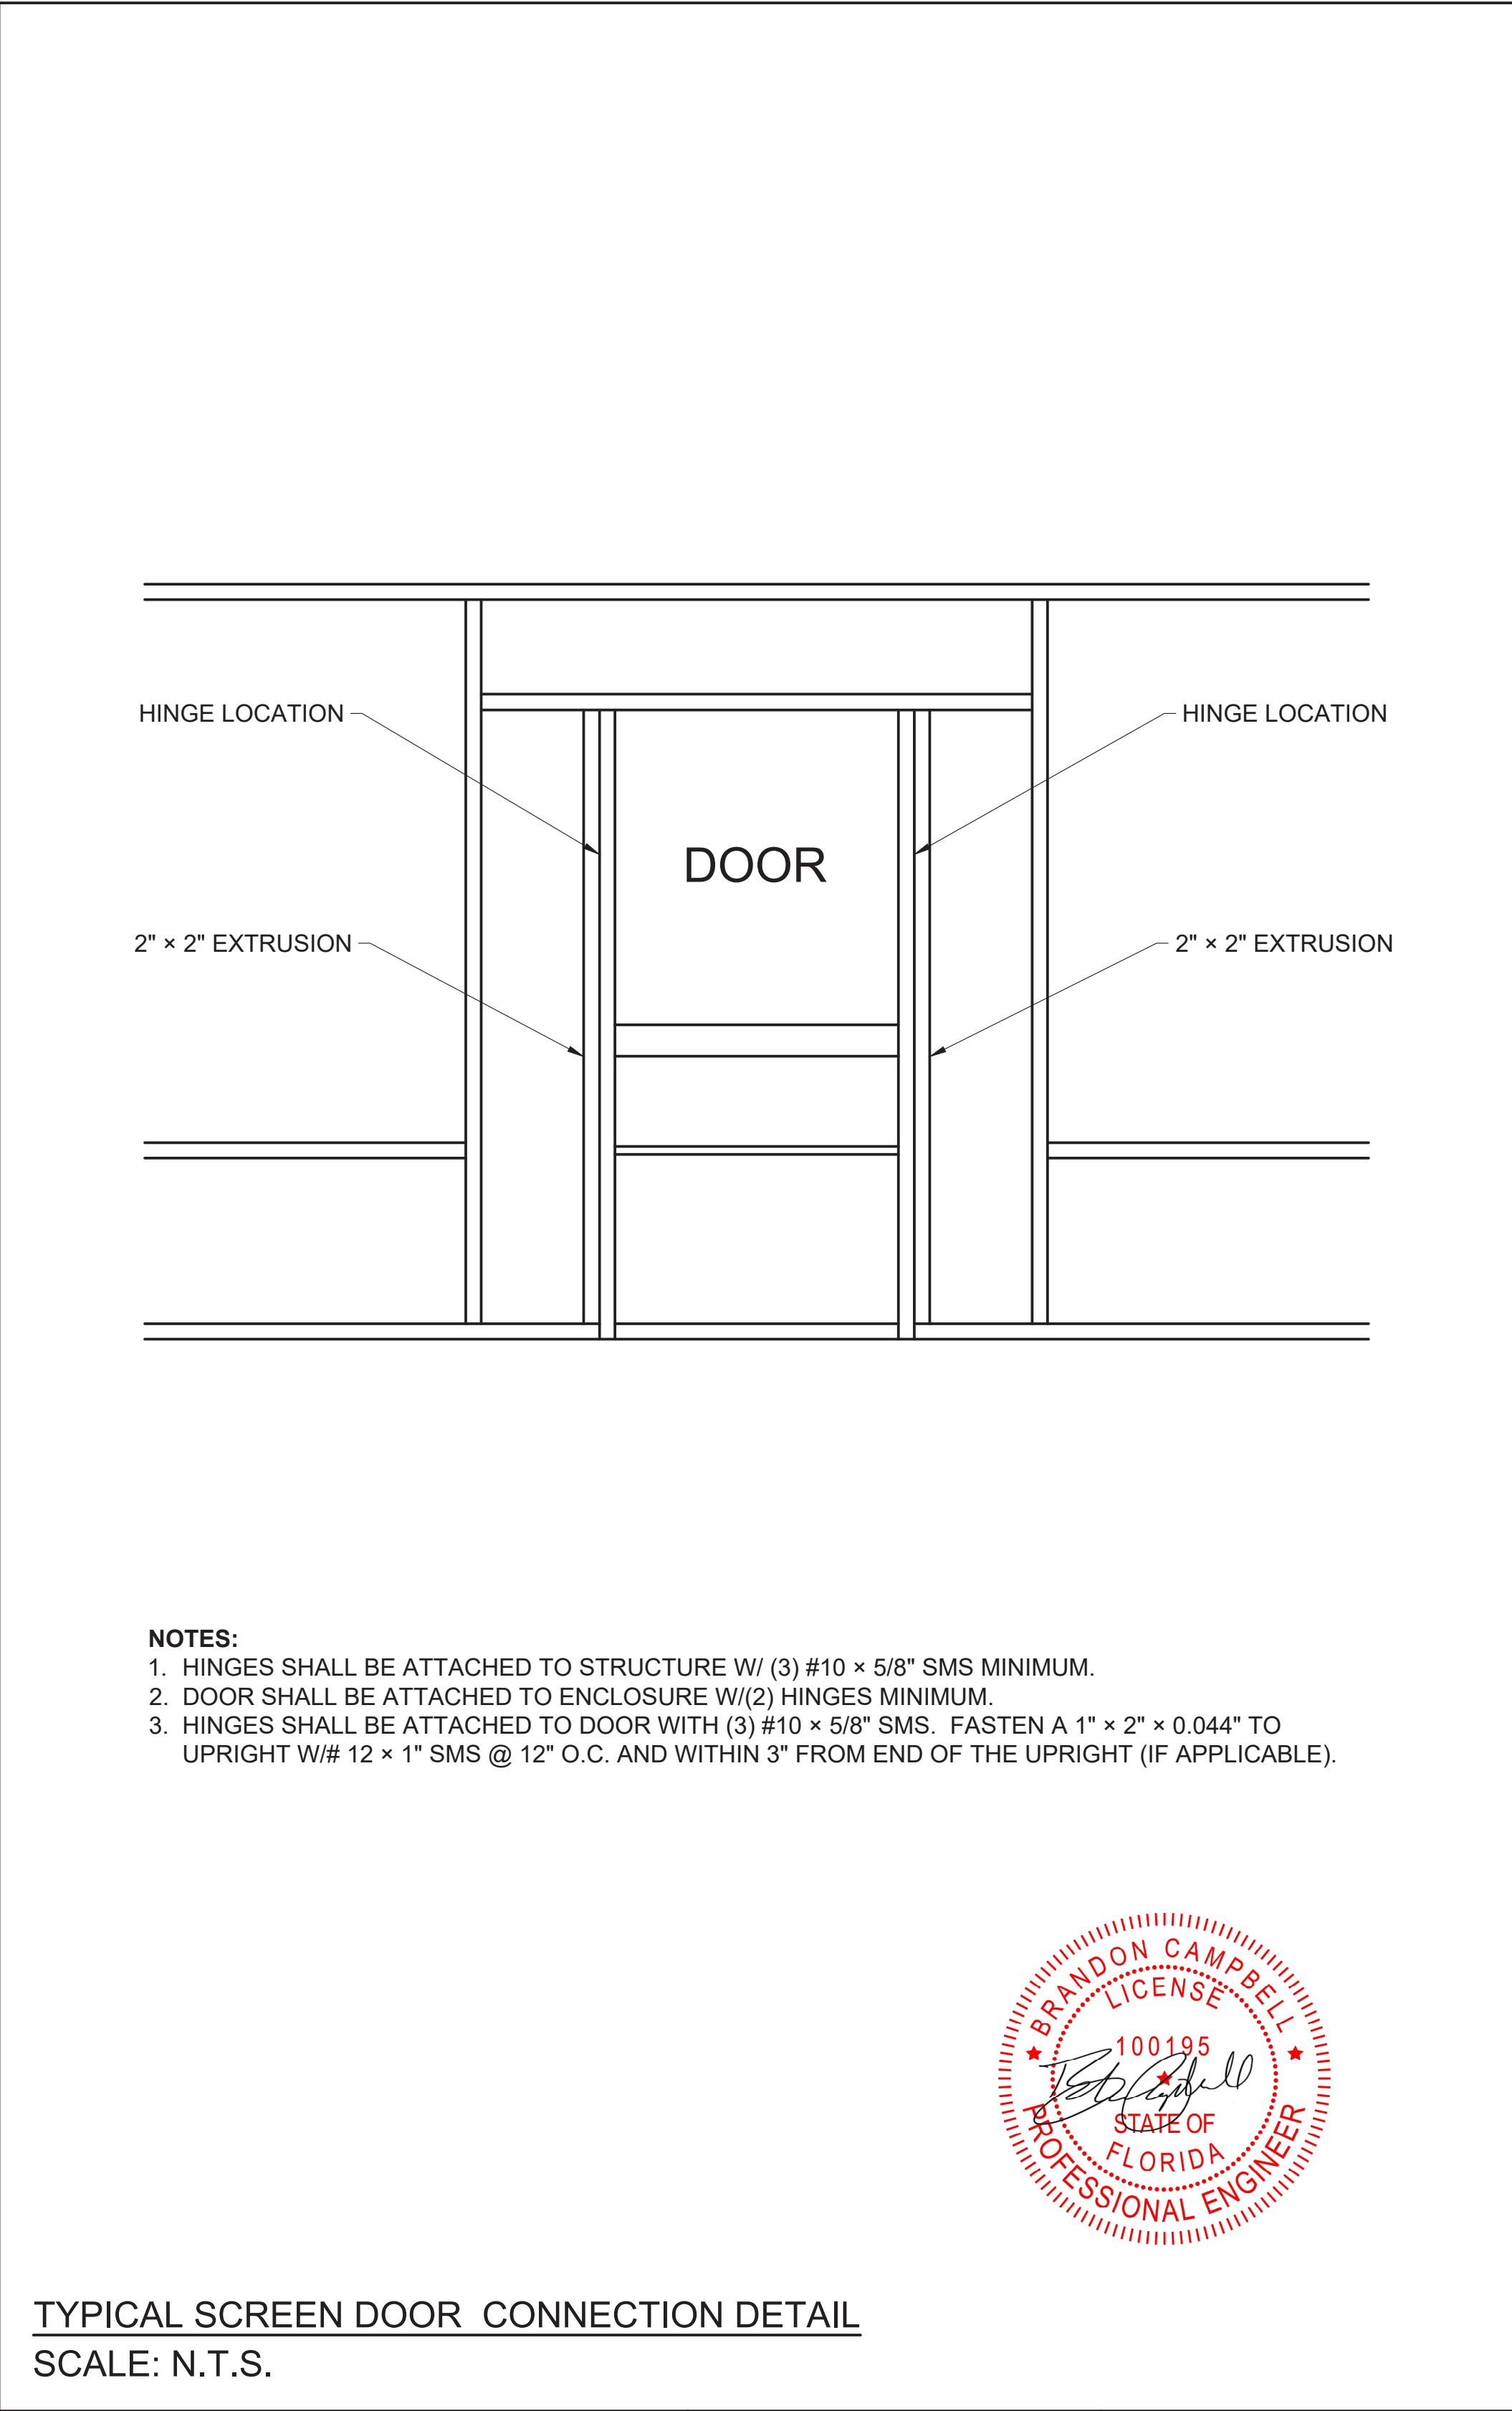

- NOTES:**
1. HINGES SHALL BE ATTACHED TO STRUCTURE W/ (3) #10 x 5/8" SMS MINIMUM.
 2. DOOR SHALL BE ATTACHED TO ENCLOSURE W/(2) HINGES MINIMUM.
 3. HINGES SHALL BE ATTACHED TO DOOR WITH (3) #10 x 5/8" SMS. FASTEN A 1" x 2" x 0.044" TO UPRIGHT W/# 12 x 1" SMS @ 12" O.C. AND WITHIN 3" FROM END OF THE UPRIGHT (IF APPLICABLE).

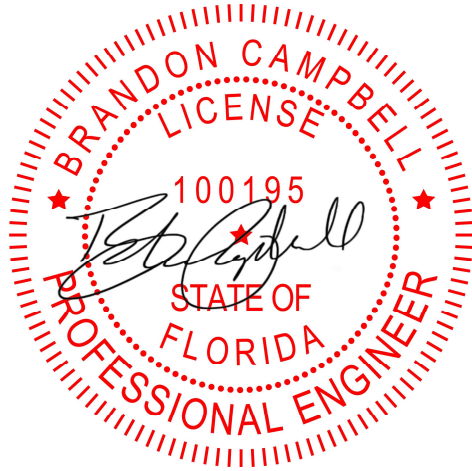

TYPICAL SCREEN DOOR CONNECTION DETAIL
SCALE: N.T.S.

1	INITIAL DESIGN	JDGV	AL	BC	5/19/2026
REV	DESCRIPTION	DRAWN	REVIEWED	APPR.	DATE

NOTICE:

THE DATA IN THIS DOCUMENT INCORPORATES PROPRIETARY RIGHTS OF ACTIVE DESIGNS LLC. ANY PARTY ACCEPTING THIS DOCUMENT DOES SO IN CONFIDENCE AND AGREES THAT IT SHALL NOT BE DUPLICATED IN WHOLE OR PART, NOR DISCLOSED TO OTHERS WITHOUT THE CONSENT OF ACTIVE DESIGNS LLC.

CONTRACTOR SHALL VERIFY ALL CONDITIONS ON JOB SITE & NOTIFY ENGINEER OF RECORD OF ANY VARIATIONS FROM DIMENSIONS SHOWN ON THESE DRAWINGS BEFORE PROCEEDING WITH ANY CONSTRUCTION.



Active Design LLC
info@activedesigneng.com
(310) 963-4514

DATE: 5/19/2026	SHEET: 7
DRAWING TITLE: DETAILS CONT.	
PROJECT NAME: HARBOUR, PRISCILLA	