


Test-procedure comparison for the biomarker x treatment interaction

OL+BDC, Architecture A; null reps=2000, power reps=1000

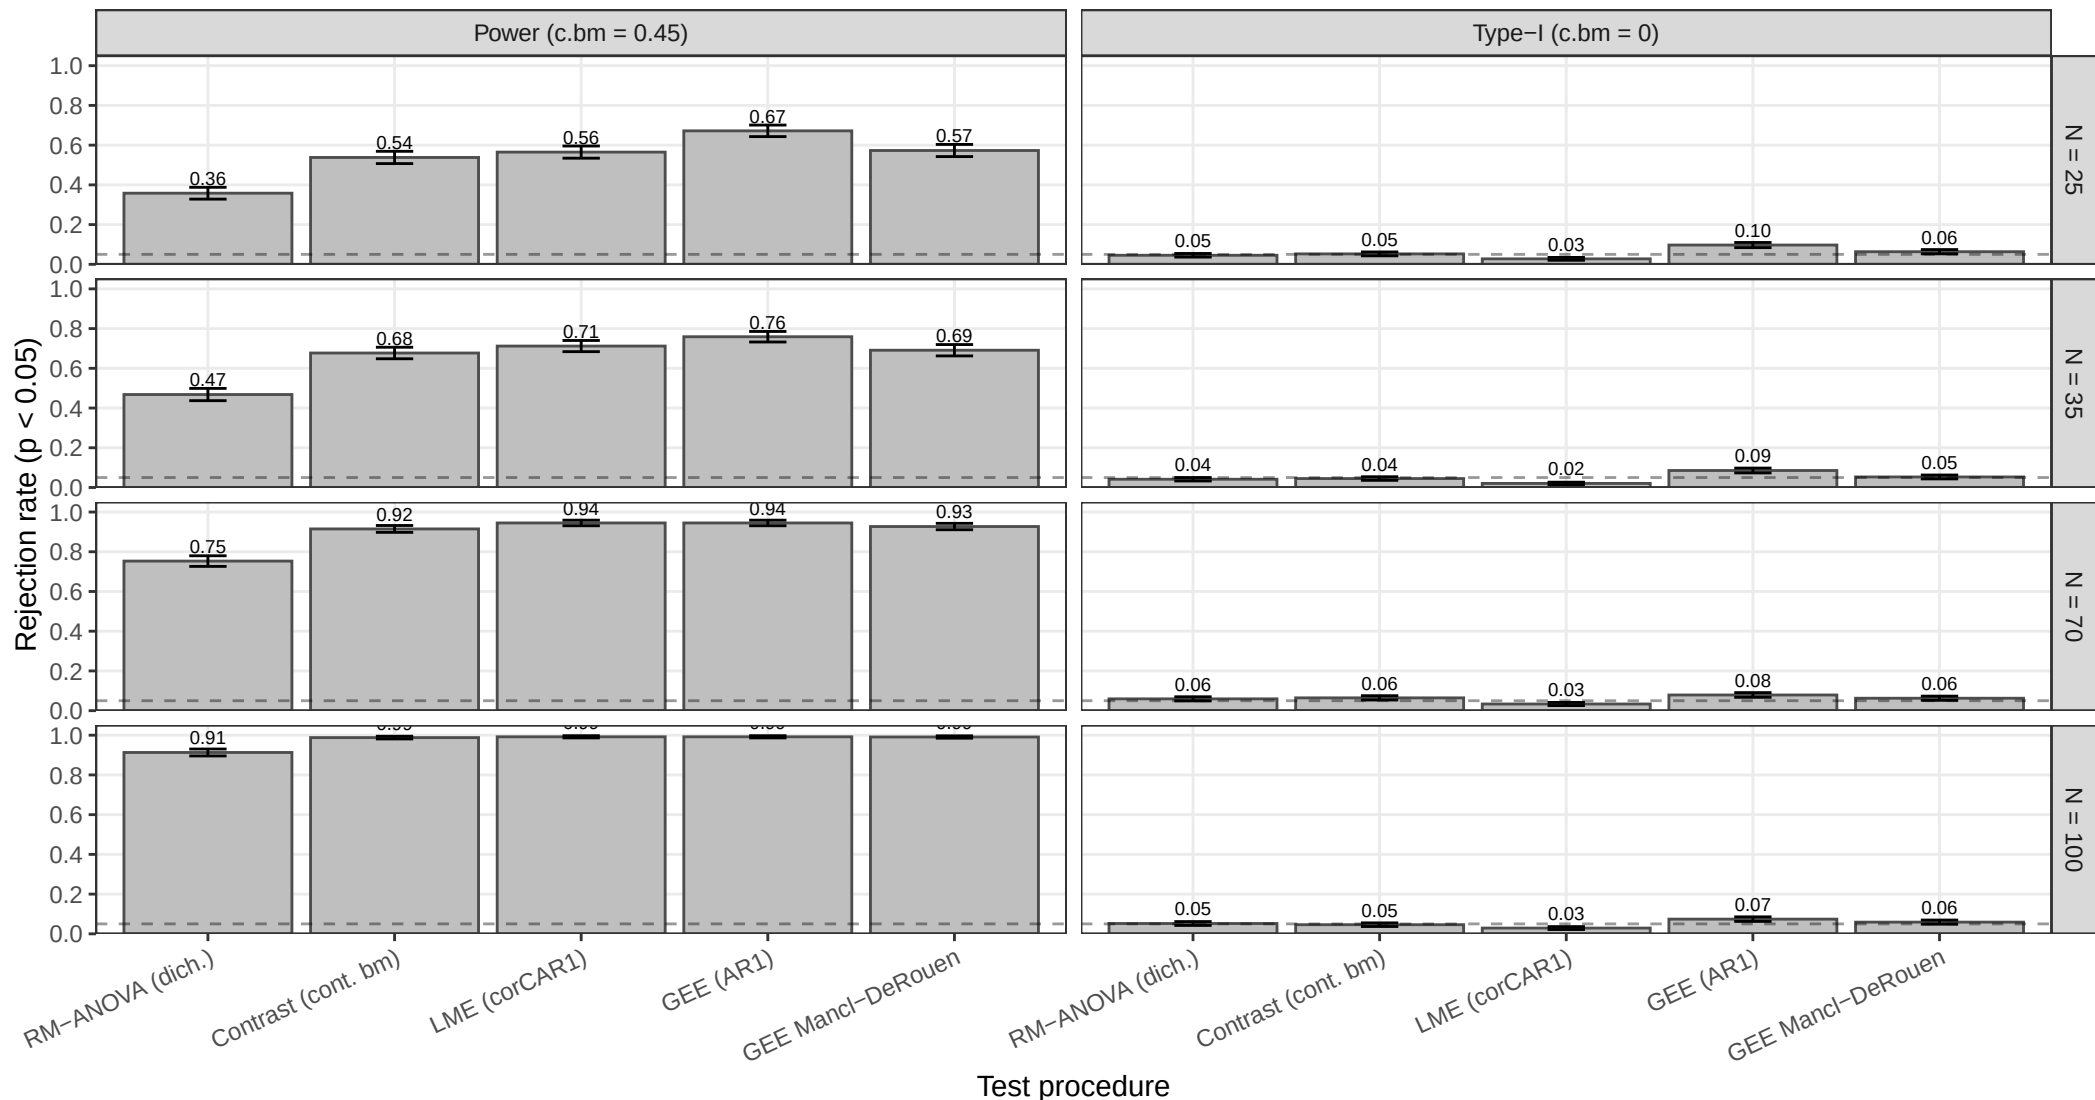

Error bars: 1.96 x MCSE (binomial); dashed line at 0.05.