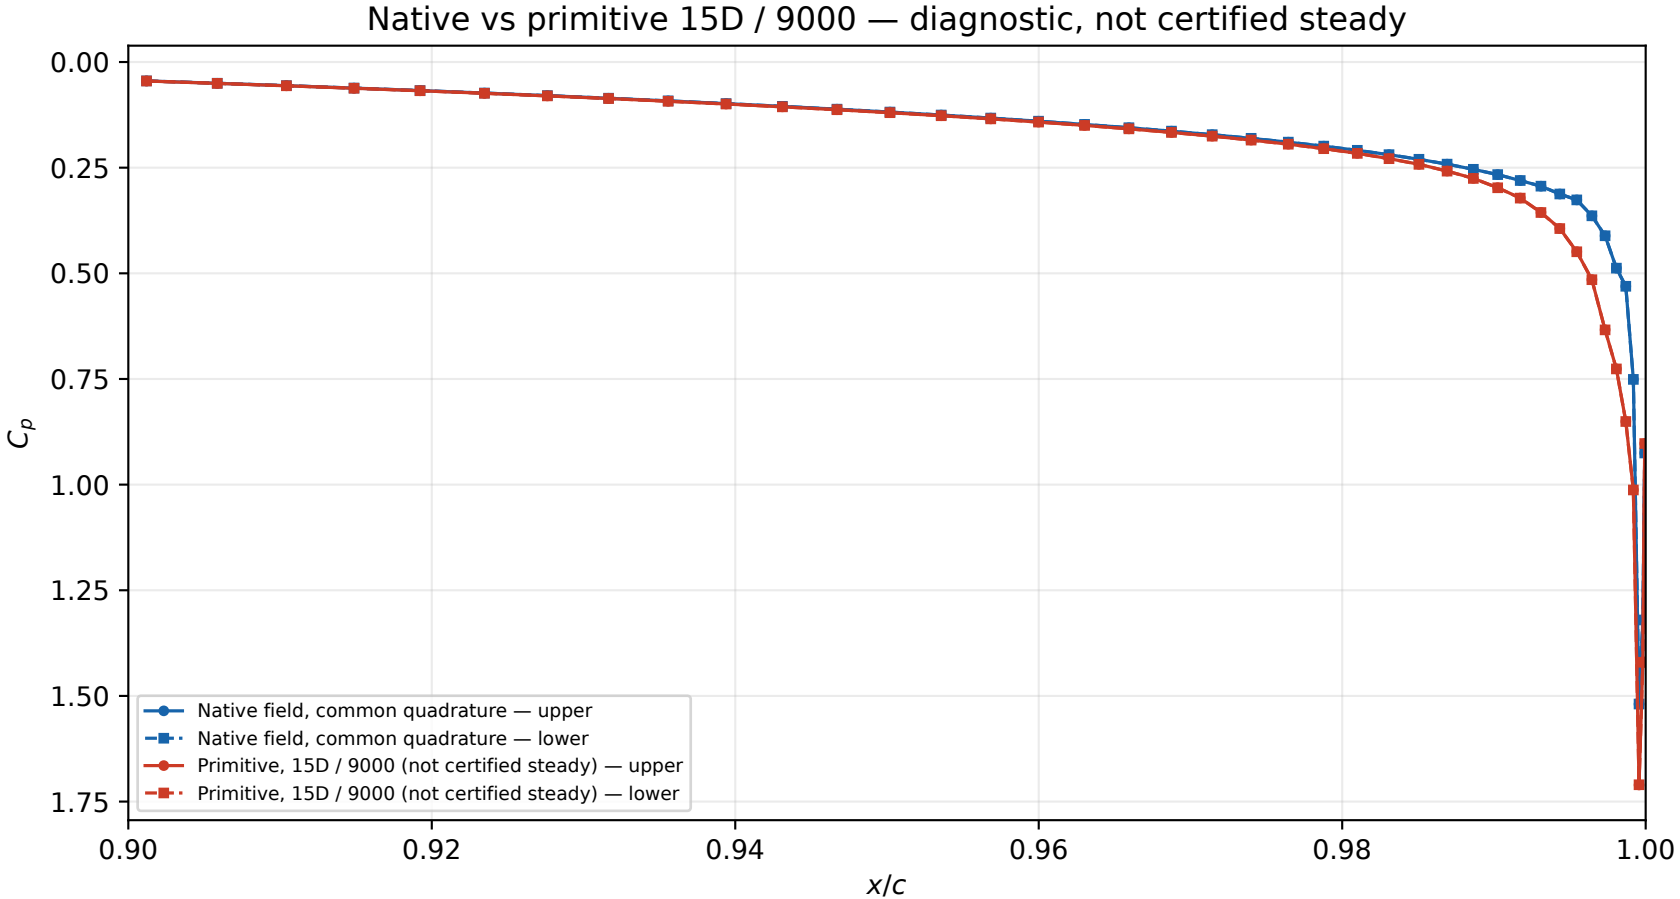
Native vs primitive 15D / 9000 — diagnostic, not certified steady
0.00
0.25
0.50
0.75
1.00
1.25
1.50
1.75
C_p
0.90
0.92
0.94
0.96
0.98
1.00
x/c
Native field, common quadrature — upper
Native field, common quadrature — lower
Primitive, 15D / 9000 (not certified steady) — upper
Primitive, 15D / 9000 (not certified steady) — lower