

BUILDING CODE DATA

APPLICABLE CODES FOR THIS BUILDING ARE THE 2000 INTERNATIONAL BUILDING CODE WITH NC AMENDMENTS, 2000 INTERNATIONAL PLUMBING CODE WITH NC AMENDMENTS, 2000 INTERNATIONAL MECHANICAL CODE WITH NC AMENDMENTS, 2005 NATIONAL ELECTRIC CODE, NC ACCESSIBILITY CODE, AND THE 2000 INTERNATIONAL FIRE CODE WITH NC AMENDMENTS.

PROJECT **RENOVATIONS FOR SUITES 401 & 310**
ADDRESS **1000 CORPORATE DRIVE**
USE **BUSINESS B**
OWNER REP **JOHN WILLIAMS 919 732 6811**

DESIGNER	NAME	LICENSE	TELEPHONE	FAX
Architectural	JOHN WILLIAMS	3357	919 732 6811	919 732 3027
Structural				
Plumbing				
HVAC				
Electrical	JOHN WILLIAMS	3357	919 732 6811	919 732 3027

Other
JOHN WILLIAMS EMAIL JCW@AIAEARTHLINK.NET

BUILDING DATA
Occupancy **BUSINESS B**
Mixed Occupancy **NO**
Construction Type **TYPE V-B**
Mixed Construction **NO**
Sprinklered **NO**
Fire District **NO**
Building Height **1 STORY 20 FEET**
Mezzanine **NO**
High Rise **NO**
Gross Building Area: Basement **NA**
First Floor **4400 SF**
Second Floor **NA**
Third Floor **NA**
TOTAL GROSS AREA **4400 SF**

Area Increase **NO**


FIRE RESISTANCE RATINGS
Party/Firewalls **NA**
Exterior Bearing Walls **0**
North
East
West
South
Exterior Non-Bearing Walls **NA**
North
East
West
South
Interior Walls
Bearing **0**
Non-Bearing **0**
Tenant Separation **EXISTING 1 HR. UL U 305**
Ceiling/Floor Assembly **NA**
Beams **0**
Columns **0**
Ceiling/Roof Assembly **0**
Vertical Shafts **0**
Chases-P.E.M. **0**
Mixed Occupancy Separation **NO**
Tenant Separation **EXISTING**

LIFE SAFETY SYSTEM
Emergency Light and Exit Sign **YES**
Fire Alarm and Smoke Detection Systems **NO**
Panic Hardware **NO**

EXIT REQUIREMENTS
Travel distance to exit-maximum condition **55 FT**
Number Exits: Total square footage of floor 4400 sf divided by net sf per occupancy_100 = **44** Total number of people on floor.
Number of doors provided **3** Number of doors required



DESIGN LOADS
Roof Live Load **20 PSF**
Wind **90 MPH**
Floor **80 PSF**
Snow **20 PSF**
Seismic

SOIL BEARING CAPACITIES
Field Test
Presumptive **2,500 PSF**

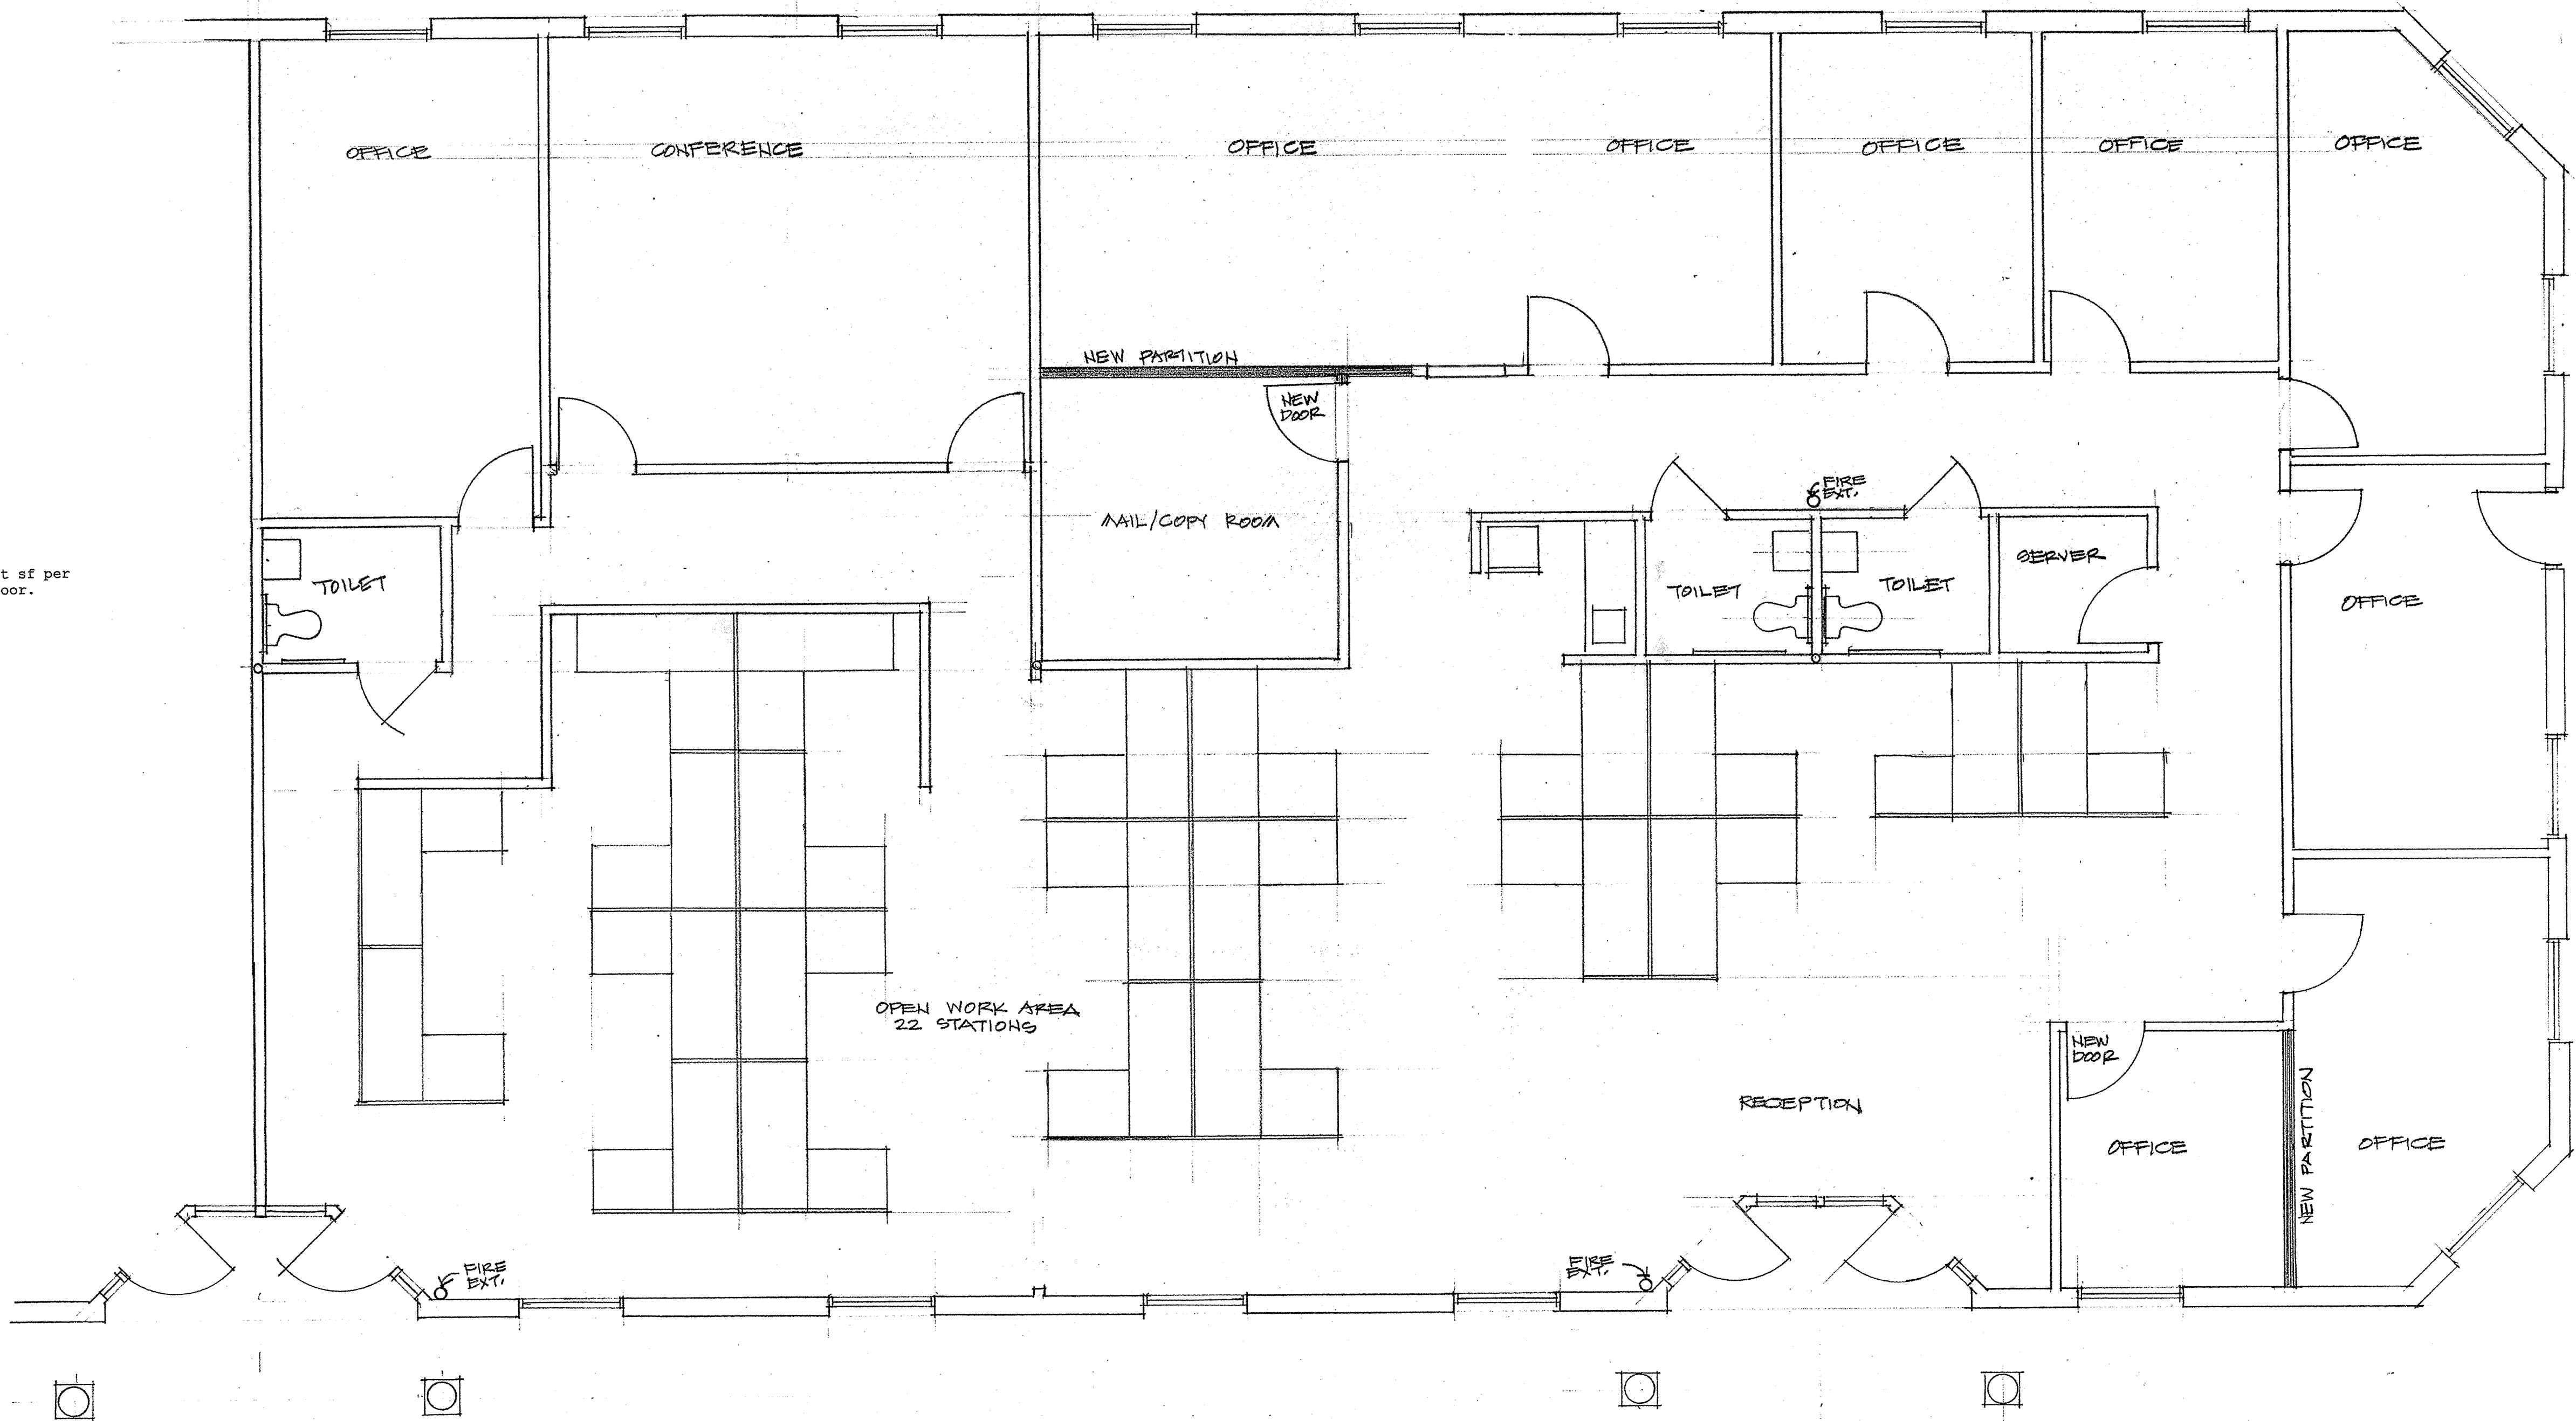

FLOOR PLAN SCALE: 1/4"=1'-0"

NOTES:
1. ALL ITEMS SHOWN ARE EXISTING EXCEPT NOTED AS NEW.
2. NEW PARTITIONS SHOWN TO BE DEMOUNTABLE TO MATCH EXISTING.
3. NEW DOORS NOTED TO BE 36" WIDE W/ LEVER DOOR HANDLES TO MATCH EXISTING AND COMPLY W/ SECTION 7.9 OF THE NC ACCESSIBILITY CODE.
4. REPAIR EXISTING FINISHES AS REQUIRED BY THIS WORK.
5. FIRE EXTINGUISHERS SHOWN ARE WALL MOUNTED, EXISTING, AND ARE MINIMUM 2A 10 BC AFD AT 36" AFF.

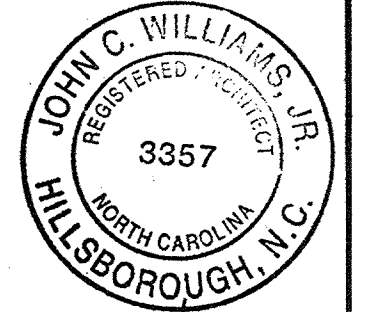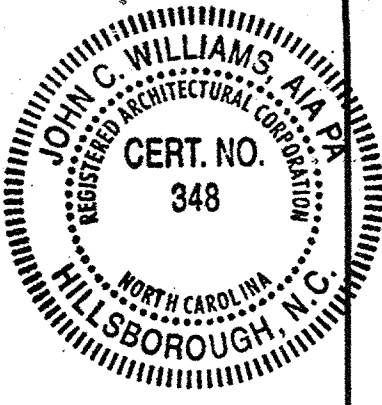

DATE
NOVEMBER 11, 2005
DECEMBER 10, 2005

John C. Williams, AIA, PA
Architect
PO Box 1018
Hillsborough, NC 27278
919 732 6811

PROJECT
RENOVATIONS FOR
SUITES 401 & 310
1000 CORPORATE DRIVE
THE MEADOWLANDS
HILLSBOROUGH, NC

FLOOR PLAN
CODE DATA

JOB NO.
0524

SHEET NO.

1