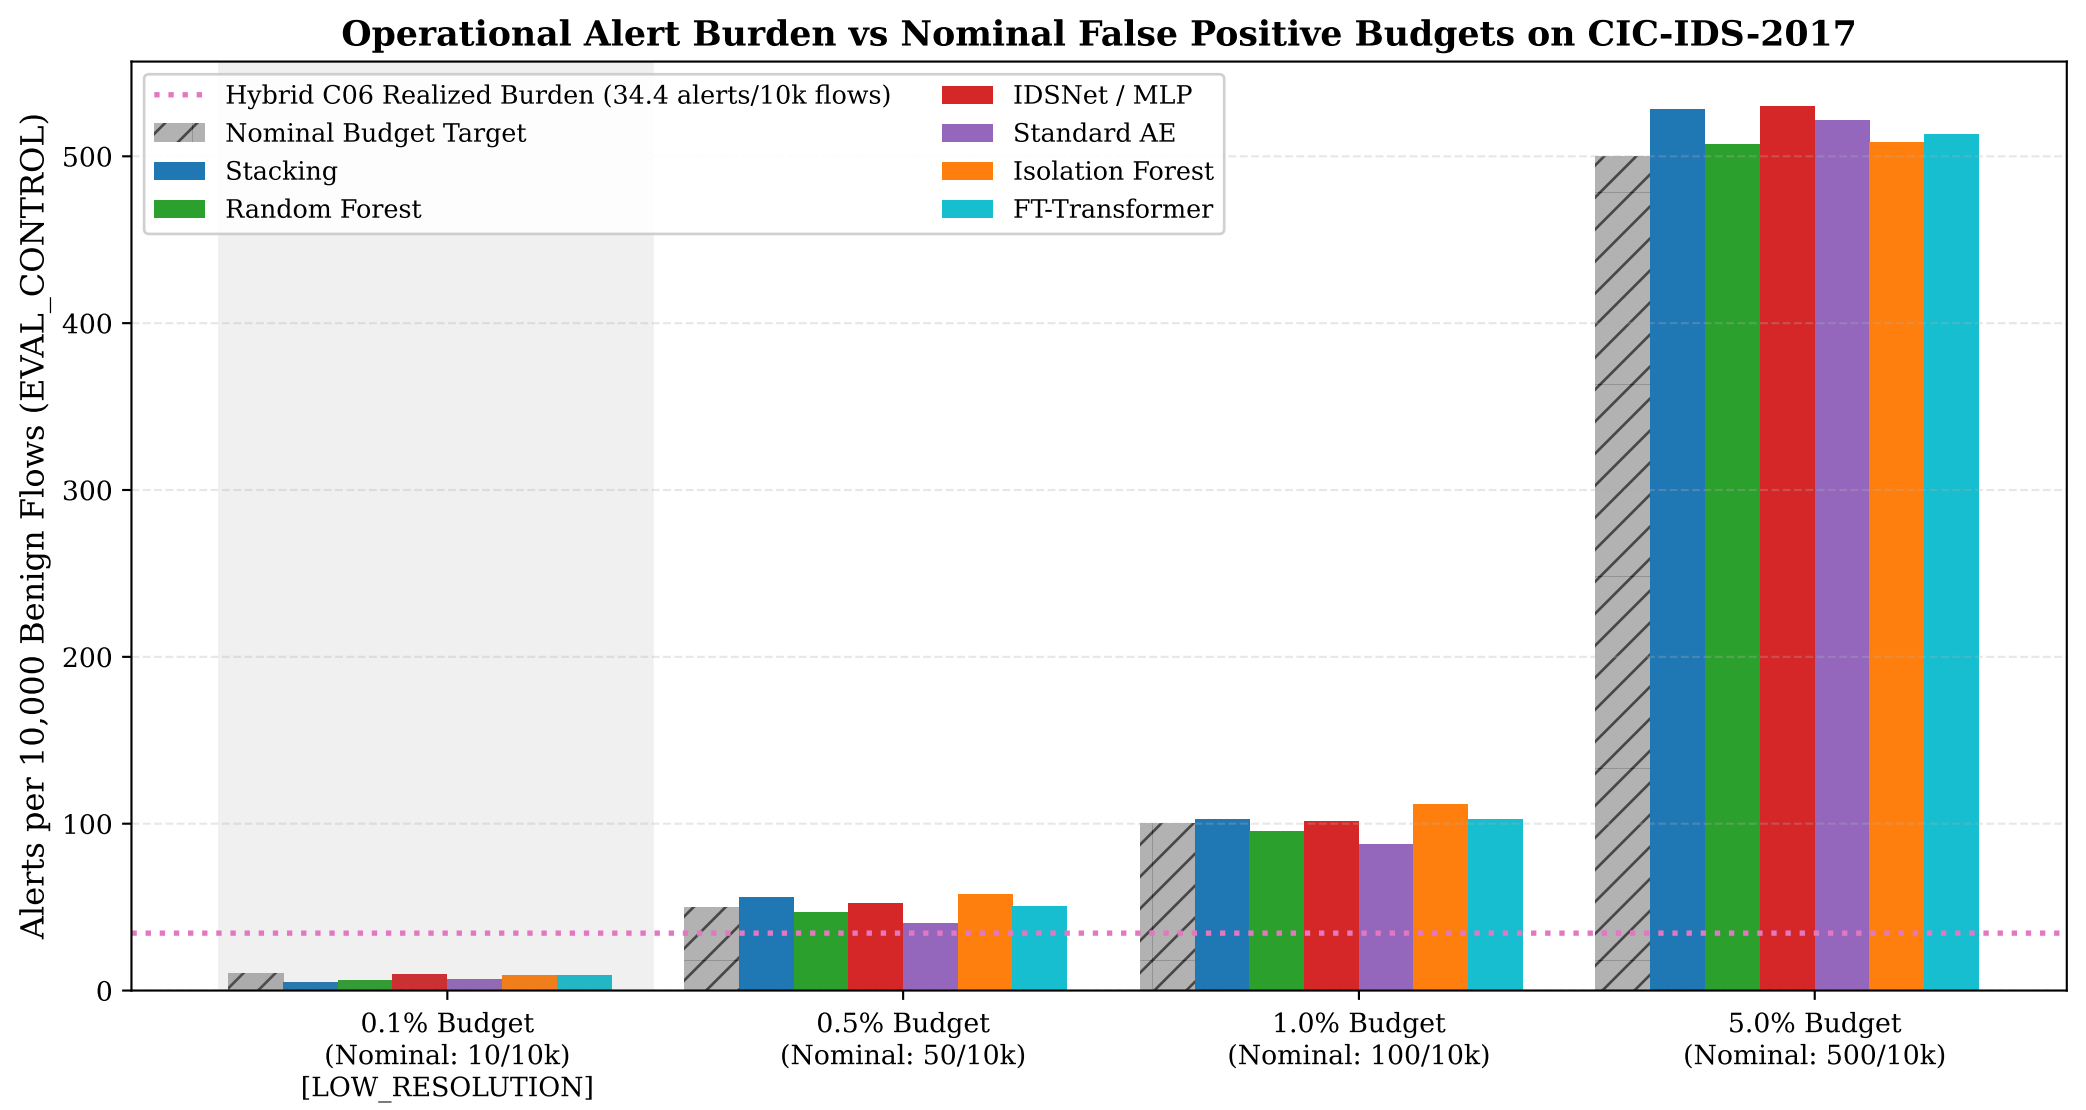

*Nominal alert rate matches alpha * 10,000. Realized control alert rate closely matches nominal targets across all models.*
Low-resolution warning applies to 0.1% budget (18.5 expected false alarms on N=18,500 control flows < 20 alarm minimum threshold).