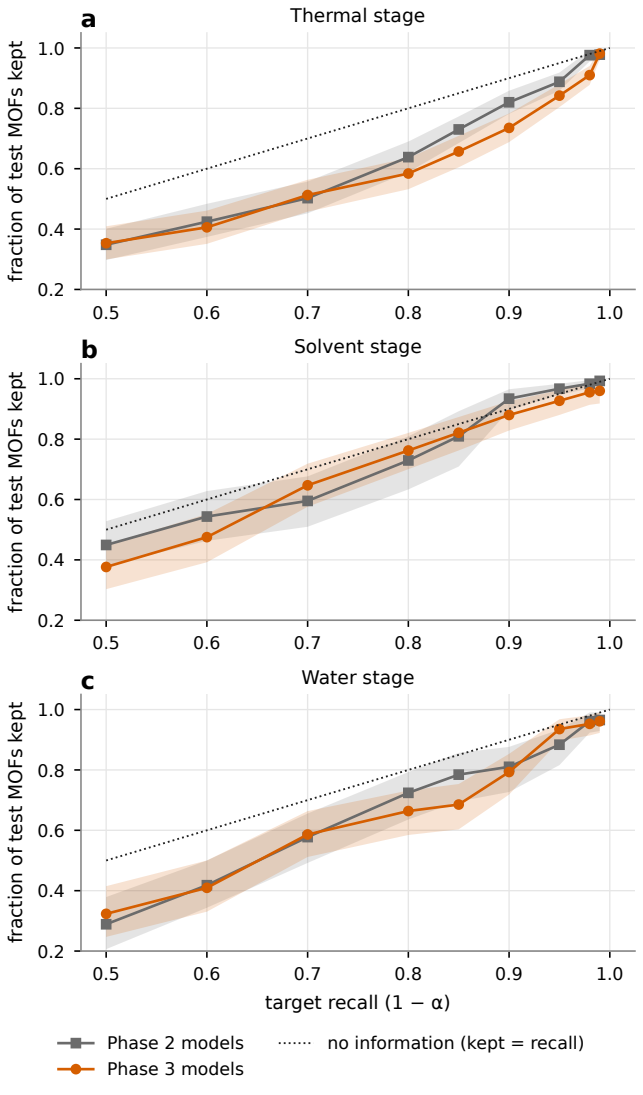
a
Thermal stage
b
Solvent stage
c
Water stage
fraction of test MOFs kept
target recall (1 − α)
0.2
0.4
0.6
0.8
1.0
0.5
0.6
0.7
0.8
0.9
1.0
Phase 2 models
Phase 3 models
no information (kept = recall)