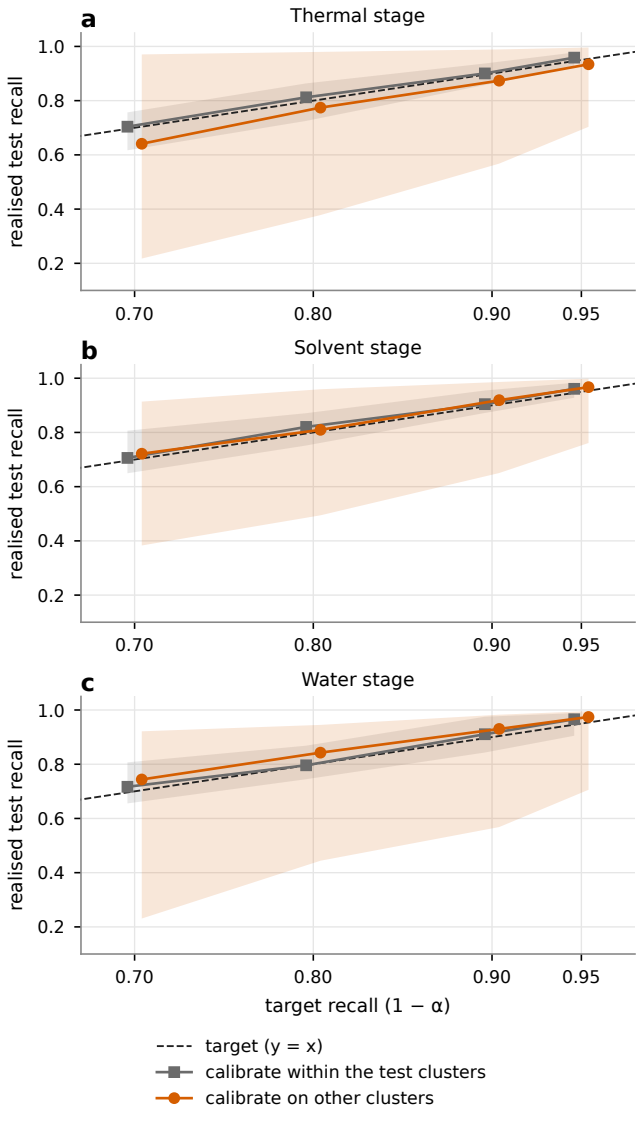
a
Thermal stage
b
Solvent stage
c
Water stage
realised test recall
1.0
0.8
0.6
0.4
0.2
0.70
0.80
0.90
0.95
target recall (1 − α)
target (y = x)
calibrate within the test clusters
calibrate on other clusters