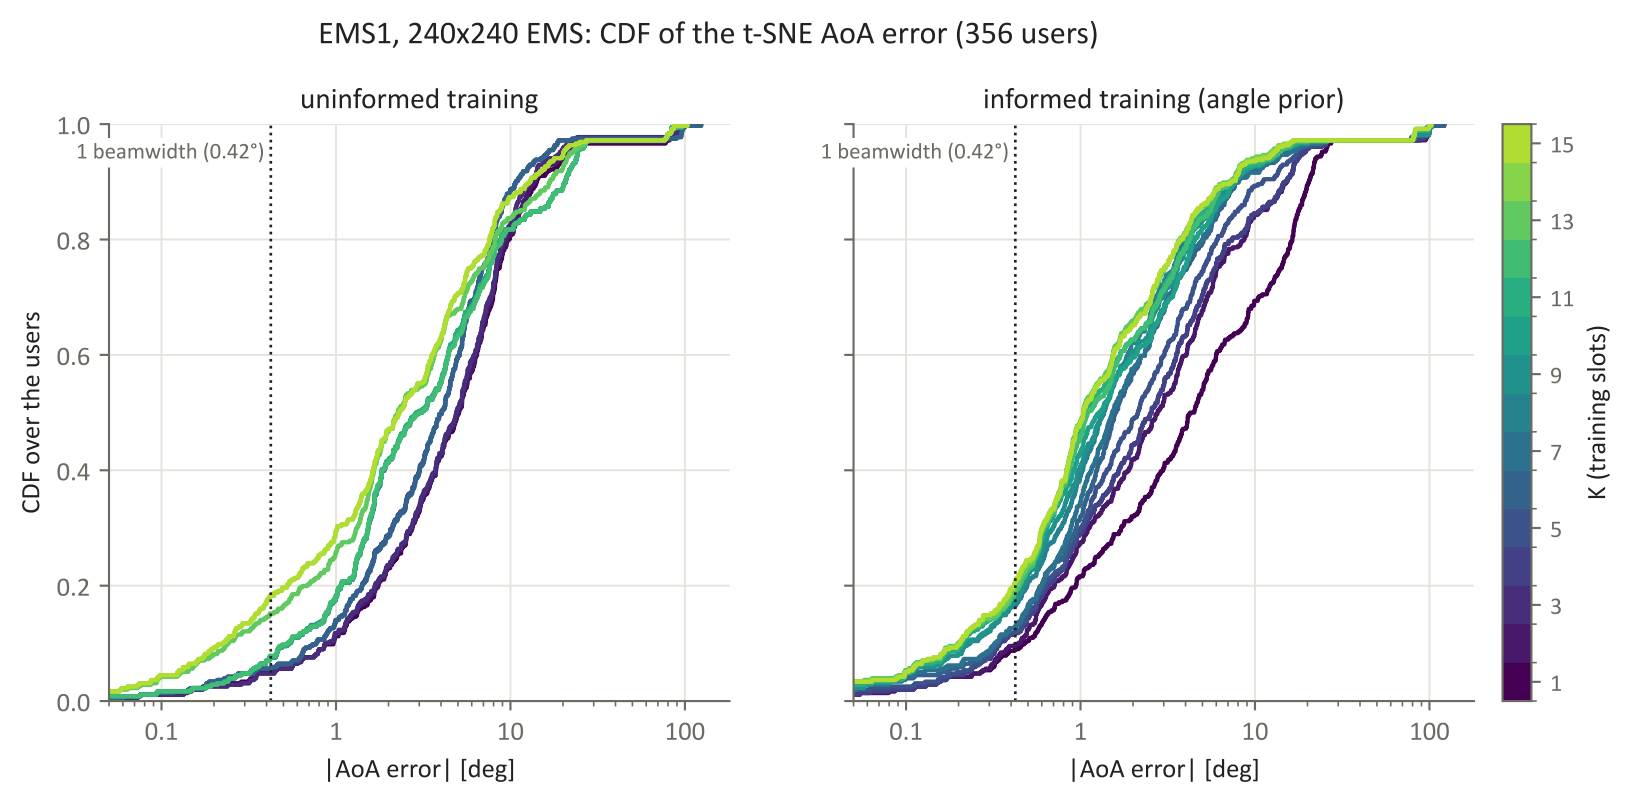

EMS1, 240x240 EMS: CDF of the t-SNE AoA error (356 users)
uninformed training
informed training (angle prior)
1 beamwidth (0.42°)
1 beamwidth (0.42°)
CDF over the users
1.0
0.8
0.6
0.4
0.2
0.0
0.1
1
10
100
|AoA error| [deg]
|AoA error| [deg]
K (training slots)
15
13
11
9
7
5
3
1