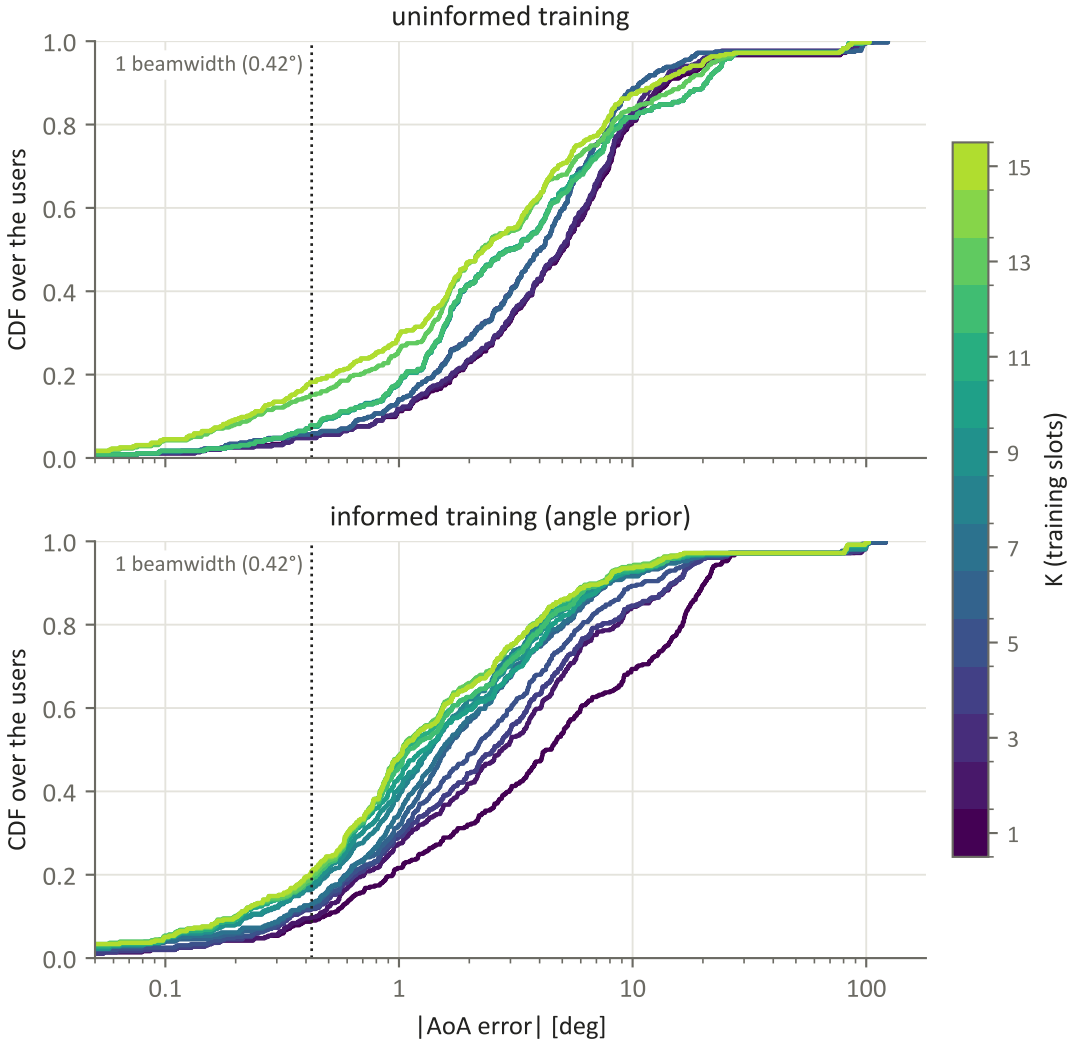

EMS1, 240x240 EMS: CDF of the t-SNE AoA error (356 users)
uninformed training
informed training (angle prior)
1 beamwidth (0.42°)
CDF over the users
0.0
0.2
0.4
0.6
0.8
1.0
0.1
1
10
100
|AoA error| [deg]
K (training slots)
1
3
5
7
9
11
13
15