



Change setPoint 200ms

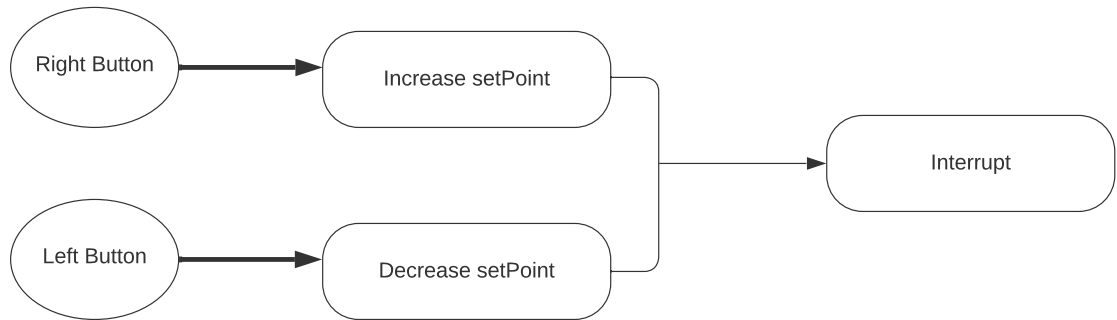

LED/Heat State 500ms

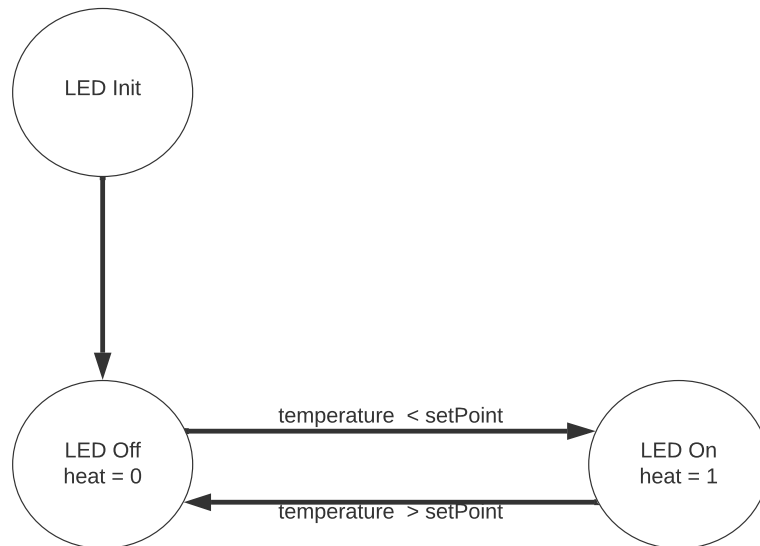

Display to Terminal 1000ms

output temperature, setpoint, heat, seconds