



Fresh selector validation at period 0.48 s

Combined measurements from two separately trained low-level controllers

Trot

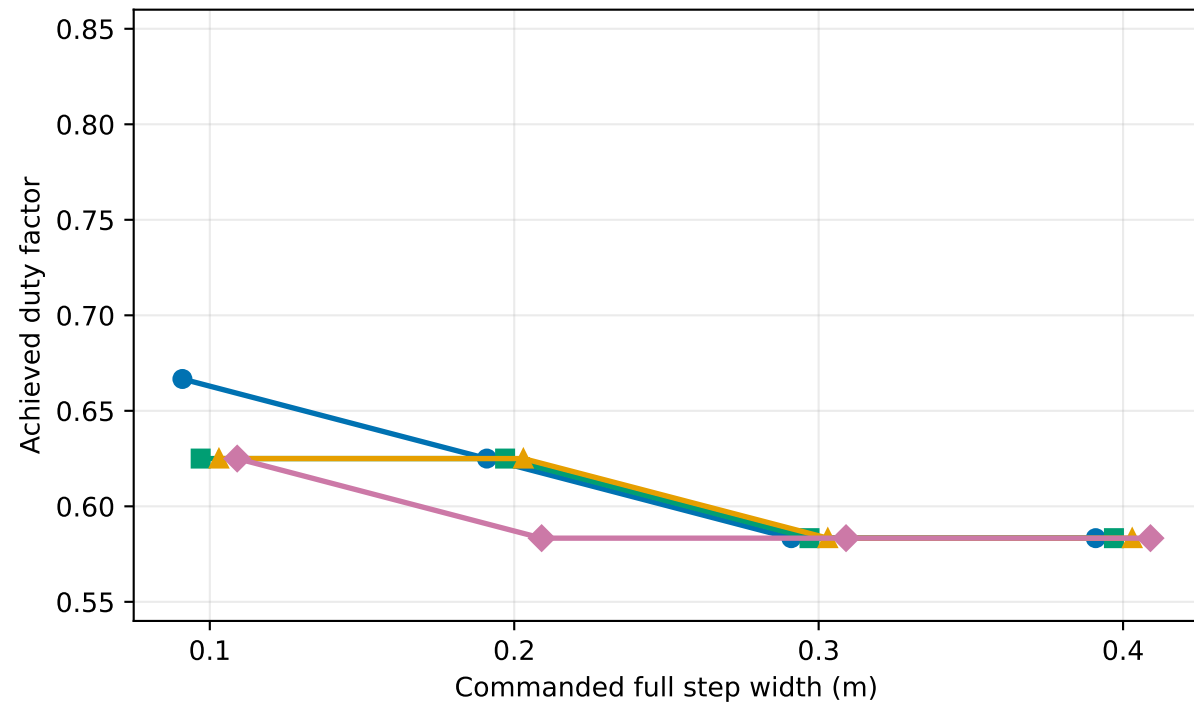

Walk

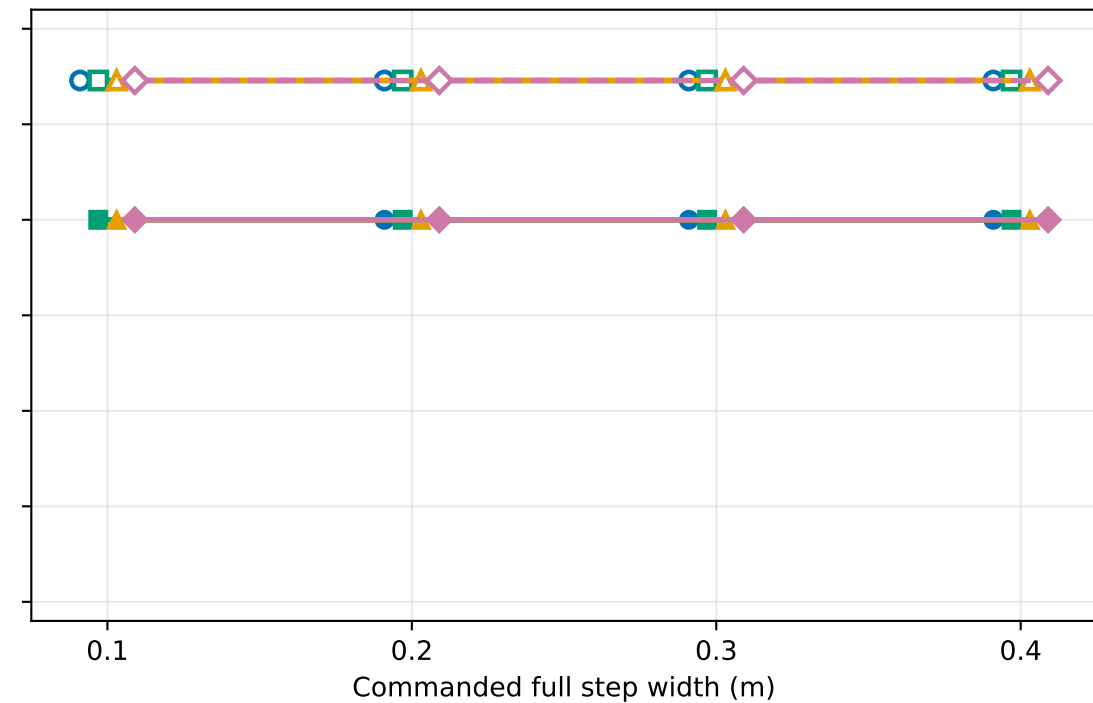

● 0.25 m/s ■ 0.30 m/s ▲ 0.35 m/s ◆ 0.40 m/s