


The output an operator sees

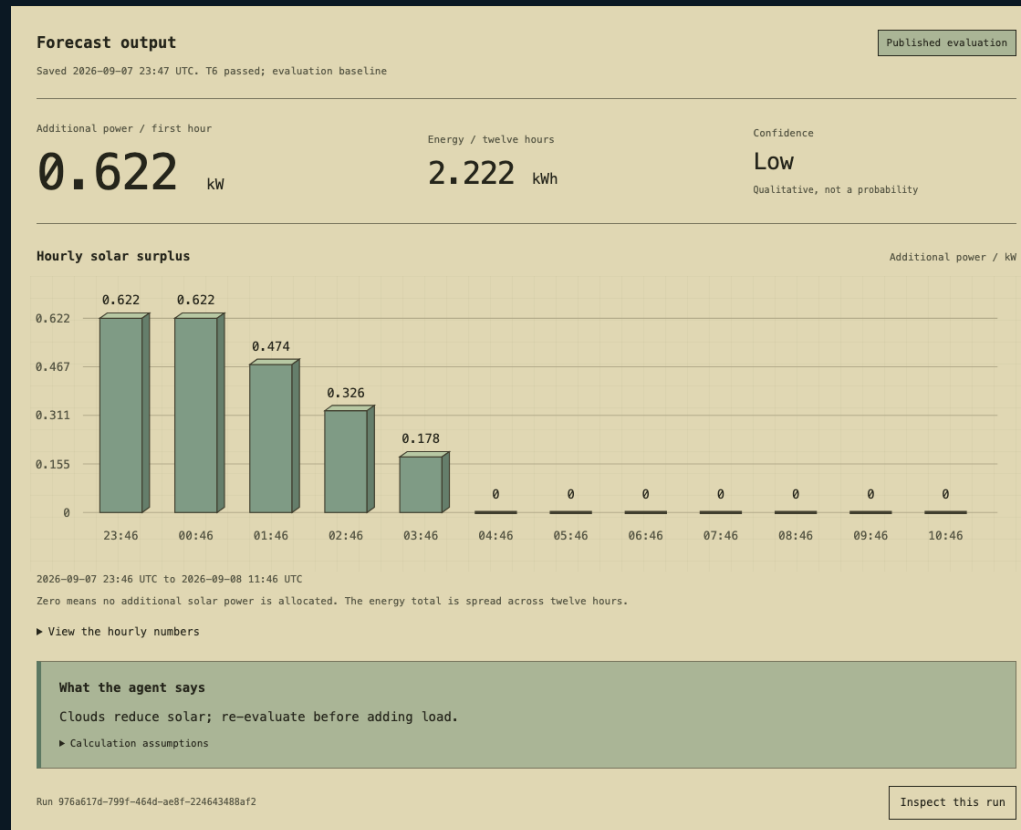

0.622 kW

Additional power in the first hour

2.222 kWh

Energy across twelve hours

Low confidence

What it does


Turns source readings into an hourly power profile.

Why it matters

Makes the result easy to review.

How to read the twelve-hour profile

Additional power (kW)

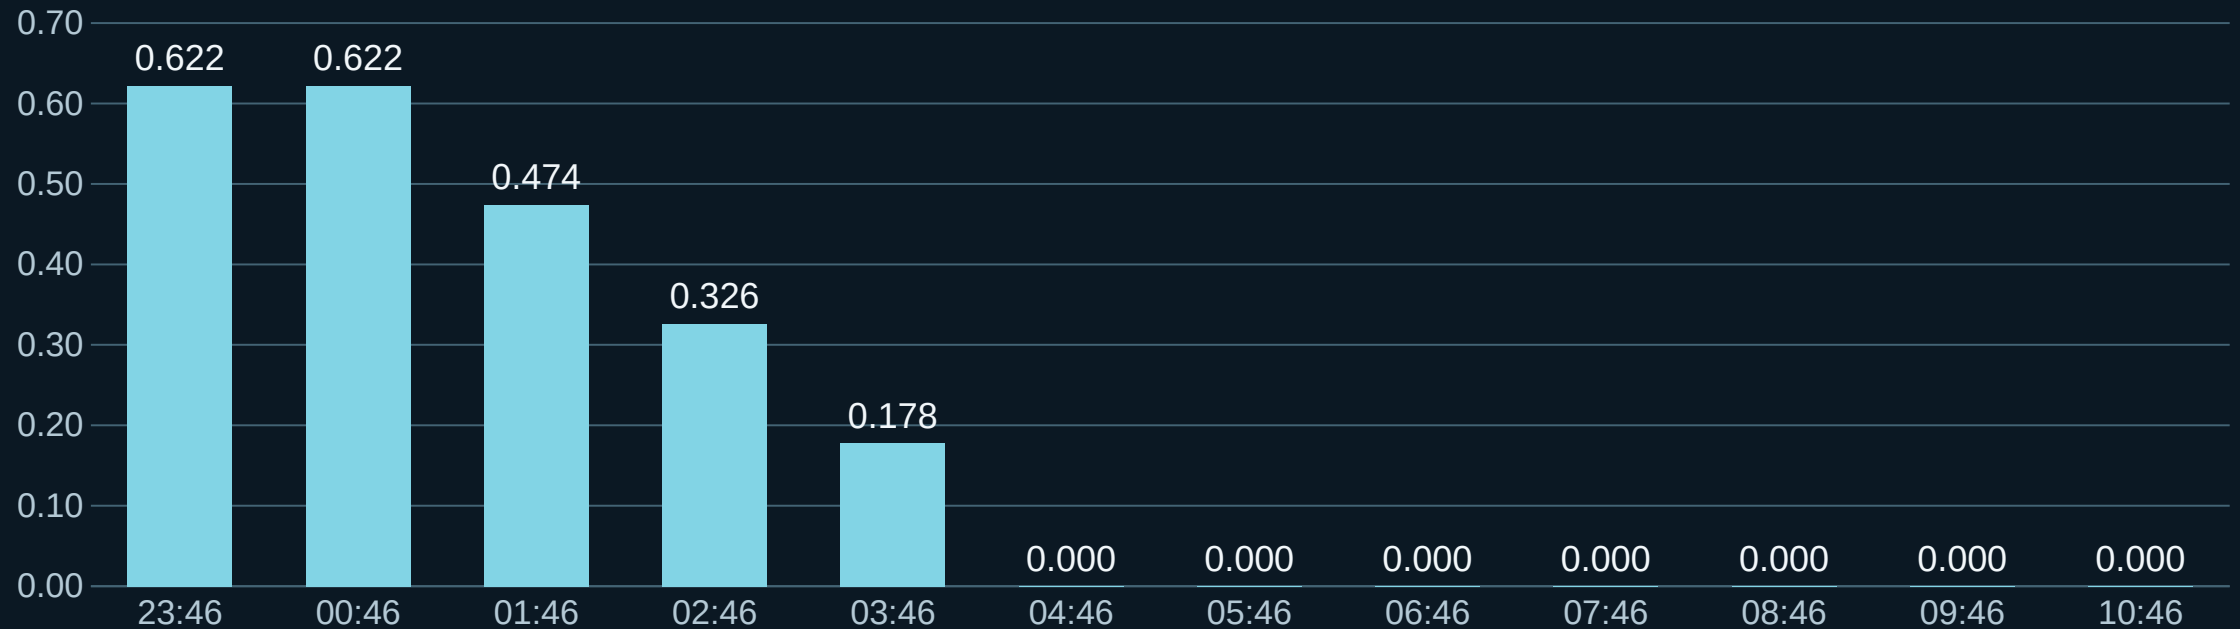

2026-09-07 23:46 to 2026-09-08 11:46 UTC

2.222 kWh in total

Zero means no additional solar allocation.
The total is spread across the forecast.

Guidance, evidence and human review

Recorded model guidance

Clouds reduce solar; re-evaluate before adding load.

What supports the result

1.48 kW measured solar
0.858 kW measured load
392.9 V battery / 305.2 V floor

What still needs judgment

Synthetic weather and constant demand
No battery discharge or equipment commands
Forecast accuracy remains unproven

Inspect this run

Saved details share one episode. Health checks the current service.