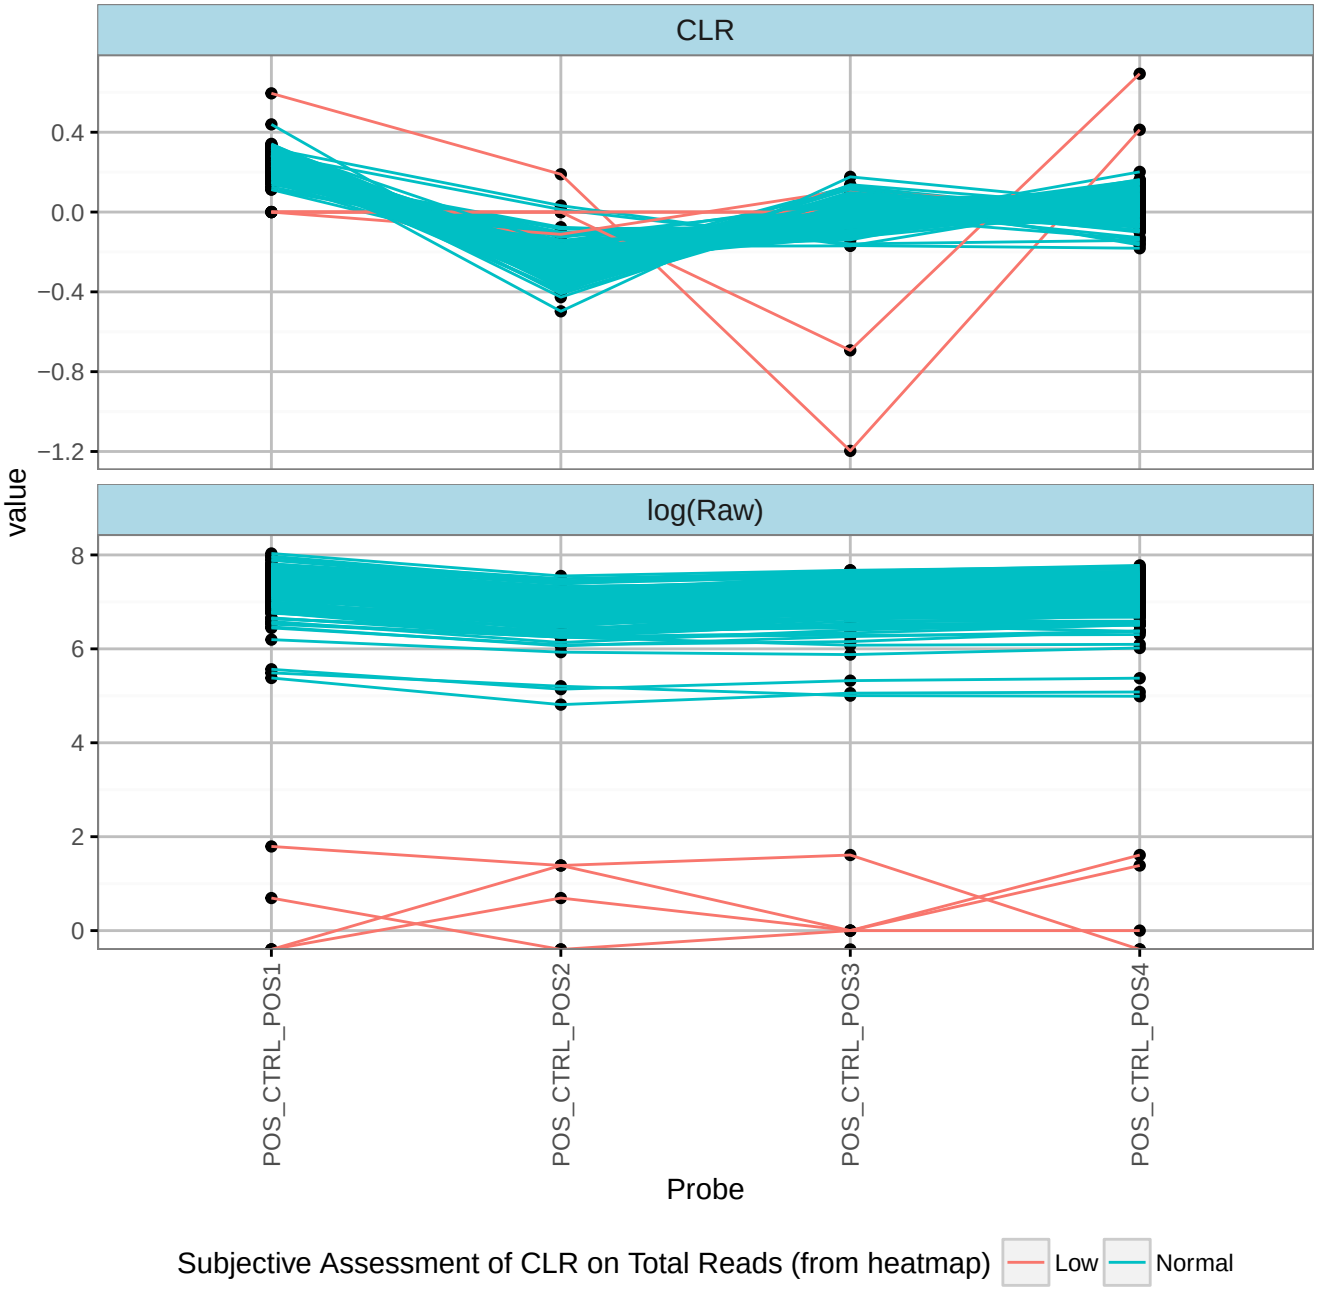
CLR
log(Raw)
value
0.4
0.0
−0.4
−0.8
−1.2
8
6
4
2
0
POS_CTRL_POS1
POS_CTRL_POS2
POS_CTRL_POS3
POS_CTRL_POS4
Probe
Subjective Assessment of CLR on Total Reads (from heatmap)
Low
Normal