



सेंट्रल ट्रांसमिशन यूटिलिटी ऑफ इंडिया लिमिटेड

(पावर ग्रिड कॉर्पोरेशन ऑफ इंडिया लिमिटेड के स्वामित्व में)

(भारत सरकार का उद्यम)

CENTRAL TRANSMISSION UTILITY OF INDIA LTD.

(A wholly owned subsidiary of Power Grid Corporation of India Limited)

(A Government of India Enterprise)

Ref: CTU/N/00/CMETS_NR/42

Date: 28-11-2025

As per distribution list

Subject: 42nd Consultation Meeting for Evolving Transmission Schemes in Northern Region-Minutes of Meeting

Dear Sir/Ma'am,

Please find enclosed the minutes of the 42nd Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 11th November 2025 (Tuesday) through virtual mode.

The minutes are also available at CTU website (www.ctuil.in)

Thanking you,

Yours faithfully,

Handwritten signature and date: 28/11/2025

(R V M M Rao)

Chief General Manager

पंजीकृत पता: "सौदामिनी", पहली तल, प्लॉट सं. 2, सेक्टर-29, गुरुग्राम-122001 (हरियाणा), सीआई एन: U40100HR2020GOI091857
Registered Address: " Saudamini", 1st Floor, Plot No.2, Sector-29, Gurugram-122001, (Haryana), CIN: U40100HR2020GOI091857
Corporate Centre Address: Ircon International Tower, Tower no-1, Plot no -16, Sector-32, Gurugram-122003, (Haryana)
कॉर्पोरेट केंद्र का पता: इरकॉन इंटरनेशनल टॉवर, टॉवर नंबर-1, प्लॉट नंबर-16, सेक्टर-32, गुरुग्राम-122003, (हरियाणा)

Website: <https://www.ctuil.in>

Distribution List:

Chief Engineer (PSP&A – I) Central Electricity Authority Sewa Bhawan, R.K.Puram, New Delhi-110 066	Member Secretary Northern Regional Power Committee 18A, Shaheed Jeet Singh Sansanwal Marg, Katwaria Sarai, New Delhi – 110 016
Director (Power System) Solar Energy Corporation of India Ltd. D-3, 1 st Floor, A wing, Religare Building, District Centre, Saket, New Delhi-110017	Director Ministry of New and Renewable Energy, Block 14, CGO Complex, Lodhi Road, New Delhi-110003
Director (SO) Grid Controller of India Limited (erstwhile POSOCO) 9 th Floor, IFCI Towers, 61, Nehru Place, New Delhi-110 016	Executive Director Northern Regional Load Despatch Centre 18-A, Qutab Institutional Area, Shaheed Jeet Singh Sansanwal Marg, Katwaria Sarai, New Delhi– 110 016
Director (P & C) HPPTCL, Headoffice, Himfed Bhawan, Panjari, Shimla-171005 Himachal Pradesh	Director(W&P) UP Power Transmission Company Ltd. Shakti Bhawan Extn, 3rd floor, 14, Ashok Marg, Lucknow-226 001
Director (Technical) Punjab State Transmission Corporation Ltd. Head Office, The Mall, Patiala 147001, Punjab	Director (Projects) Power Transmission Corporation of Uttarakhand Ltd. Vidyut Bhawan, Near ISBT Crossing, Saharanpur Road, Majra, Dehradun.
Development Commissioner (Power) Power Development Department Grid Substation Complex, Janipur, Jammu	Director (Technical) Rajasthan Rajya Vidyut Prasaran Nigam Ltd. Vidyut Bhawan, Jaipur, Rajasthan-302005.
Member (Power) Bhakra Beas Management Board Sector-19 B, Madhya Marg, Chandigarh - 160019	Superintending Engineer (Operation) Electricity Circle, 5 th Floor, UT Secretariat, Sector-9 D, Chandigarh - 161009
Director (Operations) Delhi Transco Ltd. Shakti Sadan, Kotla Road, New Delhi-110 002	Director (Technical) Haryana Vidyut Prasaran Nigam Ltd. Shakti Bhawan, Sector-6, Panchkula-134109, Haryana

Distribution List:

Shri Pavan Kumar Gupta Authorised Signatory Juniper Green Cosmic Private Limited, Juniper Green Stellar Private Limited Plot No. 18, 1st Floor, Institutional Area, Sector 32, Gurugram Haryana-122001 Ph.: 9560540654, 9871644511 Email: pavan.gupta@junipergreenenergy.com ; bd@junipergreenenergy.com	Shri Arzaan Dordi Assistant Vice President Serentica Renewables India Private Limited 5th floor, RMZ infinity, Plot No 15, Udyog Vihar Phase IV, Gurugram, Haryana - 122015 Ph.: 7428197178, 9871514760 Email: arzaan.dordi1@serenticaglobal.com ; suriya.ansari@serenticaglobal.com
Smt Rasika Balchandra Ghongade Asst Business Developer Enren-I Energy Private Limited Luceo Solar Private Limited Khaba Renewable Energy Private Limited Litsolaire Energy Private Limited 6th Floor, Tower-2, Fountainhead, Pheonix Marketcity, Viman Nagar, Pune 411014 Ph.: 8830868723, 9223349273 Email: rasika.ghongade@engie.com ; saurabh.gupta@engie.com ; sarang.patil@engie.com ;	Shri Sameer Mathur Business Head AM Green Energy Private Limited AM Green Energy Private Limited MyHome Twitza, 5th Floor, Plot No. 30/A, Survey No. 83/1 APIIC Knowledge, city of Rai Durg, Rangareddy district, Hyderabad, Telangana 500081, India Ph.: 9920324550, 9820848924 Email: approvals.amgepl@arcelormittal.com ajay.sunkari1@arcelormittal.com
Shri Yogesh Kumar Sanklecha Sr Vice President ACME Heergarh Powertech Private Limited, ACME Solar Holdings Limited Plot No.: 152 Sector 44, Gurugram-122002 (Haryana) India Ph.: 8744060601, 9911299514 Email: yogesh@acme.in ; apradhan@acme.in	Shri Dhir Singh Senior Manager Solarcraft Power India 17 Private Limited Solarcraft Power India 4 Private Limited 109, First Floor, Rishabh IPEX Mall, IP Extension, Patparganj, Delhi 110092, Ph: 9993846698, 9999885815 Email: dhir.singh@blupineenergy.com ; ashish.agarwal@blupineenergy.com ; sharad.gangwar@blupineenergy.com ;
Shri Angshuman Rudra General Manager Avaada Rjbikaner Private Limited C-11, Sector-65, Gautam Buddha Nagar, Noida, Uttar Pradesh Ph.: 7835004673, 9891063313 Email: angshuman.rudra@avaada.com ; shipra.arora@avaada.com ;	Shri Alok Kumar Nigam Director Vismaya Four Renewables Private Limited Vismaya Five Renewables Private Limited 613, 614A, 614B, 6th Floor, Magnum Global Park, Tower 2, Golf Course Extension Road, Sector 58, Gurugram-122011 Ph: 9717855521, 8800917799 Email: alok.nigam@upcrenewables.in vikram.malkotia@upcrenewables.in
Shri K A Vishwanath Assistant Vice President Altra Xergi Power Private Limited 8th Floor, DLF Phase 2, Jacaranda Marg, Sector 25, Gurugram- Email: pe1@o2power.in ; ka.vishwanath@o2power.in ;	Shri Shri V. Jayaraman CEO-Power Hindustan Zinc Limited Yashad Bhawan, Udaipur, Rajasthan Ph.: 9928140302, 9799782777 Email: v.jayaraman@vedanta.co.in ; vinod.jaroli@vedanta.co.in

Minutes of 42nd Consultation Meeting for Evolving Transmission Schemes in Northern Region held on 11.11.2025

It was informed that, the minutes of 41st CMETS NR meeting held on 10.10.2025 were circulated vide CTU letter dated 06.11.2025. No comments were received by CTUIL regarding the same. Accordingly, minutes of 41st CMETS NR meeting is confirmed as circulated. The 42nd CMETS NR meeting was held on 11.11.2025 in virtual mode. The list of participants is enclosed in **Annexure-I**.

In the meeting, it was informed that in view of the effectiveness of 3rd Amendment of Connectivity & GNA Regulations 2022, the transition process is to be carried out for all applicable entities. Accordingly, the fresh connectivity applications shall be processed only after the completion of transition process. Further, it was also informed that for the applications under 5.2 of GNA Regulations, where intimations were issued before the effectiveness of 3rd Amendment (on or before 09.09.2025), letter for submission of requisite Conn BGs was already issued on 06.11.2025.

In this meeting applications under 5.2 which were received before effectiveness of 3rd Amendment and not yet taken up in previous CMETS-NR meeting were discussed. Further, one application for grant of GNA_{RE} by HZL which was deferred in 41st CMETS NR meeting was also taken up for discussion & grant.

A. Applications for additional capacity under 5.2 received till 08.09.2025(before effectiveness of 3rd amendment)

It was highlighted that in line with the 3rd Amendment of GNA Regulation, all applicants whose application is in process or has been granted approval by the Nodal Agency under Regulation 5.2 of GNA Regulations, prior to the date of effectiveness of these amendments (on or before 08.09.2025) and where such additional capacity has not achieved COD, should comply with the requirements as per Reg. 37.10 (d) of 3rd amendment of GNA regulations 2022 as given below:

“The entity which has already made an application and whose application is in process or has been granted approval by the Nodal Agency under Regulation 5.2 of these Regulations, prior to the date of effectiveness of these amendments, and where such additional capacity has not achieved COD, shall comply with the following:

- (i) The entity shall furnish the scheduled date of commercial operation for such additional capacity, within a period of one month from the date of effectiveness of these regulations:
Provided that SCoD for such additional generation capacity shall not be later than the timeline specified in sub-clause (g) of Regulation 5.2 of these regulations, where such timeline shall start from the date of effectiveness of these amendments or date of in-principle grant by the Nodal Agency, whichever is later:*
- (ii) The entity shall furnish Conn-BG1, and Conn-BG3 as provided in sub-clause (e) of Regulation 5.2 of these regulations, within the timeline as stipulated in sub-clause (e) of Regulation 5.2 of these regulations or two months from the date of effectiveness of this Regulation, whichever is later, failing which approval for such additional generation capacity shall be revoked.*
- (iii) The entity shall furnish documents required as per Regulation 5.8(xi) of these regulations as provided in sub-clause (h) of Regulation 5.2 of these regulations, within two months from the date of effectiveness of this Regulation failing which approval for such additional generation capacity shall be revoked.*

(iv) Entity shall specify the maximum drawl required from the grid for such additional capacity (for the purpose of charging power for storage), within the quantum of Connectivity, which shall be processed by the Nodal Agency based on available margins or with augmentation, as the case may be. In case augmentation is required to allow such additional drawl within the quantum of Connectivity, the entity may be required to furnish Conn-BG2 in accordance with Regulation 8 of these regulations, as intimated by the Nodal Agency.”

List of applications discussed in the meeting are as below:

A1. June-25

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional capacity will be added	Connectivity Granted at
1.	2200002123 (05.06.2025)	Juniper Green Cosmic Private Limited	Bikaner distt. Rajasthan	Generating station(s), including REGS(s), without ESS	Stage-II: 1200003740 (100 MW) LTA: 0412100008(100 MW)	16 (BESS)	31.12.2025	220 kV Bikaner-II PS
2.	2200002125 (05.06.2025)	Juniper Green Stellar Private Limited	Barmer distt. Rajasthan	Generating station(s), including REGS(s), with ESS	0412100010 (150 MW)	28.75 (BESS)	30.04.2026	220 kV Fatehgarh-IV (Sec-I) PS
3.	2200002126 (05.06.2025)	Juniper Green Stellar Private Limited	Barmer distt. Rajasthan	(Generating station(s), including REGS(s), with ESS	0412100011 (65 MW)	17.50 (BESS)	30.04.2026	220 kV Fatehgarh-IV (Sec-I) PS
4.	2200002127 (05.06.2025)	Juniper Green Stellar Private Limited	Barmer distt. Rajasthan	Generating station(s), including REGS(s), with ESS	0412100009 (150 MW)	11.25 (BESS)	31.03.2026	220 kV Fatehgarh-IV (Sec I) PS
5.	2200002140 (11.06.2025)	Enren-I Energy Private Limited	Barmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200000286 (300 MW)	150 MW (BESS)	28.02.2026	Barmer-I PS

A2. July-25

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional capacity will be added	Connectivity Granted at
1.	2200002249 (15.07.2025)	Serentica Renewables India Private Limited	Jaisalmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	0212100034 (300 MW)	200 (Wind)	30.06.2028	400 kV Fatehgarh III PS
2.	2200002250 (15.07.2025)	Serentica Renewables India Private Limited	Jaisalmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	0212100036 (300 MW)	200 (Wind)	30.06.2028	400 kV Fatehgarh III PS
3.	2200002251 (15.07.2025)	Serentica Renewables India Private Limited	Jaisalmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200000020 (300 MW)	200 (Wind)	30.06.2028	400 kV Fatehgarh III PS
4.	2200002280 (22.07.2025)	ACME Heergarh Powertech Private Limited	Jodhpur distt. Rajasthan	Generating station(s), including REGS(s), without ESS	1200002471 (300 MW)	300 (BESS) 240 (Solar)	01.11.2025, 01.01.2027	220 kV Bhadla-II PS
5.	2200002294 (30.07.2025)	AM Green Energy Private Limited	Bikaner distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200000319 (300 MW)	100 (Solar) 125 (BESS)	31.12.2027	220 kV Bikaner-IV PS

A3. August-25

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional capacity will be added	Connectivity Granted at
1.	2200002307 (01-08-2025)	Khaba Renewable Energy Private Limited	Barmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	1200003502: 250 MW	150(BESS)	31.12.2026	Fatehgarh-III(Sec-II)
2.	2200002312 (05-08-2025)	Litsolaire Energy Private Limited	Bikaner distt. Rajasthan	Generating station(s), including REGS(s), without ESS	1200003983:100 MW	50(BESS)	31.12.2026	Bikaner-II PS
3.	2200002316 (05-08-2025)	Luceo Solar Private Limited	Barmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	0212100032:200 MW	150(BESS)	30.06.2027	Fatehgarh-IV(Sec-I)
4.	2200002332 (14-08-2025)	ACME Solar Holdings Limited	Bikaner distt. Rajasthan	Generating station(s), including REGS(s), without ESS	St-II:1200003683 (300 MW) LTA:1200003829 (300 MW)	250(Solar) 190(BESS)	01.12.2025(Solar) 31.12.2026(BESS)	Bikaner-II PS
5.	2200002330 (18-08-2025)	Avaada RJBikaner Private Limited	Bikaner distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200000254: 600 MW	590(BESS)	30.06.2027	Bikaner-IV PS
6.	2200002345 (21-08-2025)	Solarcraft Power India 4 Private Limited	Jaisalmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200001749: 50 MW	50(BESS)	20.07.2029	Bhadla-III PS
7.	2200002358 (27-08-2025)	Juniper Green Stellar Private Limited	Barmer distt. Rajasthan	Renewable Power Park developer	2200000063: 300 MW	170Wind) 150(BESS)	31.12.2027	Fatehgarh-IV(Sec-II)
8.	2200002376 (31-08-2025)	Solarcraft Power India 4 Private Limited	Jodhpur distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200000152: 150 MW	150(BESS)	31.03.2028	Bhadla-II PS

A4. September-25 (upto 8th Sep'25- received before effectiveness of 3rd amendment)

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional capacity will be added	Connectivity Granted at
1.	2200002378 (02-09-2025)	Solarcraft Power India 17 Private Limited	Bikaner distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200000210: 300 MW	300(BESS)	31.03.2028	Bikaner-IV PS
2.	2200002382 (03-09-2025)	Altra Xergi Power Private Limited	Jaisalmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	St-II:1200002637(380 MW) LTA:1200002639(380 MW)	290(Solar) 380(BESS)	31.03.2027	Fatehgarh-III(Sec-II)
3.	2200002392 (05-09-2025)	Vismaya Five Renewables Private Limited	Barmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200000954: 250 MW	150(BESS)	31.12.2031	Barmer-II PS
4.	2200002394 (05-09-2025)	Vismaya Four Renewables Private Limited	Bikaner distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200000910:250 MW	240(BESS)	01.10.2031	Bhadla-IV PS

A5. Permitting maximum drawl for BESS projects with applications under 5.2:

Regarding permitting of drawl for BESS projects under 5.2, it was informed that detailed comprehensive studies shall be carried out by CTUIL depending on the drawl requirement received by all RE developers in Rajasthan at each RE pooling station and requirement of any system augmentation for drawl are to be identified based on studies results. Therefore, maximum drawl requirement provided by the applicants shall be considered for studies & based on the outcome of studies, maximum drawl to be permitted along with requirement of any augmentation & additional Conn BGs (if applicable) shall be intimated at the later stage to the respective applicants by CTUIL after completion of detailed system studies and deliberations in CMETS meetings.

A6. Processing of applications under 5.2

It was also informed that, in Rajasthan till date, about 130 GW connectivity have been received. Transmission system for evacuation of 73 GW capacity has already been planned & approved (67GW under implementation and 6GW is under bidding). Transmission system for evacuation of balance 57GW capacity is still under planning. In the initial phases of transmission system planning in Rajasthan, EHVAC corridors with capacity of 61 GW and a HVDC corridor for 6 GW (Bhadla-Fatehpur) were planned to connect all the available major load centers in neighboring States like Haryana, Punjab, Delhi, Uttar Pradesh and Madhya Pradesh. Since all the nearby load centers have already been covered in the initial planning of EHVAC corridors, there are no nearby load centers available for evacuation of additional RE power from the State of Rajasthan necessitating planning of HVDC corridors to remote load centers/touchpoint (>1000 km) in other regions i.e. Western and Eastern Regions.

However, considering major RE developments envisaged in Gujarat region (Khavda, Bhuj etc.), corridors from Rajasthan towards Gujarat are not envisaged, constraining the planning of Tr. outlets from South-Western Rajasthan witnessing growing challenges of ROW, availability of load points and grid integration, impacting planning of transmission schemes as well as implementation timelines.

As per studies, power surplus of about 30 - 55 GW across the seasons is expected in 2030-31 timeframe. The extant of surplus shall further increase upto 85-110 GW if Green Hydrogen projects, revision of technical minimum of thermal plants from 55% to 40%, development of 50 GW storage projects (both PSP & BESS) do not materialize.

In view of the above, it has been decided that the application for 5.2 received by CTUIL shall be processed only for those entities whose transmission system associated with the connectivity granted is already finalised and approved by NCT. For those entities whose transmission system associated with the connectivity granted is not yet approved by NCT, such applications shall be considered for grant at later stage when the transmission system for connectivity is finalised and approved by NCT. However, for all such cases, application priority shall be maintained.

Since the transmission system required for the application of Vismaya Four Renewables (S. No.4 of A4) at Bhadla-IV PS has not been finalized by NCT, accordingly, the application for additional capacity of Vismaya Four Renewables at Bhadla-IV PS shall not be considered for grant in this meeting. Remaining applications shall be processed in line with the 3rd Amendment of GNA regulations.

Deliberation on June-25 Applications:

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
1.	2200002123 (05.06.2025)	Juniper Green Cosmic Private Limited	Bikaner distt. Rajasthan	Generating station(s), including REGS(s), without ESS	0412100008(100 MW)	16 (BESS)	31.12.2025	220 kV Bikaner-II PS
It was informed that M/s Juniper Green Cosmic Private Limited (JGCPL) has applied for addition of generation capacity (16 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at 220 kV Bikaner-II PS under App. No. 0412100008(100 MW)). Accordingly, it was proposed to grant addition of generation capacity (16 MW BESS) under regulation 5.2 of GNA Regulations. It was informed that 25 MW of BESS capacity addition under App. No. 2200001970 is already agreed for grant to M/s JGCPL for the same connectivity at Bikaner-II PS in the 39th CMETS NR meeting. This application is for 16 MW BESS capacity in additional to earlier granted BESS capacity of 25 MW under App. No. 2200001970(25 MW). With this grant total BESS capacity shall be 41 MW subject to compliance as per 37.10(d) of 3rd Amendment of GNA Regulations. It was also informed that the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s JGCPL (Appl. No. 00412100008 for 100 MW). Further, M/s JGCPL (Appl. No. 0412100008) shall be responsible for compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s JGCPL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances in timely manner so as to provide sufficient time for ensuring necessary compliances. M/s JGCPL noted the same. It was also informed that M/s JGCPL has submitted the SCoD of additional generation capacity as 31.12.2025. Considering the same, it was agreed to grant the above capacity addition under regulation 5.2 of GNA Regulations with SCoD of 31.12.2025 & the same shall be subject to availability of Transmission system for connectivity granted to App. No. 0412100008 (100 MW). M/s JGCPL agreed for the same. It was also informed that M/s JGCPL need to comply with the requirements mentioned in Reg. 37.10(d) (i to iv) as below within the timelines as per GNA Regulations: (i) SCoD (ii) Conn BG1 Rs. 50 lakh & Conn BG3 of Rs. 2 lakh/MW as per 5.2(e) (iii) Documents as per 5.2(h) (iv) Maximum drawl from the grid required for BESS Upon compliance as per (i), (iii) & (iv) above, in-principle intimation for grant of connectivity to additional capacity (16 MW BESS) within the connectivity quantum shall be issued. Further, as informed earlier, the maximum drawl permitted for BESS shall be intimated at the later stage (with requirement of additional Conn BGs if applicable)). M/s JGCPL noted the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
2.	2200002125 (05.06.2025)	Juniper Green Stellar Private Limited	Barmer distt. Rajasthan	Generating station(s), including REGS(s), with ESS	0412100010 (150 MW)	28.75 (BESS)	30.04.2026	220 kV Fatehgarh-IV (Sec-I) PS

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
It was informed that M/s Juniper Green Steller Private Limited (JGSPL) has applied for addition of generation capacity (28.75 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at 220 kV Fatehgarh-IV (Sec-I) PS under App. No. 0412100010(150 MW). Accordingly, it was proposed to grant addition of generation capacity (28.75 MW BESS) under regulation 5.2 of GNA Regulations. It was also informed that the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s JGSPL (Appl. No. 0412100010 for 150 MW). Further, M/s JGSPL (Appl. No. 0412100010) shall be responsible for compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s JGSPL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances in timely manner so as to provide sufficient time for ensuring necessary compliances. M/s JGSPL noted the same. It was also informed that M/s JGSPL has submitted the SCoD of additional generation capacity as 30.04.2026. Considering the same, it was agreed to grant the above capacity addition under regulation 5.2 of GNA Regulations with SCOD of 30.04.2026 & the same shall be subject to availability of Transmission system for connectivity granted to App. No. 0412100010 (150 MW). It was also informed that M/s JGSPL need to comply with the requirements mentioned in Reg. 37.10(d) (i to iv) as below within the timelines as per regulations: (i) SCoD (ii) Conn BG1 Rs. 50 lakh & Conn BG3 of Rs. 2lakh/MW as per 5.2(e) (iii) Documents as per 5.2(h) (iv) Maximum drawl from the grid required for BESS Upon compliance as per (i), (iii) & (iv) above, in-principle intimation for grant of connectivity to additional capacity (28.75 MW BESS) within the connectivity quantum shall be issued. Further, as informed earlier, the maximum drawl permitted for BESS shall be intimated at the later stage (with requirement of additional Conn BGs (if applicable)). M/s JGSPL noted the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
3.	2200002126 (05.06.2025)	Juniper Green Stellar Private Limited	Barmer distt. Rajasthan	(Generating station(s), including REGS(s), with ESS	0412100011 (65 MW)	17.50 (BESS)	30.04.2026	220 kV Fatehgarh-IV (Sec-I) PS
It was informed that M/s Juniper Green Steller Private Limited (JGSPL) has applied for addition of generation capacity (17.5 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at 220 kV Fatehgarh-IV (Sec-I) PS under App. No. 0412100011(65 MW). Accordingly, it was proposed to grant addition of generation capacity (17.5 MW BESS) under regulation 5.2 of GNA Regulations. It was also informed that the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s JGSPL (Appl. No. 0412100011 for 65 MW). Further, M/s JGSPL (Appl. No. 0412100011) shall be responsible for compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s JGSPL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances in timely manner in timely manner so as to provide sufficient time for ensuring necessary compliances. M/s JGSPL noted the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
---------	------------------------	-----------	------------------	---------------------	---	----------------------------------	--	-------------------------

It was also informed that M/s JGSPL has submitted the SCoD of additional generation capacity from 30.04.2026. However, firm start date of original connectivity granted to M/s Juniper Green Steller (App. No. 0412100011 – 65 MW) is 30.06.2026. Since as per Regulation 5.2 (g), SCOD of the additional capacity shall not be prior to the firm start date of original connectivity accordingly, it was agreed to grant the above capacity addition under regulation 5.2 of GNA Regulations with SCoD of 30.06.2026 & the same shall be subject to availability of Transmission system for connectivity granted to App. No. 0412100011 (65 MW). M/s JGSPL agreed for the same.

It was also informed that M/s JGSPL need to comply with the requirements mentioned in Reg. 37.10(d) (i to iv) as below within the timelines as per regulations:

- (i) SCoD
- (ii) Conn BG1 Rs. 50 lakh & Conn BG3 of Rs. 2 lakh/MW as per 5.2(e)
- (iii) Documents as per 5.2(h)
- (iv) Maximum drawl from the grid required for BESS

Upon compliance as per (i), (iii) & (iv) above, in-principle intimation for grant of connectivity to additional capacity (17.5 MW BESS) within the connectivity quantum shall be issued. Further, as informed earlier, the maximum drawl permitted for BESS shall be intimated at the later stage (with requirement of additional Conn BGs if applicable)). M/s JGSPL noted the same.

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
4.	2200002127 (05.06.2025)	Juniper Green Steller Private Limited	Barmer distt. Rajasthan	Generating station(s), including REGS(s), with ESS	0412100009 (150 MW)	11.25 (BESS)	31.03.2026	220 kV Fatehgarh-IV (Sec I) PS

It was informed that M/s Juniper Green Steller Private Limited (JGSPL) has applied for addition of generation capacity (11.25 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at 220 kV Fatehgarh-IV (Sec-I) PS under App. No. 0412100009(150 MW). Accordingly, it was proposed to grant addition of generation capacity (11.25 MW BESS) under regulation 5.2 of GNA Regulations.

It was also informed that, the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s JGSPL (Appl. No. 0412100009 for 150 MW). Further, M/s JGSPL (Appl. No. 0412100009) shall be responsible for compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s JGSPL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances in timely manner in timely manner so as to provide sufficient time for ensuring necessary compliances. M/s JGSPL noted the same.

It was also informed that M/s JGSPL has submitted the SCoD of additional generation capacity from 31.03.2026. Considering the same, it was agreed to grant the above capacity addition under regulation 5.2 of GNA Regulations with SCoD of 31.03.2026 & the same shall be subject to availability of Transmission system for connectivity granted to App. No. 0412100009 (150 MW).

It was also informed that M/s JGSPL need to comply with the requirements mentioned in Reg. 37.10(d) (i to iv) as below within the timelines as per regulations:

- (i) SCoD
- (ii) Conn BG1 Rs. 50 lakh & Conn BG3 of Rs. 2 lakh/MW as per 5.2(e)

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
(iii)	Documents as per 5.2(h)							
(iv)	Maximum drawl from the grid required for BESS							
Upon compliance as per (i), (iii) & (iv) above, in-principle intimation for grant of connectivity to additional capacity (11.25 MW BESS) within the connectivity quantum shall be issued. Further, as informed earlier, the maximum drawl permitted for BESS shall be intimated at the later stage (with requirement of additional Conn BGs if applicable)). M/s JGSPL noted the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
5.	2200002140 (11.06.2025)	Enren-I Energy Private Limited	Barmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200000286 (300 MW)	150 MW (BESS)	28.02.2026	Barmer-I PS
It was informed that M/s Enren-I Energy Private Limited (E1EPL) has applied for addition of generation capacity (150 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at 220 kV Barmer-I PS under App. No. 2200000286 (300 MW). Accordingly, it was proposed to grant addition of generation capacity (150 MW BESS) under regulation 5.2 of GNA Regulations. It was also informed that, the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s E1EPL (Appl. No. 2200000286 for 300 MW). Further, M/s E1EPL (Appl. No. 2200000286) shall be responsible for compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s E1EPL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances in timely manner in timely manner so as to provide sufficient time for ensuring necessary compliances. It was also informed that M/s E1EPL has submitted the SCoD of additional generation capacity from 28.02.2026. However, start date of connectivity granted of original application granted to M/s E1EPL (App. No. 2200002140-300 MW) as per final intimation is 07.11.2026. Since as per Regulation 5.2 (g), SCOD of the additional capacity shall not be prior to the firm start date of original connectivity accordingly, it was proposed to grant the above capacity addition under regulation 5.2 of GNA Regulations with SCoD of 07.11.2026. In this regard, M/s E1EPL in the meeting and vide email dated 11.11.2025 requested to consider SCOD for additional capacity as 31.03.2027. In view of above it was agreed to grant the same with SCOD of 31.03.2027 & subject to availability of Transmission system for connectivity granted to App. No. 2200000286 (300 MW). M/s E1EPL agreed for the same. It was also informed that M/s E1EPL need to comply with the requirements mentioned in Reg. 37.10(d) (i to iv) as below within the timelines as per Regulations: (i) SCoD (ii) Conn BG1 Rs. 50 lakh & Conn BG3 of Rs. 2 lakh/MW as per 5.2(e) (iii) Documents as per 5.2(h) (iv) Maximum drawl from the grid required for BESS Upon compliance as per (i), (iii) & (iv) above, in-principle intimation for grant of connectivity to additional capacity (150 MW BESS) within the connectivity quantum shall be issued. Further, as informed earlier, the maximum drawl permitted for BESS shall be intimated at the later stage (with requirement of additional Conn BGs if applicable)). M/s E1EPL noted the same.								

Deliberation on July-25 Applications:

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
1.	2200002249 (15.07.2025)	Serentica Renewables India Private Limited	Jaisalmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	0212100034 (300 MW)	200 (Wind)	30.06.2028	400 kV Fatehgarh III PS
It was informed that M/s Serentica Renewables India Private Limited (SRIPL) has applied for addition of generation capacity (200 MW Wind) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at 400 kV Fatehgarh-III PS(Sec-II) under App. No. 0212100034(300 MW). M/s Serentica Renewables in the meeting informed that they have not submitted the documents for transition as per 3rd Amendment of GNA Regulation with respect to above application (No. 2200002249). In view of the above, it was decided to close the above application in line with 37.10(d) (iii) of GNA Regulations. M/s SRIPL noted the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
2.	2200002250 (15.07.2025)	Serentica Renewables India Private Limited	Jaisalmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	0212100036 (300 MW)	200 (Wind)	30.06.2028	400 kV Fatehgarh III PS
It was informed that M/s Serentica Renewables India Private Limited (SRIPL) has applied for addition of generation capacity (200 MW Wind) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at 400 kV Fatehgarh-III PS(Sec-II) under App. No. 0212100036(300 MW). M/s Serentica Renewables in the meeting informed that they have not submitted the documents for transition as per 3rd Amendment of GNA Regulation with respect to above application (No. 2200002250). In view of the above, it was decided to close the above application in line with 37.10(d) (iii) of GNA Regulations. M/s SRIPL noted the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
3.	2200002251 (15.07.2025)	Serentica Renewables India Private Limited	Jaisalmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200000020 (300 MW)	200 (Wind)	30.06.2028	400 kV Fatehgarh III PS
It was informed that M/s Serentica Renewables India Private Limited (SRIPL) has applied for addition of generation capacity (200 MW Wind) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at 400 kV Fatehgarh-III PS(Sec-II) under App. No. 0212100036(300 MW). M/s Serentica Renewables in the meeting informed that they have not submitted the documents for transition as per 3rd Amendment of GNA Regulation with respect to above application (No. 2200002251). In view of the above, it was decided to close the above application in line with 37.10(d) (iii) of GNA Regulations. M/s SRIPL noted the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
4.	2200002280 (22.07.2025)	ACME Heergarh Powertech Private Limited	Jodhpur distt. Rajasthan	Generating station(s), including REGS(s), without ESS	1200002471 (300 MW)	300 (BESS) 240 (Solar)	01.11.2025, 01.01.2027	220 kV Bhadla-II PS
It was informed that M/s ACME Heergarh Powertech Private Limited (AHPPL) has applied for addition of generation capacity (240 MW Solar & 300 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at Bhadla-II PS under App. No. 1200002471 (300 MW). Accordingly, it was proposed to grant addition of generation capacity (240 MW Solar & 300 MW BESS) under regulation 5.2 of GNA Regulations. It may be noted that M/s AHPPL has provided different start dates for solar & BESS capacity. However, for a single application there cannot be multiple dates. Therefore, M/s AHPPL was asked to clarify regarding the same & inform the single date for the project. It was also suggested that in case AHPPL wants separate start dates for Solar & BESS capacity, M/s AHPPL is required to file separate applications under 5.2. M/s AHPPL informed that they have submitted SCoD of 31.03.2027 as per 3rd amendment & the same may be considered as SCoD of both Solar and BESS capacity. The same was noted. It was also informed that the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s AHPPL (Appl. No. 1200002471 for 300 MW). Further, M/s AHPPL (Appl. No. 1200002471) shall be responsible for compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s AHPPL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances in timely manner so as to provide sufficient time for ensuring necessary compliances. M/s AHPPL noted the same. Accordingly, it was agreed to grant the above capacity addition under regulation 5.2 of GNA Regulations with SCoD of 31.03.2027 & the same shall be subject to availability of Transmission system for connectivity granted to App. No. 1200002471 (300 MW). It was also informed that M/s AHPPL need to comply with the requirements mentioned in Reg. 37.10(d) (i to iv) as below within the timelines as per regulations: (i) SCoD (ii) Conn BG1 Rs. 50 lakh & Conn BG3 of Rs. 2 lakh/MW as per 5.2(e) (iii) Documents as per 5.2(h) (iv) Maximum drawl from the grid required for BESS Upon compliance as per (i), (iii) & (iv) above, in-principle intimation for grant of connectivity to additional capacity (300 MW BESS & 240 MW Solar) within the connectivity quantum shall be issued. Further, as informed earlier, the maximum drawl permitted for BESS shall be intimated at the later stage (with requirement of additional Conn BGs (if applicable)). M/s AHPPL noted the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
5.	2200002294 (30.07.2025)	AM Green Energy Private Limited	Bikaner distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200000319 (300 MW)	100 (Solar) 125 (BESS)	31.12.2027	220 kV Bikaner-IV PS

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
It was informed that M/s AM Green Energy Private Limited (AMGEPL) has applied for addition of generation capacity (100MW Solar & 125 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at Bikaner-IV PS under App. No. 2200000319 (300 MW). Accordingly, it was proposed to grant addition of generation capacity (125 MW BESS & 100 MW Solar) under regulation 5.2 of GNA Regulations. It was also informed that, the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s AMGEPL (Appl. No. 2200000319 for 300 MW). Further, M/s AMGEPL (Appl. No. 2200000319) shall be responsible for compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s AMGEPL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances in timely manner so as to provide sufficient time for ensuring necessary compliances. It was also informed that M/s AMGEPL has submitted the SCoD of additional generation capacity from 31.12.2027. However, as per the regulations 5.2 (g), SCoD of additional capacity shall not be greater than 24 months from the date of issuance of in-principle grant. Even if it is considered that intimation shall be issued by the end of this month (Nov'25), the SCoD cannot be beyond 24 months from the date of issuance of in-principle intimation i.e. Nov'27 as per Regulations. Accordingly, M/s AMGEPL was asked to prepone the SCoD date of additional capacity and inform a suitable date within the timeline as per regulations. M/s AMGEPL in the meeting requested to align the SCoD date with 24 months from the date of issuance of in-principle intimation in line with the regulations. Considering the same, it was agreed to grant the above capacity addition under regulation 5.2 of GNA Regulations with SCoD of 24 months from date of in-principle intimation. Further, the above grant shall be subject to availability of Transmission system for connectivity granted to App. No. 2200000319 (300 MW). M/s AMGEPL noted and agreed for the same. It was also informed that M/s AMGEPL need to comply with the requirements mentioned in Reg. 37.10(d) (i to iv) as below within the timelines as per regulations: (i) SCoD (ii) Conn BG1 Rs. 50 lakh & Conn BG3 of Rs. 2 lakh/MW as per 5.2(e) (iii) Documents as per 5.2(h) (iv) Maximum drawl from the grid required for BESS Upon compliance as per (i), (iii) & (iv) above, in-principle intimation for grant of connectivity to additional capacity (100 MW Solar & 125 MW BESS) within the connectivity quantum shall be issued. Further, as informed earlier, the maximum drawl permitted for BESS shall be intimated at the later stage (with requirement of additional Conn BGs (if applicable)). M/s AMGEPL noted the same.								

Deliberation on August-25 Applications:

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
1.	2200002307 (01-08-2025)	Khaba Renewable Energy Private Limited	Barmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	1200003502 (250 MW)	150(BESS)	31.12.2026	Fatehgarh-III PS(Sec-II)

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
It was informed that M/s Khaba Renewable Energy Private Limited (KREPL) has applied for addition of generation capacity (150 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at 220 kV Fatehgarh-III PS(Sec-II) under App. No. 1200003502 (250 MW). Accordingly, it was proposed to grant addition of generation capacity (150 MW BESS) under regulation 5.2 of GNA Regulations. It was also informed that, the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s KREPL (Appl. No. 1200003502 for 250 MW). Further, M/s KREPL (Appl. No. 1200003502) shall be responsible for compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s KREPL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances in timely manner so as to provide sufficient time for ensuring necessary compliances. M/s KREPL noted the same M/s KREPL has submitted the SCoD of additional generation capacity from 31.12.2026. Considering the same, it was agreed to grant the above capacity addition under regulation 5.2 of GNA Regulations with SCoD of 31.12.2026 & the same shall be subject to availability of Transmission system for connectivity granted to App. No. 1200003502 (250 MW). M/s KREPL agreed for the same It was also informed that M/s KREPL need to comply with the requirements mentioned in Reg. 37.10(d) (i to iv) as below within the timelines as per regulations: (i) SCoD (ii) Conn BG1 Rs. 50 lakh & Conn BG3 of Rs. 2 lakh/MW as per 5.2(e) (iii) Documents as per 5.2(h) (iv) Maximum drawl from the grid required for BESS Upon compliance as per (i), (iii) & (iv) above, in-principle intimation for grant of connectivity to additional capacity (150 MW BESS) within the connectivity quantum shall be issued. Further, as informed earlier, the maximum drawl permitted for BESS shall be intimated at the later stage (with requirement of additional Conn BGs (if applicable)). M/s KREPL noted the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
2.	2200002312 (05-08-2025)	Litsolaire Energy Private Limited	Bikaner distt. Rajasthan	Generating station(s), including REGS(s), without ESS	1200003983 (100 MW)	50(BESS)	31.12.2026	Bikaner-II PS
M/s Litsolaire Energy Private Limited (LEPL) has applied for addition of generation capacity (50 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at 220 kV Bikaner-II PS under App. No. 1200003983 (100 MW)). Accordingly, it was proposed to grant addition of generation capacity (50 MW BESS) under regulation 5.2 of GNA Regulations. It was also informed that, the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s LEPL (Appl. No. 1200003983 for 100 MW). Further, M/s LEPL (Appl. No. 1200003983) shall be responsible for compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s LEPL								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances in timely manner so as to provide sufficient time for ensuring necessary compliances. M/s LEPL noted the same. M/s LEPL has submitted the SCoD of additional generation capacity from 31.12.2026. Considering the same, it was agreed to grant the above capacity addition under regulation 5.2 of GNA Regulations with SCoD of 31.12.2026 & the same shall be subject to availability of Transmission system for connectivity granted to App. No. 1200003983 (100 MW). It was also informed that M/s LEPL need to comply with the requirements mentioned in Reg. 37.10(d) (i to iv) as below within the timelines as per regulations: (i) SCoD (ii) Conn BG1 Rs. 50 lakh & Conn BG3 of Rs. 2lakh/MW as per 5.2(e) (iii) Documents as per 5.2(h) (iv) Maximum drawl from the grid required for BESS Upon compliance as per (i), (iii) & (iv) above, in-principle intimation for grant of connectivity to additional capacity (50 MW BESS) within the connectivity quantum shall be issued. Further, as informed earlier, the maximum drawl permitted for BESS shall be intimated at the later stage (with requirement of additional Conn BGs (if applicable)). M/s LEPL noted the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
3.	2200002316 (05-08-2025)	Luceo Solar Private Limited	Barmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	0212100032 (200 MW)	150(BESS)	30.06.2027	Fatehgarh-IV(Sec-I)
M/s Luceo Solar Private Limited (LSPL) has applied for addition of generation capacity (150 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at 220 kV Fatehgarh-IV (Sec-I) PS under App. No. 0212100032(150 MW). Accordingly, it was proposed to grant addition of generation capacity (150 MW BESS) under regulation 5.2 of GNA Regulations. M/s LSPL shall note that as per GNA Regulations, the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s LSPL (Appl. No. 0212100032 for 200 MW). Further, M/s LSPL (Appl. No. 0212100032) shall be responsible for compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s LSPL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances in timely manner so as to provide sufficient time for ensuring necessary compliances. M/s LSPL noted the same. M/s LSPL has submitted the SCoD of additional generation capacity from 30.06.2027. Accordingly, it was agreed to grant the above capacity addition under regulation 5.2 of GNA Regulations with SCoD of 30.06.2027 & the same shall be subject to availability of Transmission system for connectivity granted to App. No. 0212100032 (200 MW). M/s LSPL agreed for the same. It was also informed that M/s LSPL need to comply with the requirements mentioned in Reg. 37.10(d) (i to iv) as below within the timelines as per regulations: (i) SCoD								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
	(ii)	Conn BG1 Rs. 50 lakh & Conn BG3 of Rs. 2lakh/MW as per 5.2(e)						
	(iii)	Documents as per 5.2(h)						
	(iv)	Maximum drawl from the grid required for BESS						
Upon compliance as per (i), (iii) & (iv) above, in-principle intimation for grant of connectivity to additional capacity (150 MW BESS) within the connectivity quantum shall be issued. Further, as informed earlier, the maximum drawl permitted for BESS shall be intimated at the later stage (with requirement of additional Conn BGs (if applicable)). M/s LSPL noted the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
4.	2200002332 (14-08-2025)	ACME Solar Holdings Limited	Bikaner distt. Rajasthan	Generating station(s), including REGS(s), without ESS	St-II:1200003683 (300 MW) LTA:1200003829 (300 MW)	250(Solar) 190(BESS)	01.12.2025(Solar) 31.12.2026(BESS)	Bikaner-II PS
It was informed that M/s ACME Solar Holdings Limited (ASHPL) has applied for addition of generation capacity (250 MW Solar & 190 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at Bikaner-II PS under App. No. 1200003829 (300 MW).								
It was mentioned that a similar application for additional capacity under Regulation 5.2 by ACME (App. No. 2200001843) was discussed in 38 th CMETS NR meeting held on 28.05.2025. Regarding the processing of application (App. No. 2200001843) in 38 th CMETS NR meeting, it was decided as below:								
Quote “The processing of above application under 5.2 is dependent on the status of connectivity of 300 MW granted to M/s ACME Solar Holdings Limited at Bikaner-II PS. Since the matter is currently sub-judice & there is no issue of priority in this grant under 5.2, it was decided to defer the above application under 5.2 at this stage & may be taken up for grant at later stage after certain clarity on status of the above connectivity at Bikaner-II PS is established.”								
Unquote Subsequently, the above application under 5.2(App. No. 2200001843) was withdrawn by M/s ACME and accordingly the application was closed by CTUIL.								
Now M/s ACME has filed similar application (No. 2200002332) for additional capacity under Regulation 5.2 within the same connectivity of 300 MW at Bikaner-II PS. However, till date, there is no change in the status with respect to the revocation of original connectivity of 300MW granted to M/s ACME at Bikaner-II PS. The matter is still sub-judice and the order in this regard from Hon'ble CERC is still awaited. Accordingly, it was decided to defer the above application under 5.2 at this stage & it was informed that the above application may be taken up for grant at later stage based on the outcome of CERC order. M/s ACME noted and agreed for the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
5.	2200002330 (18-08-2025)	Avaada RJBikaner Private Limited	Bikaner distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200000254 (600 MW)	590(BESS)	30.06.2027	Bikaner-IV PS

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
M/s Avaada RJBikaner Private Limited (ARJBPL) has applied for addition of generation capacity (590 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at Bikaner-IV PS under App. No. 2200000254 (600 MW). Accordingly, it was proposed to grant addition of generation capacity (590 MW BESS) under regulation 5.2 of GNA Regulations. It was also informed that, the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s ARJBPL (Appl. No. 2200000254 for 600 MW). Further, M/s ARJBPL (Appl. No. 2200000254) shall be responsible for compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s ARJBPL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances in timely manner so as to provide sufficient time for ensuring necessary compliances. M/s ABRJPL noted the same M/s ARJBPL has submitted SCoD of additional generation capacity from 30.06.2027. Considering the same, it was agreed to grant the above capacity addition under regulation 5.2 of GNA Regulations with SCoD of 30.06.2027 & the same shall be subject to availability of Transmission system for connectivity granted to App. No. 2200000319 (300 MW). M/s ABRJPL noted and agreed for the same. It was also informed that M/s ARJBPL need to comply with the requirements mentioned in Reg. 37.10(d) (i to iv) as below within the timelines as per regulations: (i) SCoD (ii) Conn BG1 Rs. 50 lakh & Conn BG3 of Rs. 2lakh/MW as per 5.2(e) (iii) Documents as per 5.2(h) (iv) Maximum drawl from the grid required for BESS Upon compliance as per (i), (iii) & (iv) above, in-principle intimation for grant of connectivity to additional capacity (590 MW BESS) within the connectivity quantum shall be issued. Further, as informed earlier, the maximum drawl permitted for BESS shall be intimated at the later stage (with requirement of additional Conn BGs (if applicable)). M/s ABRJPL noted the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
6.	2200002345 (21-08-2025)	Solarcraft Power India 4 Private Limited	Jaisalmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200001749 (50 MW)	50(BESS)	20.07.2029	Bhadla-III PS
M/s Solarcraft Power India 4 Private Limited (SPI4PL) has applied for addition of generation capacity (50 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at 220 kV Bhadla-III PS under App. No. 2200001749(50 MW)). Accordingly, it was proposed to grant addition of generation capacity (50 MW BESS) under regulation 5.2 of GNA Regulations. It was also informed that, the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s SPI4PL (Appl. No. 2200001749 for 50 MW). Further, M/s SPI4PL (Appl. No. 2200001749) shall be responsible for compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s SPI4PL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances in timely manner so as to provide sufficient time for ensuring necessary compliances. M/s SPI4PL noted the same								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
M/s SPI4PL has submitted SCoD of additional generation capacity from 20.07.2029. Considering the same, it was agreed to grant the above capacity addition under regulation 5.2 of GNA Regulations with SCoD of 20.07.2029 (tentative) matching with the start date of connectivity of original connectivity & the same shall be subject to availability of Transmission system for connectivity granted to App. No. 2200001749 (50 MW). Further, it was also informed that the final grant intimation to SPI4PL for App. No. 22000001749 is being issued shortly by CTUIL. As per regulations, only connectivity grantees are eligible for grant under 5.2. Therefore, the intimation for grant under 5.2 shall be issued only after issuance of final grant & subsequent signing of Connectivity Agreement. M/s SPI4PL agreed for the same. It was also informed that M/s SPI4PL need to comply with the requirements mentioned in Reg. 37.10(d) (i to iv) as below within the timelines as per regulations: (i) SCoD (ii) Conn BG1 Rs. 50 lakh & Conn BG3 of Rs. 2lakh/MW as per 5.2(e) (iii) Documents as per 5.2(h) (iv) Maximum drawl from the grid required for BESS Upon compliance as per (i), (iii) & (iv) above, in-principle intimation for grant of connectivity to additional capacity (50 MW BESS) within the connectivity quantum shall be issued. Further, as informed earlier, the maximum drawl permitted for BESS shall be intimated at the later stage (with requirement of additional Conn BGs (if applicable)). M/s SPI4PL noted the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
7.	2200002358 (27-08-2025)	Juniper Green Stellar Private Limited	Barmer distt. Rajasthan	Renewable Power Park developer	2200000063 (300 MW)	170(Wind) 150(BESS)	31.12.2027	Fatehgarh-IV(Sec-II)
M/s Juniper Green Stellar Private Limited (JGSPL) has applied for addition of generation capacity (170 MW Wind & 150 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at 220 kV Fatehgarh-IV (Sec-II) PS under App. No. 2200000063 (300 MW). Accordingly, it was proposed to grant addition of generation capacity (170 MW Wind & 150 MW BESS) under regulation 5.2 of GNA Regulations. It was also informed that, the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s JGSPL (Appl. No. 2200000063 for 300 MW). Further, M/s JGSPL (Appl. No. 2200000063) shall be responsible for compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s JGSPL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances in timely manner so as to provide sufficient time for ensuring necessary compliances. M/s JGSPL noted the same. It was also informed that M/s JGSPL has requested SCoD of additional generation capacity from 31.12.2027. However, as per the regulations 5.2 (g), SCoD of additional capacity shall not be greater than 24 months from the date of issuance of in-principle grant. Even if it is considered that intimation shall be issued by the end of this month (Nov'25), the SCoD cannot be beyond Nov'27 as per Regulations. Accordingly, M/s JGSPL was asked to prepone the SCoD date of additional capacity and inform a suitable date within the timeline as per regulations.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
M/s JGSPL in the meeting requested to align the SCoD date with 24 months from the date of issuance of in-principle intimation in line with the regulations. Considering the same, it was agreed to grant the above capacity addition under regulation 5.2 of GNA Regulations with SCoD of 24 months from date of in-principle intimation. Further, the above grant shall be subject to availability of Transmission system for connectivity granted to App. No. 2200000063 (300 MW). M/s JGSPL noted the same It was also informed that M/s JGSPL need to comply with the requirements mentioned in Reg. 37.10(d) (i to iv) as below within the timelines as per regulations: (i) SCoD (ii) Conn BG1 Rs. 50 lakh & Conn BG3 of Rs. 2lakh/MW as per 5.2(e) (iii) Documents as per 5.2(h) (iv) Maximum drawl from the grid required for BESS Upon compliance as per (i), (iii) & (iv) above, in-principle intimation for grant of connectivity to additional capacity (170 MW Wind & 150 MW BESS)) within the connectivity quantum shall be issued. Further, as informed earlier, the maximum drawl permitted for BESS shall be intimated at the later stage (with requirement of additional Conn BGs (if applicable)). M/s JGSPL noted the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
8.	2200002376 (31-08-2025)	Solarcraft Power India 4 Private Limited	Jodhpur distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200000152: 150 MW	150(BESS)	31.03.2028	Bhadla-II PS
M/s Solarcraft Power India 4 Private Limited (SPI4PL) has applied for addition of generation capacity (150 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at 220 kV Bhadla-II PS under App. No. 2200000152(150 MW)). Accordingly, it was proposed to grant addition of generation capacity (50 MW BESS) under regulation 5.2 of GNA Regulations. It was also informed that, the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s SPI4PL (Appl. No. 2200000152 for 150 MW). Further, M/s SPI4PL (Appl. No. 2200000152) shall be responsible for compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s SPI4PL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances in timely manner so as to provide sufficient time for ensuring necessary compliances. M/s SPI4PL has requested SCoD of additional generation capacity from 31.03.2028. However, as per the regulations 5.2 (g), SCoD of additional capacity shall not be greater than 24 months from the date of issuance of in-principle grant. Even if it is considered that intimation shall be issued by the end of this month (Nov'25), the SCoD cannot be beyond Nov'27 as per Regulations. Accordingly, M/s SPI4PL was asked to prepone the SCoD date of additional capacity and inform a suitable date within the timeline as per regulations. M/s SPI4PL in the meeting requested to align the SCoD date with 24 months from the date of issuance of in-principle intimation in line with the regulations. Considering the same, it was agreed to grant the above capacity addition under regulation 5.2 of GNA Regulations with SCoD of 24 months from date of in-principle intimation. Further, the above grant shall be subject to availability of Transmission system for connectivity granted to App. No. 2200000152 (150 MW). M/s JGSPL noted and agreed for the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
It was also informed that M/s SPI4PL need to comply with the requirements mentioned in Reg. 37.10(d) (i to iv) as below within the timelines as per regulations: (i) SCoD (ii) Conn BG1 Rs. 50 lakh & Conn BG3 of Rs. 2lakh/MW as per 5.2(e) (iii) Documents as per 5.2(h) (iv) Maximum drawl from the grid required for BESS Upon compliance as per (i), (iii) & (iv) above, in-principle intimation for grant of connectivity to additional capacity(150 MW BESS)) within the connectivity quantum shall be issued. Further, as informed earlier, the maximum drawl permitted for BESS shall be intimated at the later stage (with requirement of additional Conn BGs (if applicable)). M/s SPI4PL noted the same.								

Deliberation on September-25 Applications(upto 08-08-2025):

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
1.	2200002378 (02-09-2025)	Solarcraft Power India 17 Private Limited	Bikaner distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200000210 (300 MW)	300(BESS)	31.03.2028	Bikaner-IV PS
M/s Solarcraft Power India 17 Private Limited (SPI17PL) has applied for addition of generation capacity (300 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at 220 kV Bikaner-IV PS under App. No. 2200000210 (300 MW)). Accordingly, it was proposed to grant addition of generation capacity (300 MW BESS) under regulation 5.2 of GNA Regulations. It was also informed that, the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s SPI17PL (Appl. No. 2200000210 for 300 MW). Further, M/s SPI17PL (Appl. No. 2200000210) shall be responsible for compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s SPI17PL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances in timely manner so as to provide sufficient time for ensuring necessary compliances. M/s SPI17PL has requested SCoD of additional generation capacity from 31.03.2028. However, as per the regulations 5.2 (g), SCoD of additional capacity shall not be greater than 24 months from the date of issuance of in-principle grant. Even if it is considered that intimation shall be issued by the end of this month (Nov'25), the SCoD cannot be beyond Nov'27 as per Regulations. Accordingly, M/s SPI4PL was asked to prepone the SCoD date of additional capacity and inform a suitable date within the timeline as per regulations. M/s SPI17PL in the meeting requested to align the SCoD date with 24 months from the date of issuance of in-principle intimation in line with the regulations. Considering the same, it was agreed to grant the above capacity addition under regulation 5.2 of GNA Regulations with SCoD of 24 months from date of in-principle intimation. Further, the above grant shall be subject to availability of Transmission system for connectivity granted to App. No. 2200000210 (300 MW). M/s JGSPL noted the same It was also informed that M/s SPI17PL need to comply with the requirements mentioned in Reg. 37.10(d) (i to iv) as below within the timelines as per regulations:								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
(i) SCoD (ii) Conn BG1 Rs. 50 lakh & Conn BG3 of Rs. 2 lakh/MW as per 5.2(e) (iii) Documents as per 5.2(h) (iv) Maximum drawl from the grid required for BESS Upon compliance as per (i), (iii) & (iv) above, in-principle intimation for grant of connectivity to additional capacity (300 MW BESS)) within the connectivity quantum shall be issued. Further, as informed earlier, the maximum drawl permitted for BESS shall be intimated at the later stage (with requirement of additional Conn BGs (if applicable)). M/s SPI17PL noted the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
2.	2200002382 (03-09-2025)	Altra Xergi Power Private Limited	Jaisalmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	St-II:1200002637(380 MW) LTA:1200002639(380 MW)	290(Solar) 380(BESS)	31.03.2027	Fatehgarh-III(Sec-II)
It was informed that, M/s Altra Xergi Power Private Limited (AXPPL) has applied for addition of generation capacity (290 MW Solar & 380 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at 220 kV Fatehgarh-III PS(Sec-II) under App. No. 1200002639 (380 MW). M/s AXPPL in the meeting informed that they have not submitted the documents for transition of the above applications as per 3 rd Amendment of GNA Regulation. In view of the above, it was decided to close the above application in line with 37.10(d) (iii) of GNA Regulations.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
3.	2200002392 (05-09-2025)	Vismaya Five Renewables Private Limited	Barmer distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200000954 (250 MW)	150(BESS)	31.12.2031	Barmer-II PS
M/s Vismaya Five Renewables Private Limited (VFRPL) has applied for addition of generation capacity (150 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at 220 kV Barmer-II PS under App. No. 2200000954 (250 MW)). Accordingly, it was proposed to grant addition of generation capacity (150 MW BESS) under regulation 5.2 of GNA Regulations. It was also informed that, the net injection at any point of time shall not exceed the quantum of total Connectivity granted to the existing Connectivity grantee i.e., M/s VFRPL (Appl. No. 2200000954 for 250 MW). Further, M/s VFRPL (Appl. No. 2200000954) shall be responsible for compliance with the Grid Code and other regulations of the Central Commission for the above additional generation capacity as 'Lead generator' in terms of clause (y)(ii) of Regulation 2.1. Further, M/s VFRPL shall submit the technical connection data i.r.o. above additional capacity for checking necessary compliances in timely manner so as to provide sufficient time for ensuring necessary compliances. M/s VFRPL noted the same. It was informed that M/s VFRPL has provided SCoD of additional generation capacity from 31.12.2031. However, as per GNA Regulations 5.2 (g), SCoD of additional capacity shall not be greater than 24 months from the date of issuance of in-principle grant and in case the SCoD falls before firm start date of connectivity of								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
additional capacity then SCoD shall be considered as firm start date of connectivity. As per in-principle intimation of connectivity granted to VFRPL, the tentative start date of SCoD 31.12.2030 (tentative). The start date shall be firmed up intimated at later stage after award of transmission system. Accordingly, in line with the GNA Regulations, it was agreed to grant the above capacity addition under regulation 5.2 of GNA Regulations with SCoD of 31.12.2030 (tentative) & the same shall be subject to availability of Transmission system for connectivity granted to App. No. 2200000954 (250 MW). Further, it was also informed that upon firming up of start date of original connectivity (App. No. 2200000954 – 250 MW), above SCoD for additional capacity shall be aligned with the firm start date of connectivity. M/s VFRPL agreed the same. Further, it was also informed that the final grant intimation to VFRPL for App. No. 2200000954 is being issued shortly by CTUIL. As per regulations, only connectivity grantees are eligible for grant under 5.2. Therefore, the intimation for grant under 5.2 shall be issued only after issuance of final grant & subsequent signing of Connectivity Agreement. It was also informed that M/s VFRPL need to comply with the requirements mentioned in Reg. 37.10(d) (i to iv) as below within the timelines as per regulations: (i) SCoD (ii) Conn BG1 Rs. 50 lakh & Conn BG3 of Rs. 2 lakh/MW as per 5.2(e) (iii) Documents as per 5.2(h) (iv) Maximum drawl from the grid required for BESS Upon compliance as per (i), (iii) & (iv) above, in-principle intimation for grant of connectivity to additional capacity (150 MW BESS)) within the connectivity quantum shall be issued. Further, as informed earlier, the maximum drawl permitted for BESS shall be intimated at the later stage (with requirement of additional Conn BGs (if applicable)). M/s VFRPL noted the same.								

Sl. No.	Application No. & Date	Applicant	Project Location	Nature of Applicant	App. No. & Conn. Quantum (MW) of already granted Connectivity	Planned additional capacity (MW)	Date from which additional generation capacity will be added	Connectivity Granted at
4.	2200002394 (05-09-2025)	Vismaya Four Renewables Private Limited	Bikaner distt. Rajasthan	Generating station(s), including REGS(s), without ESS	2200000910 (250 MW)	240(BESS)	01.10.2031	Bhadla-IV PS
It was informed that Vismaya Four Renewables Private Limited has applied for addition of generation capacity (240 MW BESS) under regulation 5.2 of GNA Regulations, 2022 within the same connectivity quantum earlier granted at Bhadla-IV PS under App. No. 2200000910 (250 MW). In this regard, it was informed that, the above application shall be taken up for grant at later stage after finalisation & approval of transmission system for connectivity at Bhadla-IV PS by competent authority. M/s Vismaya Four Renewables Private Limited agreed for the same.								

It was also informed that, upon compliance of above applicants in line with GNA Regulations 3rd Amendment, the Solar Hour and Non-Solar Hour access granted to the original Connectivity applications shall be revised as per 5.11(b) of GNA Regulations.

B1. GNA_{RE} application by Hindustan Zinc Ltd. (180 MW) deferred in 41st CMETS NR meeting:

SI No.	Application No. & Date	Name of the Applicant	Nature of applicant	GNA _{RE} within Region (MW)	GNA _{RE} outside Region (MW)	Total GNA _{RE} Required (MW)	Start date of GNA _{RE}	End date of GNA _{RE}
1.	2200002025 (17.05.2025)	Hindustan Zinc Limited	Bulk consumer seeking to connect to ISTS directly	5	175	180	01.02.2027	31.01.2052

It was informed that, in the 41st CMETS NR meeting, Hindustan Zinc Limited(HZL) was asked to explore the feasibility of getting interconnected at 765/400 kV Beawar substation at 220 kV level by installation of 2x500 MVA 400/220kV ICTs at Beawar S/s under the scope of HZL (to be constructed & maintained either by HZL or by a ISTS licensee at the cost of M/s HZL).

Subsequently, HZL vide mail dated 30.10.2025 agreed for grant of GNA_{RE} with interconnection at Beawar S/s at 220 kV level. Considering the same, studies were carried out and from the studies, it is observed that the power flow is in order in base case as well as N-1 contingency scenarios. Details of studies are enclosed in **Exhibit-I**.

Accordingly, it was proposed to grant 180 MW GNA_{RE} to HZL at 220 kV level of Beawar S/s with creation of 220 kV level along with augmentation of 2x500 MVA, 400/220 kV ICTs at Beawar S/s under the scope of HZL(to be constructed & maintained either by HZL or by a ISTS licensee at the cost of M/s HZL)as per 12.5 of GNA Regulations.

Details of Transmission System for Grant of GNA_{RE}:**A. Dedicated Transmission system for GNA_{RE} (to be constructed and maintained by HZL or by an ISTS licensee at the cost of HZL):**

- (i) Creation of 220 kV level along with augmentation of 2x500 MVA 400/220 kV ICTs at 765/400 kV Beawar S/s
- (ii) 220 kV Hindustan Zinc Ltd. (Rampur-Agoocha) Switchyard– Beawar S/s D/c line along with associated bays at both ends (suitable to carry minimum 300 MW per circuit at nominal voltage)

B. Common Transmission system for GNA_{RE} (under ISTS):

- (i) Establishment of 2x1500 MVA 765/400 kV Beawar S/s(under construction)
- (ii) LILO of 400 kV Kota – Metra Line at Beawar S/s(under construction)
- (iii) LILO of 765 kV Chittorgarh-Ajmer D/c line at Beawar (under construction)
- (iv) 765 kV Fatehgarh-III PS – Beawar D/c line (under construction)

Start date of GNA_{RE}: 01.02.2027 (subject to availability of Common transmission system)

End date of GNA_{RE}: 31.01.2052

As per 22.2(b-i), applicable Conn BGs (Conn BG-1: Rs. 50 lakh & Conn BG3: Rs. 2lakh/MW) are to be submitted by M/s HZL within one month from the date of intimation. M/s HZL noted the same.

No comments or observations were received regarding the above proposal. Accordingly, it was agreed to grant GNA_{RE} to Hindustan Zinc Ltd with interconnection at Beawar S/s at 220 kV. It was also informed that M/s Hindustan Zinc agreed to the same.

SI No.	Application No. & Date	Name of the Applicant	Nature of applicant	GNA _{RE} within Region (MW)	GNA _{RE} outside Region (MW)	Total GNA _{RE} Required (MW)	Start date of GNA _{RE}	End date of GNA _{RE}
In the meeting, HZL enquired about the status of Common transmission system (CTS). In this regard, CTUIL informed that the CTS is currently under implementation by M/s Sterlite and is expected date of commissioned in Mar'26 as per latest JCC meeting held in Sep'25. HZL noted the same. Further, it was also informed that there is no provision for dual connectivity (both STU & ISTS) to Bulk consumer under Connectivity & GNA Regulations 2022. As HZL Rampur-Agoocha unit is presently connected with STU network of RVPN and seeking direct connectivity to ISTS, it is necessary to submit NoC from STU for disconnection from intra state network. Accordingly, M/s HZL was asked to expedite submission of NOC from RVPN for disconnection. Regarding, NoC HZL informed that they have submitted the request to RVPN and the same is forwarded by RVPN to AVVNL. They are expecting it to be received in a week time. Once received they shall submit the same to CTUIL. RVPN informed that they have forwarded the NoC request to AVVNL. They shall coordinate with M/s HZL and AVVNL and issue the same shortly. CTUIL informed that intimation for grant of GNA_{RE} shall be issued to HZL only upon submission of NoC from STU for disconnection. </s HZL & RVPN noted the same.								

Annexure-I

List of Participants of 42nd Consultation meeting for Evolving Transmission Schemes in NR held on 11-11-2025

CEA

Smt. Kavita Jha Director

CTUIL

Shri Sandeep Kumawat	DGM (CTUIL)
Shri Narendra Sathvik Ranganath	Ch. Manager (CTUIL)
Shri Shyam Sunder Goyal	Ch. Manager (CTUIL)
Shri Yatin Sharma	Manager (CTUIL)
Shri Madhusudan Meena	Engineer (CTUIL)
Shri Rishabh Bansal	Engineer Trainee (CTUIL)
Shri Jayesh Raikwar	Engineer Trainee (CTUIL)

RVPNL

SE (P&P)

PTCUL


Shri Ashok Kumar XEN

Connectivity/GNA Applicants

Shri Tushar Garg	Altra Xergi Power Private Limited
Shri Pritpal Singh	Altra Xergi Power Private Limited
Shri Ajay Sunkari	AM Green Energy Private Limited
Shri Shubham Kothari	Vismaya Five Renewables Pvt. Ltd, Vismaya Four Renewables Pvt Ltd
Shri Vikram Malkotia	Vismaya Five Renewables Pvt. Ltd, Vismaya Four Renewables Pvt Ltd
Smt Monalisha Dash	Juniper Green Cosmic Pvt. Ltd, Juniper Green Stellar Pvt. Ltd
Shri Pavan Kumar Gupta	Juniper Green Cosmic Pvt. Ltd, Juniper Green Stellar Pvt. Ltd
Smt Rasika Ghongade	Enren-I Energy Pvt. Ltd, Luceo Solar Pvt. Ltd, Khaba Renewable Energy Pvt. Ltd, Litsolaire Energy Pvt. Ltd
Mr Fahim Alam	Serentica Renewables India Private Limited
Shri Rahul Kumar	ACME Heergarh Powertech Pvt. Ltd, ACME Solar Holdings Limited
Shri Angshuman Rudra	Avaada RJBikaner Private Limited
Shri Dhir Singh	Solarcraft Power India 17 Pvt. Ltd, Solarcraft Power India 4 Pvt. Ltd
Shri Vinod Jaroli	Hindustan Zinc Limited

Exhibit-I

Summer Solar Max
Base Case

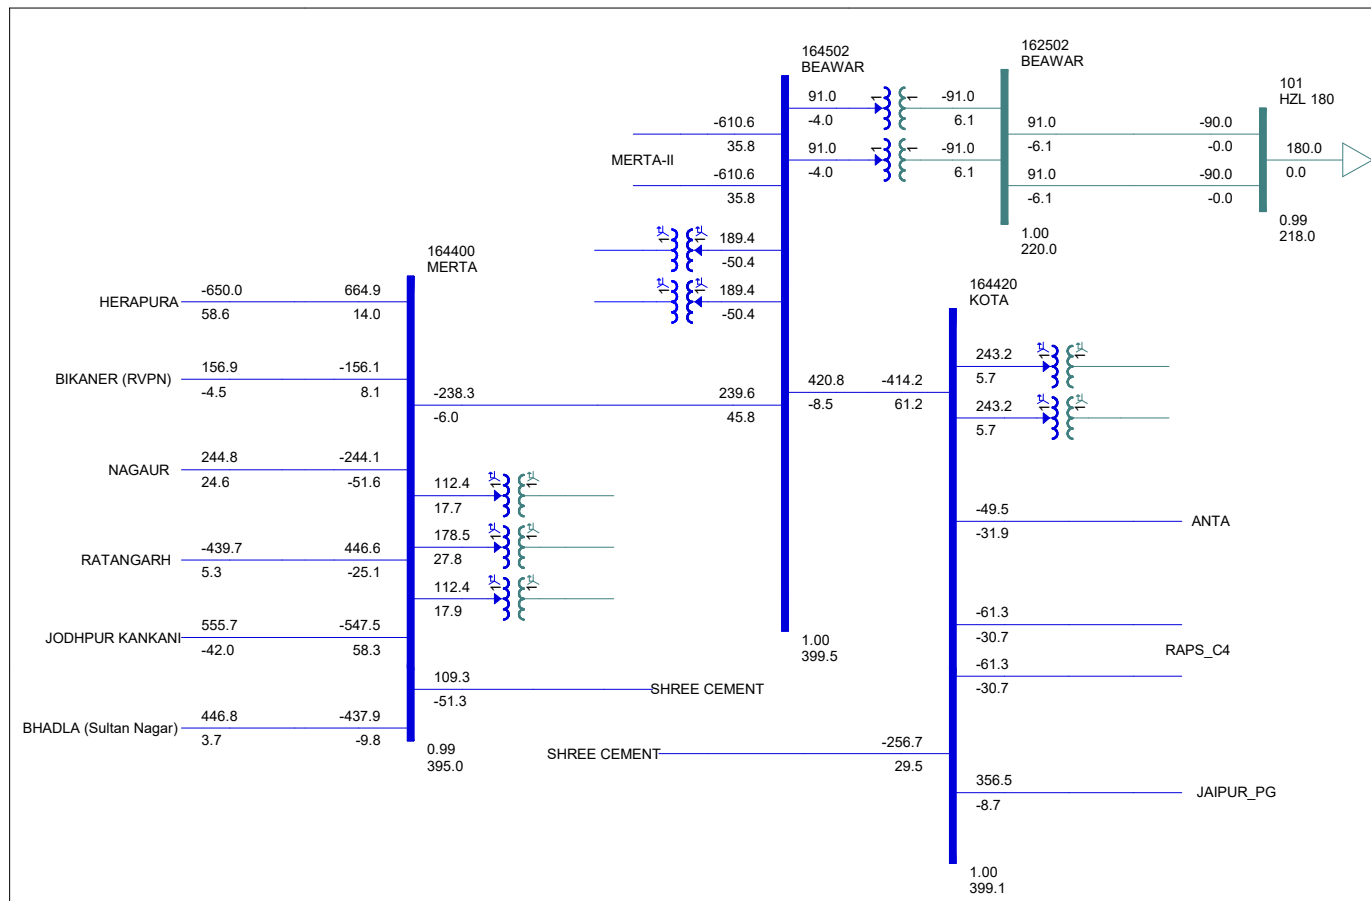

Summer Evening Peak Base Case

