


22 of 24 planned data center sites sit within 10 miles of a municipal treatment plant whose effluent could cover the peak-day cooling demand of at least 50 MW of IT load

10 of those 22 sites have an unverified location or source (dashed outline). Effluent is the median monthly DMR flow from July 2023 to June 2026 at the nearest eligible plant within 10 miles. Demand is the calibrated hybrid cooling model at 13,286 gal/day per MW of IT load on the peak day (Trenton weather, 2005 to 2024). 16 of 24 sites publish no capacity.

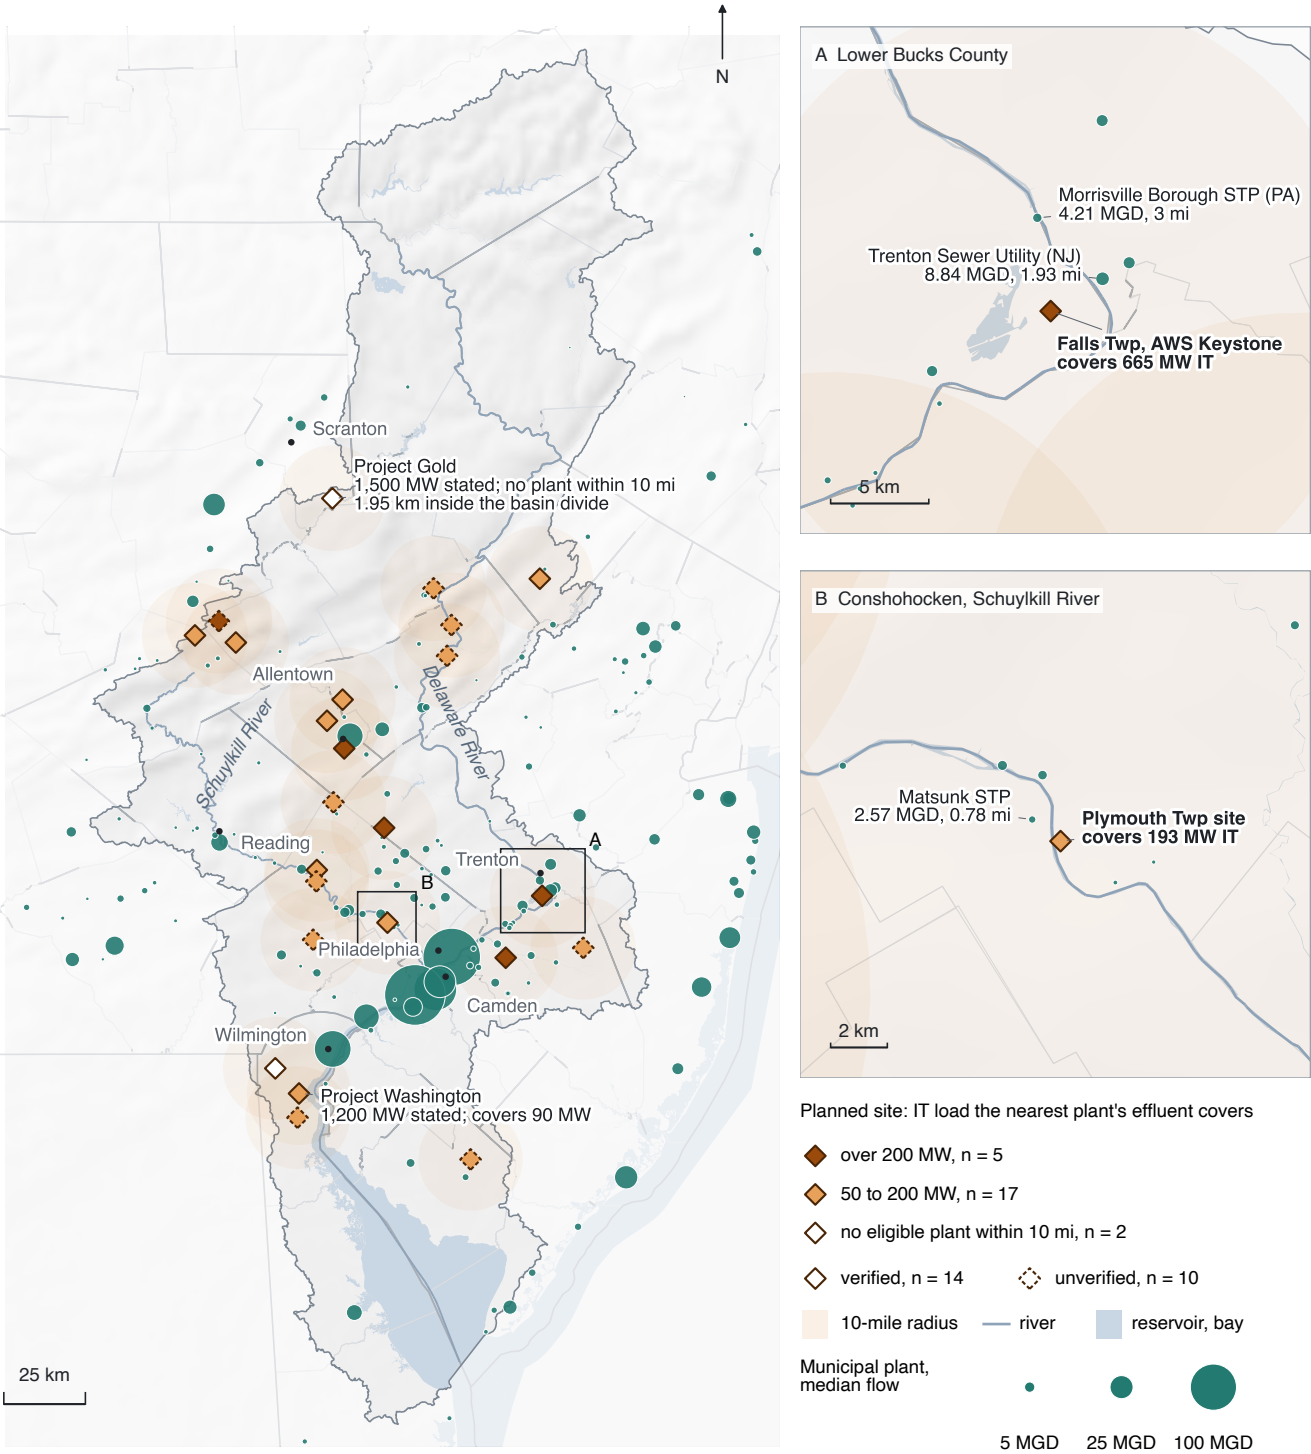

Sources: [trackdatacenters_2026]; [epa_echo]; [noaa_isd]; [stull_2011]; [falls_levittown_2026]; [usgs_wbd]; [usgs_nhdplus_hr]; [census_tiger]; [natural_earth]. Plotted values are in figures/supply_screen_map_data.csv.