


22 of 24 planned sites have a municipal plant within 10 miles whose effluent covers the peak-day cooling demand of at least 50 MW of IT load

IT load covered at peak day by the nearest eligible plant's median flow, calibrated hybrid cooling model.

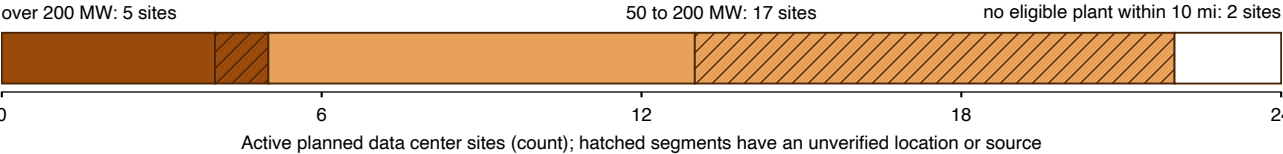

Sources: [trackdatacenters_2026]; [epa_echo]; [noaa_isd]; [falls_levittown_2026]. Plotted values are in figures/supply_screen_bar_data.csv.