

Format No P013/MT/02

TEST REPORT

Rev. No.01

TEST REPORT ISSUED BY: **BHUBANESWAR LAB**
TEST REPORT NO.
TEST REPORT & ISSUE DATE:
DISCIPLINE : MECHANICAL TEST
CUSTOMER NAME & ADDRESS:
M/s. MONOATOM LABS Pvt. Ltd.

SAMPLE TESTED BY/AT: **BHUBANESWAR LAB**
BNR-1140-TR-793018
15/07/2025
GROUP NAME : BUILDING MATERIALS
PROJECT SITE ADDRESS:
M/s. MONOATOM LABS Pvt. Ltd.

QUANTITY:
DATE OF RECEIPT:
CUSTOMER REF. NO & DATE:
CONDITION OF SAMPLE ON RECEIPT:
SOURCE OF SAMPLE AS GIVEN BY CUSTOMER:
TEST METHOD:

1 No(s)
10/07/2025
Order No. 35 & Dated : 28-06-2025
Ok
Concrete Mix Design
IS 10262 : 2019, IS 456-2000 RA 2021 Amd-5, IS 9013 : 1978 RA 2013

CONCRETE MIX DESIGN REPORT

PERIOD OF TEST: 10/07/2025 TO 15/07/2025

1. STIPULATION FOR PROPORTIONING

GRADE DESIGNATION: M-20	TYPE OF CONCRETE: RCC
TYPE OF CEMENT : OPC-53	
MAXIMUM NOMINAL SIZE OF AGGREGATE: 20 mm	EXPOSURE CONDITION: MILD
WORKABILITY(SLUMP): 130 mm	METHOD OF CONCRETE PLACING: PUMPABLE

2. TEST DATA:

DATA OF INGREDIENTS

Ingredients	Type of material	Source of materials	Average Specific Gravity	Water Absorption, %	DLBD, kg/l
Coarse Aggregate	20 mm	Gudiakatni	2.89 (ssd condition)	0.16	1.54
	10 mm	Gudiakatni	2.89 (ssd condition)	0.38	1.54
Fine aggregate	Natural Sand	Mahanadi	2.62 (ssd condition)	0.73	1.54
Cement	OPC-53	Ultratech	3.13	-	-

RAW MATERIAL ANALYSIS USE FOR CONCRETE MIX

TYPE OF AGGREGATE : Natural Sand

IS SIEVE DESIGNATION (mm)	Percentage Retain Weight	Percentage Cumulative Retain Weight	Percentage Cumulative Passing Weight	Requirement of % Passing As Per IS 383 , Table No-9 for Fine Aggregate
10	0	0	100	100
4.75	0.7	0.7	99.3	90-100
2.36	2.7	3.4	96.6	75-100
1.18	11	14.4	85.6	55-90
0.6	31	45.4	54.6	35-59
0.3	33.5	78.9	21.1	8-30
0.15	19.2	98.1	1.9	0-10
CONFIRMS TO ZONE : II				

TYPE OF AGGREGATE : 20 mm

IS SIEVE DESIGNATION (mm)	Percentage Retain Weight	Percentage Cumulative Retain Weight	Percentage Cumulative Passing Weight	Requirement of % Passing As Per IS 383 , Table No-7 for Single Size Agg.



TEST REPORT NO. : BNR-1140-TR-793018

40	0	0	100	100
20	15.1	15.1	84.9	85 - 100
10	83.9	99	1	0 - 20
4.75	0.5	99.5	0.5	0 - 5


TYPE OF AGGREGATE : 10 mm

IS SIEVE DESIGNATION (mm)	Percentage Retain Weight	Percentage Cumulative Retain Weight	Percentage Cumulative Passing Weight	Requirement of % Passing As Per IS 383 , Table No-7 for Single Size Agg.
12.5	13.6	13.6	86.4	100
10	26.6	40.2	59.8	85 - 100
4.75	48.4	88.6	11.4	0 - 20
2.36	8.5	97.1	2.9	0 - 5

ALL IN AGGREGATE GRADING

IS Sieve DESIGNATION	Percentage passing and proportion of aggregates			As per table 10 of IS 383, percentage passing for All in aggregate grading (20 mm nominal size)
	20 mm	10 mm	River Sand	
	28.4%	30.9%	40.6%	
40		100		100
20		95.7		95 - 100
4.75		44.1		30 - 50
0.6		22.2		10 - 35
0.15		0.8		0 - 6

ALL IN AGGREGATE GRAPH

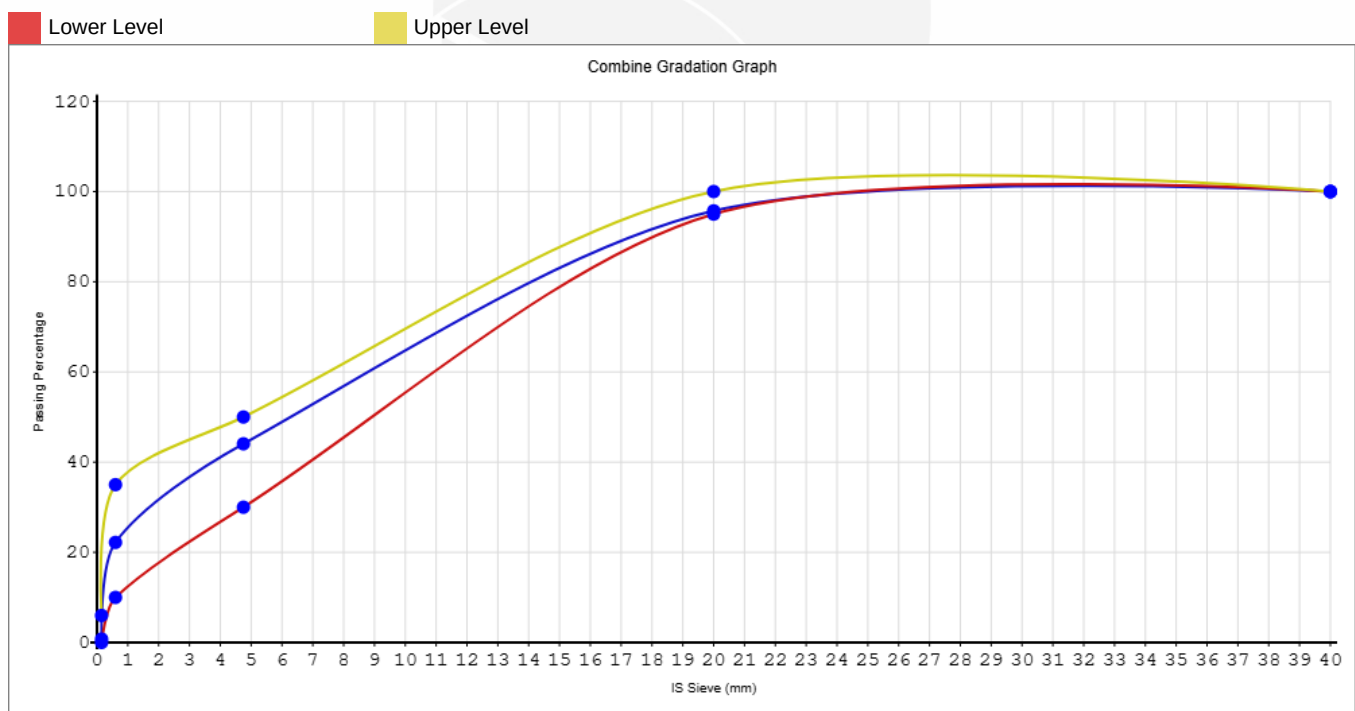

3. TARGET MEAN STRENGTH

a) $f_{ck}' = f_{ck} + 1.65S$: 26.6 N/mm²

where $f_{ck} = 20$ N/mm² and Standard deviation as per Table no. 2 clause no. 4.2.1.3 of IS 10262 for the grade of concrete M-20 (S) = 4.

b) $f_{ck}' = f_{ck} + X$: 25.5 N/mm²

where $f_{ck} = 20$ N/mm² and value of X as per Table no. 1 clause no. 4.2.1.3 of IS 10262 for the grade of concrete M-20 (S) = 5.5


The higher value is to be adopted. Therefore, target strength will be 26.6 N/mm² is higher than 25.5 N/mm²

TEST REPORT NO. : BNR-1140-TR-793018

4. AIR CONTENT: As Per Clause No 5.2 Table No. 3 of IS 10262 for Max Aggregate Size 20 mm & grade of concrete M-20 is 1%.
Volume of air content= 0.01 cum

5. SELECTION OF WATER CEMENT RATIO (based on trial experience & also referred figure-1 of IS 10262:2019 & table-5 of IS 456:2000):

Sr No	Adopted Water Cement Ratio (W/c)	Revised W/c
1	0.55	0.55

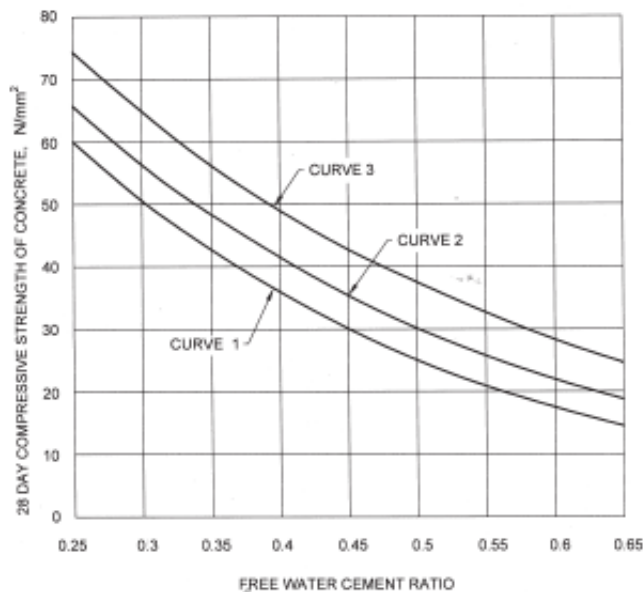

NOTES
1 In the absence of data on actual 28 days compressive strength of cement, the curves 1, 2 and 3 may be used for OPC 33, OPC 43 and OPC 53, respectively.
2 While using PPC/PSG, the appropriate curve as per the actual strength may be utilized. In the absence of the actual 28 days compressive strength data, curve 2 may be utilized.

FIG 1. RELATIONSHIP BETWEEN FREE WATER CEMENT RATIO AND 28 DAYS COMPRESSIVE STRENGTHS OF CONCRETE FOR CEMENTS OF VARIOUS EXPECTED 28 DAYS COMPRESSIVE STRENGTHS

6. ESTIMATION OF WATER CONTENT: As Per Clause No 5.3 Table No 4 of IS 10262:

- 6.1: For 50 mm slump using maximum aggregate size 20 mm and texture of aggregate Angular =186 kg
6.2: Addition of water for workability requirement @ 3% for each 25mm workability above 50 mm workability = 17.9 kg
6.3: Water content (Free Water) =204 kg

7. CALCULATION OF CEMENT CONTENT:

- 7.1: Adopted Water Cement Ratio (W/c)=0.55
7.2 Cement Content= 371 kg/m³
7.2a: Revised Water-Cement Ratio =0.55

7.3: Volume of cement used = 0.119 cum

TEST REPORT NO. : BNR-1140-TR-793018

8. ESTIMATION OF COARSE AGGREGATE AND FINE AGGREGATE CONTENT:

8.1: Calculation of Volume of Total Aggregate= 0.667 cum.

8.2: Estimation of Coarse Aggregate Content:

8.2.a: For w/c ratio 0.5 and Max Aggregate Size 20 mm and fine aggregate used of zone 2 as per Table No 5 of IS 10262 =0.62 * Volume of total aggregate.

8.2.b: Subtraction of coarse aggregate as per clause no 5.5.1 of IS 10262 for revised water cement ratio (0.55)= -0.01 * Volume of total aggregate.

8.2.c: Reduction of coarse aggregate as per clause no 5.5.2 of IS 10262 for pumpable mix @ 0% = 0 * Volume of total aggregate.

8.2.d: Reduction of Coarse Aggregate to get desired workability as per clause no 5.5.2 of IS 10262 = 0.04.

8.2.d.1: Volume of coarse aggregate per unit volume of Total Aggregate = 0.57.

8.2.e: Final Volume of coarse aggregate per unit volume of concrete = 0.38 cum.

8.2.1: Volume of 20 mm coarse aggregate used 48% volume of total coarse aggregate =0.182 cum.

20 mm coarse aggregate content =526 kg.

8.2.2: Volume of 10 mm coarse aggregate used 52% volume of total coarse aggregate =0.198cum.

10 mm coarse aggregate content =572 kg.

8.3: Calculation for Volume of Fine Aggregate Content: 0.287 cum.

8.3.a: Volume of Natural sand used 43 % volume of total aggregate: 0.287 cum.

8.3.b: Natural sand aggregate content: 752 kg.

9. Mix Calculation:

a) Total Volume of concrete: 1 cum.

b) Volume of Entrapped Air: 0.01 cum.

c) Volume of Cement: 0.119 cum.

d) Volume of Water: 0.204 cum.

e) Volume of Chemical Admixture: 0 cum.

f) Volume of Total Aggregate: 0.667 cum.

g) Mass of Coarse Aggregate: 1098 kg.

h) Mass of Fine Aggregate : 752 kg.

9.1 CONCRETE MIX PROPORTION USING SSD CONDITION AGGREGATE

Sr No	Ingredients	Material in kg/cum	Percentage proportion of aggregates in SSD condition	Material in kg/Cement bag	Material in Vol (L) / Cement bag	Aggregate by Farma of 35L Cap/ Cement Bag
1	Cement OPC-53	371	-	-		
2	SSD 20 mm	526	28.4	71	46	1.3
3	SSD 10 mm	572	30.9	77	50	1.4
4	SSD River Sand	752	40.6	101	66	1.9
5	Free Water	204	-	27	27.5	

NOTE - Aggregates shall be used in saturated surface dry condition. If otherwise, when computing the requirement of mixing water, allowance shall be made for the free (surface) moisture contributed by the fine and coarse aggregates. On the other hand, if the aggregates are dry, the amount of mixing water shall be increased by an amount equal to the moisture likely to be absorbed by the aggregates. Necessary adjustments are also required to be made in mass of aggregates.

10. CONCRETE MIX PROPORTION USING DRY CONDITION AGGREGATE

Sr No	Ingredients	Material in kg/cum	Percentage proportion of aggregates in DRY condition	Material in kg/Cement bag	Material in Vol (L) / Cement bag	Aggregate by Farma of 35L Cap/ Cement Bag
1	Cement OPC-53	371	-	-		
2	DRY 20 mm	525	28.5	71	46	1.3
3	DRY 10 mm	570	30.9	77	50	1.4
4	DRY River Sand	747	40.6	101	65	1.9
5	Total Water	212	-	29	28.6	



TEST REPORT NO. : BNR-1140-TR-793018

CONCRETE MIX DESIGN CUBE COMPRESSION TEST RESULTS (ACT BY BOILING WATER METHOD AS PER IS 9013:1978)

CUBE SIZE(mm): 150X150X150

DATE OF CASTING: 14-07-2025

AGE OF SPECIMEN(DAYS):1

DATE OF TESTING : 15-07-2025

Sr. No	Dimension of specimen, mm			Cross sectional area mm ²	Weight, kg	Accelerated Crushing Load, kN	Accelerated Compressive Strength MPa, (Ra)	Equi. 28 Days Comp., (R28=8.09 + 1.64 Ra) Strength, MPa	Type of Failure occurred as per IS 516 Part-1 Sec-1
	Length	Width	Thickness						
1	151.6	151.1	151.6	22905	8.655	233.3	10	24.5	Usual
2	151	151	151.2	22804	8.500	239.5	10.5	25.5	Usual
3	150.6	150.8	151.1	22711	8.587	226.8	10	24.5	Usual
Average Value =							10	25	

- Mix will require necessary moisture correction of water at site depending on the condition of aggregate (see clause No. 10.2.5 of IS 456:2016)
 - As per Clause No.10.2 of IS 456: 2016, Water shall be weighed or measured by volume in a calibrated tank for batching of concrete (see also IS 4925)
 - Mix will require necessary bulkgage correction for fine aggregate if volumetric batching.
 - As per Clause No.9.2.3 of IS 456: 2016, Mix design done earlier not prior to one year may be considered adequate for later work provided there is no change in source and the quality of the materials.
 - Dosage of Admixture is varied (+/- 0.2%) as per the working conditions, environmental conditions (temperature & humidity) and desired workability within the manufacturer recommendations. Performance of admixture shall be checked periodically at site
 - The bulk density and specific gravity of materials to be used shall be confirmed by testing of such materials from time to time. If any deviations in the above parameters are observed, suitable corrections for proportions shall be applied at site.
 - The coarse and fine aggregate used shall conform to the requirements given in IS 383:2016. The gradation shall be same as that used in the design mix.
 - This Certificate valid only to the sample submitted for testing
 - Any Correction or changes invalid this Certificate
- The authenticity of this report can be verified by scan QR Code to know your Report mentioned below.

*****End of Report*****


H. JOSHI
(Quality Manager)

Authorized Signatory