

# Producer statement cover sheet for Pool Fencing / Barrier

One cover sheet must be provided for each balustrade system

## PART 1: TO BE COMPLETED BY THE DESIGN PROFESSIONAL / MANUFACTURER SUPPLYING THE GLASS SYSTEM

|                                  |                      |
|----------------------------------|----------------------|
| Cover sheet issued on behalf of: | Royal Glass          |
| In respect of (system type):     | Mini Post Pool Fence |
| Supplied to:                     | Auckland Council     |
| Client / designers name:         |                      |
| Description of work:             |                      |
| Address of property:             |                      |

## PART 2: CONSTRUCTION DETAILS (tick boxes that apply)

|                                       |                                 |                                                                                                                                                                        |                                   |                                |                                         |
|---------------------------------------|---------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------|--------------------------------|-----------------------------------------|
| Deck / balcony / stairs construction: | <input type="checkbox"/> Timber | <input type="checkbox"/> Precast                                                                                                                                       | <input type="checkbox"/> Concrete | <input type="checkbox"/> Steel | <input type="checkbox"/> Please specify |
| Maximum fall height:                  | < 1 (m)                         | <b>Note:</b> If barrier is <u>not</u> protecting a fall of more than 1.0m, barrier required to be designed for wind load only – no additional safety features required |                                   |                                |                                         |

## PART 3: GLASS DETAILS (tick boxes that apply)

|                                                                                                  |                                    |                                              |                                                                    |
|--------------------------------------------------------------------------------------------------|------------------------------------|----------------------------------------------|--------------------------------------------------------------------|
| Type:                                                                                            | <input type="checkbox"/> Toughened | <input type="checkbox"/> Toughened laminated | <input type="checkbox"/> Toughened laminated with stiff interlayer |
| Thickness:                                                                                       | (mm)                               | Width of pane:                               | 1.8 (m)                                                            |
| Height above floor:                                                                              | (m)                                | Height above fixing:                         | (m)                                                                |
| <b>Note:</b> If barrier extends more than 1.2m above fixing point, test reports must be provided |                                    |                                              |                                                                    |
| Supplier:                                                                                        |                                    |                                              |                                                                    |

## PART 4: BARRIER DETAILS

|                            |                          |
|----------------------------|--------------------------|
| System name:               | Mini Post Pool Fence     |
| Drawings (ref page number) |                          |
| Engineers name:            | Lautrec Technology Group |
| Hardware (type):           | 316 Stainless Steel      |

Drawings must show the type of hardware being used to support the glass (i.e. channel, discs, etc.)

**PART 5: SAFETY FEATURES** (tick all boxes that apply; not required if fall height <1.0m)N/A ☐☐ Continuous interlinking rail (show how fixed to building and each pane of glass)☐ Continuous interlinking top cap (show how fixed to building and each pane of glass)☐ Clamps, brackets or point fixings (show how fixed to building and each pane of glass)☐ Framed with structural sealant min. 2 edges (show how fixed to building and each pane of glass)☐ Glass with stiff interlayer☐ Two or three glass edges supported by continuous clamps☐ Structural post to fix interlinking rail to deck☐ Other (specify)

Engineers name: Lautrec Technology Group

Drawings (ref page number)

Comments:

**PART 6: COVER SHEET COMPLETED BY**

Name: Roxy Huang

Signature: 

Date:

Contact number: 0800 769 254

Email: info@royalglass.co.nz

NAME:

ADDRESS:

DATE:

CONSENT AUTHORITY: Auckland Council



THIS PS1 DOES NOT CONSTITUTE A SITE SPECIFIC REVIEW BY THE ENGINEERING COMPANY BELOW AND IS ONLY APPLICABLE FOR STANDARD FIXINGS AND DESIGN PARAMETERS AS DETAILED IN THE RELEVANT MANUAL



LAUTREC  
CONSULTING ENGINEERS



association of  
consulting engineers



## PRODUCER STATEMENT – PS1 DESIGN

**BUILDING CODE CLAUSE(S):** B1, F2, F4, F9

**JOB NUMBER:** 1392-1803

**ISSUED BY:** Lautrec Technology Group Limited  
(Engineering Design Firm)

**TO:** Juralco Aluminium Building Products Ltd  
(Owner/Developer)

**TO BE SUPPLIED TO:** All Building Consent Authorities in NZ  
(Building Consent Authority)

**IN RESPECT OF:** Juralco Viking® Balustrade System  
(Description of Building Work)

**AT:** N/A (all locations within NZ Wind Zone)  
(Address, Town/City)

**LEGAL DESCRIPTION:**

N/A ☒

We have been engaged by the owner/developer referred to above to provide (Extent of Engagement):

Specific engineering design for structural components only

in respect of the requirements of the Clause(s) of the Building Code specified above for Part only, as specified in the Schedule, of the proposed building work.

The design carried out by us has been prepared in accordance with:

- ☒ Compliance documents issued by the Ministry of Business, Innovation & Employment (Verification method/acceptable solution) B1/VM1 and/or;
- ☒ Alternative solution as per the attached Schedule.

The proposed building work covered by this producer statement is described on the drawings specified in the Schedule, together with the specification, and other documents set out in the Schedule.

**On behalf of the Engineering Design Firm, and subject to:**

- Site verification of the following design assumptions: assumed adequate support structure by others
- All proprietary products meeting their performance specification requirements;

**I believe on reasonable grounds that:**

- the building, if constructed in accordance with the drawings, specifications, and other documents provided or listed in the Schedule, will comply with the relevant provisions of the Building Code and that;
- the persons who have undertaken the design have the necessary competency to do so.

I recommend the **CM1** level of construction monitoring.

I, (Name of Engineering Design Professional) Kevin Brown, am:

- ☒ CPEng number 140404

and hold the following qualifications BE, CMEngNZ, CPEng, IntPE(NZ), MBA

The Engineering Design Firm holds a current policy of Professional Indemnity Insurance no less than \$200,000

The Engineering Design Firm is a member of ACE New Zealand.

**SIGNED BY (Name of Engineering Design Professional):** Kevin Brown  
(Signature below):

**ON BEHALF OF (Engineering Design Firm):** Lautrec Technology Group Limited

Date: 05/02/2026

**Note:** This statement has been prepared solely for the Building Consent Authority named above and shall not be relied upon by any other person or entity. Any liability in relation to this statement accrues to the Engineering Design Firm only. As a condition of reliance on this statement, the Building Consent Authority accepts that the total maximum amount of liability of any kind arising from this statement and all other statements provided to the Building Consent Authority in relation to this building work, whether in tort or otherwise, is limited to the sum of \$200,000.

This form is to accompany **Form 2 of the Building (Forms) Regulations 2004** for the application of a Building Consent.

## **SCHEDULE to PS1**

Please include an itemised list of all referenced documents, drawings, or other supporting materials in relation to this producer statement below:

Structural Maintenance Schedule refer to the relevant Juralco product manuals

B2 Letter

Engineering Drawings                      **Refer to product manual Juralco Viking® Balustrade System Issue 1-25**

Engineering Calculations                  **Refer to PS1 Report - Juralco Viking® Balustrade System\_11.02.25**

Alternative Solution

The design carried out by Lautrec Technology Group Limited has been prepared in accordance with the following alternative solutions:

**NZS1170.2:2021 Incorporating Amendment No. 1**

**AS/NZS 1664.1:1997**

**NZS AS 1720.1:2022**

**NZS 3101:2006**

**NZS 3404:1997**

**EOTA TR 049 and EN1992-4:2018 for post-installed anchor design**

**NZS 4223.3:2016**

**NZS 4223.4:2008**

**NZS 8500:2016**

11/02/2025

To the Building Official,

**B2 COMPLIANCE - JURALCO VIKING® BALUSTRADE SYSTEM**

at occupancy categories A, B, E, and C3; at any location in New Zealand that falls within the scope of this PS1 - see supporting PS1 report for scope

We have been asked to provide a PS1 for Clause B2 of the Building Code - Structural Durability

We are not able to provide this because there is no effective verification method for B2 contained within the New Zealand Building Code.

As these systems can be installed in a variety of settings, including internal and exposed environments, it is not deemed practical to specify durability requirements for the sub structure. Timber treatments, mild steel corrosion protection coatings, and concrete and masonry covers are therefore up to the building designer to specify in accordance with the relevant recognised standards.

However, we can confirm that for the structural elements shown in the attached documentation:

| Material                                                          | Means of compliance  | Details                                                                                                                                                                                                                                                                                                                                                                                                                                  |
|-------------------------------------------------------------------|----------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Juralco Viking® Balustrade System - Aluminium and Stainless Steel | Alternative Solution | <p>Stainless steel components conform to SS316.</p> <p>Aluminium extrusions, components, and hardware conform to 6060 T5.</p> <p>Non-structural cladding has a durability requirement not less than 50 years for this project.</p> <p>Note that the industry proven life of Aluminium, Stainless Steel, and Glass would satisfy a 50-year design life requirement.</p> <p>We note that this is on a time to first maintenance basis.</p> |
| Connections - Stainless Steel fixings                             | Alternative Solution | <p>All bolt and screw fixings within Juralco Viking® Balustrade System shall be minimum SS316.</p> <p>Non-structural fixings that are difficult to replace has a durability requirement not less than 50 years for this project.</p> <p>Note that the industry proven life of Stainless Steel would satisfy a 50-year design life requirement.</p>                                                                                       |

It is assumed that these structural elements are fixed to adequate structures by others.

Minor tea staining may occur in coastal environments. Refer to Juralco Viking® Balustrade System manual issue 1-25 v1 for the supplier's maintenance requirements.

Yours faithfully,

Managing Director  
Kevin Brown  
BE, CMEngNZ, CPEng, IntPE(NZ), MBA



**Complies With AS/NZS 1170:2002, NZS 4223.3.2016, NZ Building Code B1, B2, F2 ,F4 and F9  
Complies with French Standard NF P01-013 (1988-08)**

**Viking® Balustrade is for Occupancy types A, A Other and C3 only  
Occupancy Types as per AS/NZ 1170.1.2002.**

| Code        | Type of Occupancy for part of the building or structure                        | Specific Uses                                                                                                                             | Glass                        |
|-------------|--------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------|------------------------------|
| A           | Domestic and Residential activities                                            | All areas within or serving exclusively one dwelling including stairs, landings etc, but excluding external balconies and edges of roofs. | 6mm and 10mm Toughened Glass |
| A Other, C3 | Areas without obstacles for moving people and not susceptible to over crowding | Stairs, landings, external balconies, edges of roofs etc.                                                                                 |                              |

**Note 1** All for 6mm and 10mm, Toughened Glass. Glass must have a minimum strength of 100MPa. All edges polished

**Note 2** Juralco Balustrade Systems building code compliance documentation requires all balustrade installations are to be completed in accordance with the requirements of our authorised installer certification.

**Note 3** All Semi Frameless glass Balustrades must have a Top or Side mounted handrail to conform to NZS 4223.3.2016.

**masterspec partner**  
Section 4852JB

## Index

| Heading                     | Pages   | Description.                                                                       | <a href="#">Use the Bookmarks</a>  <a href="#">List to jump to selected pages</a> |
|-----------------------------|---------|------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Specifications              | 4       | Juralco standard Specification sheet and Powder coating recommendations            |                                                                                                                                                                        |
| Configurations              | 5 - 7   | Shows typical Glass and Baluster Balustrade layouts                                |                                                                                                                                                                        |
| Materials                   | 8 - 13  | Shows all Extrusions and components                                                |                                                                                                                                                                        |
| Viking Gates                | 14 - 16 | Shows Gate Components and Glass, Baluster layouts                                  |                                                                                                                                                                        |
| Interlinking Rail           | 17      | Shows the Interlinking Rail mounter to a JEC29 Bracket                             |                                                                                                                                                                        |
| Design Guide                | 18 - 19 | Balustrade Height and Post Spacing for differing Building Areas                    |                                                                                                                                                                        |
| Constructions               | 20 - 21 | Shows Typical Joints                                                               |                                                                                                                                                                        |
| Assemblies                  | 22 - 25 | Shows Typical Assemblies                                                           |                                                                                                                                                                        |
| Post Mount Types            | 26      | Shows the Three Post mount types                                                   |                                                                                                                                                                        |
| Mountings                   | 27 - 44 | Shows Mounting details - For Timber (p27-31), Steel (p28-37) and Concrete (p38-42) |                                                                                                                                                                        |
|                             | 45 - 50 | Shows Mounting details. Older Timber structures pre NZS3604:2011                   |                                                                                                                                                                        |
| Post to Rail                | 51      | Shows Post to Rail connections                                                     |                                                                                                                                                                        |
| Setouts. Glass and Baluster | 52 - 69 | Setouts for 6mm Glass (p50-55), 10mm Glass (p56-61), 17mm Baluster (p62-67)        |                                                                                                                                                                        |
| Corners. Glass and Baluster | 70 - 71 | Setouts for 6mm and 10mm Glass (p68), 17mm Baluster (p69)                          |                                                                                                                                                                        |
| Surface Care                | 72 - 73 | Instructions for the care of Powder coated and Glass surfaces                      |                                                                                                                                                                        |

### Specifications for Juralco Viking® Balustrade System

#### 1.Scope

- This specification details the documents the Juralco Viking® Balustrade System refers to in relation to the New Zealand Building Code, the manufacturer's documents, products used in the System, requirements in relation to fixing and surface finishings.

#### 2. NZBC Compliance

- The Juralco Viking® Balustrade System has been reviewed by Lautrec Technology Group Ltd, to demonstrate compliance with the structural requirements of the New Zealand Building Code and AS/NZS 1170 : 2002 occupancy A, A Other and C3. NZS 3604 Wind Zones, up to and including Low, Medium, High, Very High and Extra High.
- The Structural Engineering design includes the requirements of B1 Structure, B2 Durability, F2 Hazardous Materials and F4 Safety from falling, from the Building Code.
- Verification Method B1 / VM1, B2/AS1, F4 / AS1
- All glass used in the Juralco Viking® Balustrade System must conform to AS/NZS 2208.
- Complies with NZS 4223.3.2016

#### 3. Manufacturer's Documents

- The Juralco Viking® Balustrade System manual details all extrusions and components used for the fabrication and installation/fixing of the system.
- A Producer Statement 1(Design) is available.  
Copies of the above documents are available from:  
Juralco Aluminium Building Products Ltd  
48 Bruce McLaren Rd, Henderson, Auckland  
Phone 09 478 8018 Fax 09 478 7883 Email [specify@juralco.co.nz](mailto:specify@juralco.co.nz)
- Any deviation from the standard fabrication or installation/fixing must be accompanied by a site specific PS1 with site specific calculations and drawings

#### 4. Products

- Only extrusions, components and hardware supplied by or specified by JABP may be used in the Juralco Viking® System
- Aluminium extrusions, components and hardware – unless specified are manufactured to 6060 T5 or T6 specifications
- Stainless Steel components, hardware, fixings – all components to 316 grade
- Glass - all glass used in the Juralco Viking® Balustrade System must conform to the specifications as listed in the Juralco Viking® manual with each panel conforming to AS/NZS 2208 as confirmed by the Safety Stamp detailing the manufacturer's description and licence number.

#### 5.Surface Finishing

- Juralco Aluminium Building Products Ltd is a Dulux Registered Applicator site, registration number 2101.  
JABP uses only Dulux branded powder coating materials
- Dulux Duralloy® powder coating systems are suitable for properties greater than 100m from high tide level  
AAMA 2603 performance. Residential buildings, 3 levels max. Warranty 10 yrs
- Dulux Duralloy Plus® powder coating systems are suitable for properties greater than 10m from high tide level.  
AAMA 2603 performance. Residential and Light commercial buildings, 3 levels max Warranty 15 yrs
- Dulux Duratec® powder coating systems are suitable for properties greater than 10m from high tide level  
AAMA2603 and 2604 performance. All Residential and Commercial buildings. Warranty 25 yrs

#### 6. Installation and Fixing

- The Juralco Viking® Balustrade System must only be installed in accordance with the Juralco Viking® Balustrade System manual
- Any deviation from that specified in the Juralco Viking manual must only be in accordance with the site specific PS1 with site specific calculations and drawings listing the non standard details
- The Juralco Viking® Balustrade System must only be fabricated/installed by a Juralco approved fabricator
- Upon completion of the installation the fabricator must supply the owner with a PS3 (Construction)

#### **Important information - Powder Coating systems.**

**Powdercoat Systems** The new standard Dulux powder coating system used by Juralco is Duralloy Plus®. Also Duralloy® and Duratec®. All as per specs above. Juralco Powder coated prices are for Duralloy Plus® and Duralloy® (same pricing). Duratec® prices on application.

**Attachment to structures** A PVC Tape or similar material spacer must be used to separate powder coated aluminium items from all concrete and steel structures. Failure to do so can lead to the chemicals in the structure affecting the powder coating, leading to corrosion.

**Swimming Pools** The chlorinated water in swimming pools can cause the deterioration of powder coated surfaces, leading to corrosion of the underlying surface. It is recommended that Powder coated surfaces be 1200mm min from a pool.




**Care** The Dulux powder coating warranty period is conditional upon the surface being maintained in accordance with the Dulux 'Care and Maintenance Instructions'. Download from Dulux or refer to the back page of this manual.



**For 17mm Baluster**



**17mm Baluster - Split Rail. Handrail + Top and Bottom Rail.**

Balustrade Height, 1000mm min, 1275mm max above FFL.

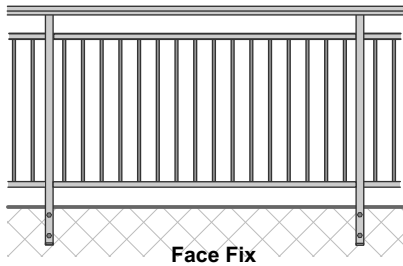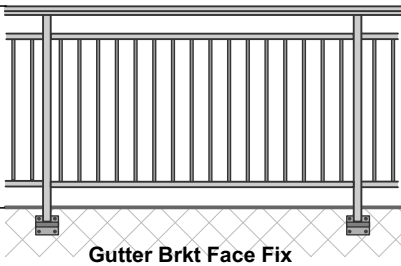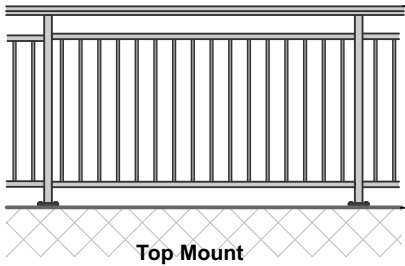


**17mm Baluster - Full Height. Handrail + Bottom Rail.**

Balustrade Height, 1000mm min, 1275mm max above FFL.

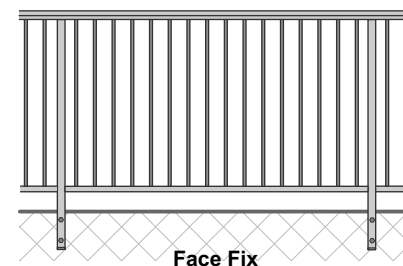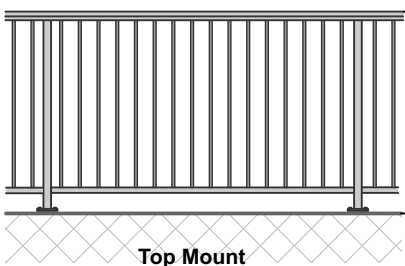


**For JA/160 50mm dia Aluminium Tube + wall Brackets**

Handrail Bracket JVB116  
(Curved, Side Fix)



Handrail - Wall mount. Could be Horizontal or for Stairway

Handrail Bracket JVB117  
(80mm Top fix)




Handrail - Nib Wall mount. Could be Horizontal or for Stairway



**Juralco Viking® Balustrade System Stair Setouts, Construction**

Viking Balustrade  
Face Fix shown

Typical Stair installation  
Fixings into Single or Double Joists/Stiffeners, Concrete or Steel

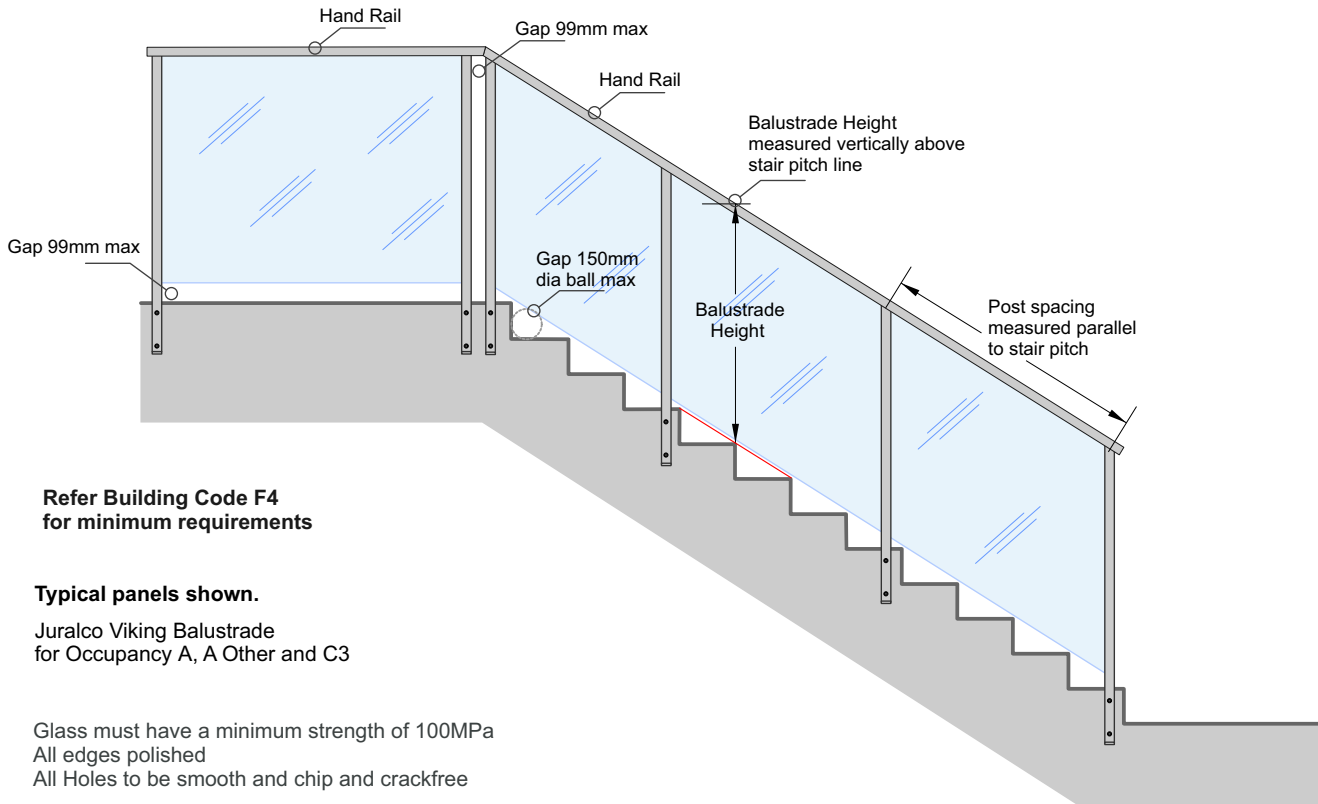

**Refer Building Code F4  
for minimum requirements**


**Typical panels shown.**

Juralco Viking Balustrade  
for Occupancy A, A Other and C3


Glass must have a minimum strength of 100MPa  
All edges polished  
All Holes to be smooth and chip and crackfree

Viking Balustrade  
Stair Stringer Detail


Stair structure to be designed by others to resist Balustrade actions as per NZS1170.1 Table 3.3  
Applicable to Occupancy A only unless Project Engineer ensures it can support appropriate balustrade loads

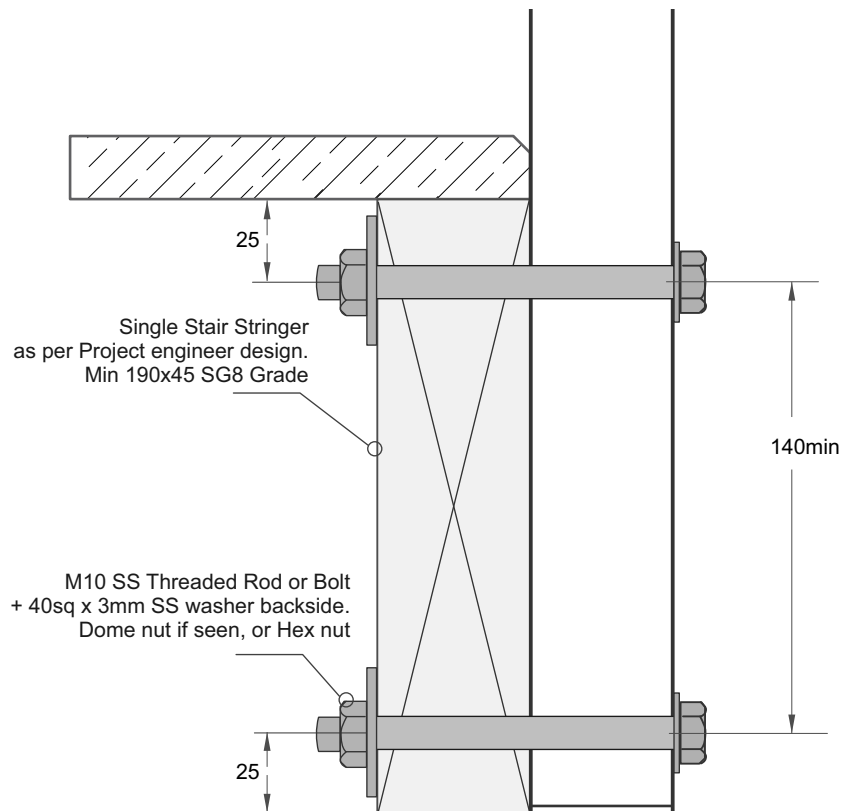


Handrails below suitable for Private and Common Stairways, but **NOT** suitable for Accessible Stairways

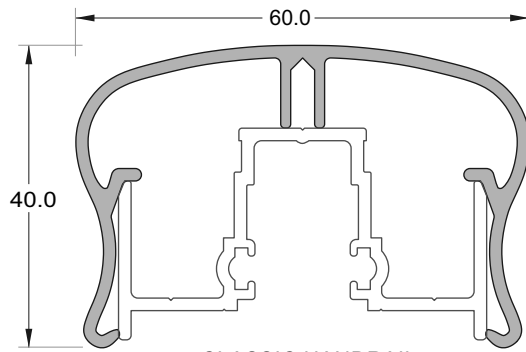


**CLASSIC HANDRAIL**  
 JVB/001/5.8

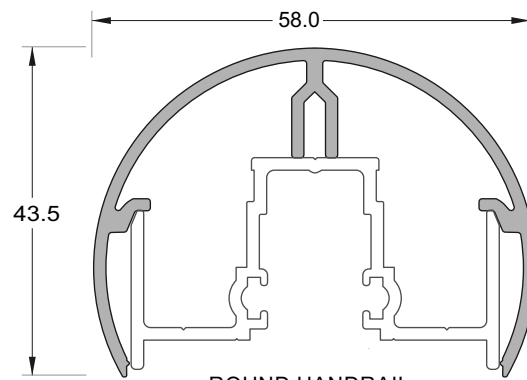


**ROUND HANDRAIL**  
 JVB/009/5.8

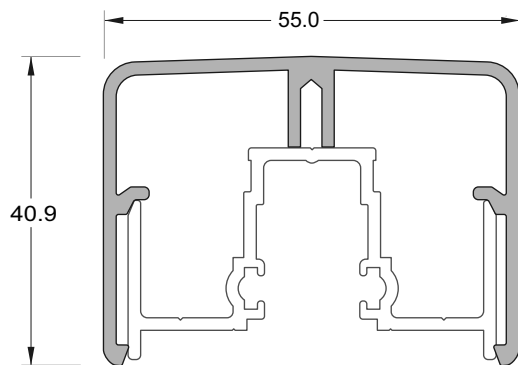


**RECTANGULAR HANDRAIL**  
 JVB/016/5.8

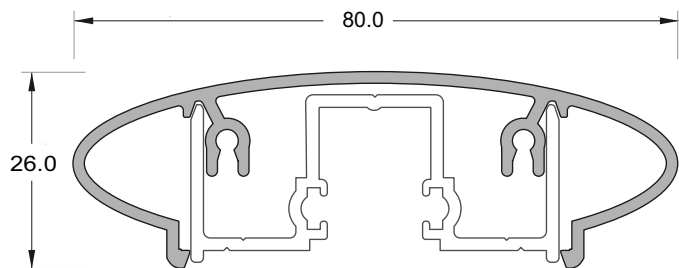


**ELLIPTICAL HANDRAIL**  
 JVB/024/5.8

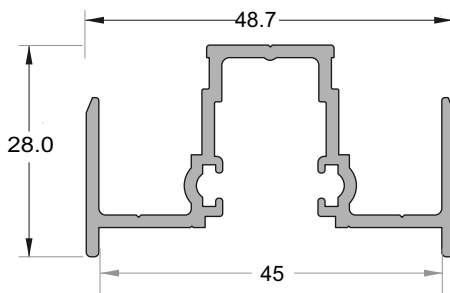

**TOP RAIL**  
 JVB/004/5.8











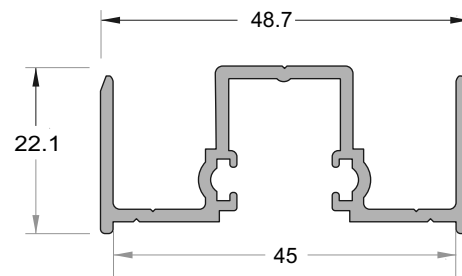



**ELLIPTICAL TOP RAIL**  
 JVB/023/5.8

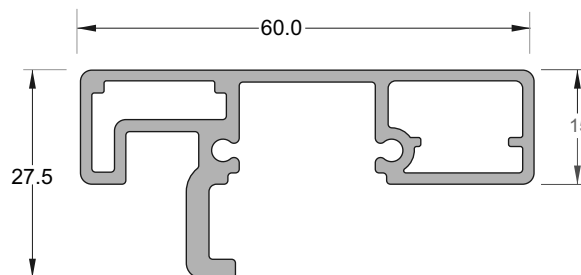


**INTERLINKING RAIL**  
 JEB/222/5.8

**Note - For use with JEC 29 Handrail Bracket**  
 - Infill clips not used with the JEB 222

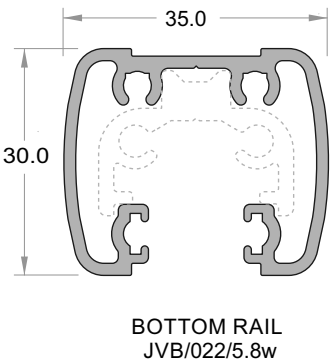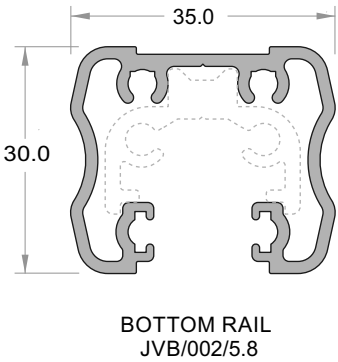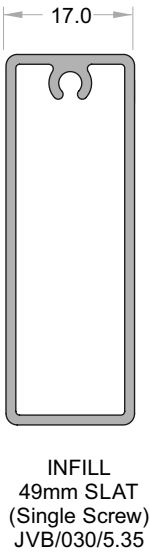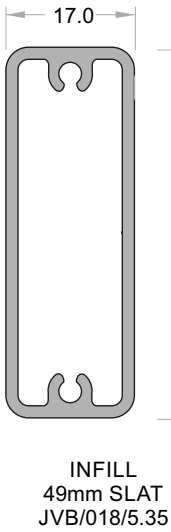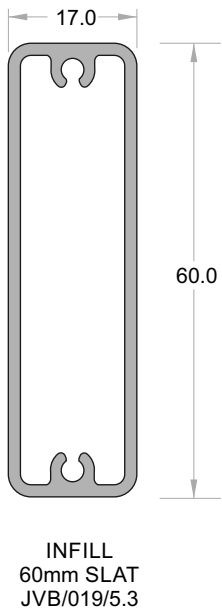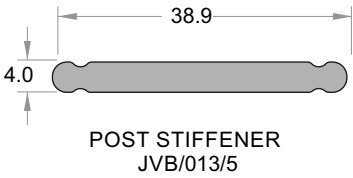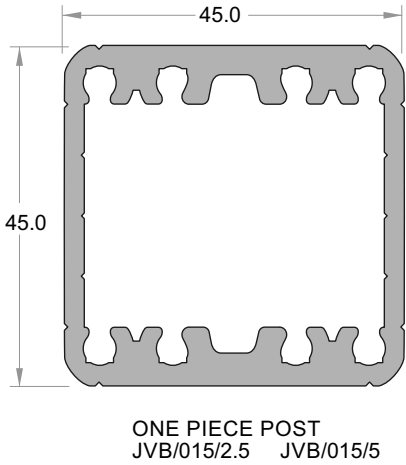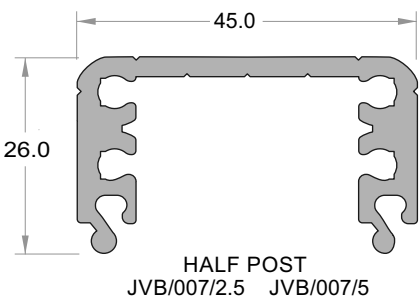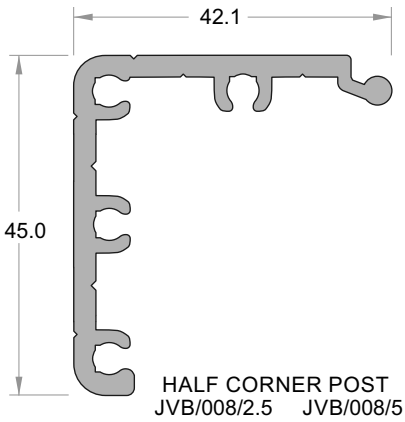


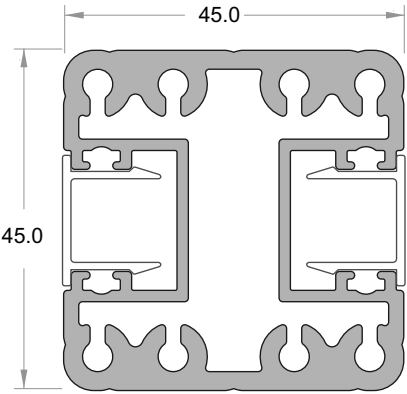


**FRAMELESS POST**  
JVB/011/2.5 JVB/011/5

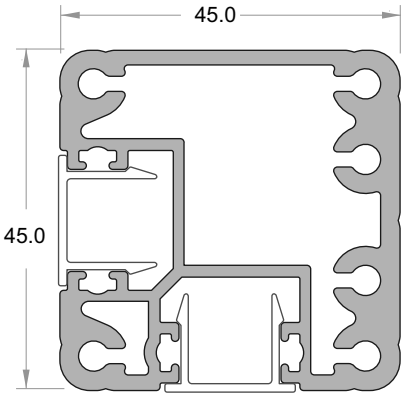


**FRAMELESS CORNER POST**  
JVB/012/2.5 JVB/012/5




**BALUSTER**  
JVB/005/5.35




**FRAMELESS POST CAP**  
JVB/006



**SEMI FRAMELESS  
POST STIFFENER**  
JVB/020/5

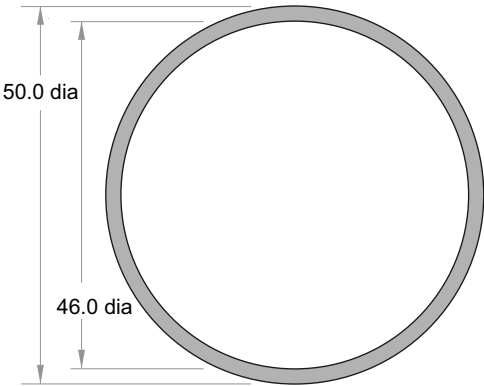


**HANDRAIL**  
JA160/5

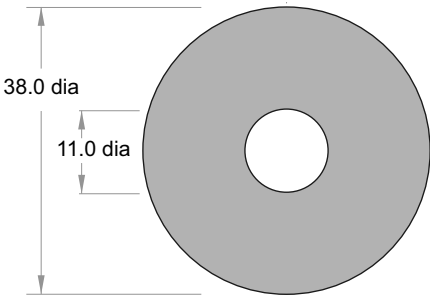


**SPACER LENGTH**  
JVB/125/1000

Base Plate  
JVB100




100mm x 100mm x 12mm - 4 x holes

Base Plate  
JVB100/Blank




100mm x 100mm x 12mm - 4 x holes

Base Plate  
JVB121




110mm x 90mm x 12mm - 4 x holes

Base Plate  
JVB121/Blank




110mm x 90mm x 12mm - 4 x holes

Gutter Bracket  
JVB137/45




120mm wide x 135mm high

Base Plate  
JVB101




110mm x 90mm x 12mm - 2 x holes

Base Plate  
JVB101/Blank



110mm x 90mm x 12mm - 2 x holes


Gutter Bracket Spacer  
JEC139



135mm x 120mm x 5mm - 4 x holes


**Components**

Handrail Corner Joiner 90deg  
JVB150




Legs 70mm long x 9mm wide  
x 3mm thick

Handrail Corner Joiner 90deg  
JVB151




Legs 100mm long x 11mm wide  
x 3mm thick

Handrail Corner Joiner 135deg  
JVB152




Legs 70mm long x 11mm wide  
x 3mm thick


Classic End Cap  
JVB105




Round End Cap  
JVB113




Rectangular End Cap  
JVB129




Elliptical End Cap  
JVB140



Top Rail Wall Bracket  
4.5mm thick JVB103




Glass Setting Angle  
JVB118




30mm x 30mm Angle x 12mm wide


Frameless Post-top Cap  
JVB115



Post End Cap  
JVB104



Bottom Rail Wall Bracket  
3mm thick JVB102




4mm Glass Setting Block  
Part No JVB119




4mm x 8mm x 30mm long

Glazing Block 50mm  
JVB108




17mm x 9mm x 350mm long

Handrail Bracket JVB116  
(Curved, Side Fix)




Satin or SCC finishes

Handrail Bracket JVB117  
(80mm Top fix)



Satin or SCC finishes

50.8mm dia Handrail End Cap  
JGS 132



SCC finishes

**Components**

PK SCREW SS  
JVBScrew/10x6



Top Rail  
to Handrail  
Pan SQ drive

PK SCREW SS  
JVBScrew/25x6



Bottom Rail  
to Baluster  
Pan SQ drive

PK SCREW SS  
JVBScrew/38x6



Top Rail  
to Baluster  
C/S SQ drive

PK SCREW SS  
JVBScrew/25x8



Post to  
Bottom Rail  
Pan SQ drive

PK SCREW SS  
JVBScrew/25x10



Top Rail  
to Post  
Pan SQ drive

PK SCREW SS  
JVBScrew/50x10




Attaching Post to Base plate  
or Gutter Bracket  
C/S SQ drive. High Tensile


COACHSCREW SS  
JVBCoach/M10x160

COACHSCREW SS  
JVBCoach/M10x180

COACHSCREW SS  
JVBCoach/M10x200

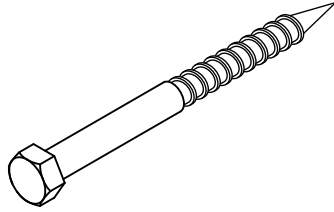

Square Washer  
JVBSqwsh/40x40x3



SS 40mm sq x 3mm

Round Washer  
JVBSqwsh/21x2



SS 21mmdiax11x2mm thick

Face Fix Spacer  
JVB125/30mm


Face Fix Spacer  
JVB125/15mm

Face Fix Spacer  
JVB125/10mm


EPDM Washer  
JVB126

EPDM Washer  
JVB130

All For M10 SS  
Coachscrews  
or Bolts



Aluminium  
38mm dia  
x 30mm long.



Aluminium  
38mm dia  
x 15mm long.



Aluminium  
38mm dia  
x 10mm long.




For M10 Fastener  
38mm dia  
x 3mm




For M10 Fastener  
20mm dia  
x 1.6mm

SIKA Supergrip  
JEC SUPERGRIP30




For All Coachscrews fixings

Rhodorsil V60 Clear Silicone  
H/RTV419098




Construction Silicone

Foam Tape 100mm x 4.8mm  
JVB/FTAPE100




Base Plate Separator  
for Concrete and Steel  
Single sided 100mm wide x 15.2mt Roll

BULB SEAL  
JVB/Bulbseal




300m Roll, Black

GLAZING WEDGE  
JVBWedge/Brown




6mm Glass Wedge 75m Roll, Black

BACKING WEDGE  
JVB/BackWedge500



500m Roll, Black


Foam Tape 38mm x 4.8mm  
JVB/FTAPE38



Face fix Post Separator  
for Concrete and Steel  
Single sided 38mm wide x 15.2mt Roll


HANDRAIL BRACKET KIT  
JEC 29/Kit

Includes 2 x grub screws  
(For use with Interlinking  
Rail Extrusion)

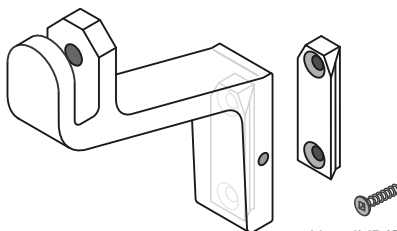


Use JVB/Screw 10gx20 C/S



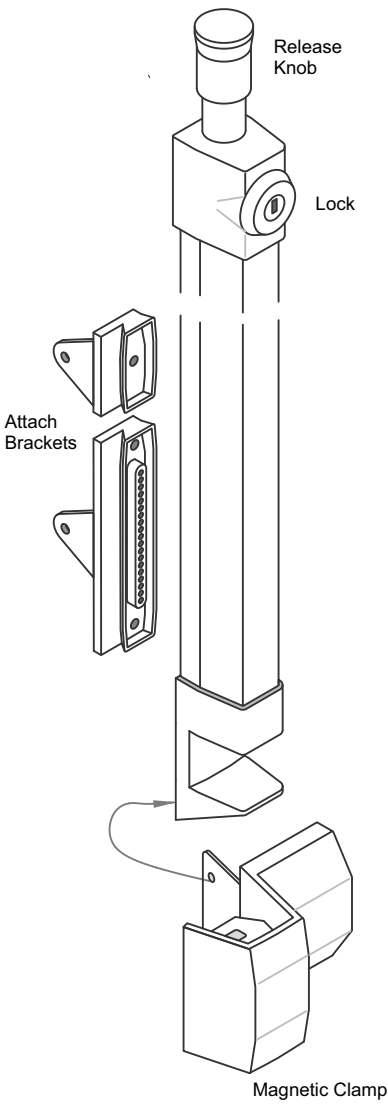

**Latch - 540mm high OA**


**MAGNETIC POOL GATE LATCH**  
Nylon, Black  
JEF/APL



**SOFT GATE STOP**  
Nylon, Black.  
Part No JEF/GS




**GATE HANDLE**  
Nylon, Black.  
Part No JEF/GH

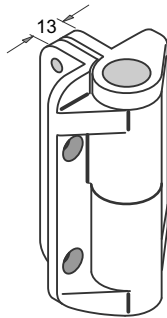


Suitable for Pool gates  
Max Self Closing 45kg

**ADJUSTABLE TENSION  
HINGE, LEGS**  
JEF/AHHD (Pairs)


**These Latches not suitable for Pool Gates**

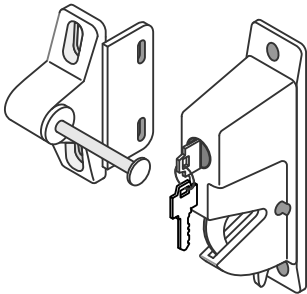

**UNIVERSAL DROP LATCH  
AND STRIKER**  
Nylon, Black  
JEF/DL


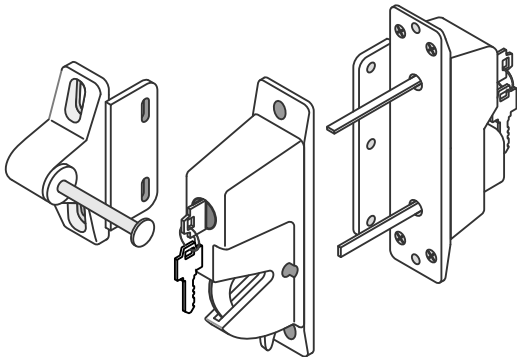


**UNIVERSAL DROP LATCH  
AND STRIKER**  
Nylon, Black. (External Access)  
JEF/DLEA




**PARKING LATCH**  
Nylon, Black.  
G21

Typical Gate Assembly - Baluster

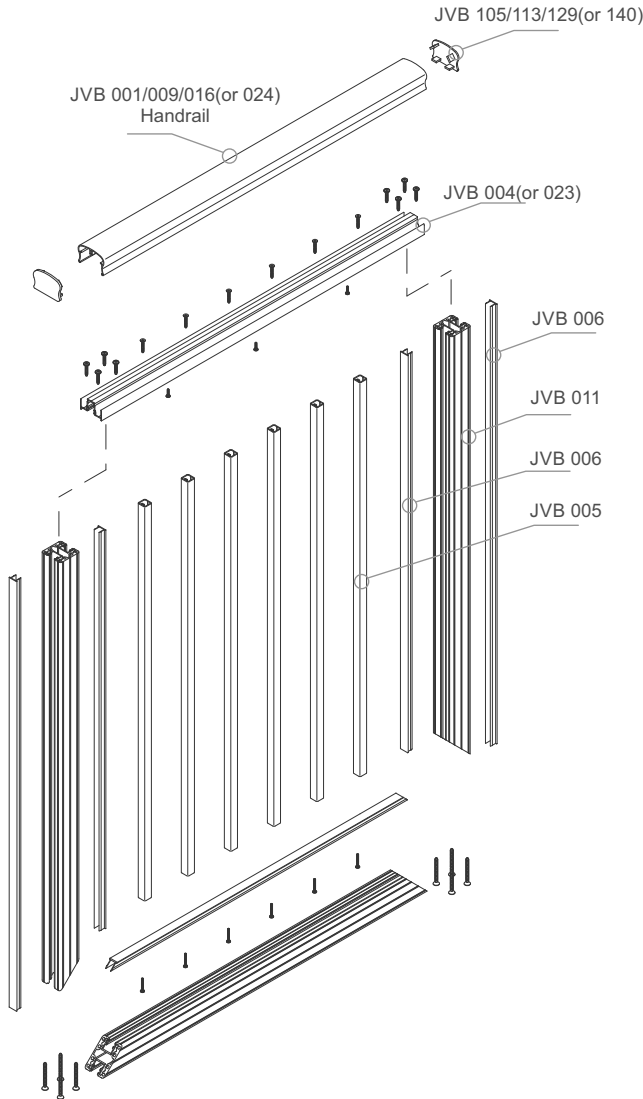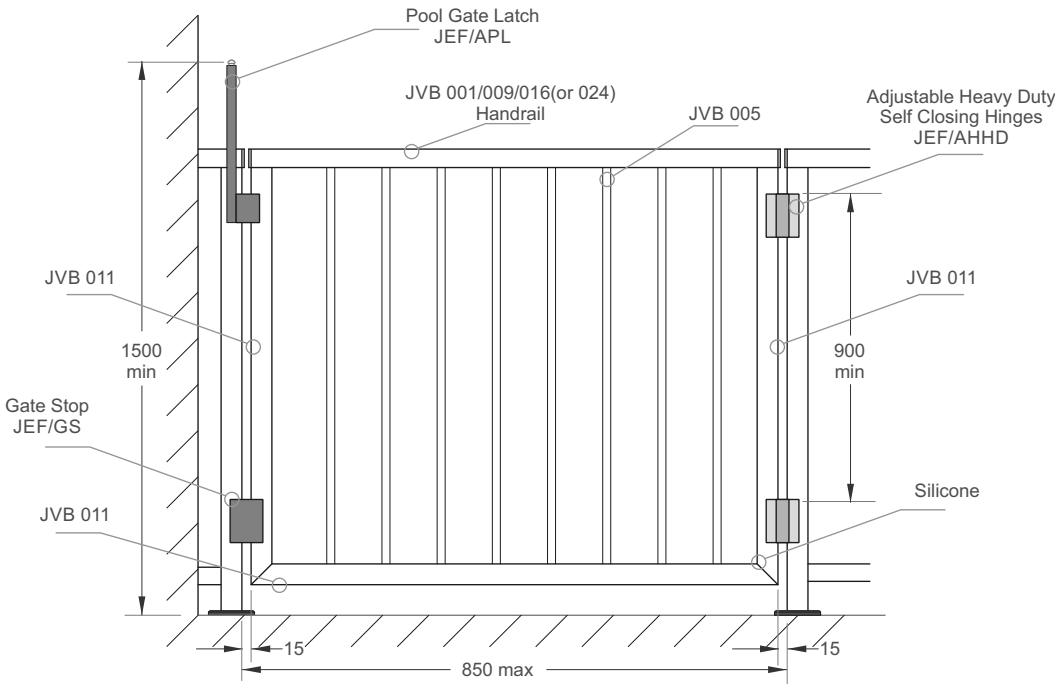

## Juralco Viking® Balustrade System

### Balustrade Design Guide

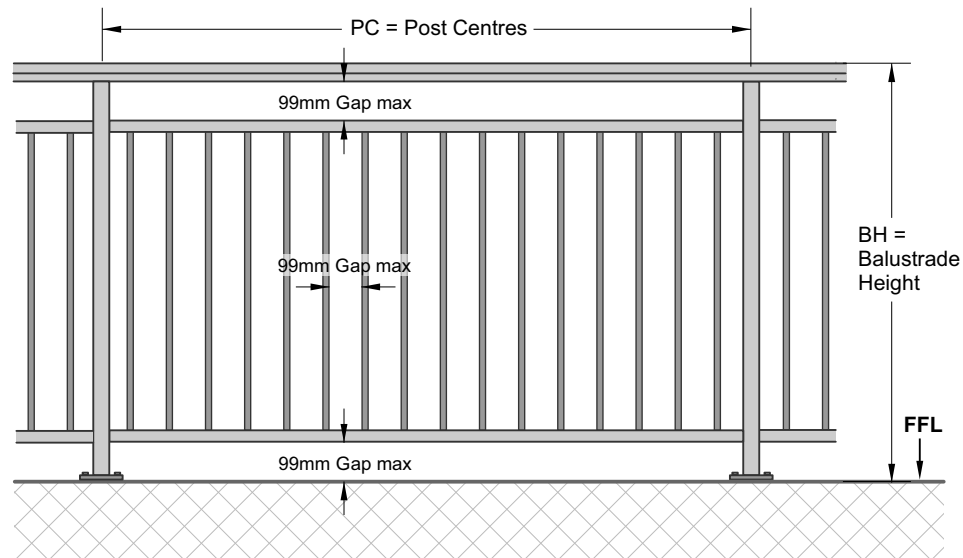

BALUSTRADE DESIGN GUIDE - for building types below. All other applications please contact Juralco

| BH = HEIGHT OF<br>BALUSTRADE<br><br>(Measured from FFL<br>to top of Barrier) | BUILDING TYPE                                                                                                                      | LOCATION                                                                 | HEIGHT (mm) |
|------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------|-------------|
|                                                                              | Detached dwellings<br>and within<br>household units of<br>multi-unit dwellings                                                     | Stairs and ramps and their landings                                      | 900         |
|                                                                              |                                                                                                                                    | Balconies and decks, and edges of internal floors<br>or mezzanine floors | 1000        |
|                                                                              | All other buildings, and<br>common areas<br>of multi-unit dwellings                                                                | Stairs or ramps (excluding landings)                                     | 900         |
|                                                                              |                                                                                                                                    | Barriers within 530mm of the front of fixed seating                      | 800         |
|                                                                              |                                                                                                                                    | All other locations                                                      | 1100        |
|                                                                              | Note: A Building Consent is required when installing Swimming Pools<br>or replacing a Swimming Pool Fence. Refer to NZBC Clause F9 |                                                                          | 1200        |

|                     |  |    |
|---------------------|--|----|
| GAPS (max) as above |  | 99 |
|---------------------|--|----|


|                            |                                                                              |      |
|----------------------------|------------------------------------------------------------------------------|------|
| PC = POST<br>CENTRES (max) | 17mm Balusters                                                               | 1400 |
|                            | 6mm Toughened glass infill panels                                            | 1400 |
|                            | 10mm Toughened glass for up to & including 1200mm High<br>and High wind zone | 1400 |

#### NZBC REQUIREMENTS - SECTION F4 : SAFETY FROM FALLING

##### NOTES:

- 1 - Heights are measured vertically from finished floor level (ignoring carpet or vinyl, or similar thickness coverings) on floors, landings and ramps. On stairs the height is measured vertically from the pitch line or stair nosings.
- 2 - A landing is a platform with the sole function of providing access.
- 3 - Household unit does not include a hostel, boarding house, motel or other specialized accommodation.
- 4 - Stairs or ramps for all other buildings does not include landings - use all other locations
- 5 - The triangular opening formed by the riser, tread, and bottom rail of the barrier on a stair shall be of such a size that a 150mm diameter sphere can not pass through it, except for swimming pool stairs where the diameter is 100mm.
- 6 - Barriers to swimming pools shall have in addition to performance F9 and NZS8500
  - a) All gates and doors fitted with latching devices not readily operated by children, and constructed to automatically close and latch when released from any stationary position 150mm or more from the closed and secured position but excluding sliding and sliding-folding doors that give access to the immediate pool surround from a building that forms part of the barrier and,
  - b) No permanent objects on the outside or inside of the barrier that could provide a climbing step
- 7 - No toeholds between the heights of 150mm and 760mm above floor level (or stair nosing).

**Juralco Viking Balustrade System building code compliance documentation requires all balustrade installations are to be completed in accordance with the requirements of our authorised installer certification.**

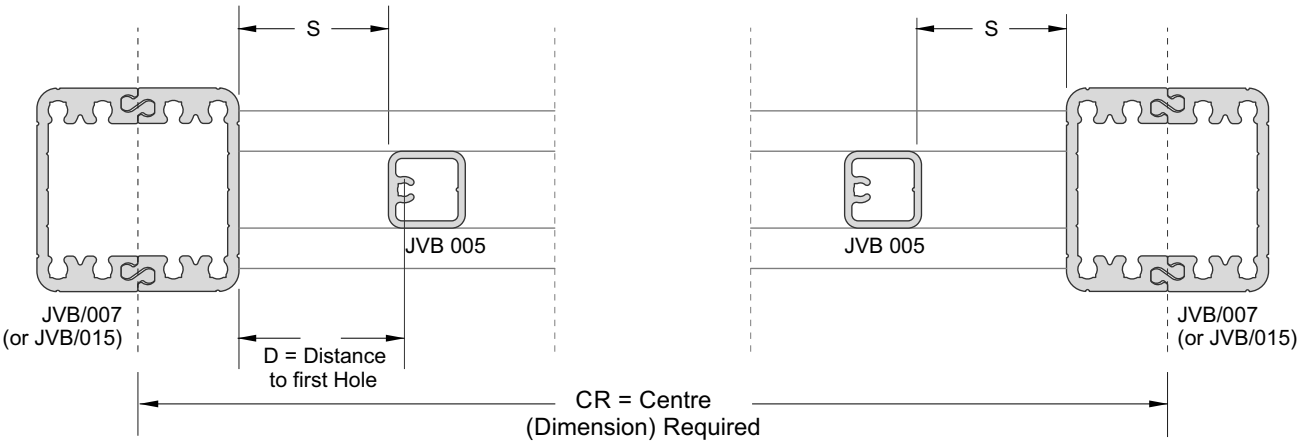

| CM= Centre, Maximum (of Posts) | Max CRS for No of Balusters | No of Balusters |
|--------------------------------|-----------------------------|-----------------|
|                                | 260                         | 1               |
|                                | 376                         | 2               |
|                                | 492                         | 3               |
|                                | 608                         | 4               |
|                                | 724                         | 5               |
|                                | 840                         | 6               |
|                                | 956                         | 7               |
|                                | 1072                        | 8               |
|                                | 1188                        | 9               |
|                                | 1304                        | 10              |
|                                | 1420                        | 11              |


To achieve an equal distance 'S' from either end of panel use equation shown below.  
 $= 103 - (CM - CR)/2$

Example:  
 The distance required (CR) is 890mm centres,  
 Use CM = 956 as next value up.

Substitute into equation shown above  
 $= 103 - [(956-890)/2]$   
 $= 103-33$   
 $= 70$

Therefore make first cut 70mm from first hole (as shown at the LH End)  
 Note: Balusters JVB005 must be positioned as shown.


### Two Post 90 Deg Corner

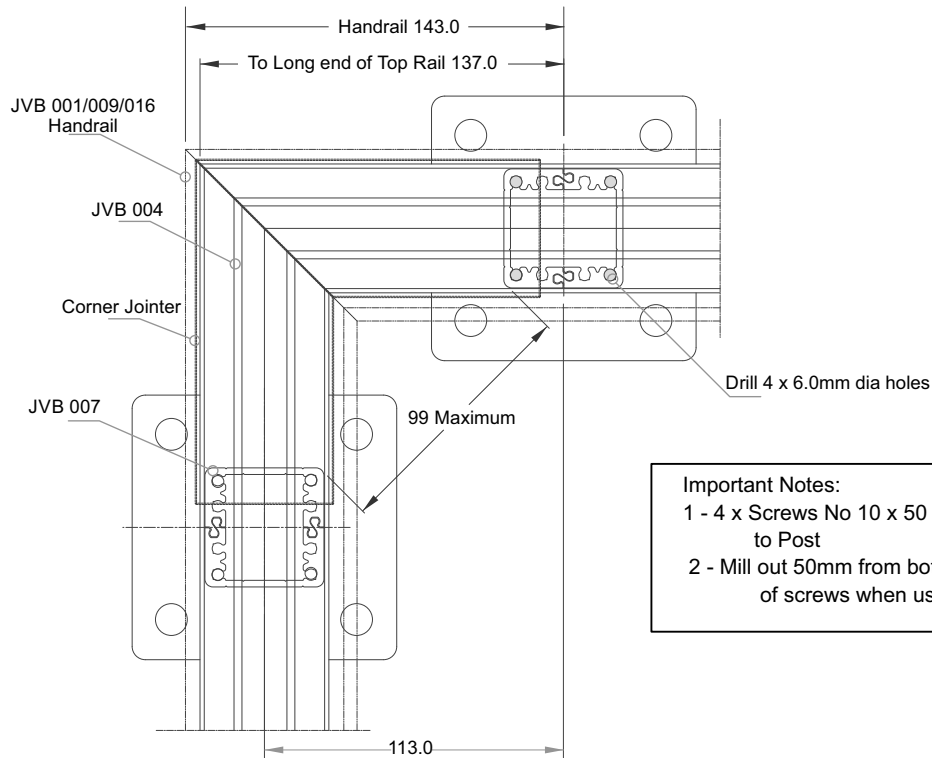

**Important Notes:**

- 1 - 4 x Screws No 10 x 50 pan required to fix Base Plate to Post
- 2 - Mill out 50mm from bottom of Post to allow fitment of screws when using Base Plate


### Single Post 90 Deg Corner

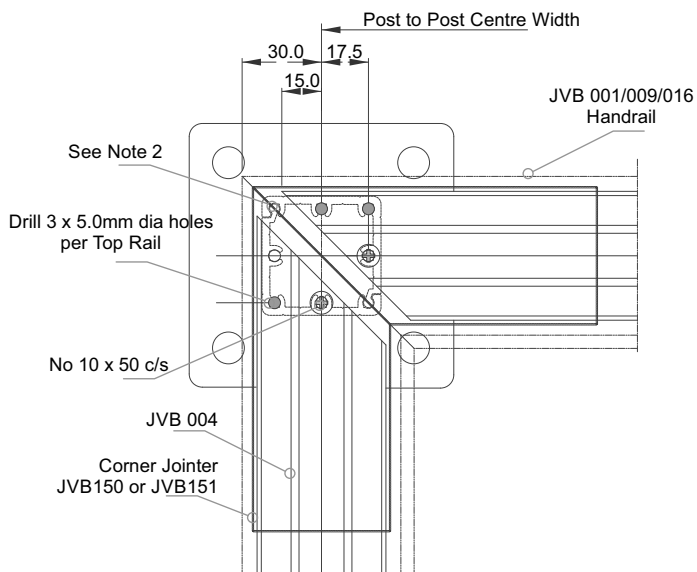

**Important Notes:**

- 1 - 4 x Screws No 10 x 50 pan required to fix Base Plate to Post
- 2 - Mill out 50mm from bottom of Post to allow fitment of screws when using Base Plate


**Angled Corner**

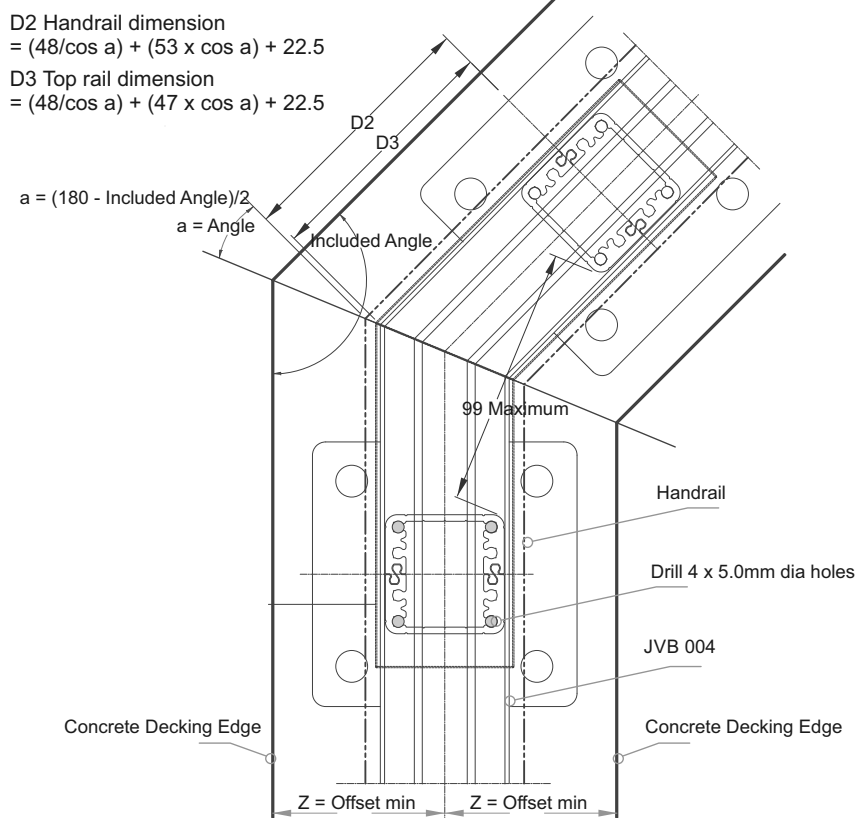


Minimum Edge distance when fixing to Concrete and anchor types.  
JVB 101 Baseplate , Z = 50mm, 2 x M12 x 80mm deep Epcon or Chemset anchors  
JVB 100 Baseplate , Z = 70mm, 4 x M10 x 90mm deep Epcon or Chemset anchors  
These fastenings are based on a minimum concrete strength of 17.5 MPa

Corner Joints to be Cut/Welded by installer


**Typical Assembly - Top Handrail**

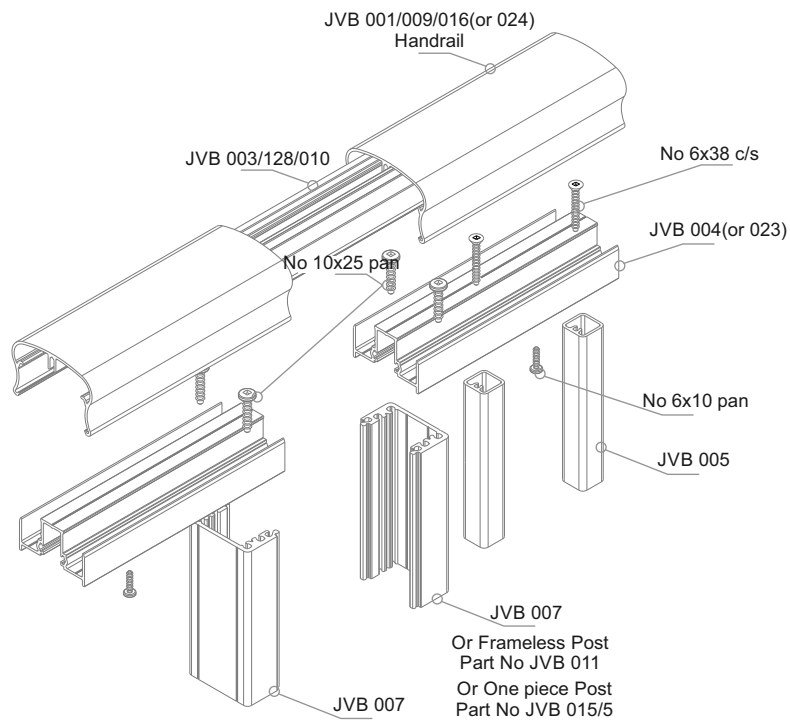


**Typical Assembly - Lower Panel**

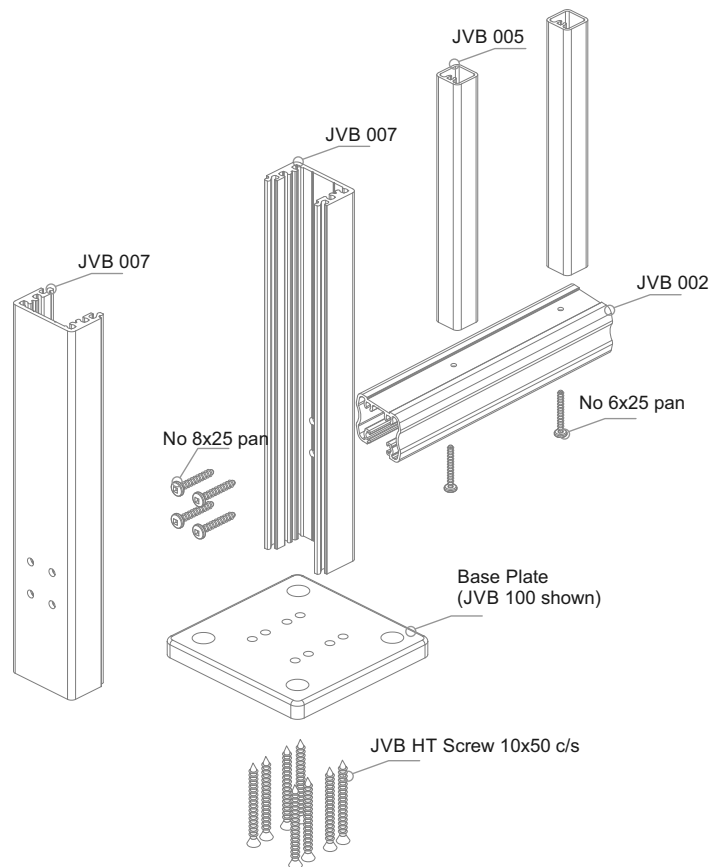

**Typical Assembly - Semi Frameless Glass and Handrail**

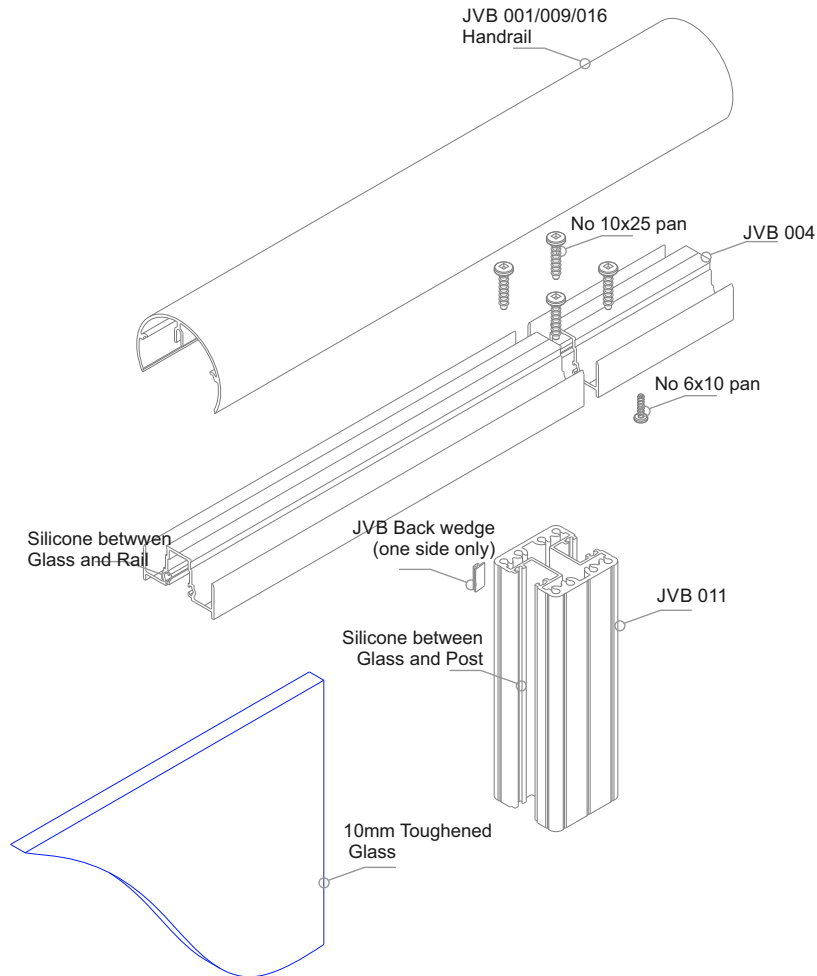


**Typical Assembly - Corner**

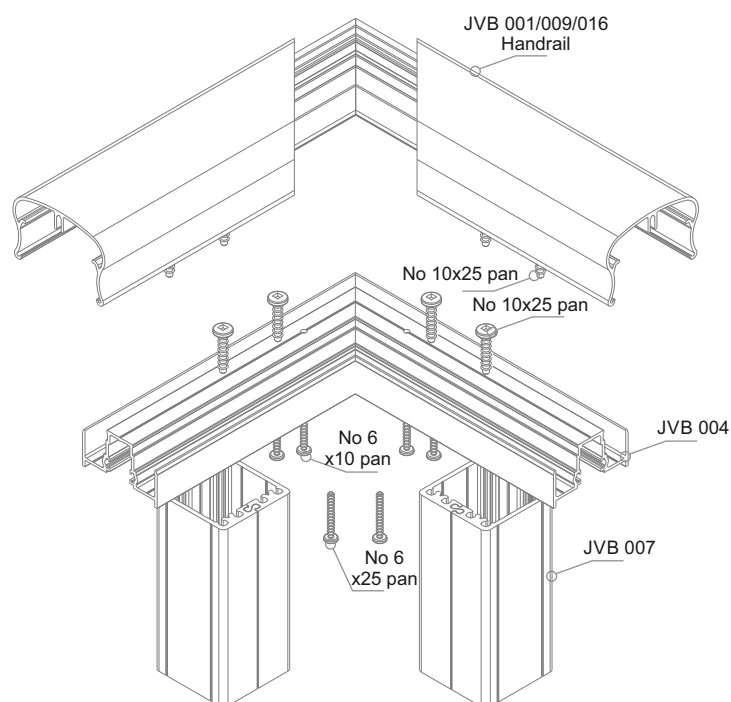





**Typical Assembly - Nib Wall, Handrail**

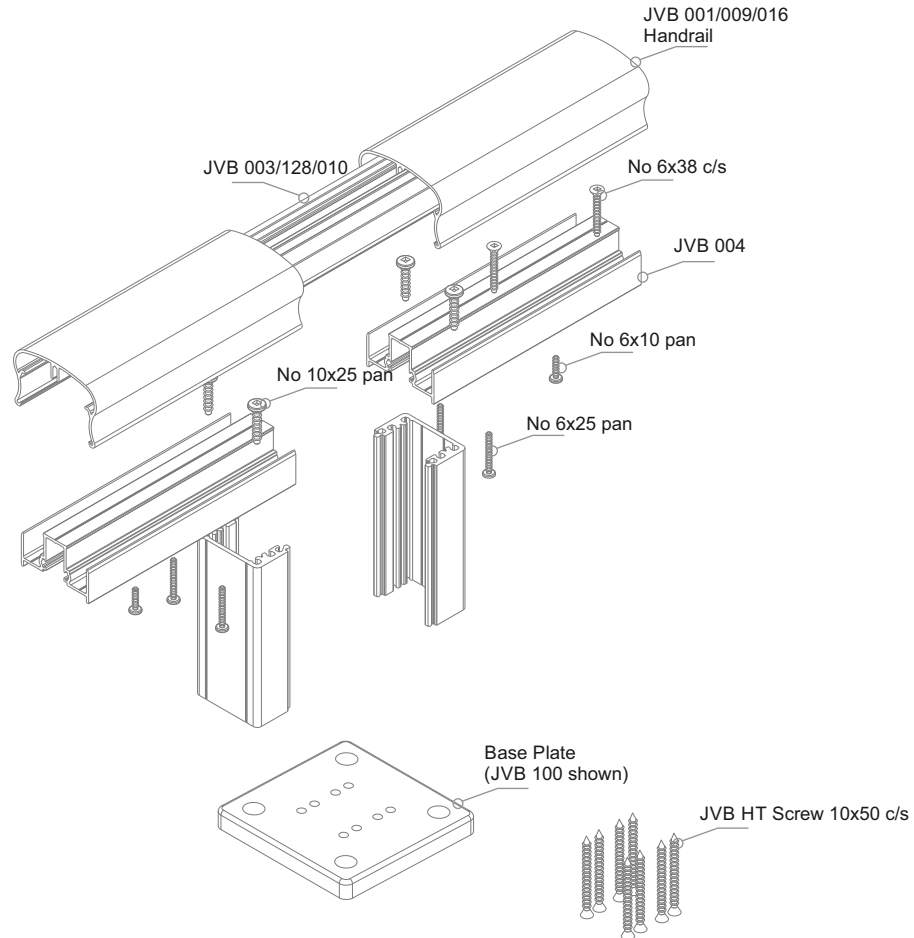

**Typical Assembly - Rail Brackets**

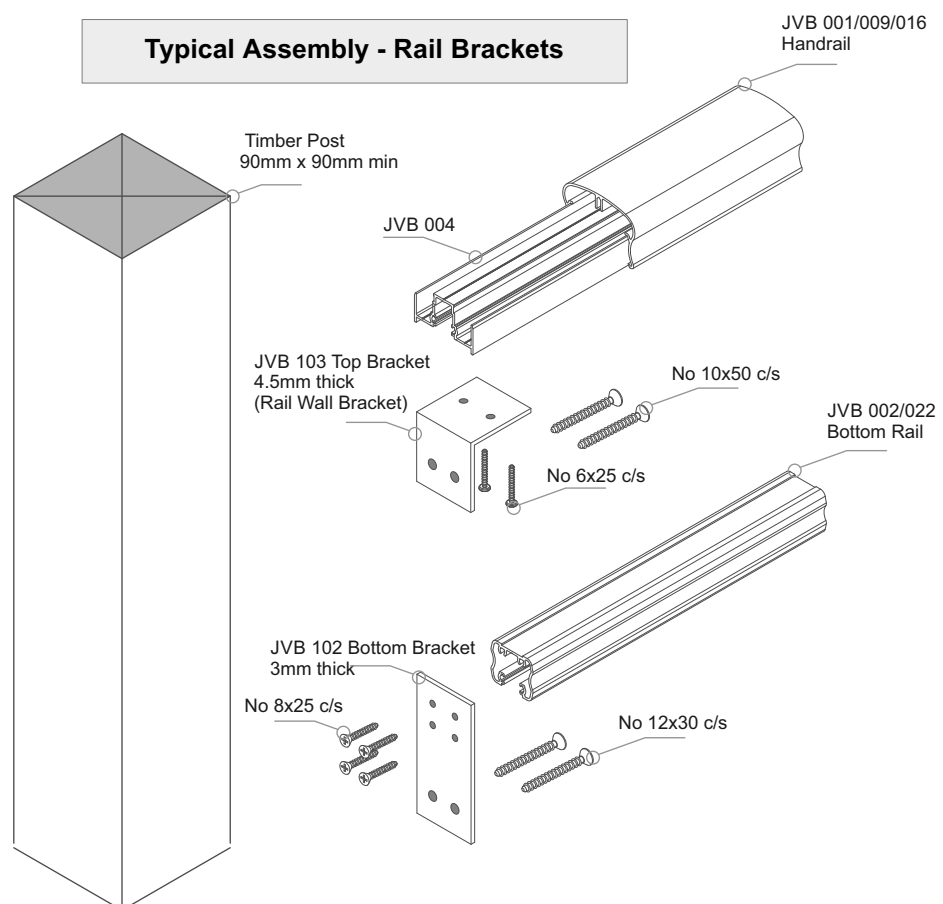


**Typical Assembly - Wall Mounted Handrail**

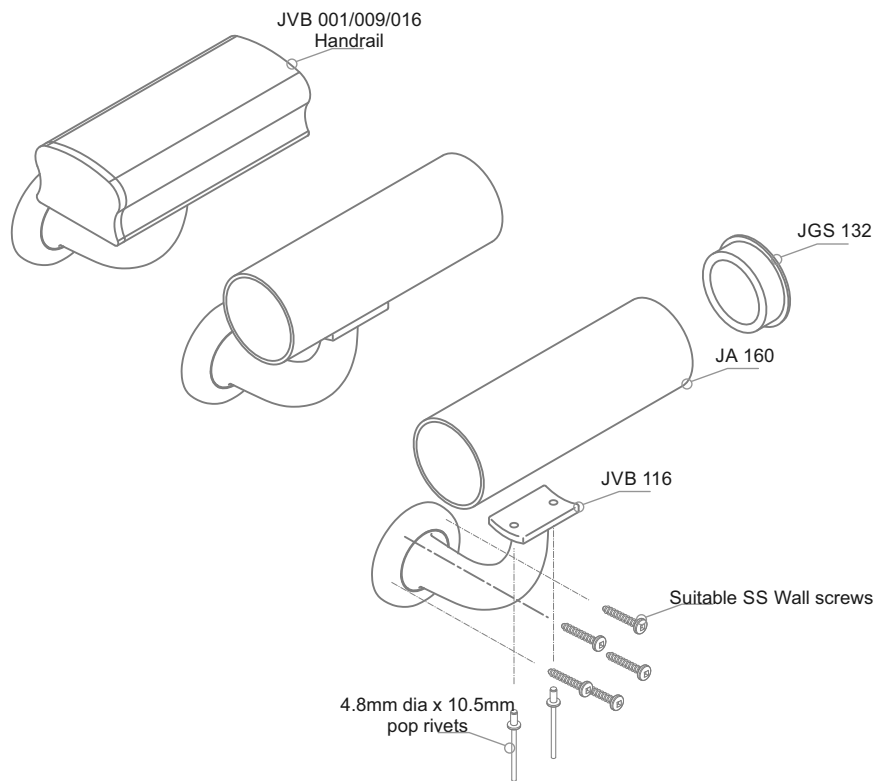


## Juralco Viking® Balustrade System




### Post Mounting Options

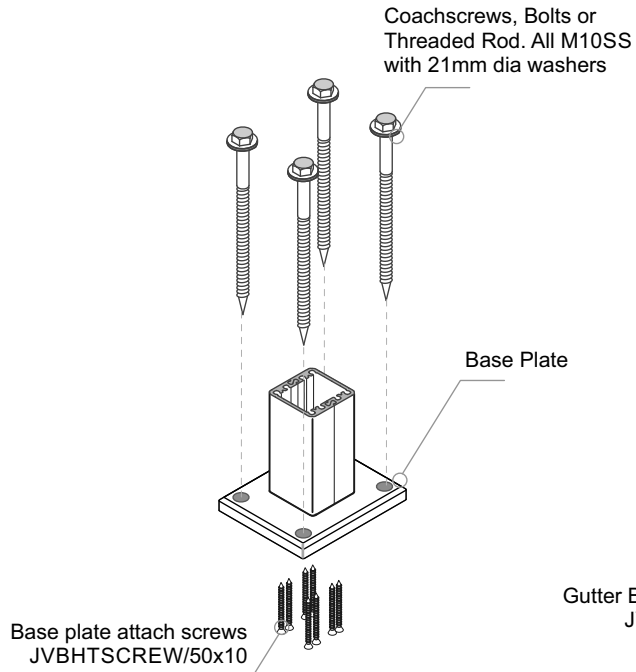

**Top Fix**  
Base Plates in a variety of sizes.  
Different fasteners types depending on the Building substrate.  
Includes a 90deg Semi Frameless Corner Post

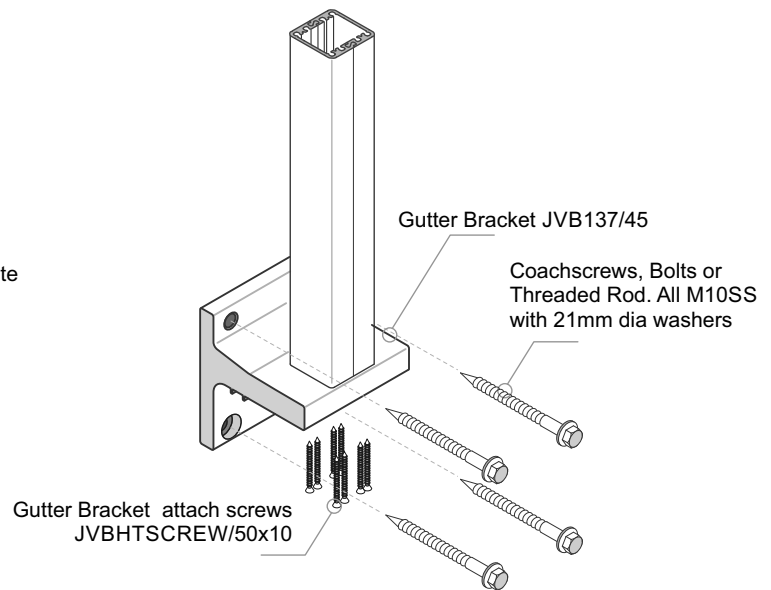

**Gutter Bracket Face Fix**  
Different fasteners types depending on the Building substrate.

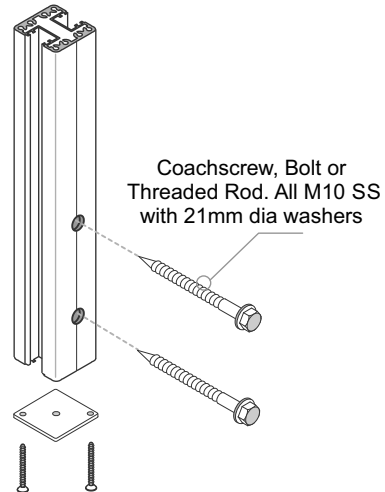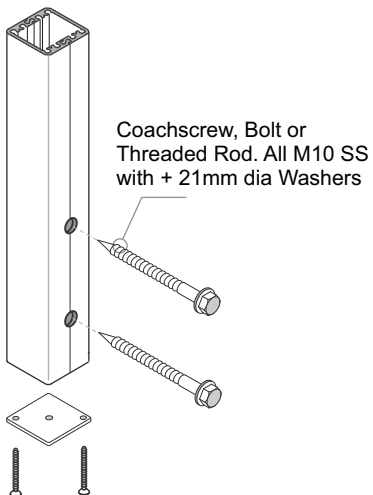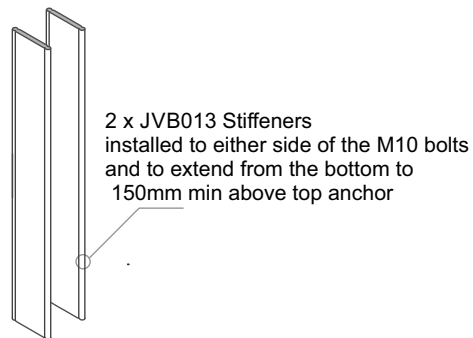

**Face Fix**  
Different fasteners types depending on the Building substrate.


Typical TOP Fix to Timber - JVB121, 110mm x 90mm, 4 hole Base Plate - M10 SS Coachscrews

Balustrade Dimensions by Wind Zone


| Up to and including Very High Wind Zone |      |      |      |      |      |      |     |
|-----------------------------------------|------|------|------|------|------|------|-----|
| Balustrade Height, mm                   |      |      |      |      |      |      |     |
| 1000                                    | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 | max |
| 1400                                    | 1350 | 1300 | 1250 | 1200 | 1150 | 1100 |     |
| Post Spacing max, mm                    |      |      |      |      |      |      |     |
|                                         |      |      |      |      |      |      |     |

| Extra High Wind Zone  |  |
|-----------------------|--|
| 17mm Balusters only   |  |
| Balustrade Height, mm |  |
| 1275 max              |  |
| 1400                  |  |
| Post Spacing max, mm  |  |
|                       |  |

- General Notes:
- 1 - All measurements mm
  - 2 - Occupancy only A, A other and C3.
  - 3 - Balustrade Height measured above Deck/FFL.
  - 4 - Wind Zones as per NZS 3604:2011

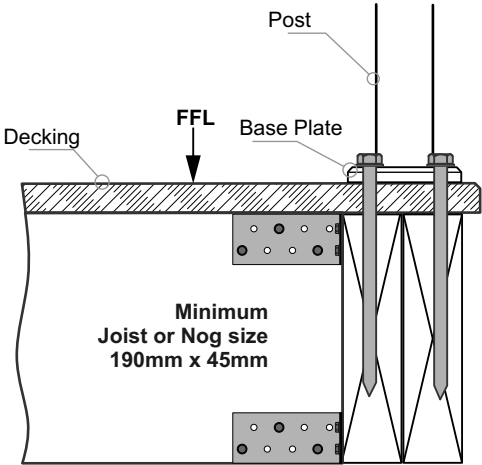



- Important Installation notes:**
- 1 - The Project Engineer must ensure the structure can support the appropriate loads
  - 2 - Substructure shown indicatively only. Timber SG8 minimum strength
  - 3 - Coachscrews 130mm min engagement into joists, predrill 6mm holes.
  - 4 - Bond all coachscrews with SIKa Supergrip to full depth
  - 5 - All Fixings must be Stainless steel

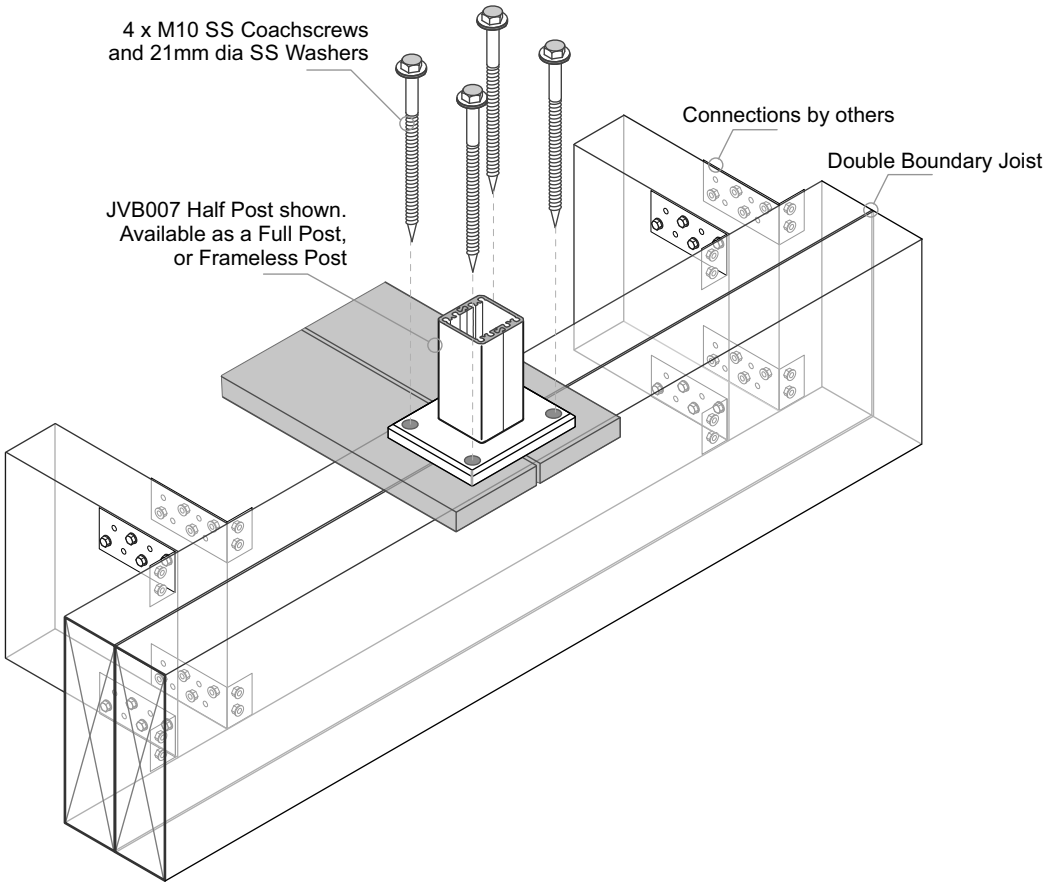


Typical FACE Fix Post to Timber - M10 SS Coachscrews

| Balustrade Dimensions by Wind Zone      |      |      |      |      |      |          |  |
|-----------------------------------------|------|------|------|------|------|----------|--|
| Up to and including Very High Wind Zone |      |      |      |      |      |          |  |
| Balustrade Height, mm                   |      |      |      |      |      |          |  |
| 1000                                    | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 max |  |
| 1400                                    | 1350 | 1300 | 1250 | 1200 | 1150 | 1100     |  |
| Post Spacing max, mm                    |      |      |      |      |      |          |  |
|                                         |      |      |      |      |      |          |  |
| Extra High Wind Zone                    |      |      |      |      |      |          |  |
| All Balustrades                         |      |      |      |      |      |          |  |
| Coachscrews as shown                    |      |      |      |      |      |          |  |
| NOT SUITABLE.                           |      |      |      |      |      |          |  |
| Must use Bolts                          |      |      |      |      |      |          |  |

- General Notes:
- 1 - All measurements mm
  - 2 - Occupancy only A, A other and C3.
  - 3 - Balustrade Height measured above Deck/FFL.
  - 4 - Wind Zones as per NZS 3604:2011

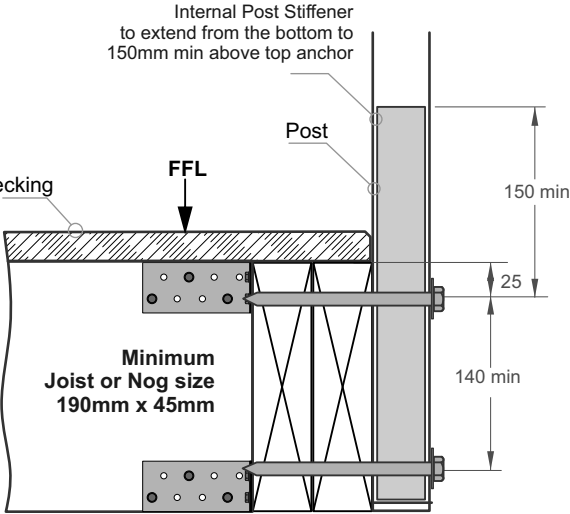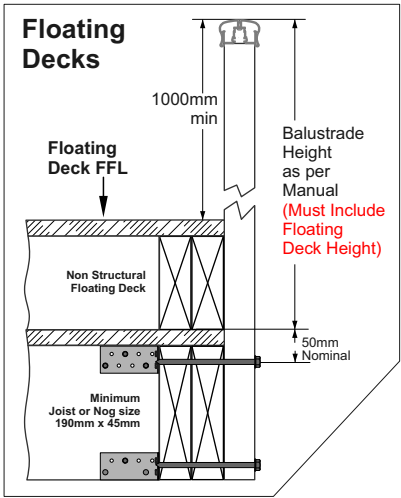

- Important Installation notes:**
- 1 - The Project Engineer must ensure the structure can support the appropriate loads
  - 2 - Substructure shown indicatively only. Timber SG8 minimum strength
  - 3 - Coachscrews 90mm min engagement into joists, predrill 6mm holes.
  - 4 - Bond all coachscrews with SIKA Supergrip to full depth
  - 5 - All Fixings must be Stainless steel

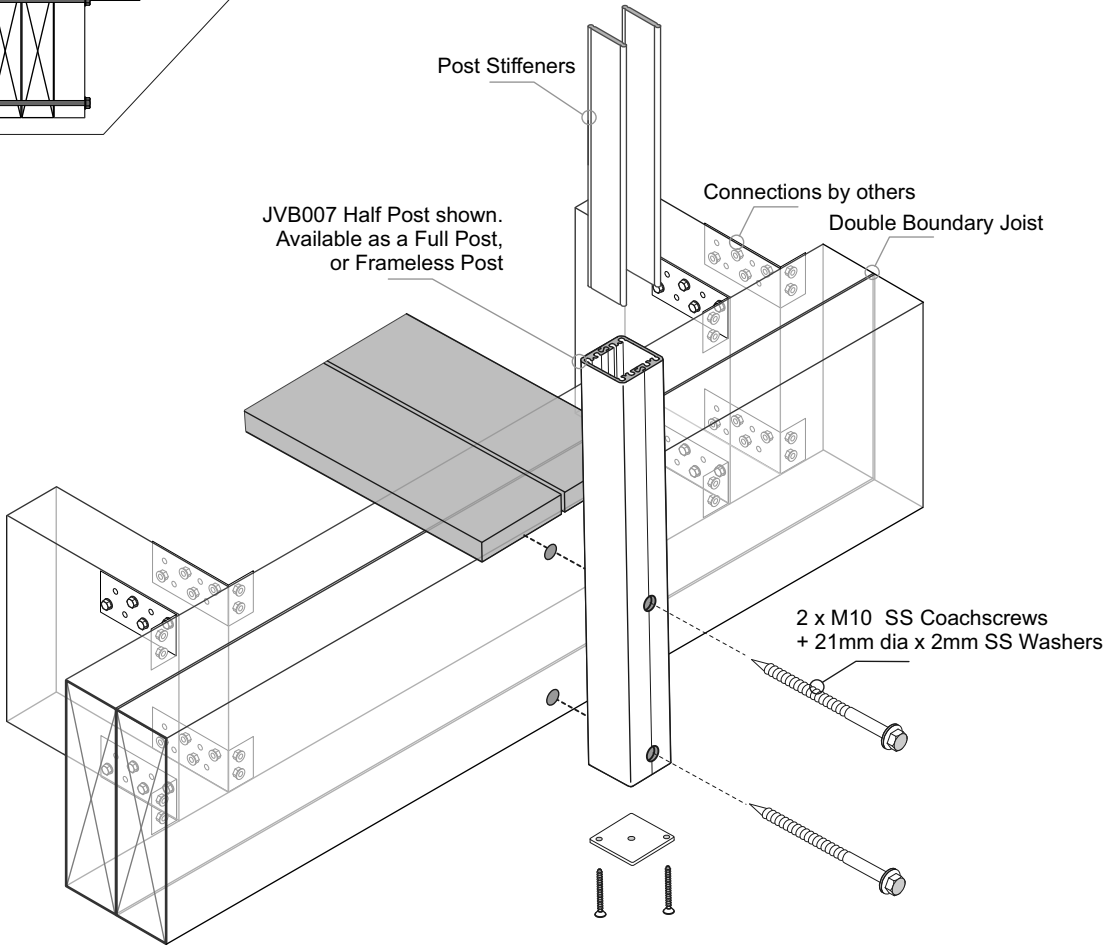

### Typical FACE Fix Post to Timber - M10 SS Bolts or Threaded Rod

### Balustrade Dimensions by Wind Zone

## Up to and including Very High Wind Zone


| Balustrade Height, mm |      |      |      |      |      |          |
|-----------------------|------|------|------|------|------|----------|
| 1000                  | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 max |
| 1400                  | 1350 | 1300 | 1250 | 1200 | 1150 | 1100     |
| Post Spacing max, mm  |      |      |      |      |      |          |

### Extra High Wind Zone


|                       |
|-----------------------|
| 17mm Balusters only   |
| Balustrade Height, mm |
| <b>1275 max</b>       |
| 1400                  |
| Post Spacing max, mm  |

General Notes:

- 1 - All measurements mm  
2 - Occupancy only A, A other and C3.  
3 - Balustrade Height measured above Deck/FFL.  
4 - Wind Zones as per NZS 3604:2011

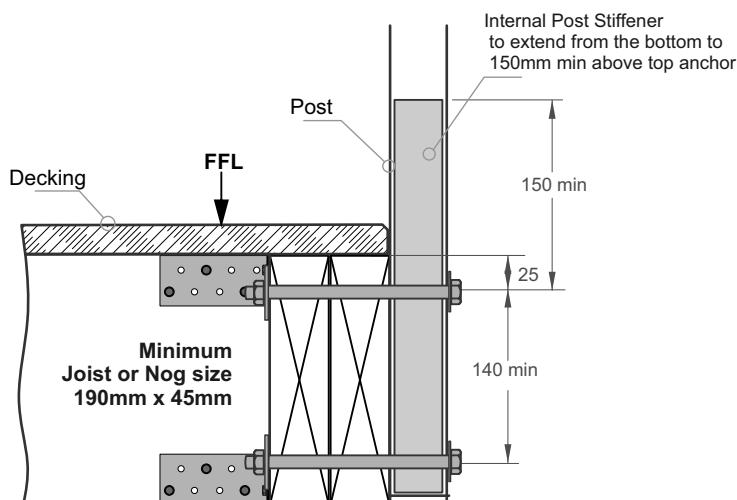


## Floating Decks

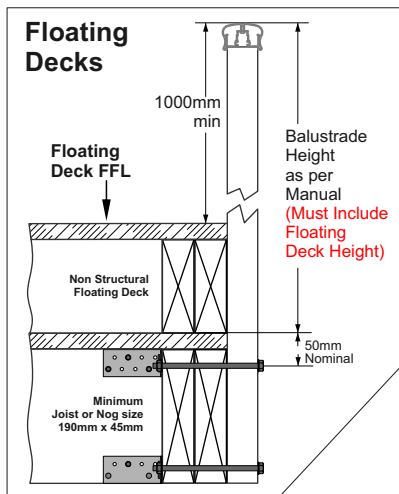

### Important Installation notes:

- 1 - The Project Engineer must ensure the structure can support the appropriate loads
- 2 - Substructure shown indicatively only. Timber SG8 minimum strength
- 3 - All Fixings must be Stainless steel

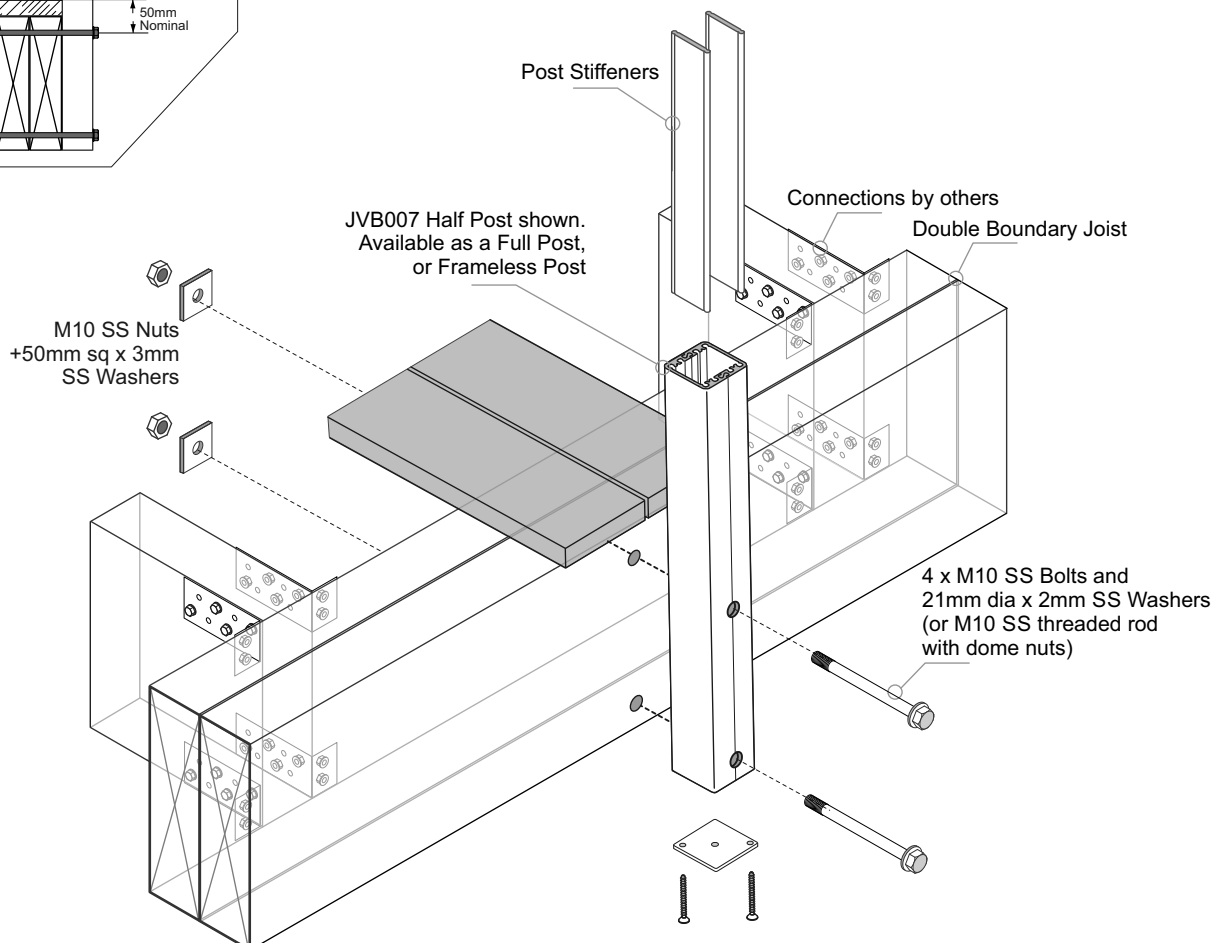



Typical FACE Fix to Timber - JVB137/45, Gutter Bracket - M10 SS Coachscrews

Balustrade Dimensions by Wind Zone


| Up to and including Very High Wind Zone |      |      |      |      |      |      |     |
|-----------------------------------------|------|------|------|------|------|------|-----|
| Balustrade Height, mm                   |      |      |      |      |      |      |     |
| 1000                                    | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 | max |
| 1400                                    | 1350 | 1300 | 1250 | 1200 | 1150 | 1100 |     |
| Post Spacing max, mm                    |      |      |      |      |      |      |     |
|                                         |      |      |      |      |      |      |     |

| Extra High Wind Zone  |  |
|-----------------------|--|
| 17mm Balusters only   |  |
| Balustrade Height, mm |  |
| 1275 max              |  |
| 1400                  |  |
| Post Spacing max, mm  |  |
|                       |  |

- General Notes:
- 1 - All measurements mm
  - 2 - Occupancy only A, A other and C3.
  - 3 - Balustrade Height measured above Deck/FFL.
  - 4 - Wind Zones as per NZS 3604:2011

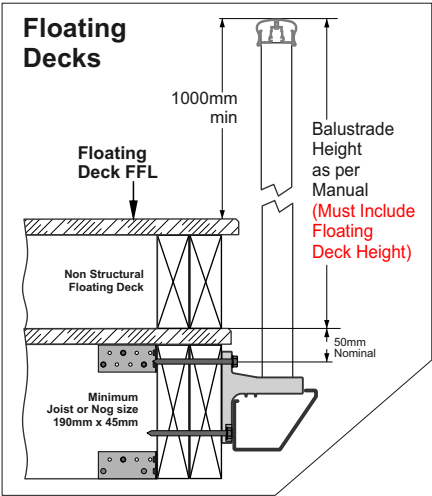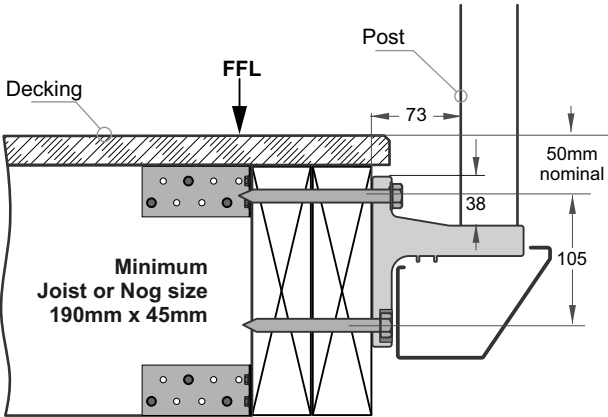

- Important Installation notes:
- 1 - The Project Engineer must ensure the structure can support the appropriate loads
  - 2 - Substructure shown indicatively only. Timber SG8 minimum strength
  - 3 - Coachscrews 90mm min engagement into joists, predrill 6mm holes.
  - 4 - Bond all coachscrews with SIKA Supergrip to full depth
  - 5 - All Fixings must be Stainless steel

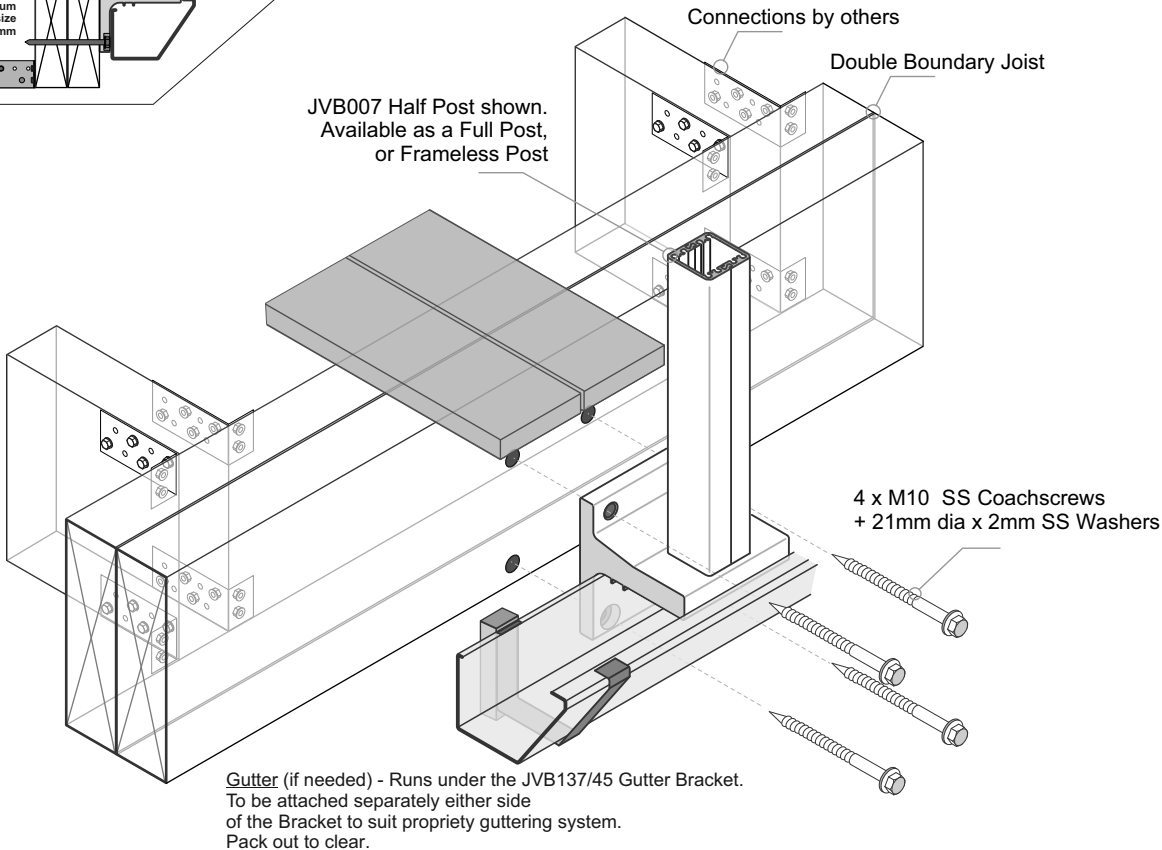



Typical FACE Fix to Timber - JVB137/45, Gutter Bracket - M10 SS Bolts

Balustrade Dimensions by Wind Zone


| Up to and including Very High Wind Zone |      |      |      |      |      |          |  |
|-----------------------------------------|------|------|------|------|------|----------|--|
| Balustrade Height, mm                   |      |      |      |      |      |          |  |
| 1000                                    | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 max |  |
| 1400                                    | 1350 | 1300 | 1250 | 1200 | 1150 | 1100     |  |
| Post Spacing max, mm                    |      |      |      |      |      |          |  |
|                                         |      |      |      |      |      |          |  |

| Extra High Wind Zone  |  |
|-----------------------|--|
| 17mm Balusters only   |  |
| Balustrade Height, mm |  |
| 1275 max              |  |
| 1400                  |  |
| Post Spacing max, mm  |  |
|                       |  |

- General Notes:
- 1 - All measurements mm
  - 2 - Occupancy only A, A other and C3.
  - 3 - Balustrade Height measured above Deck/FFL.
  - 4 - Wind Zones as per NZS 3604:2011

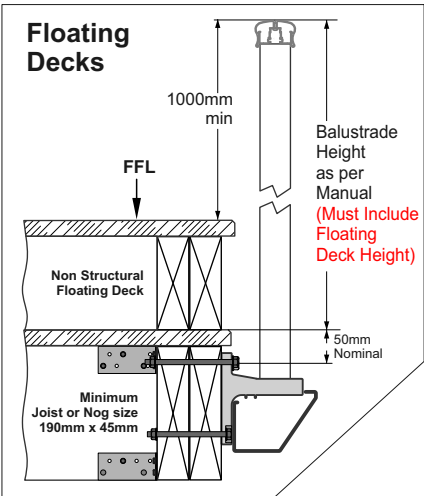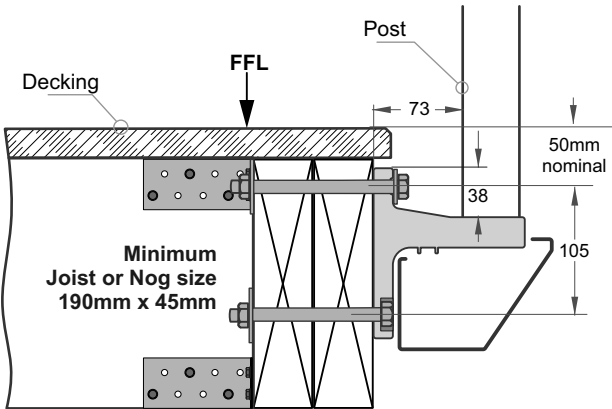

- Important Installation notes:
- 1 - The Project Engineer must ensure the structure can support the appropriate loads
  - 2 - Substructure shown indicatively only. Timber SG8 minimum strength
  - 3 - All Fixings must be Stainless steel

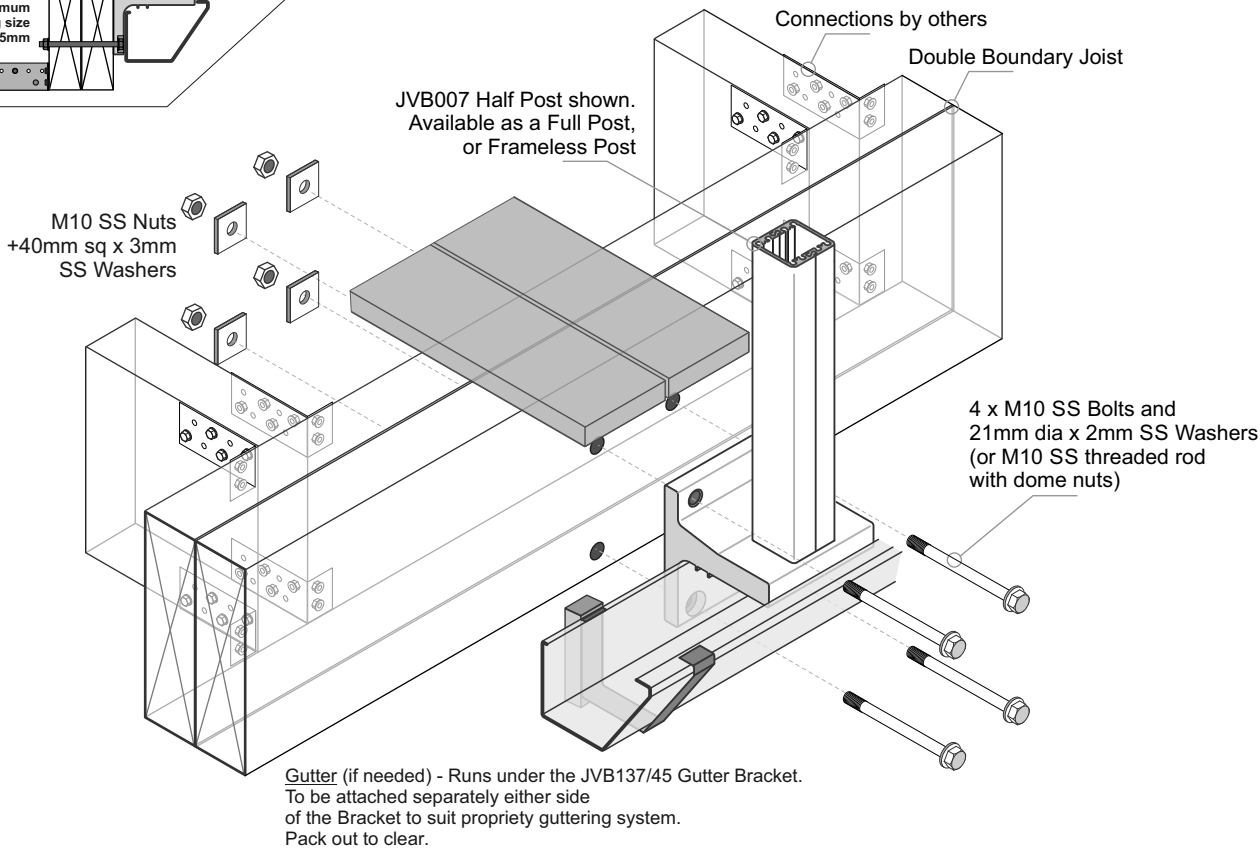




Typical TOP Fix to Steel with Timber Deck - JVB121, 110mm x 90mm, 4 hole Base Plate - M10 SS Bolts

Balustrade Dimensions by Wind Zone


| Up to and including Very High Wind Zone |      |      |      |      |      |          |
|-----------------------------------------|------|------|------|------|------|----------|
| Balustrade Height, mm                   |      |      |      |      |      |          |
| 1000                                    | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 max |
| 1400                                    | 1350 | 1300 | 1250 | 1200 | 1150 | 1100     |
| Post Spacing max, mm                    |      |      |      |      |      |          |
|                                         |      |      |      |      |      |          |

| Extra High Wind Zone  |  |
|-----------------------|--|
| 17mm Balusters only   |  |
| Balustrade Height, mm |  |
| 1275 max              |  |
| 1400                  |  |
| Post Spacing max, mm  |  |
|                       |  |

- General Notes:
- 1 - All measurements mm
  - 2 - Occupancy only A, A other and C3.
  - 3 - Balustrade Height measured above Deck/FFL.
  - 4 - Wind Zones as per NZS 3604:2011

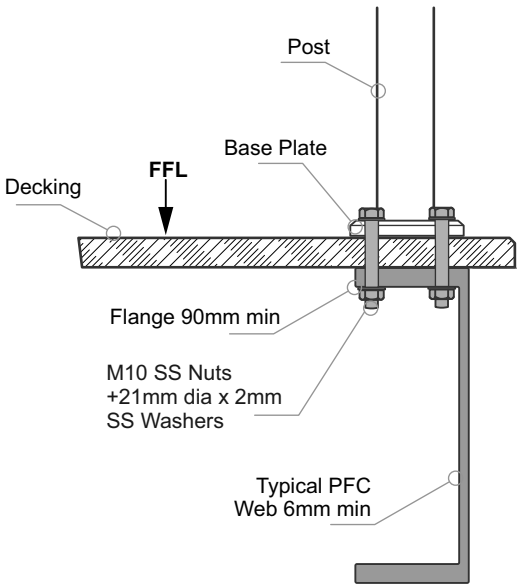

- Important Installation notes:
- 1 - The Project Engineer must ensure the structure can support the appropriate loads
  - 2 - Substructure shown indicatively only
  - 3 - All fixings must be Stainless steel

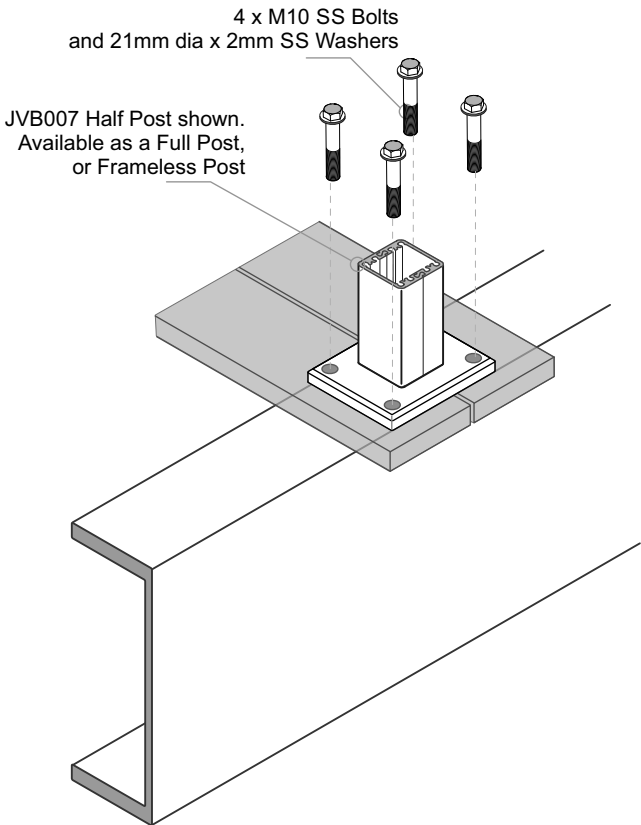


Typical TOP Fix to Timber Deck + Steel - JVB101, 110mm x 90mm, 2 hole Base Plate - M10 SS Bolts

Balustrade Dimensions by Wind Zone


| Up to and including Very High Wind Zone |      |      |      |      |      |          |
|-----------------------------------------|------|------|------|------|------|----------|
| Balustrade Height, mm                   |      |      |      |      |      |          |
| 1000                                    | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 max |
| 1400                                    | 1350 | 1300 | 1250 | 1200 | 1150 | 1100     |
| Post Spacing max, mm                    |      |      |      |      |      |          |

Extra High Wind Zone  
NOT SUITABLE.

- General Notes:
- 1 - All measurements mm
  - 2 - Occupancy only A, A other and C3.
  - 3 - Balustrade Height measured above Deck/FFL.
  - 4 - Wind Zones as per NZS 3604:2011

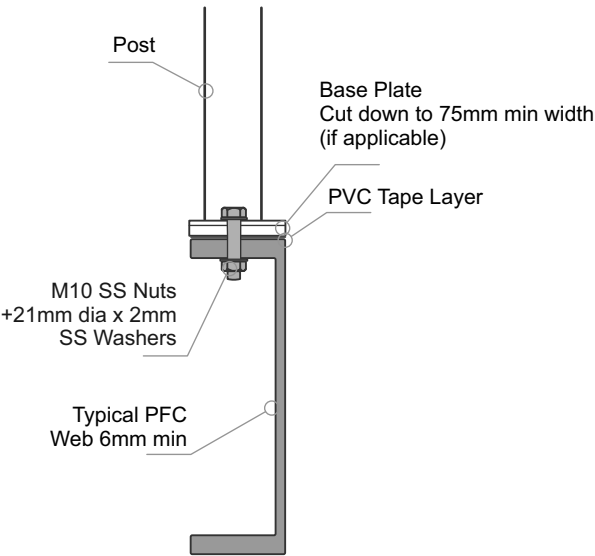

- Important Installation notes:
- 1 - The Project Engineer must ensure the structure can support the appropriate loads
  - 2 - Substructure shown indicatively only
  - 3 - The Baseplate can be cut down to 75mm wide
  - 4 - Both Base plate and PFC must be aligned, with Bolt at C/L
  - 5 - A PVC tape layer must be placed between Baseplate and Steel
  - 6 - All fixings must be Stainless steel

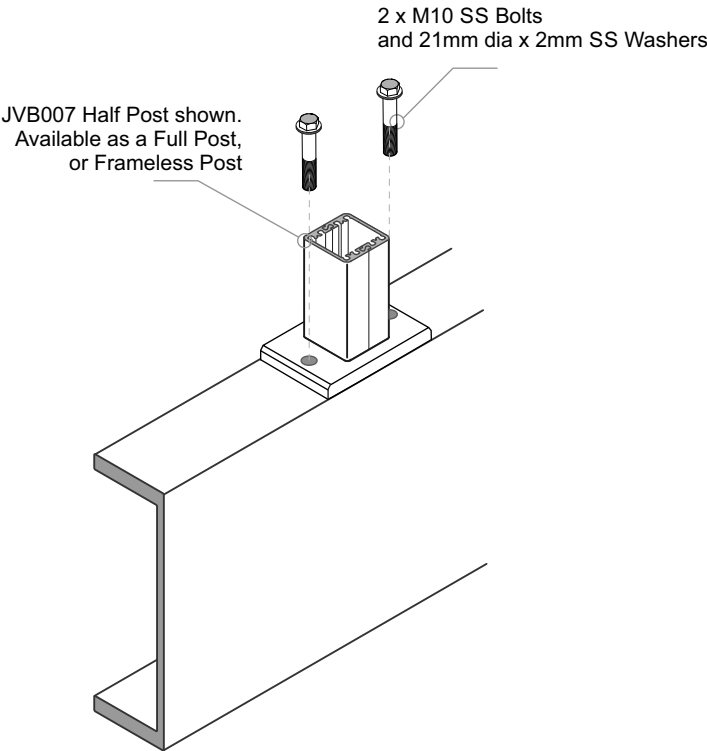

Typical FACE Fix Post to Steel - M10 SS Bolts

Balustrade Dimensions by Wind Zone

Up to and including Very High Wind Zone

| Balustrade Height, mm |      |      |      |      |      |          |
|-----------------------|------|------|------|------|------|----------|
| 1000                  | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 max |
| 1400                  | 1350 | 1300 | 1250 | 1200 | 1150 | 1100     |
| Post Spacing max, mm  |      |      |      |      |      |          |



Extra High Wind Zone

|                       |
|-----------------------|
| 17mm Balusters only   |
| Balustrade Height, mm |
| 1275 max              |
| 1400                  |
| Post Spacing max, mm  |

General Notes:


- 1 - All measurements mm
- 2 - Occupancy only A, A other and C3.
- 3 - Balustrade Height measured above Deck/FFL.
- 4 - Wind Zones as per NZS 3604:2011

Floating Decks

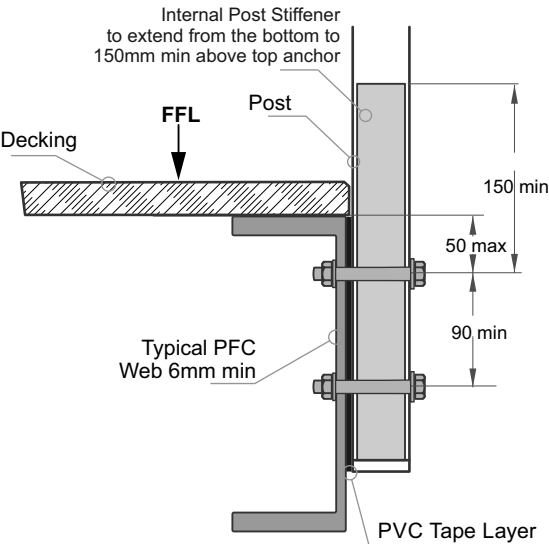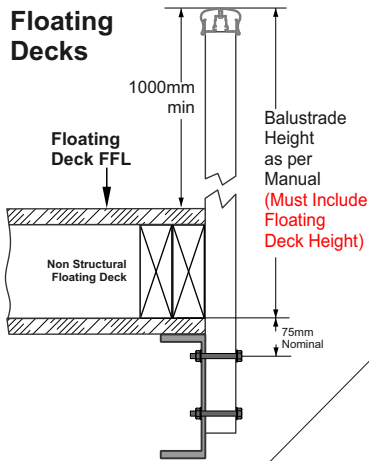

Important Installation notes:

- 1 - The Project Engineer must ensure the structure can support the appropriate loads
- 2 - Substructure shown indicatively only
- 3 - A PVC tape layer must be placed between Post and Steel
- 4 - All fixings must be Stainless steel

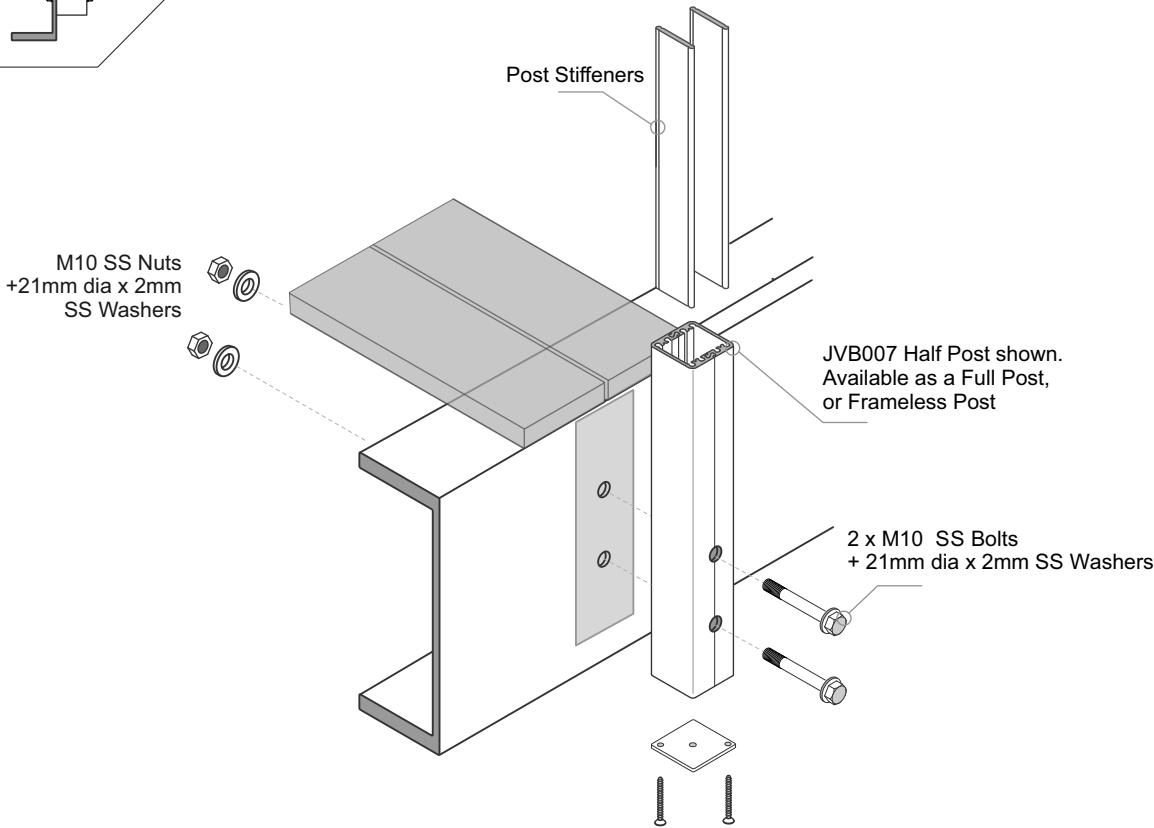

**Typical FACE Fix Post to Steel + Wooden Packers - M10 SS Bolts**

**Balustrade Dimensions by Wind Zone**

**Up to and including Very High Wind Zone**

| Balustrade Height, mm |      |      |      |      |      |          |
|-----------------------|------|------|------|------|------|----------|
| 1000                  | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 max |
| 1400                  | 1350 | 1300 | 1250 | 1200 | 1150 | 1100     |
| Post Spacing max, mm  |      |      |      |      |      |          |



**Extra High Wind Zone**

|                       |
|-----------------------|
| 17mm Balusters only   |
| Balustrade Height, mm |
| <b>1275 max</b>       |
| 1400                  |
| Post Spacing max, mm  |

**General Notes:**


- 1 - All measurements mm
- 2 - Occupancy only A, A other and C3.
- 3 - Balustrade Height measured above Deck/FFL.
- 4 - Wind Zones as per NZS 3604:2011

**Floating Decks**

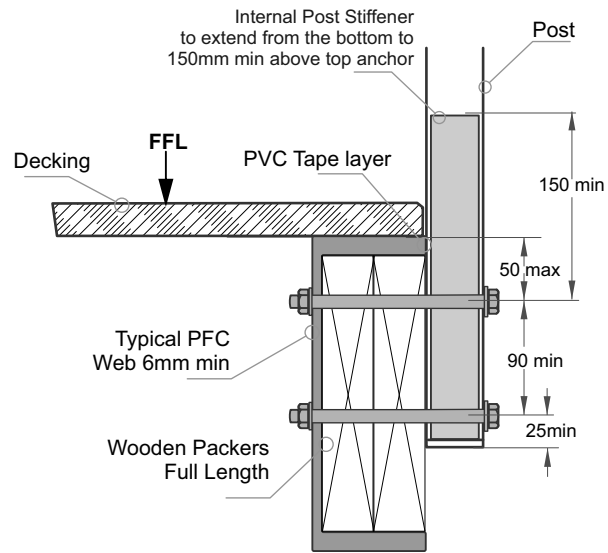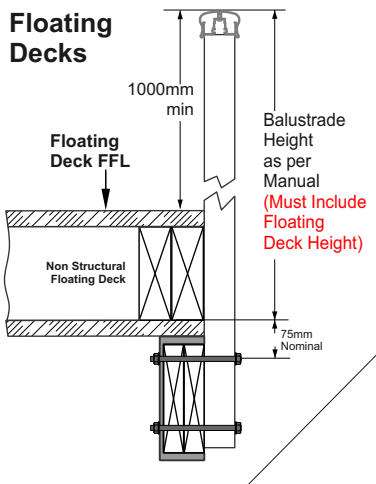

**Important Installation notes:**

- 1 - The Project Engineer must ensure the structure can support the appropriate loads
- 2 - Substructure shown indicatively only. Timber SG8 minimum strength
- 3 - A PVC Tape layer must be installed between the Post and Top Steel Flange
- 4 - All Fixings must be Stainless steel

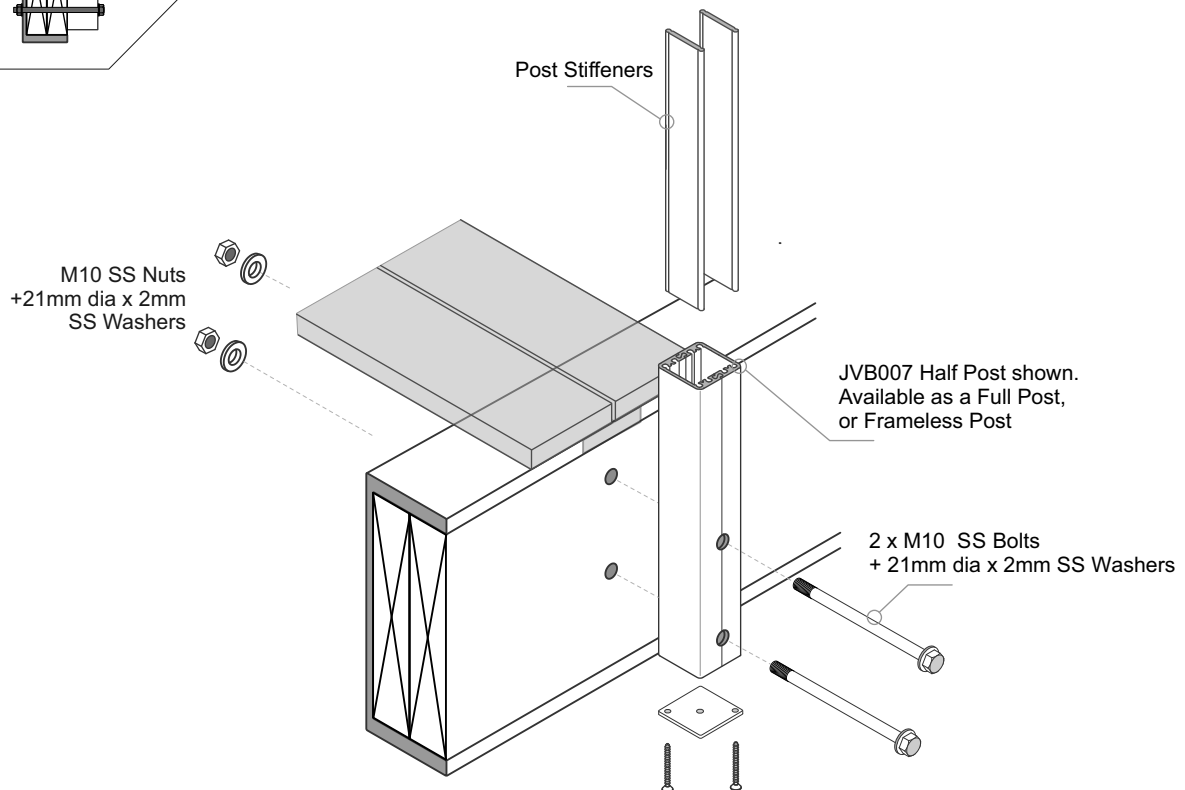

Typical FACE Fix Post to Steel + Wooden Packers - M10 SS Bolts

Balustrade Dimensions by Wind Zone

Up to and including Very High Wind Zone



| Balustrade Height, mm |      |      |      |      |      |          |
|-----------------------|------|------|------|------|------|----------|
| 1000                  | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 max |
| 1400                  | 1350 | 1300 | 1250 | 1200 | 1150 | 1100     |
| Post Spacing max, mm  |      |      |      |      |      |          |

Extra High Wind Zone

|                       |
|-----------------------|
| 17mm Balusters only   |
| Balustrade Height, mm |
| 1275 max              |
| 1400                  |
| Post Spacing max, mm  |


- General Notes:
- 1 - All measurements mm
  - 2 - Occupancy only A, A other and C3.
  - 3 - Balustrade Height measured above Deck/FFL.
  - 4 - Wind Zones as per NZS 3604:2011

Floating Decks

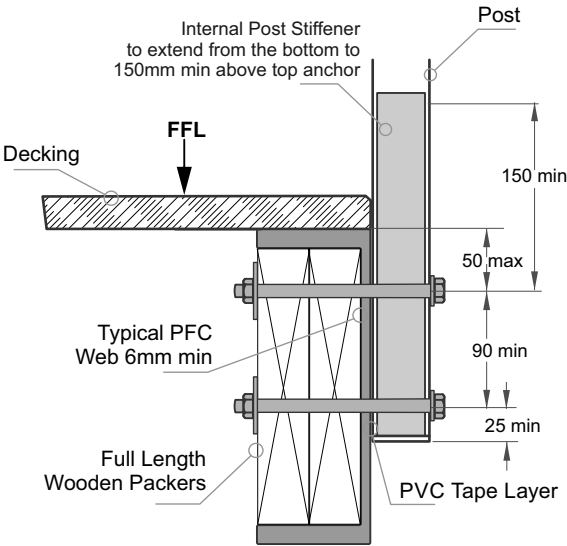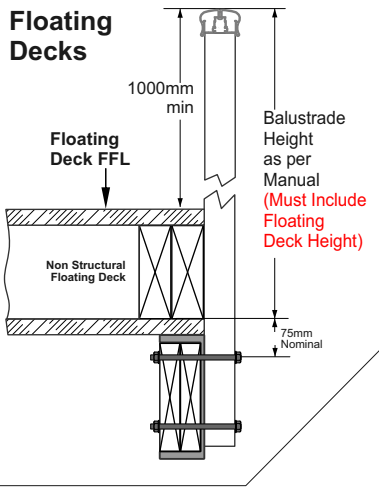

Important Installation notes:

- 1 - The Project Engineer must ensure the structure can support the appropriate loads
- 2 - Substructure shown indicatively only. Timber SG8 minimum strength
- 3 - A PVC Tape layer must be installed between the Post and Steel
- 4 - All Fixings must be Stainless steel

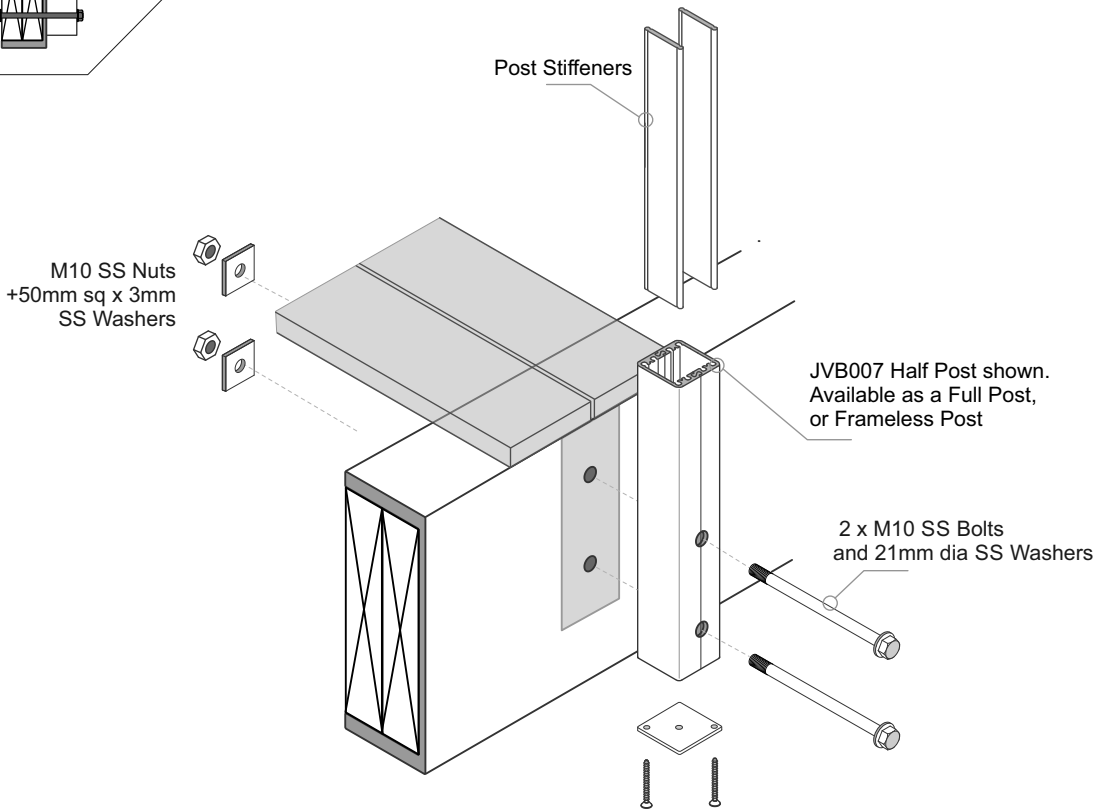

Typical FACE Fix to Steel - JVB137/45, Gutter Bracket - M10 SS Bolts

Balustrade Dimensions by Wind Zone

Up to and including Very High Wind Zone

| Balustrade Height, mm |      |      |      |      |      |          |
|-----------------------|------|------|------|------|------|----------|
| 1000                  | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 max |
| 1400                  | 1350 | 1300 | 1250 | 1200 | 1150 | 1100     |
| Post Spacing max, mm  |      |      |      |      |      |          |



Extra High Wind Zone

|                       |
|-----------------------|
| 17mm Balusters only   |
| Balustrade Height, mm |
| 1275 max              |
| 1400                  |
| Post Spacing max, mm  |

General Notes:


- 1 - All measurements mm
- 2 - Occupancy only A, A other and C3.
- 3 - Balustrade Height measured above Deck/FFL.
- 4 - Wind Zones as per NZS 3604:2011

Floating Decks

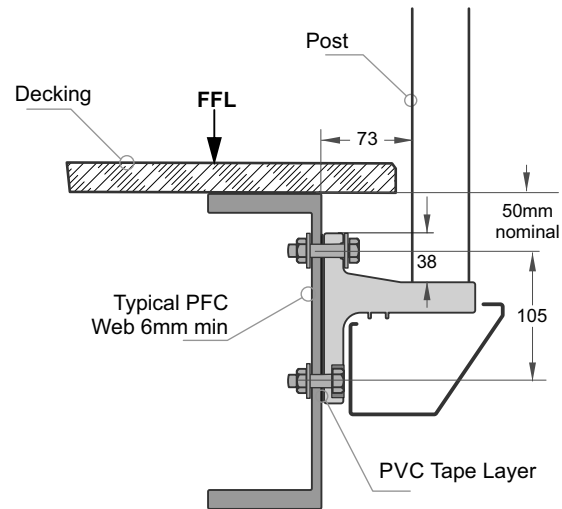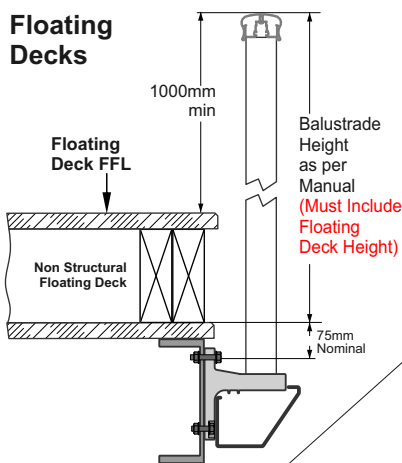

Important Installation notes:

- 1 - The Project Engineer must ensure the structure can support the appropriate loads
- 2 - Substructure shown indicatively only. Timber SG8 minimum strength
- 3 - A PVC Tape layer must be installed between the Gutter Bracket and Steel
- 4 - All Fixings must be Stainless steel

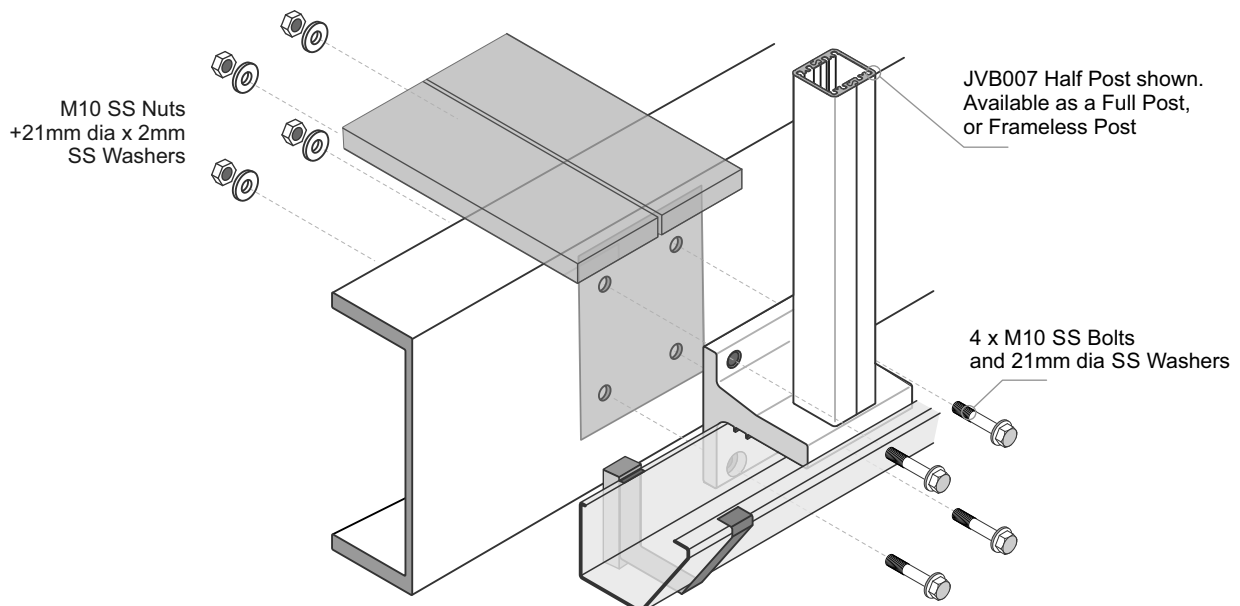

Gutter (if needed) - Runs under the JVB137/45 Gutter Bracket. To be attached separately either side of the Bracket to suit propriety guttering system. Pack out to clear.

Typical TOP Fix to Concrete - JVB100, 100mm x 100mm, 4 hole Base Plate - M10 SS Studs

Balustrade Dimensions by Wind Zone

| Up to and including Very High Wind Zone |      |      |      |      |      |          |
|-----------------------------------------|------|------|------|------|------|----------|
| Balustrade Height, mm                   |      |      |      |      |      |          |
| 1000                                    | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 max |
| 1400                                    | 1350 | 1300 | 1250 | 1150 | 1050 | 1000     |
| Post Spacing max, mm                    |      |      |      |      |      |          |
|                                         |      |      |      |      |      |          |


| Extra High Wind Zone  |  |
|-----------------------|--|
| 17mm Balusters only   |  |
| Balustrade Height, mm |  |
| 1275 max              |  |
| 1300                  |  |
| Post Spacing max, mm  |  |
|                       |  |

- General Notes:
- 1 - All measurements mm
  - 2 - Occupancy only A, A other and C3.
  - 3 - Balustrade Height measured above Deck/FFL.
  - 4 - Wind Zones as per NZS 3604:2011




Installation details Fischer FIS V 300T

- |                     |         |
|---------------------|---------|
| Thread diameter     | M10     |
| Drill hole diameter | = 12 mm |
| Drill hole depth    | = 95 mm |
| Anchorage depth     | = 85 mm |
- 
- |                     |                                                          |
|---------------------|----------------------------------------------------------|
| Drilling method     | Hammer drilling                                          |
| Drill hole cleaning | 4 times blowing,<br>4 times brushing,<br>4 times blowing |
- No borehole cleaning required in case of using a hollow drill bit, e.g. fischer FHD.

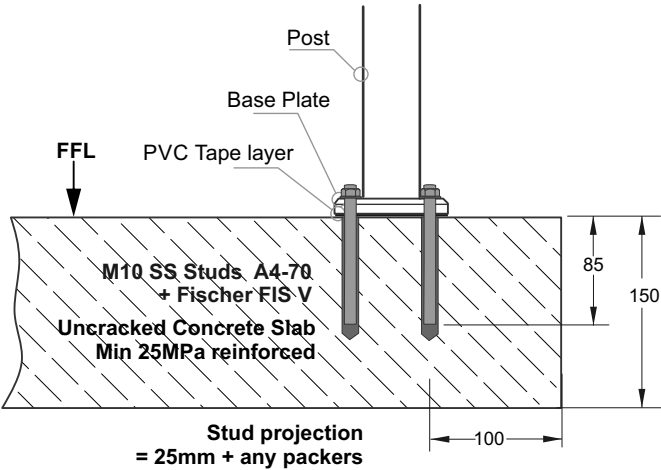

- Important Installation Notes:**
- 1 - The Project Engineer must ensure the structure can support the appropriate loads
  - 2 - Substructure shown indicatively only
  - 3 - Fixings must engage into the structural slab
  - 4 - A PVC Tape layer must be installed between the Baseplate and Concrete
  - 5 - Use Threadlok on Nuts
  - 6 - All fixings must be Stainless Steel

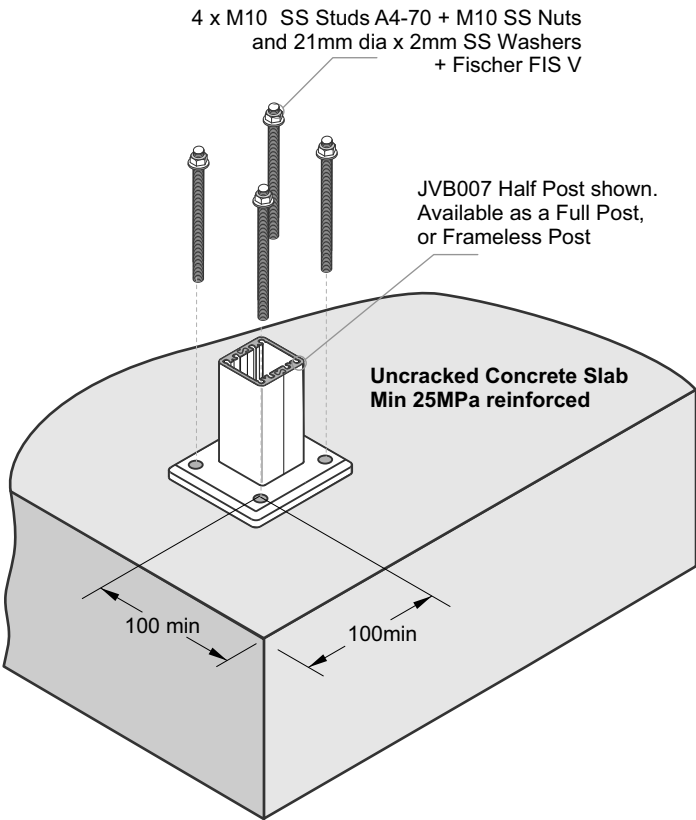

## Typical TOP Fix to Thin Concrete - JVB100, 100mm x 100mm, 4 hole Base Plate - M10 SS Studs

### Balustrade Dimensions - 17mm Balusters ONLY

| Up to and including Extra High Wind Zone |      |      |      |      |      |          |
|------------------------------------------|------|------|------|------|------|----------|
| Balustrade Height, mm                    |      |      |      |      |      |          |
| 1000                                     | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 max |
| 1250                                     | 1200 | 1150 | 1100 | 1050 | 1050 | 1050     |
| Post Spacing max, mm                     |      |      |      |      |      |          |
|                                          |      |      |      |      |      |          |


- General Notes:
- 1 - All measurements mm
  - 2 - Occupancy only A, A other and C3.
  - 3 - Balustrade Height measured above Deck/FFL.
  - 4 - Wind Zones as per NZS 3604:2011




#### Installation details Fischer FIS V 300T

- |                     |                                                          |
|---------------------|----------------------------------------------------------|
| Thread diameter     | M10                                                      |
| Drill hole diameter | = 12 mm                                                  |
| Drill hole depth    | = 70mm                                                   |
| Anchorage depth     | = 60 mm                                                  |
| Drilling method     | Hammer drilling                                          |
| Drill hole cleaning | 4 times blowing,<br>4 times brushing,<br>4 times blowing |

No borehole cleaning required in case of using a hollow drill bit, e.g. fischer FHD.

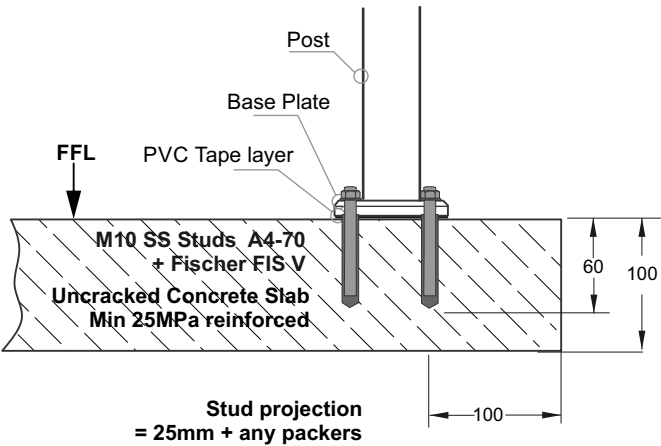

- Important Installation Notes:**
- 1 - The Project Engineer must ensure the structure can support the appropriate loads
  - 2 - Substructure shown indicatively only
  - 3 - Fixings must engage into the structural slab
  - 4 - A PVC Tape layer must be installed between the Baseplate and Concrete
  - 5 - Use Threadlok on Nuts
  - 6 - All fixings must be Stainless Steel

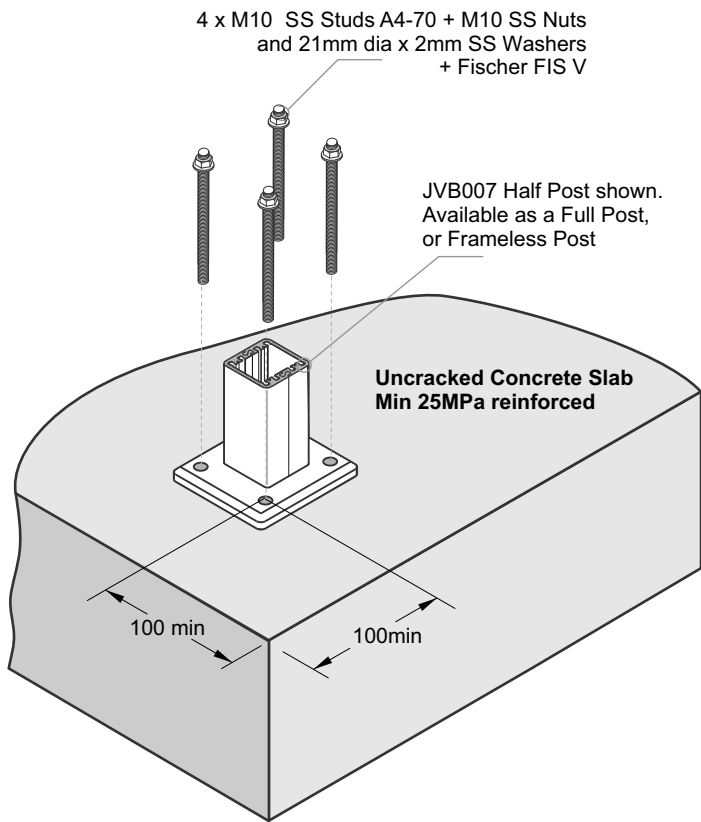



Typical TOP Fix to Concrete - JVB101, 110mm x 90mm, 2 hole Base Plate - M12 SS Studs

Balustrade Dimensions by Wind Zone

Up to and including Very High Wind Zone

| Balustrade Height, mm |      |      |      |      |      |          |
|-----------------------|------|------|------|------|------|----------|
| 1000                  | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 max |
| 1100                  | 1050 | 1000 | 900  | 800  | 750  | 700      |
| Post Spacing max, mm  |      |      |      |      |      |          |

Extra High Wind Zone

| 17mm Balusters only   |
|-----------------------|
| Balustrade Height, mm |
| 1275 max              |
| 900                   |
| Post Spacing max, mm  |

General Notes:

- 1 - All measurements mm
- 2 - Occupancy only A, A other and C3.
- 3 - Balustrade Height measured above Deck/FFL.
- 4 - Wind Zones as per NZS 3604:2011




Installation details Fischer FIS V 300T

|                     |          |
|---------------------|----------|
| Thread diameter     | M12      |
| Drill hole diameter | = 14 mm  |
| Drill hole depth    | = 100 mm |
| Anchorage depth     | = 90 mm  |


|                     |                                                          |
|---------------------|----------------------------------------------------------|
| Drilling method     | Hammer drilling                                          |
| Drill hole cleaning | 4 times blowing,<br>4 times brushing,<br>4 times blowing |

No borehole cleaning required in case of using a hollow drill bit, e.g. fischer FHD.

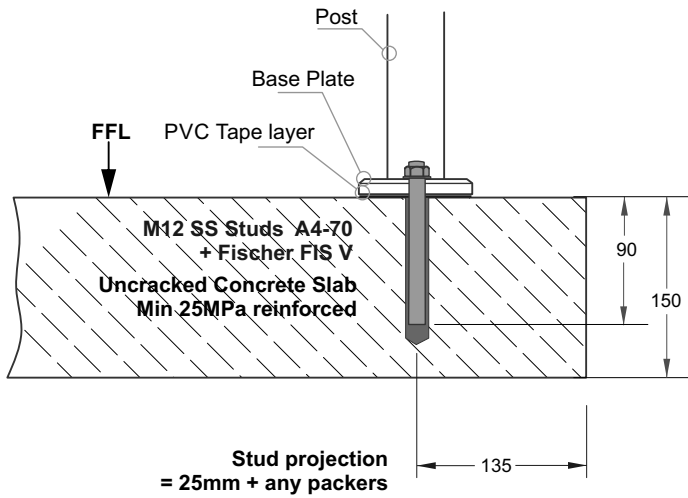

Important Installation Notes:

- 1 - The Project Engineer must ensure the structure can support the appropriate loads
- 2 - Substructure shown indicatively only
- 3 - Fixings must engage into the structural slab
- 4 - A PVC Tape layer must be installed between the Baseplate and Concrete
- 5 - Use Threadlok on Nuts
- 6 - All fixings must be Stainless Steel

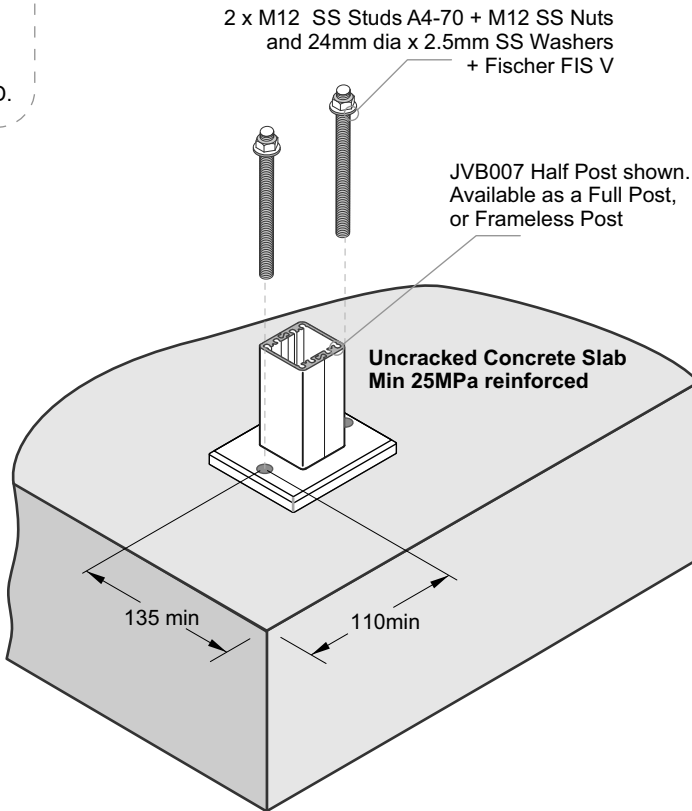


Typical TOP Fix to Concrete - Embed Post in Concrete Slab

Balustrade Dimensions by Wind Zone


| Up to and including Very High Wind Zone |      |      |      |      |      |          |
|-----------------------------------------|------|------|------|------|------|----------|
| Balustrade Height, mm                   |      |      |      |      |      |          |
| 1000                                    | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 max |
| 1400                                    | 1350 | 1300 | 1250 | 1200 | 1150 | 1100     |
| Post Spacing max, mm                    |      |      |      |      |      |          |
|                                         |      |      |      |      |      |          |

| Extra High Wind Zone  |  |
|-----------------------|--|
| 17mm Balusters only   |  |
| Balustrade Height, mm |  |
| 1275 max              |  |
| 1400                  |  |
| Post Spacing max, mm  |  |
|                       |  |

- General Notes:
- 1 - All measurements mm
  - 2 - Occupancy only A, A other and C3.
  - 3 - Balustrade Height measured above Deck/FFL.
  - 4 - Wind Zones as per NZS 3604:2011

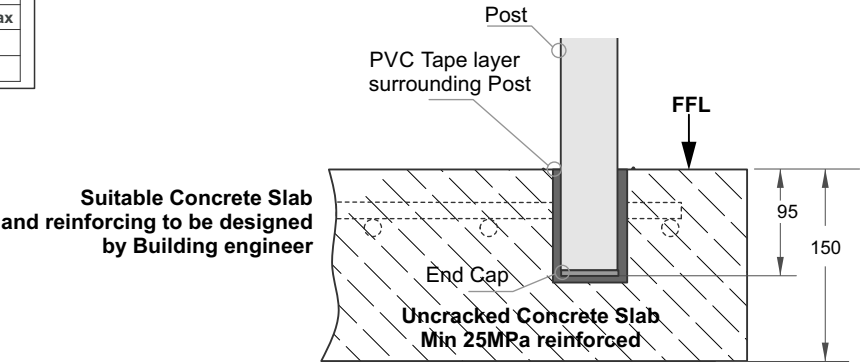

- Important Installation notes:**
- 1 - The Project Engineer must ensure the structure can support the appropriate loads
  - 2 - Substructure shown indicatively only
  - 3 - A PVC Tape layer must completely surround the Post
  - 4 - Mortar pocket 60mm sq or 80mm dia.
- Avoid mortar splashes on exposed aluminium. Wash off immediately.

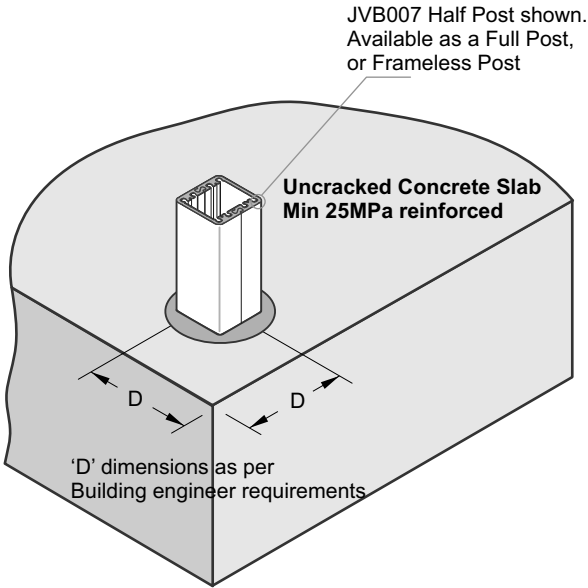

Typical FACE Fix Post to Concrete - M10 SS Studs

Balustrade Dimensions by Wind Zone

Up to and including Very High Wind Zone


| Balustrade Height, mm |      |      |      |      |      |          |
|-----------------------|------|------|------|------|------|----------|
| 1000                  | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 max |
| 1200                  | 1100 | 1000 | 900  | 850  | 800  | 750      |
| Post Spacing max, mm  |      |      |      |      |      |          |

Extra High Wind Zone

|                       |
|-----------------------|
| 17mm Balusters only   |
| Balustrade Height, mm |
| 1275 max              |
| 1000                  |
| Post Spacing max, mm  |

General Notes:

- 1 - All measurements mm
- 2 - Occupancy only A, A other and C3.
- 3 - Balustrade Height measured above Deck/FFL.
- 4 - Wind Zones as per NZS 3604:2011

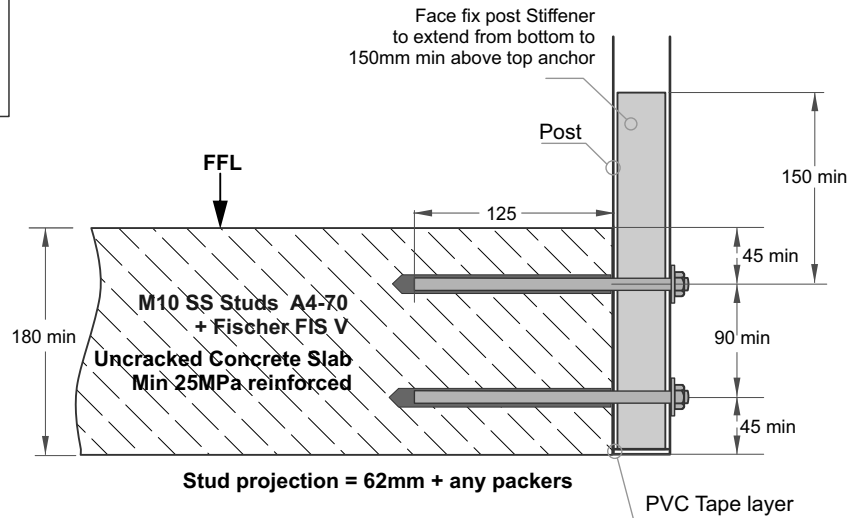

Installation details Fischer FIS V 300T


|                     |          |
|---------------------|----------|
| Thread diameter     | M10      |
| Drill hole diameter | = 12 mm  |
| Drill hole depth    | = 135 mm |
| Anchorage depth     | = 125 mm |

|                     |                                                          |
|---------------------|----------------------------------------------------------|
| Drilling method     | Hammer drilling                                          |
| Drill hole cleaning | 4 times blowing,<br>4 times brushing,<br>4 times blowing |

No borehole cleaning required in case of using a hollow drill bit, e.g. fischer FHD.

Important Installation Notes:

- 1 - The Project Engineer must ensure the structure can support the appropriate loads
- 2 - Substructure shown indicatively only
- 3 - Fixings must engage into the structural slab
- 4 - A PVC Tape layer must be installed between the Post and Concrete
- 5 - Use Threadlok on Nuts
- 6 - All fixings must be Stainless Steel

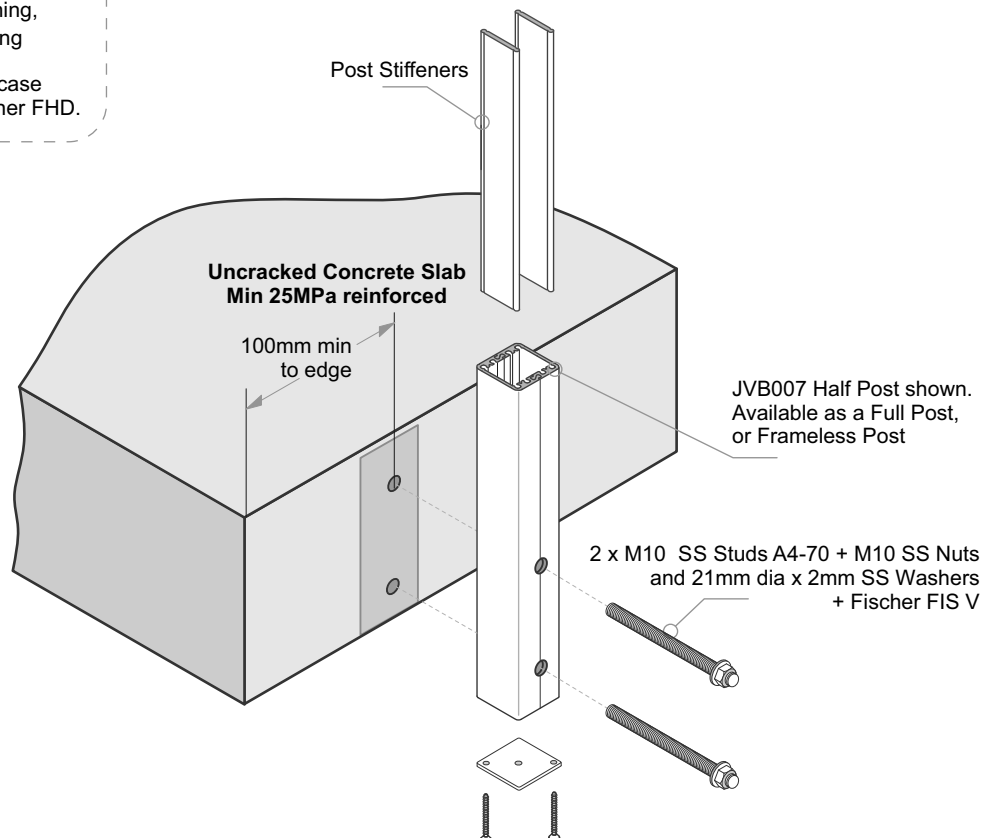

**Typical FACE Fix Post to Blockwall - M12 SS Studs**

**Balustrade Dimensions by Wind Zone**

**Up to and including Very High Wind Zone**

| Balustrade Height, mm |      |      |      |      |      |          |
|-----------------------|------|------|------|------|------|----------|
| 1000                  | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 max |
| 1200                  | 1100 | 1000 | 900  | 850  | 800  | 750      |
| Post Spacing max, mm  |      |      |      |      |      |          |

**Extra High Wind Zone**

|                       |
|-----------------------|
| 17mm Balusters only   |
| Balustrade Height, mm |
| <b>1275 max</b>       |
| 1050                  |
| Post Spacing max, mm  |

**General Notes:**


- 1 - All measurements mm
- 2 - Occupancy only A, A other and C3.
- 3 - Balustrade Height measured above Deck/FFL.
- 4 - Wind Zones as per NZS 3604:2011



**Installation details Hilti RE-500 V4**


|                     |                                                          |
|---------------------|----------------------------------------------------------|
| Thread diameter     | M12                                                      |
| Drill hole diameter | = 14 mm                                                  |
| Drill hole depth    | = 80mm                                                   |
| Anchorage depth     | = 70mm                                                   |
| Drilling method     | Hammer drilling                                          |
| Drill hole cleaning | 4 times blowing,<br>4 times brushing,<br>4 times blowing |

No borehole cleaning required in case of using a hollow drill bit.

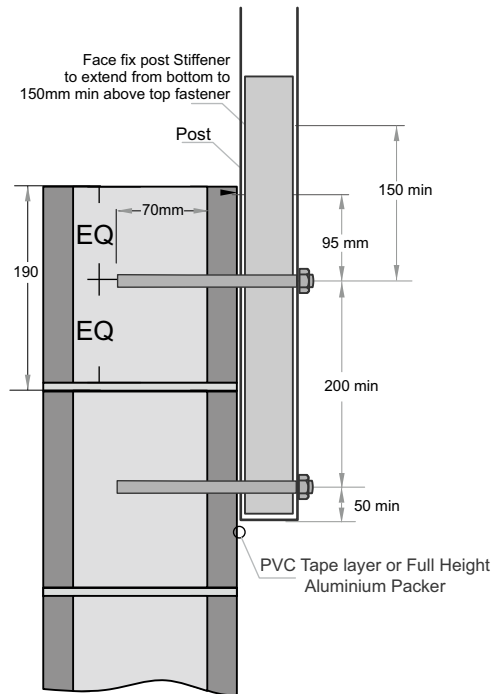

**Important Installation Notes:**

- 1 - The Project Engineer must ensure the structure can support the appropriate loads
- 2 - Substructure shown indicatively only
- 3 - Fixings must engage into the structural slab
- 4 - A PVC Tape layer must be installed between the Post and Concrete
- 5 - Use Threadlok on Nuts
- 6 - All fixings must be Stainless Steel

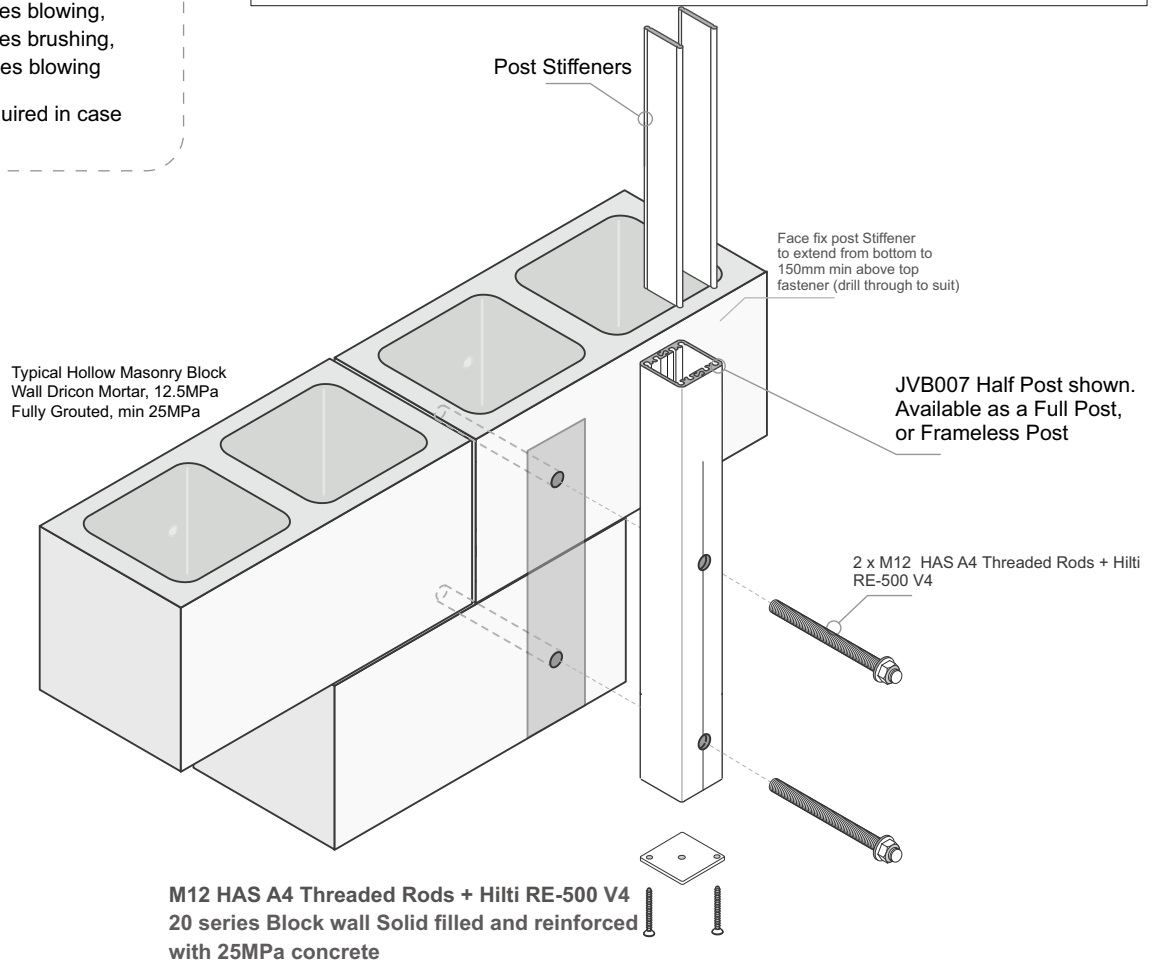

Typical FACE Fix to Concrete - JVB137/45, Gutter Bracket - M10 SS Studs

Balustrade Dimensions by Wind Zone

Up to and including Very High Wind Zone

| Balustrade Height, mm |      |      |      |      |      |          |
|-----------------------|------|------|------|------|------|----------|
| 1000                  | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 max |
| 1400                  | 1350 | 1300 | 1250 | 1200 | 1150 | 1100     |
| Post Spacing max, mm  |      |      |      |      |      |          |

Extra High Wind Zone

|                       |
|-----------------------|
| 17mm Balusters only   |
| Balustrade Height, mm |
| 1275 max              |
| 1400                  |
| Post Spacing max, mm  |

General Notes:

- 1 - All measurements mm
- 2 - Occupancy only A, A other and C3.
- 3 - Balustrade Height measured above Deck/FLL.
- 4 - Wind Zones as per NZS 3604:2011




Installation details Fischer FIS V 300T

|                     |          |
|---------------------|----------|
| Thread diameter     | M10      |
| Drill hole diameter | = 12 mm  |
| Drill hole depth    | = 130 mm |
| Anchorage depth     | = 120 mm |

|                     |                                                          |
|---------------------|----------------------------------------------------------|
| Drilling method     | Hammer drilling                                          |
| Drill hole cleaning | 4 times blowing,<br>4 times brushing,<br>4 times blowing |


No borehole cleaning required in case of using a hollow drill bit, e.g. fischer FHD.

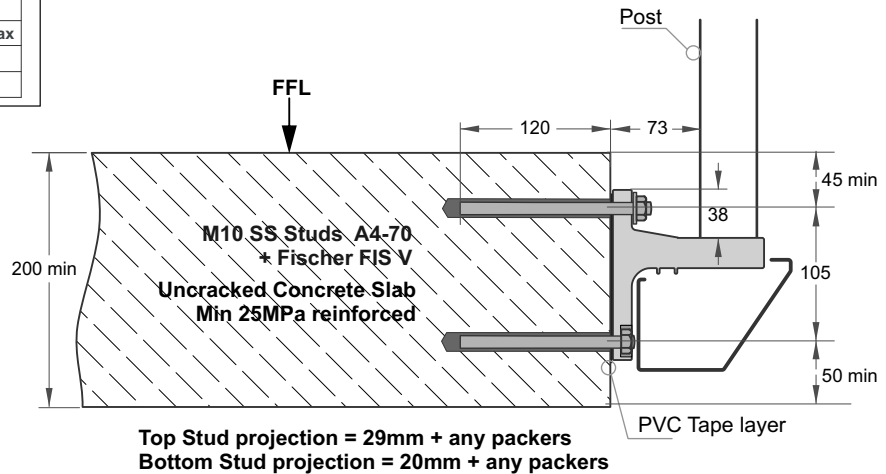

Top Stud projection = 29mm + any packers  
Bottom Stud projection = 20mm + any packers

Important Installation Notes:

- 1 - The Project Engineer must ensure the structure can support the appropriate loads
- 2 - Substructure shown indicatively only
- 3 - Fixings must engage into the structural slab
- 4 - A PVC Tape layer must be installed between the Gutter Bracket and Concrete
- 5 - Use Threadlok on Nuts
- 6 - All fixings must be Stainless Steel

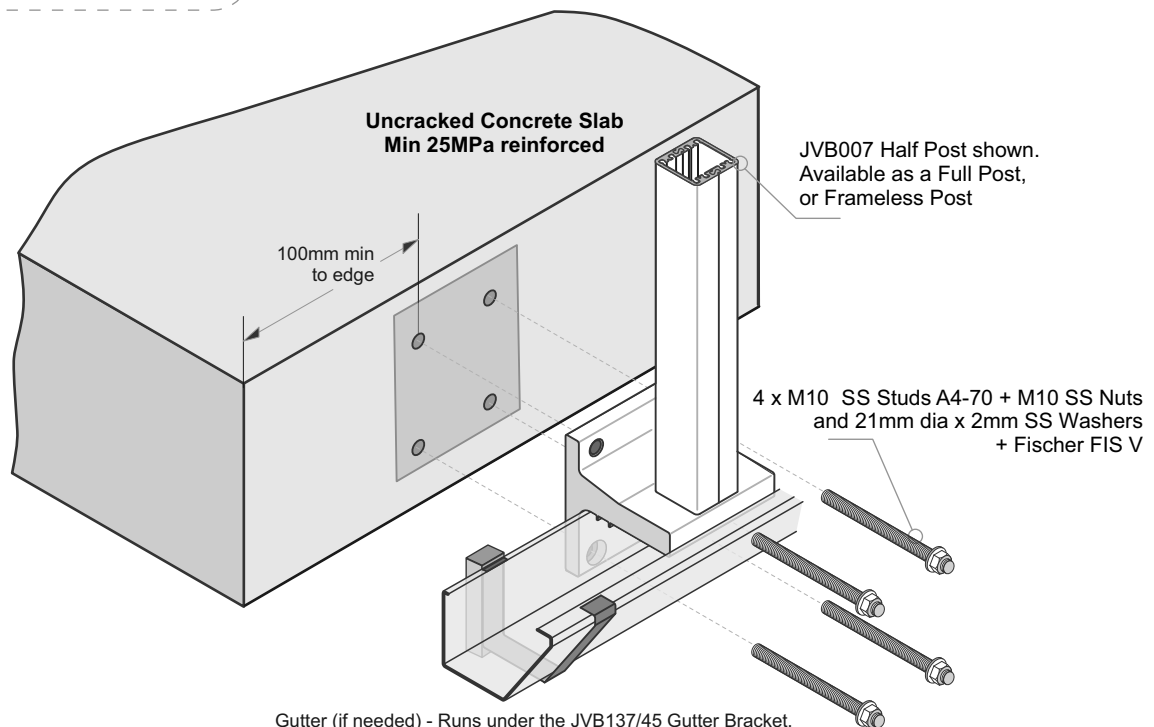

Gutter (if needed) - Runs under the JVB137/45 Gutter Bracket.  
To be attached separately either side of the Bracket to suit propriety guttering system.  
Pack out to clear.

**Typical TOP Fix to Timber - JVB121, 110mm x 90mm, 4 hole Base Plate - M10 SS Coachscrews or Bolts**

The pre NZS3604:2011 mounting details are included for older, existing buildings. New buildings must comply with NZS3604:2011- Double Boundary Joists

**Balustrade Dimensions by Wind Zone**

**Up to and including Very High Wind Zone**


| Balustrade Height, mm |      |      |      |      |
|-----------------------|------|------|------|------|
| 1000                  | 1050 | 1100 | 1150 | 1200 |
| 1400                  | 1350 | 1300 | 1250 | 1200 |
| Post Spacing max, mm  |      |      |      |      |

**Extra High Wind Zone**

**NOT SUITABLE.**

**General Notes:**


- 1 - All measurements mm
- 2 - Occupancy only A, A other and C3.
- 3 - Balustrade Height measured above Deck/FFL.
- 4 - Wind Zones as per NZS 3604:2011

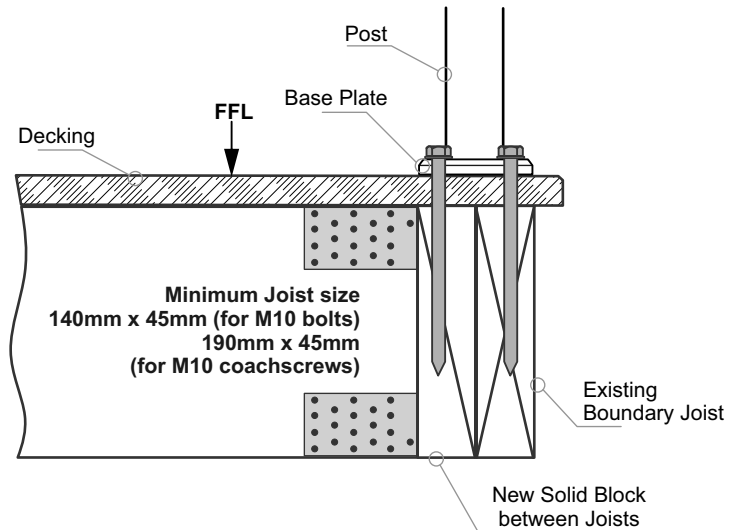

**Important Installation notes:**

- 1 - The Project Engineer must ensure the structure can support the appropriate loads
- 2 - Substructure shown indicatively only. New Timber SG8 minimum strength
- 3 - Coachscrews 130mm min engagement into joists, predrill 6mm hole
- 4 - Bond all coachscrews with SIKA Supergrip to full depth
- 5 - All Fixings must be Stainless steel

4 x M10 SS Coachscrews + 21mm dia x 2mm SS Washers  
 (or 4 x M10 SS Bolts and 21dia SS washers Top  
 and 40mm sq x 3mm SS Washers under)

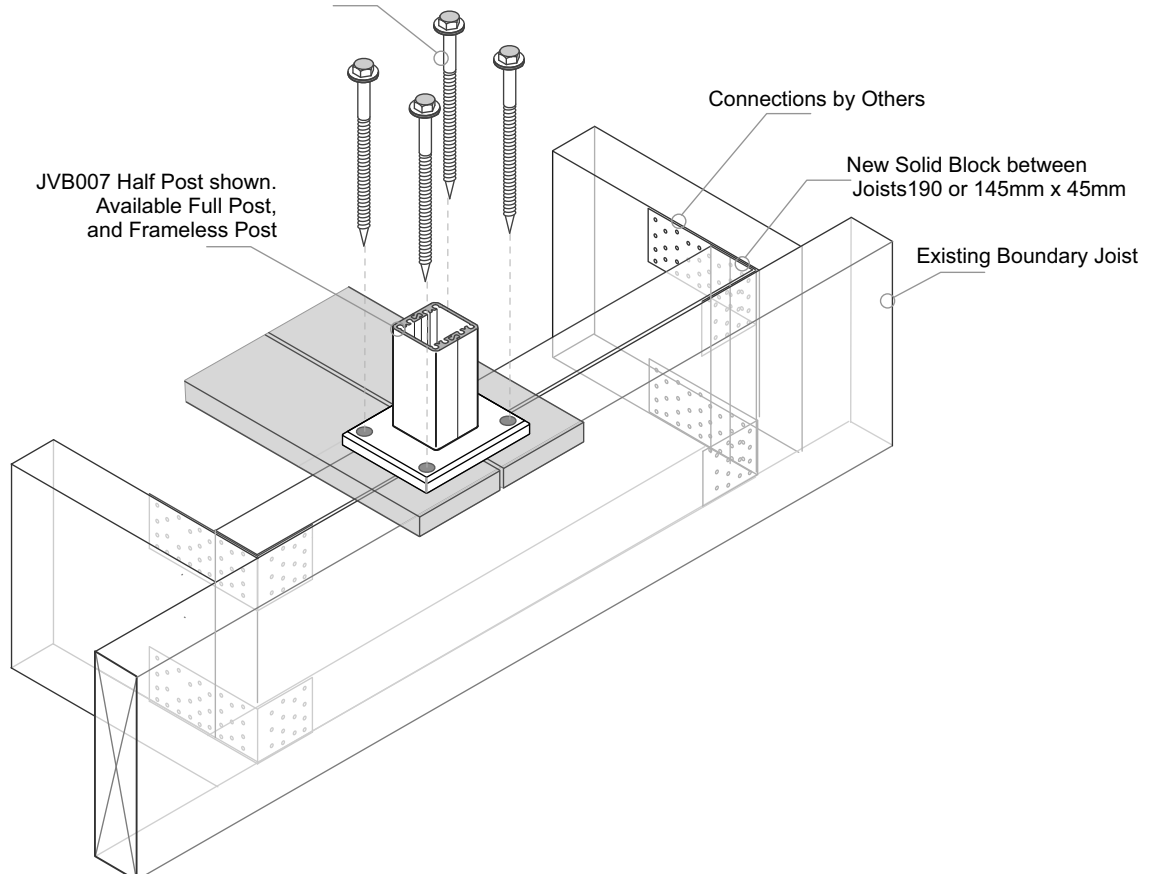

**Typical TOP Fix to Timber - JVB100, 100mm x 100mm, 4 hole Base Plate - M10 SS Coachscrews or Bolts**

The pre NZS3604:2011 mounting details are included for older, existing buildings. New buildings must comply with NZS3604:2011- Double Boundary Joists

**Balustrade Dimensions by Wind Zone**

**Up to and including Very High Wind Zone**


| Balustrade Height, mm |      |      |      |      |
|-----------------------|------|------|------|------|
| 1000                  | 1050 | 1100 | 1150 | 1200 |
| 1400                  | 1350 | 1300 | 1250 | 1200 |
| Post Spacing max, mm  |      |      |      |      |

**Extra High Wind Zone**

**NOT SUITABLE.**


**General Notes:**

- 1 - All measurements mm
- 2 - Occupancy only A, A other and C3.
- 3 - Balustrade Height measured above Deck/FFL.
- 4 - Wind Zones as per NZS 3604:2011

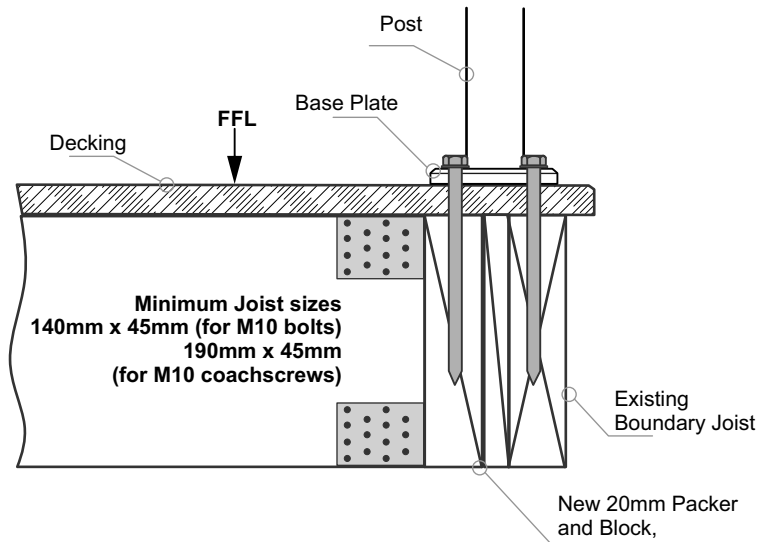

**Important Installation notes:**

- 1 - The Project Engineer must ensure the structure can support the appropriate loads
- 2 - Substructure shown indicatively only. New Timber SG8 minimum strength
- 3 - Coachscrews 130mm min engagement into joists, predrill 6mm hole
- 4 - Bond all coachscrews with SIKA Supergrip to full depth
- 5 - All Fixings must be Stainless steel

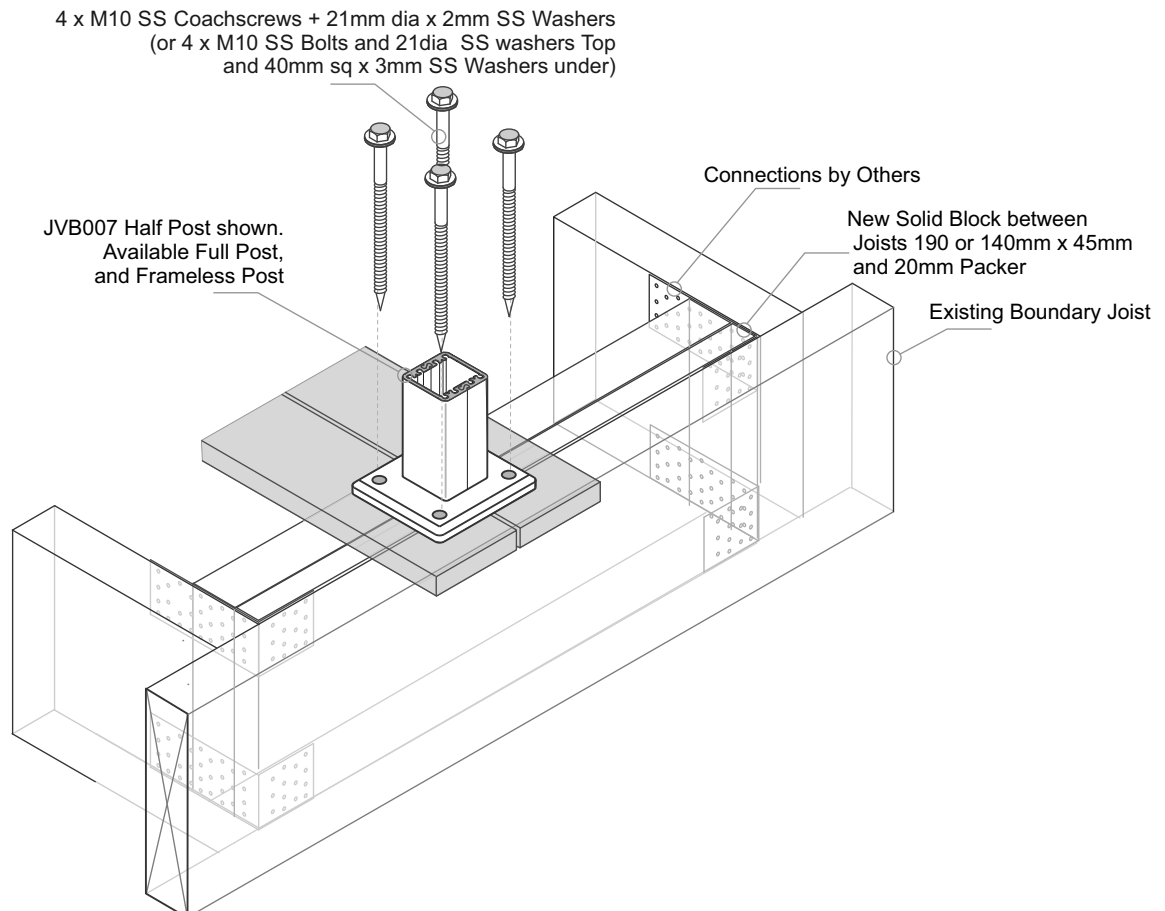



### Typical FACE Fix Post to Timber - M10 SS Bolts or Threaded Rod

The pre NZS3604:2011 mounting details are included for older, existing buildings. New buildings must comply with NZS3604:2011- Double Boundary Joists

#### Balustrade Dimensions by Wind Zone

##### Up to and including Very High Wind Zone


| Balustrade Height, mm |      |      |      |      |
|-----------------------|------|------|------|------|
| 1000                  | 1050 | 1100 | 1150 | 1200 |
| 1400                  | 1350 | 1300 | 1250 | 1200 |
| Post Spacing max, mm  |      |      |      |      |

##### Extra High Wind Zone

NOT SUITABLE.


#### General Notes:

- 1 - All measurements mm
- 2 - Occupancy only A, A other and C3.
- 3 - Balustrade Height measured above Deck/FFL.
- 4 - Wind Zones as per NZS 3604:2011

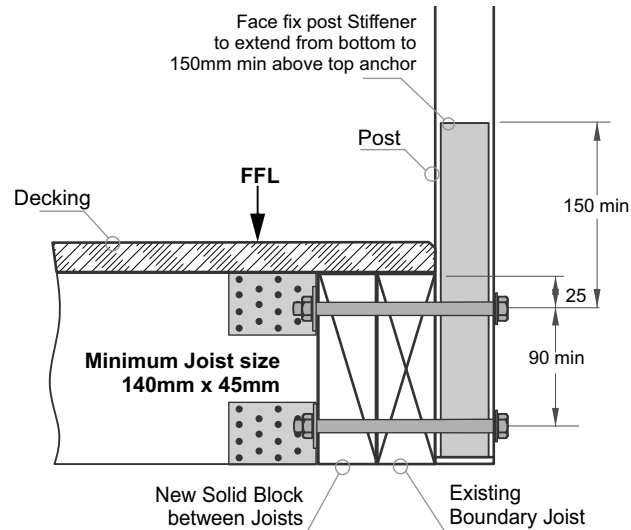

#### Important Installation notes:

- 1 - The Project Engineer must ensure the structure can support the appropriate loads
- 2 - Substructure shown indicatively only. New Timber SG8 minimum strength
- 3 - All Fixings must be Stainless steel

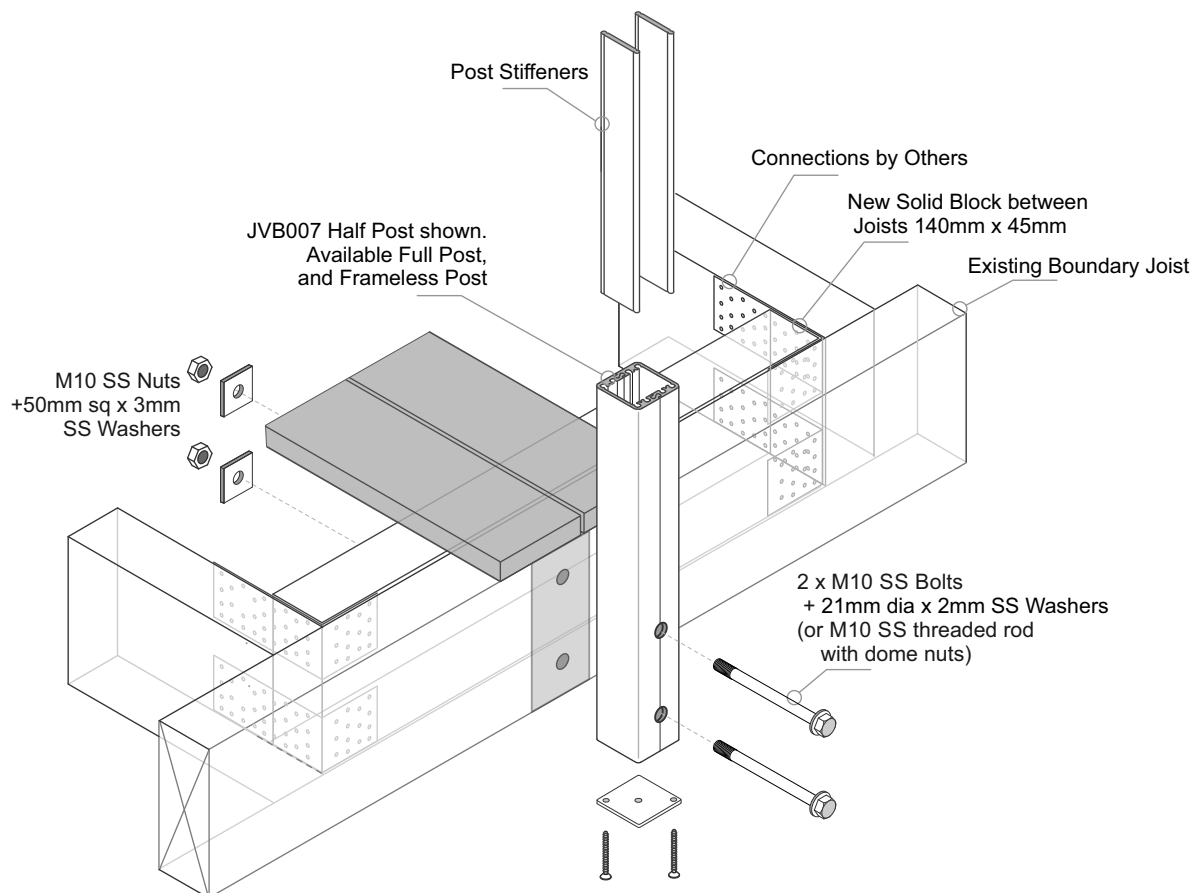



### Typical FACE Fix Post to Timber - M10 SS Coachscrews

The pre NZS3604:2011 mounting details are included for older, existing buildings. New buildings must comply with NZS3604:2011- Double Boundary Joists

#### Balustrade Dimensions by Wind Zone

##### Up to and including Very High Wind Zone


| Balustrade Height, mm |      |      |      |      |
|-----------------------|------|------|------|------|
| 1000                  | 1050 | 1100 | 1150 | 1200 |
| 1400                  | 1350 | 1300 | 1250 | 1200 |
| Post Spacing max, mm  |      |      |      |      |

#### Extra High Wind Zone

NOT SUITABLE.


#### General Notes:

- 1 - All measurements mm
- 2 - Occupancy only A, A other and C3.
- 3 - Balustrade Height measured above Deck/FFL.
- 4 - Wind Zones as per NZS 3604:2011

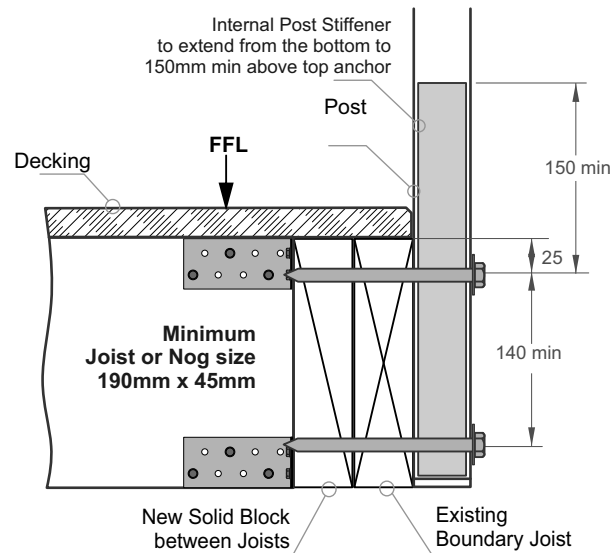

#### Important Installation notes:

- 1 - The Project Engineer must ensure the structure can support the appropriate loads
- 2 - Substructure shown indicatively only. New Timber SG8 minimum strength
- 3 - Coachscrews 90mm min engagement into joists, predrill 6mm hole
- 4 - Bond all coachscrews with SIKa Supergrip to full depth
- 5 - All Fixings must be Stainless steel

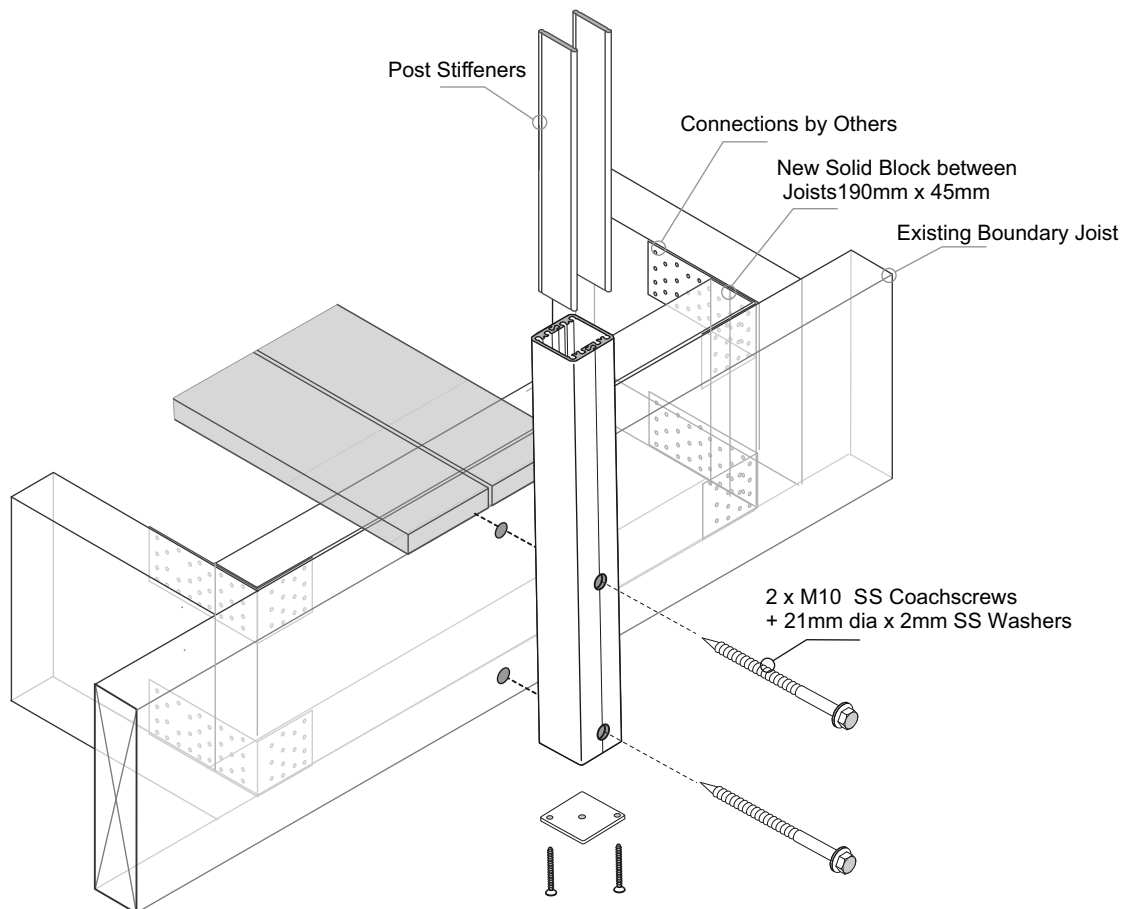

### Typical FACE Fix to Timber - JVB137/45, Gutter Bracket - M10 SS Coachscrews

The pre NZS3604:2011 mounting details are included for older, existing buildings. New buildings must comply with NZS3604:2011- Double Boundary Joists

#### Balustrade Dimensions by Wind Zone.

#### Up to and including Very High Wind Zone


| Balustrade Height, mm |      |      |      |      |
|-----------------------|------|------|------|------|
| 1000                  | 1050 | 1100 | 1150 | 1200 |
| 1400                  | 1350 | 1300 | 1250 | 1200 |
| Post Spacing max, mm  |      |      |      |      |

#### Extra High Wind Zone

NOT SUITABLE.


#### General Notes:

- 1 - All measurements mm
- 2 - Occupancy only A, A other and C3.
- 3 - Balustrade Height measured above Deck/FLL.
- 4 - Wind Zones as per NZS 3604:2011

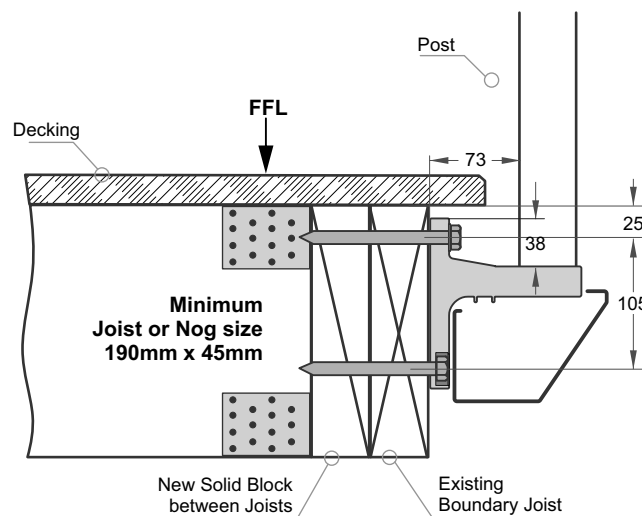

#### Important Installation notes:

- 1 - The Project Engineer must ensure the structure can support the appropriate loads
- 2 - Substructure shown indicatively only. New Timber SG8 minimum strength
- 3 - Coachscrews 90mm min engagement into joists, predrill 6mm hole
- 4 - Bond all coachscrews with SIKa Supergrip to full depth
- 5 - All Fixings must be Stainless steel

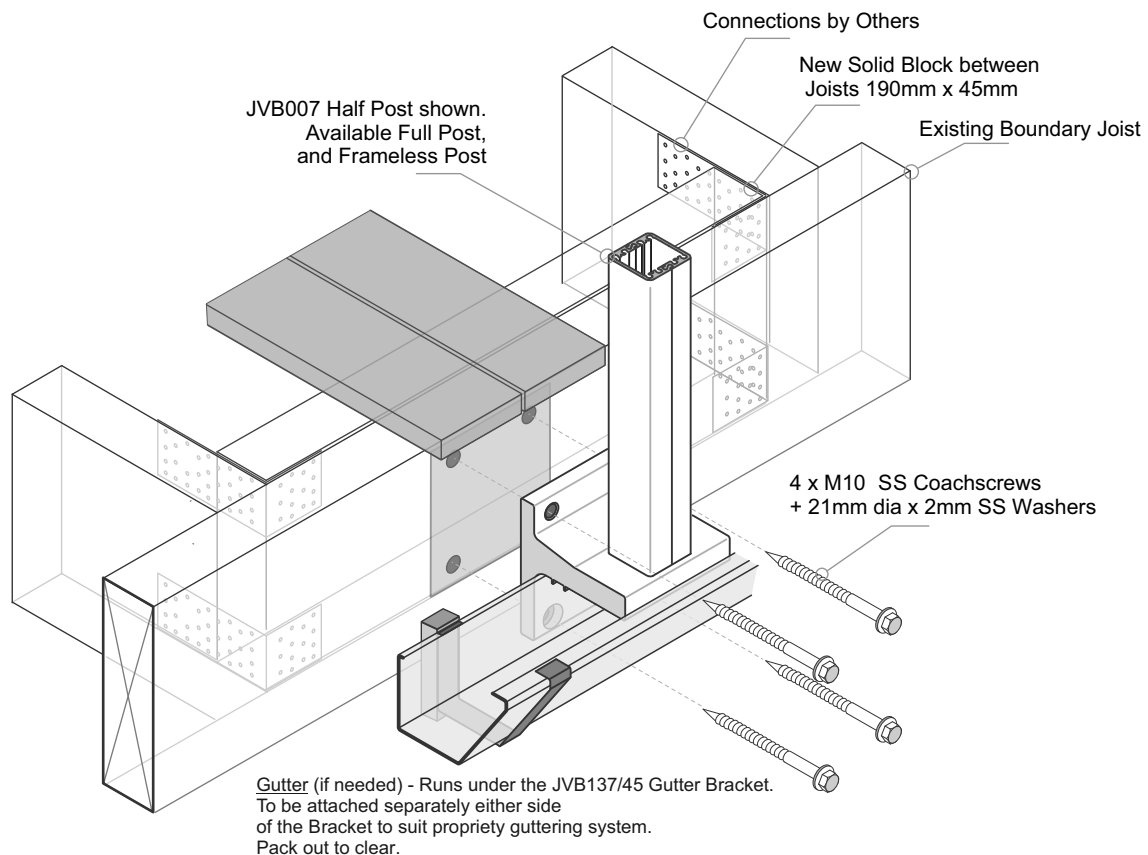

The pre NZS3604:2011 mounting details are included for older, existing buildings. New buildings must comply with NZS3604:2011- Double Boundary Joists

**Balustrade Dimensions by Wind Zone**

**Up to and including Very High Wind Zone**


| Balustrade Height, mm |      |      |      |      |
|-----------------------|------|------|------|------|
| 1000                  | 1050 | 1100 | 1150 | 1200 |
| 1400                  | 1350 | 1300 | 1250 | 1200 |
| Post Spacing max, mm  |      |      |      |      |

**Extra High Wind Zone**

**NOT SUITABLE.**


**General Notes:**

- 1 - All measurements mm
- 2 - Occupancy only A, A other and C3.
- 3 - Balustrade Height measured above Deck/FFL.
- 4 - Wind Zones as per NZS 3604:2011

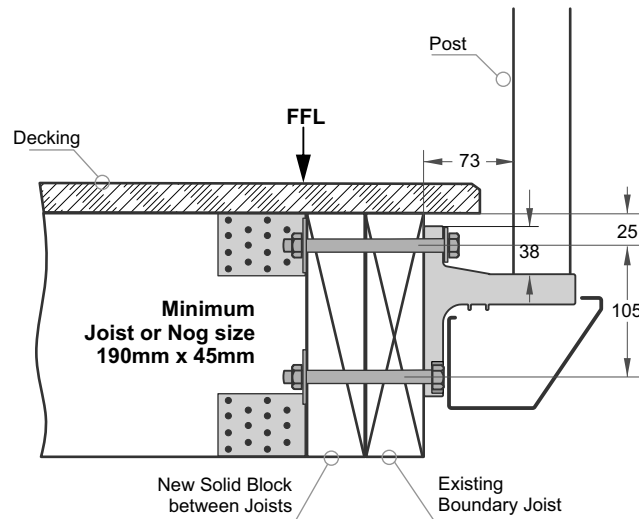




**Important Installation notes:**

- 1 - The Project Engineer must ensure the structure can support the appropriate loads
- 2 - Substructure shown indicatively only. New Timber SG8 minimum strength
- 3 - All Fixings must be Stainless steel

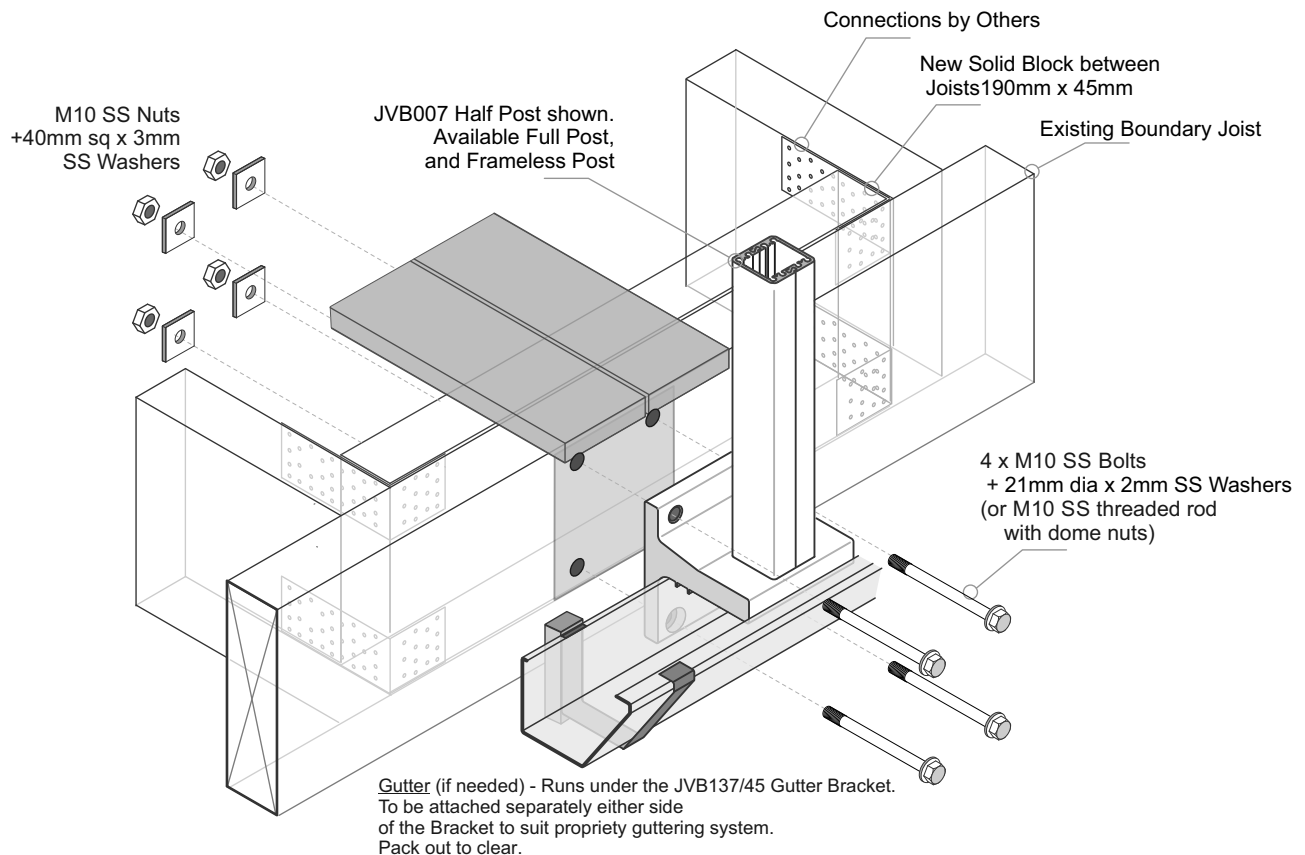


# Juralco Viking® Balustrade System


## Typical Assembly - One Piece Post to Rail

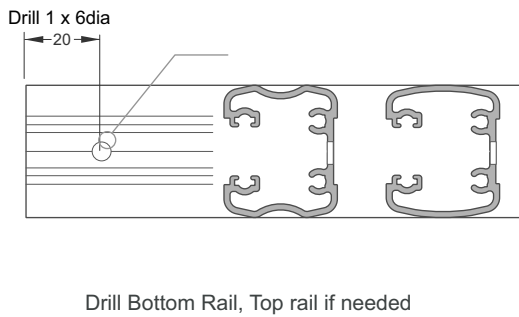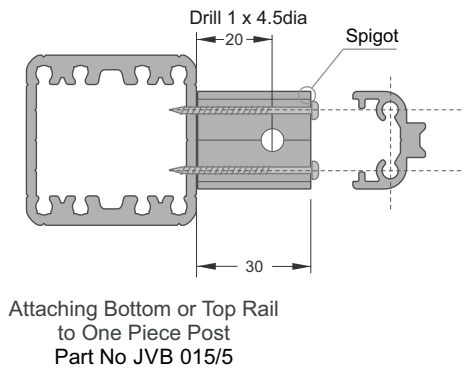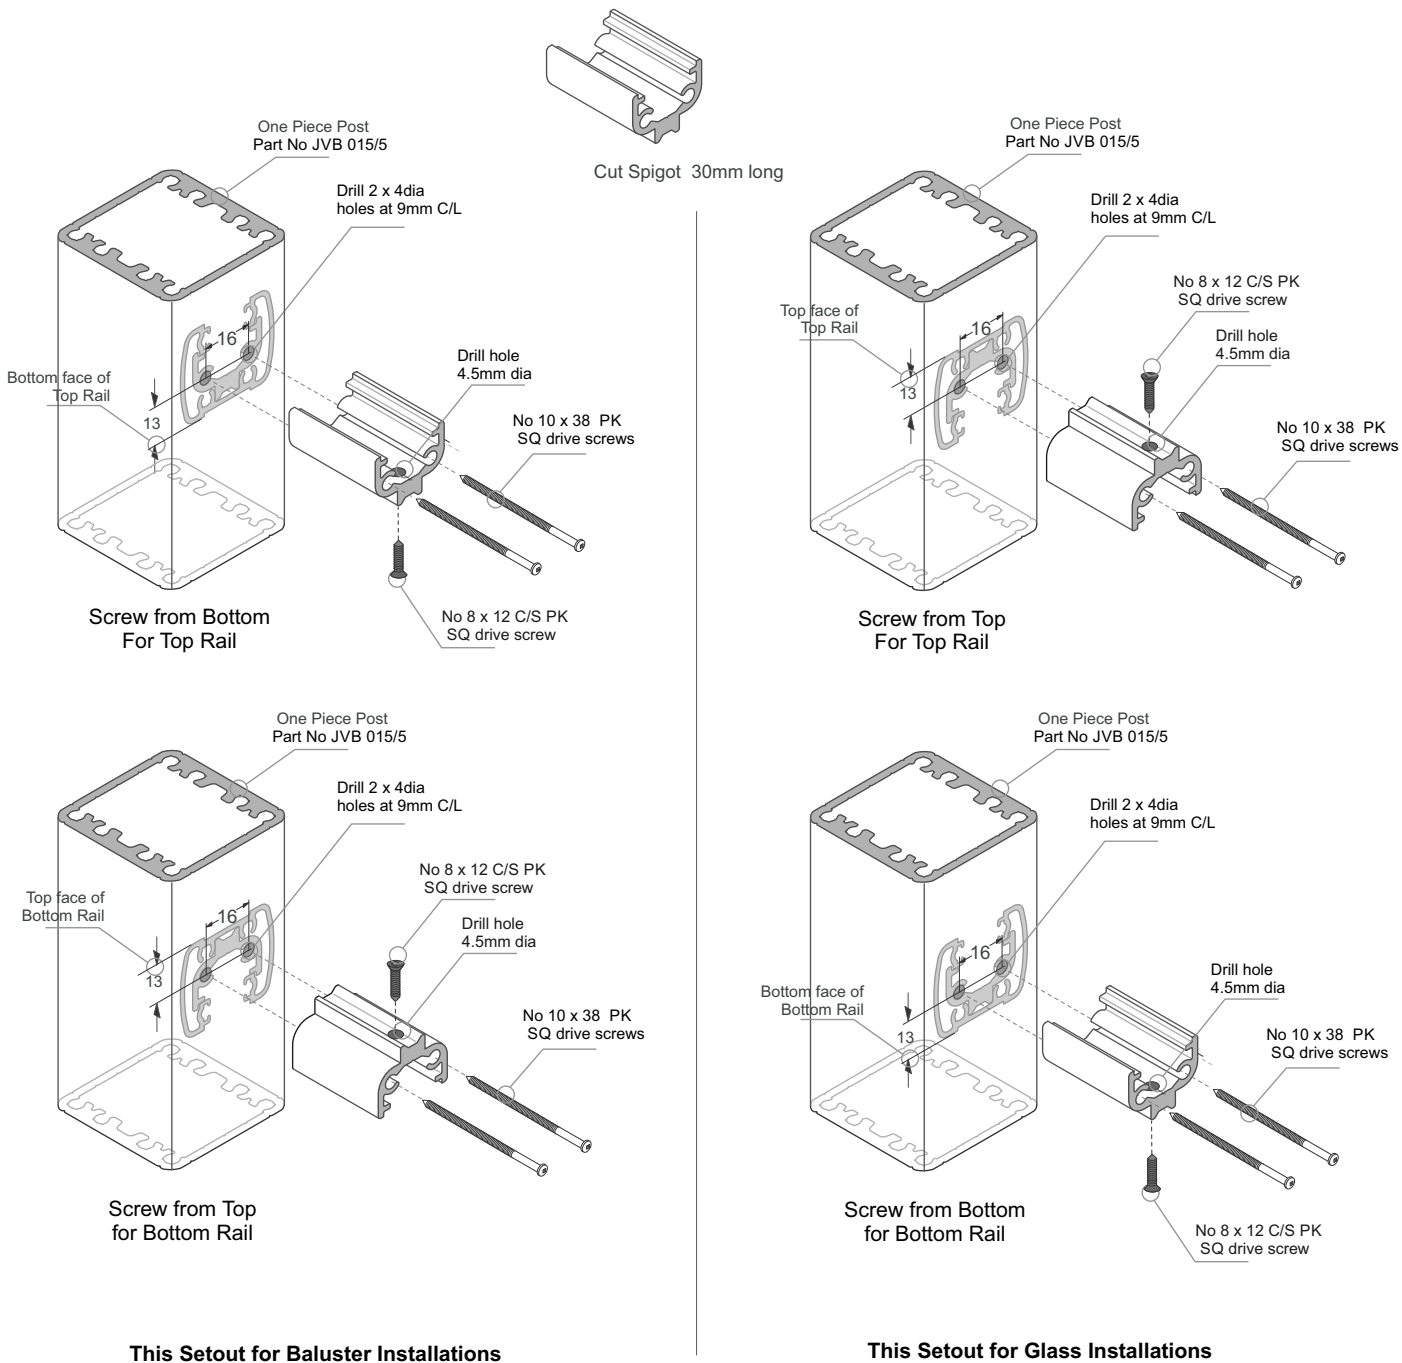

**1 - Refer Post Mounting type and installation Wind zone. Then choose Balustrade Height and max Post spacing.**

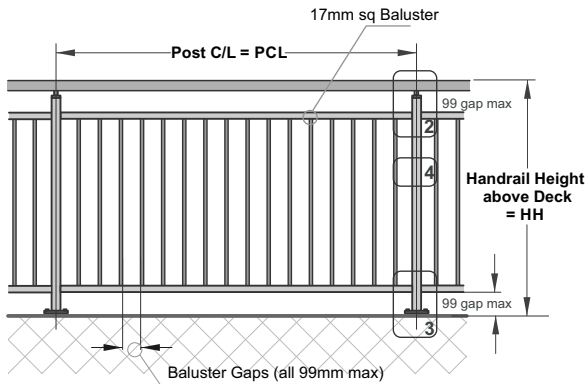

**2 - Handrail - Offsets**

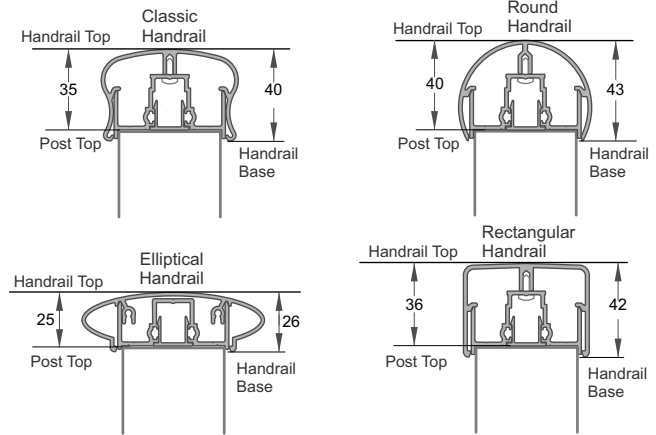


**A**  
For Post Height.  
Post Top to Handrail Top  
25-40 Depending on  
chosen Handrail


**B**  
For Top Gap Height  
Handrail Base to Handrail Top  
26-43 Depending on  
chosen Handrail

**3 - Post Height offsets**

**Selected  
Handrail  
as above**

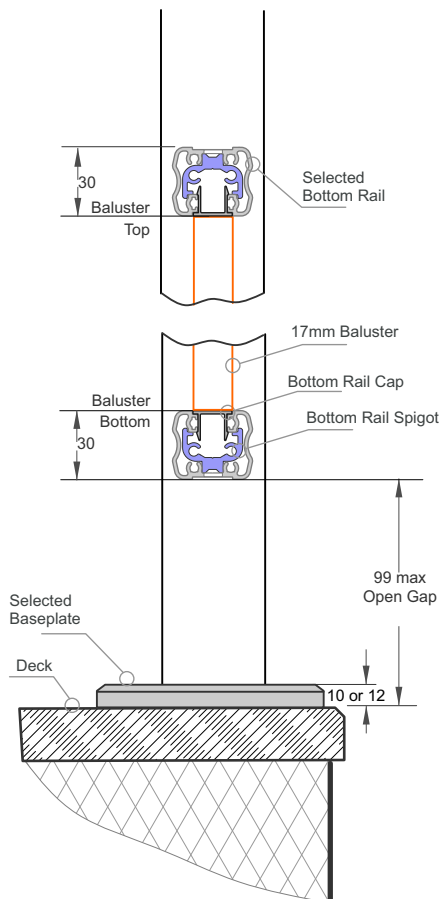

**4 - Width Offsets**

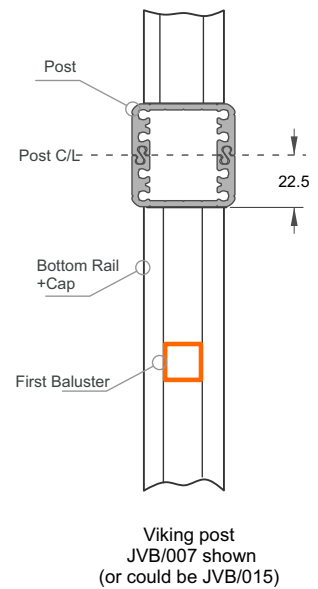


Viking post  
JVB/007 shown  
(or could be JVB/015)


**5 - Cutting Guide**

- a - Hand Rail = Use maximum lengths
- b - Post, Cut to  
= HH - **A** - (10 or 12) = Post Height
- c - Bottom Rail (x2), Cut to  
= PCL - 2x22.5 = PCL - 45
- d - 17mm Balustrade Height  
= HH - **B** - 2x99 - 2x30

**1 - Refer Post Mounting type and installation Wind zone. Then choose Balustrade Height and max Post spacing.**

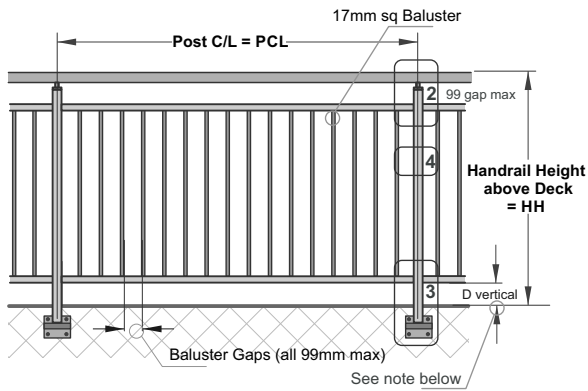

**2 - Handrail - Offsets**

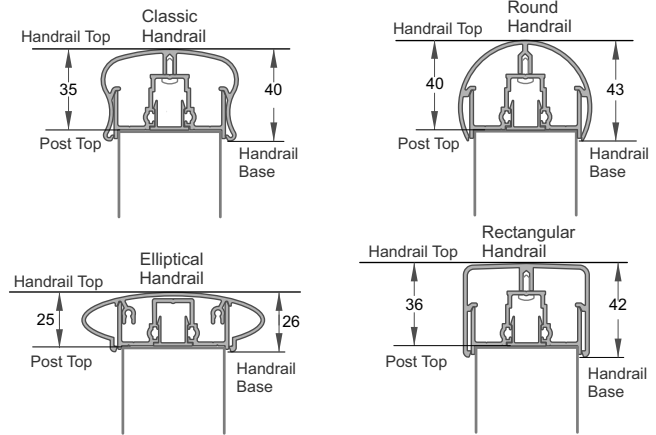


**A**  
For Post Height.  
Post Top to Handrail Top  
25-40 Depending on  
chosen Handrail

**B**  
For Top Gap Height  
Handrail Base to Handrail Top  
26-43 Depending on  
chosen Handrail

**3 - Post Height offsets**


Selected  
Handrail  
as above

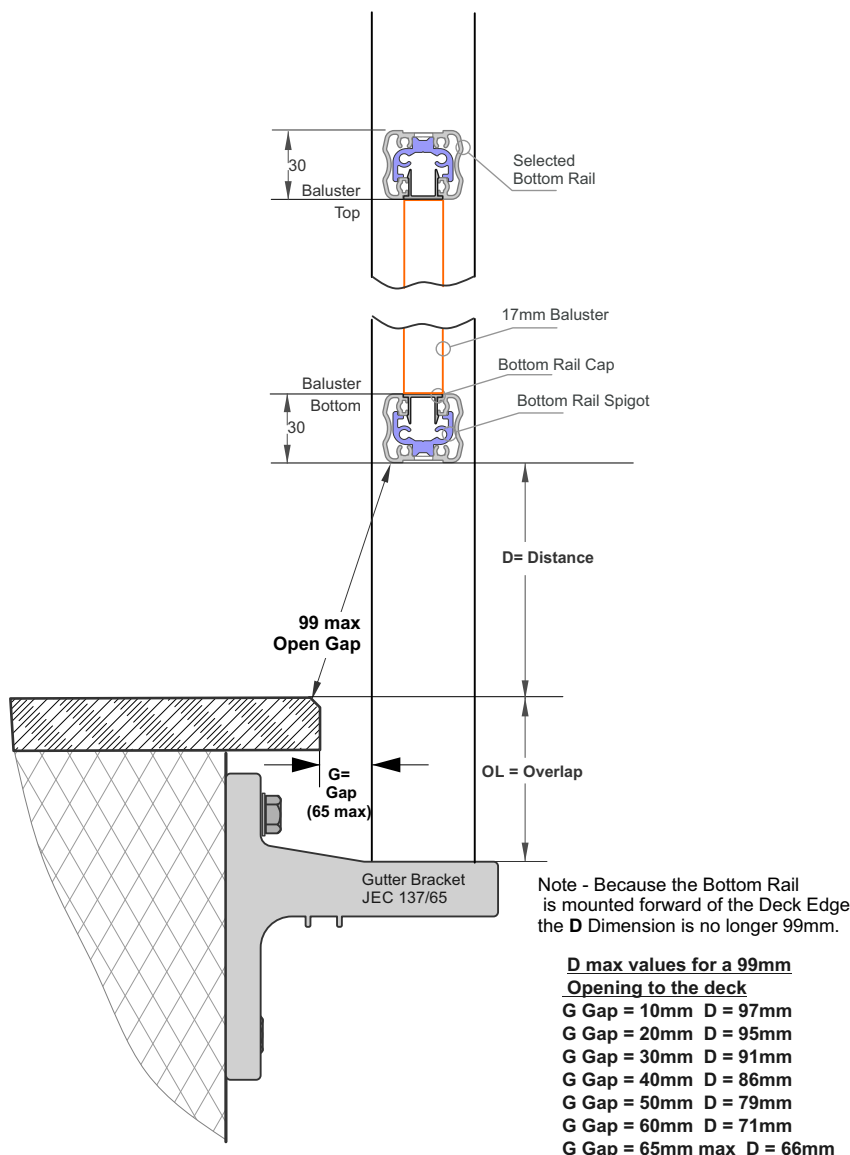

**D max values for a 99mm Opening to the deck**

|                  |          |
|------------------|----------|
| G Gap = 10mm     | D = 97mm |
| G Gap = 20mm     | D = 95mm |
| G Gap = 30mm     | D = 91mm |
| G Gap = 40mm     | D = 86mm |
| G Gap = 50mm     | D = 79mm |
| G Gap = 60mm     | D = 71mm |
| G Gap = 65mm max | D = 66mm |


**4 - Width Offsets**

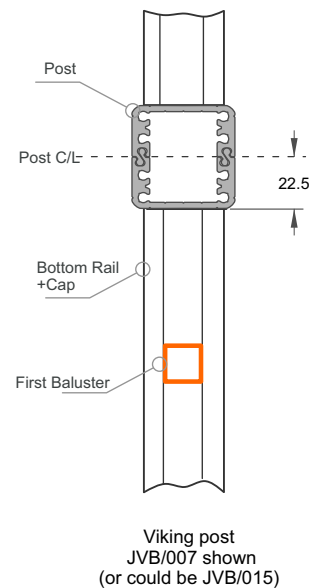


**5 - Cutting Guide**

- a - Hand Rail = Use maximum lengths
- b - Post, Cut to  
= HH - **A** + OL = Post Height
- c - Bottom Rail (x2), Cut to  
= PCL - 2x22.5 = PCL - 45
- d - 17mm Balustrade Height  
= HH - **B** - 99 - D - 2x30

**1 - Refer Post Mounting type and installation Wind zone. Then choose Balustrade Height and max Post spacing.**

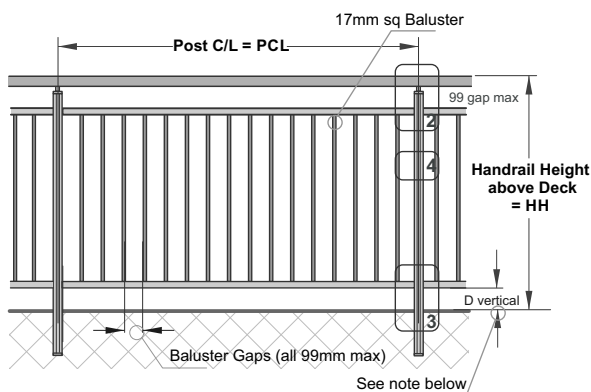

**2 - Handrail - Offsets**

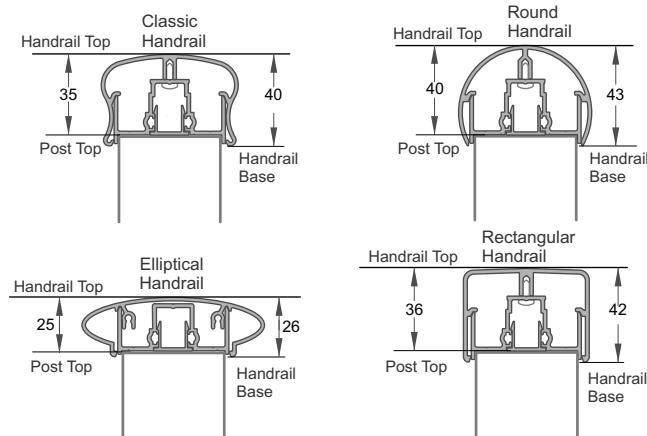


**A**  
For Post Height.  
Post Top to Handrail Top  
25-40 Depending on  
chosen Handrail

**B**  
For Top Gap Height  
Handrail Base to Handrail Top  
26-43 Depending on  
chosen Handrail

**3 - Post Height offsets**


Selected  
Handrail  
as above

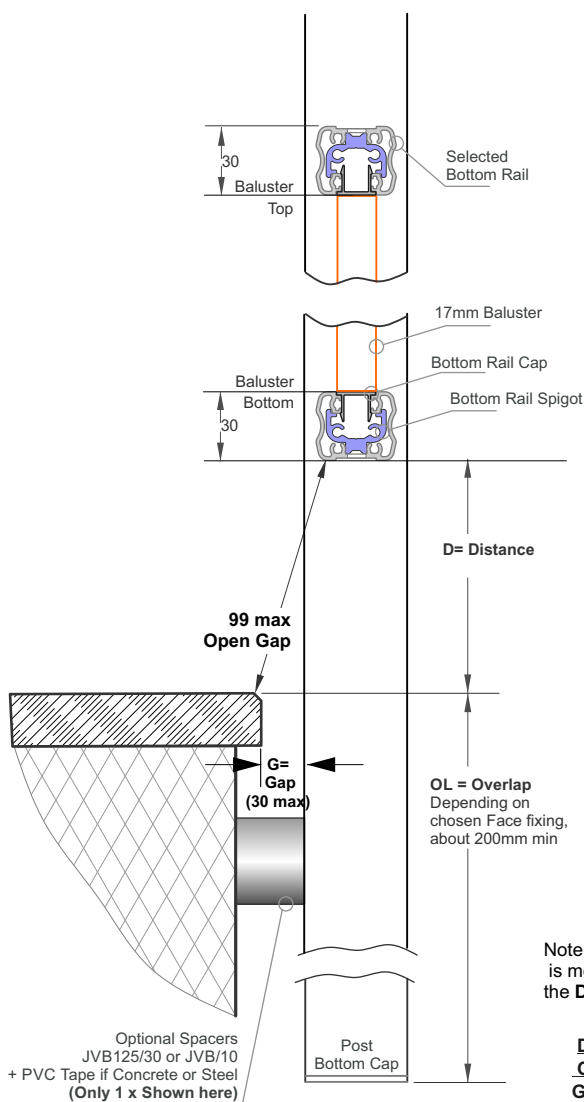

Note - Because the Bottom Rail is mounted forward of the Deck Edge the D Dimension is no longer 99mm.

**D max values for a 99mm Opening to the deck**  
G Gap = 10mm D = 97mm  
G Gap = 20mm D = 95mm  
G Gap = 30mm max D = 91mm

**4 - Width Offsets**

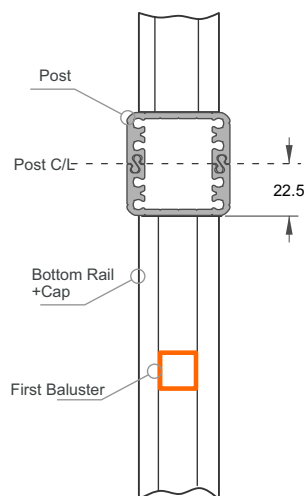


Viking post  
JVB/007 shown  
(or could be JVB/015)

**5 - Cutting Guide**


- a - Hand Rail = Use maximum lengths
- b - Post, Cut to  
= HH - **A** + OL = Post Height
- c - Bottom Rail (x2), Cut to  
= PCL - 2x22.5 = PCL - 45
- d - 17mm Balustrade Height  
= HH - **B** - 99 - D - 2x30



**1 - Refer Post Mounting type and installation Wind zone. Then choose Balustrade Height and max Post spacing.**

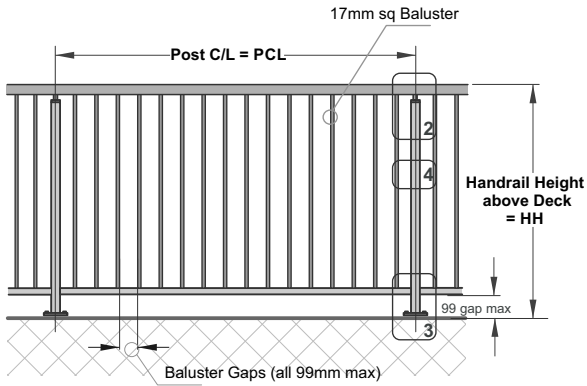


**2 - Handrail - Offsets**

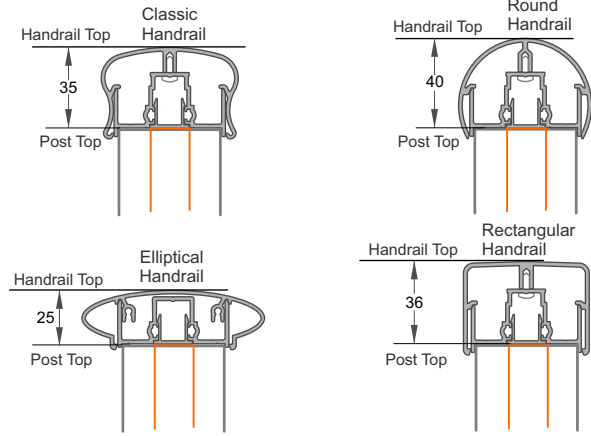


**A**  
For Post and Baluster Top Height.  
Post Top to Handrail Top  
25-40 Depending on  
chosen Handrail

**3 - Post Height offsets**

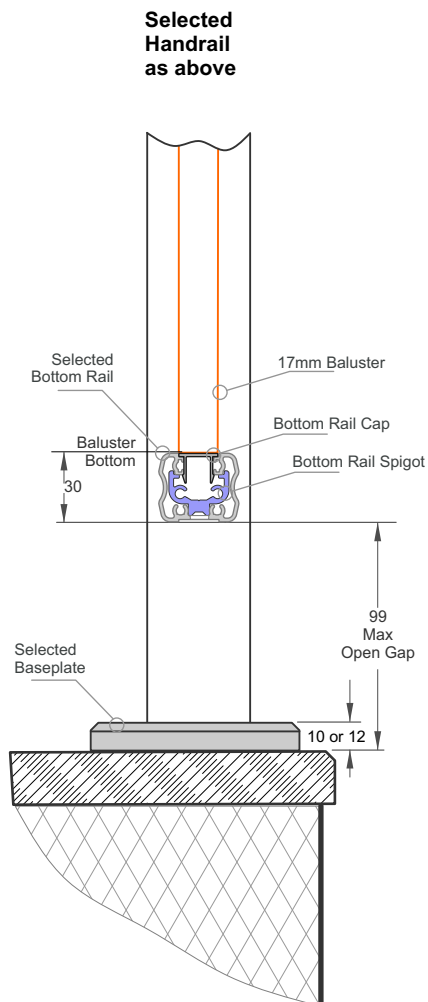

**4 - Width Offsets**

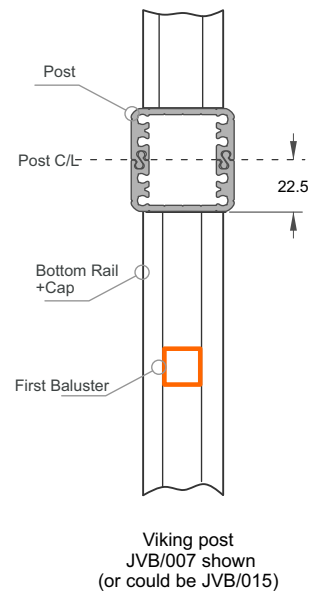


**5 - Cutting Guide**


- a - Hand Rail = Use maximum lengths
- b - Post, Cut to  
= HH - **A** - (10 or 12) = Post Height
- c - Bottom Rail (x2), Cut to  
= PCL - 2x22.5 = PCL - 45
- d - 17mm Balustrade Height  
= HH - **A** - 99 - 30



**1 - Refer Post Mounting type and installation Wind zone. Then choose Balustrade Height and max Post spacing.**

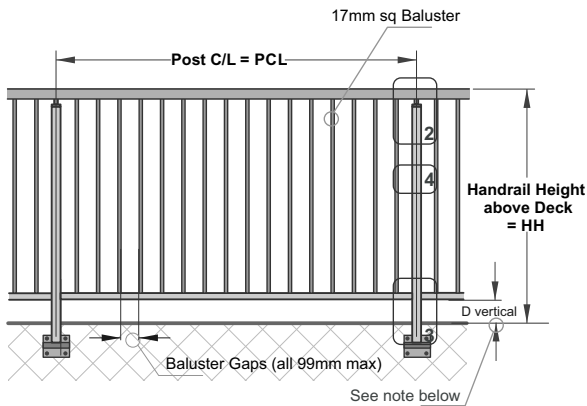


**2 - Handrail - Offsets**

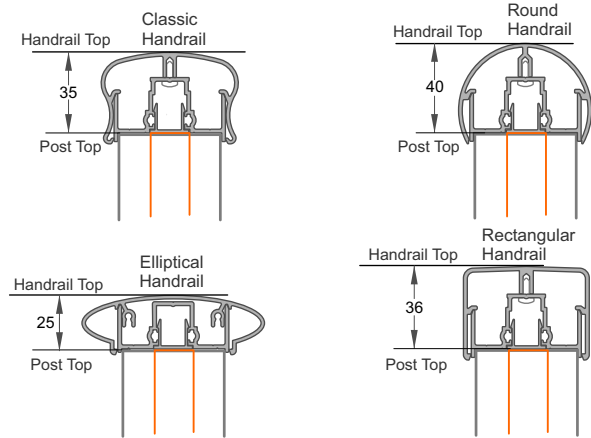

**A**  
For Post and Baluster Top Height.  
Post Top to Handrail Top  
25-40 Depending on  
chosen Handrail


**3 - Post Height offsets**

**Selected  
Handrail  
as above**

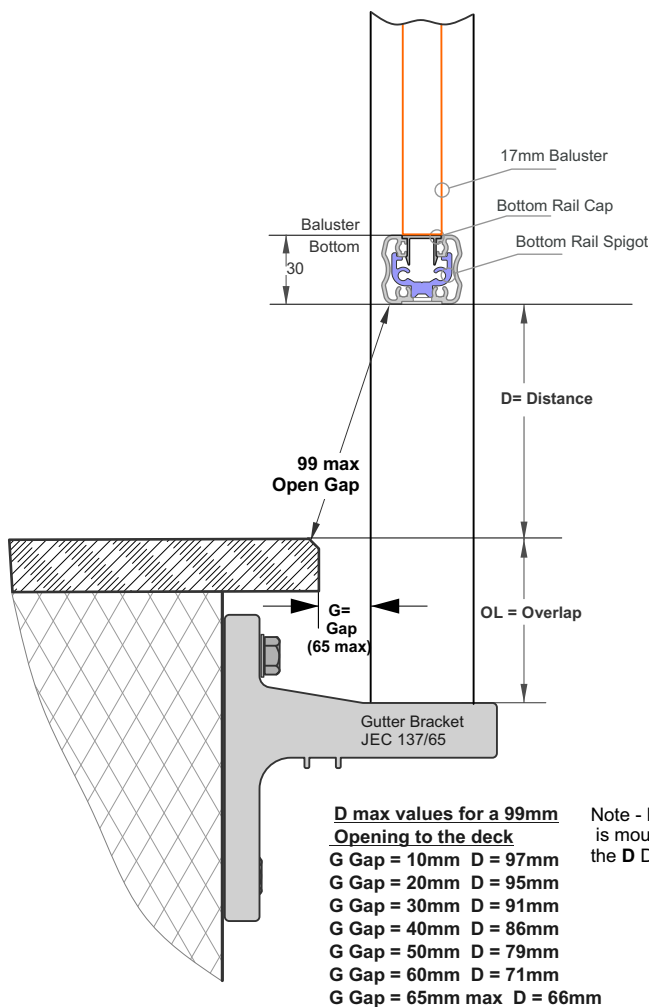

Note - Because the Bottom Rail is mounted forward of the Deck Edge the D Dimension is no longer 99mm.


**4 - Width Offsets**

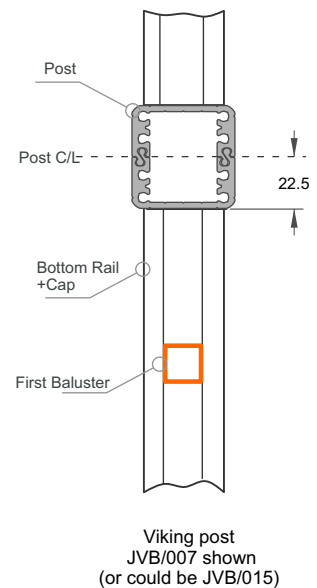


**5 - Cutting Guide**

- a - Hand Rail = Use maximum lengths
- b - Post, Cut to  
= HH - **A** + OL = Post Height
- c - Bottom Rails (x2), Cut to  
= PCL - 2x22.5 = PCL - 45
- d - 17mm Balustrade Height  
= HH - **A** - 99 - 30

### 1 - Refer Post Mounting type and installation Wind zone. Then choose Balustrade Height and max Post spacing.

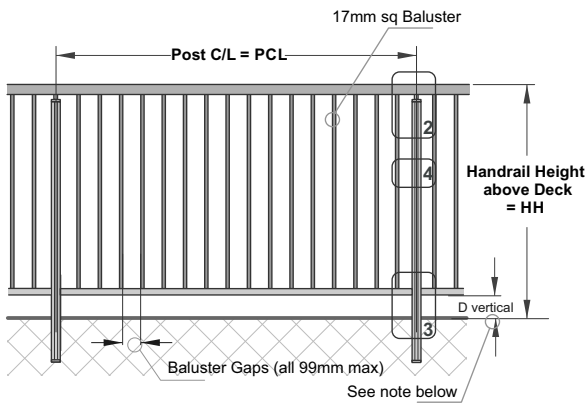


### 2 - Handrail - Offsets

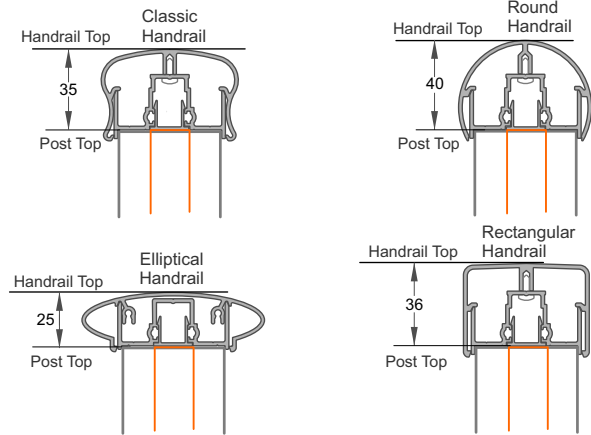


**A**  
For Post and Baluster Top Height.  
Post Top to Handrail Top  
25-40 Depending on  
chosen Handrail

### 3 - Post Height offsets

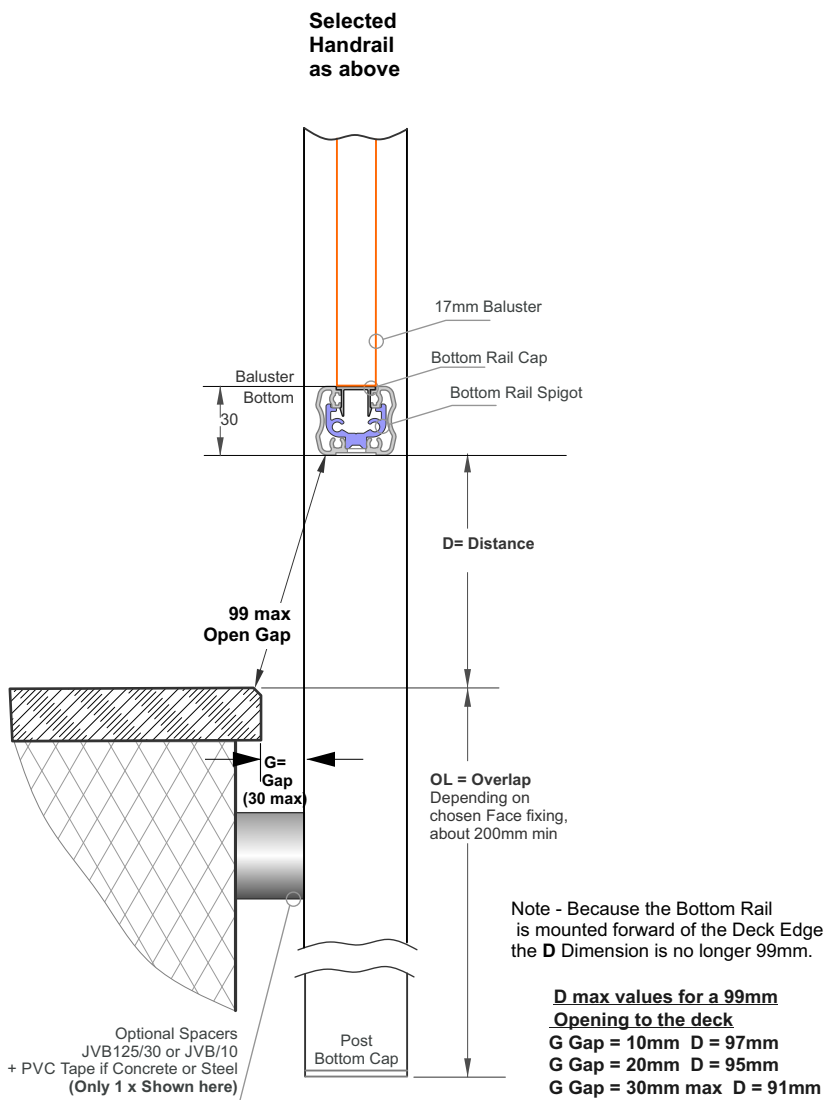





### 4 - Width Offsets

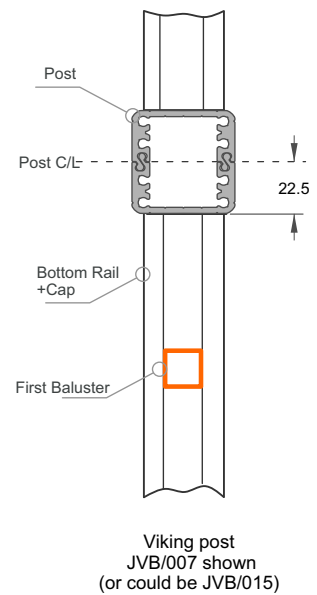





### 5 - Cutting Guide

- a - Hand Rail = Use maximum lengths
- b - Post, Cut to  
= HH - **A** + OL = Post Height
- c - Bottom Rails (x2), Cut to  
= PCL - 2x22.5 = PCL - 45
- d - 17mm Balustrade Height  
= HH - **A** - 99 - 30

17mm Baluster - Split Rail. Handrail + Top and Bottom Rail.

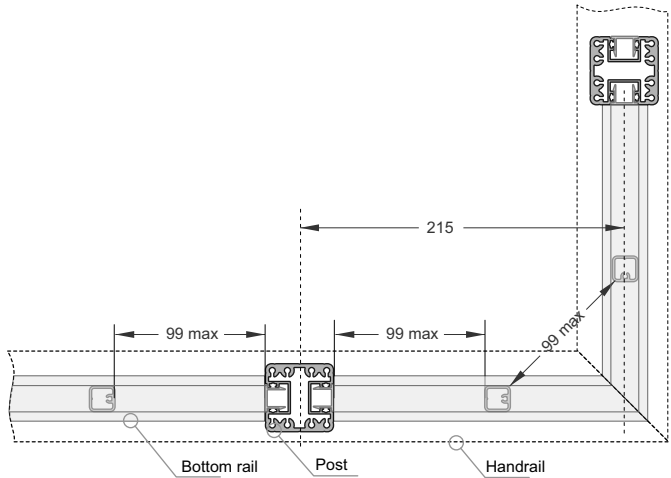

17mm Baluster - Full Height. Handrail + Bottom Rail.

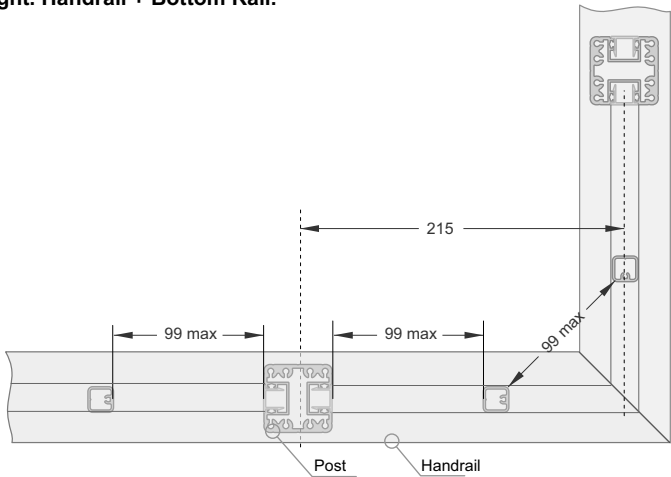

# Juralco Viking® Balustrade System - Powder Coating Care and Maintenance

## Powder Coating Installation Care

### **Warning re use of solvents:**

- In some cases strong solvents are recommended for thinning various types of paints and also for cleaning up mastics and sealants.
- These can be harmful to the extended life of the powder coated surface, and must not be used for cleaning purposes.
- It is important to note that the damage will not be visible immediately and may take up to 12 months to develop.

If paint splashes or sealants and mastics need to be removed then the following may be safely used:  
Methylated Spirits, Ethyl Alcohol, Isopropanol or preferably a mild detergent in warm water.

### **Joinery Protection during Installation:**

All the activity on a construction site means that your powder coated items may get knocked or scratched, splattered with mortar, plaster, textured coating or paint during the later stages of construction.

Please ensure that all powder coated articles are masked or covered at this time. It is far easier to prevent accidents than to try and correct them. Should your joinery receive mortar or paint splashes see that these are removed before cure and follow the instructions contained in this brochure.

Typical sticker used to warn other trades of the need to protect and mask off powder coated joinery (applies to anodised joinery also)

**"IMPORTANT ALL TRADES"**  
This valuable aluminium joinery will suffer permanent damage from: plaster, mortar and paint splashes - Protect if splashes occur - Immediately wash down joinery with water or meths - Do not allow splashes to harden! ~ Do not use solvents! - Do not remove this label until final clean completed.

This photograph displays damage that has occurred on site, post installation. The photo of the masked joinery displays clear signs of damage that could have occurred were it not masked. Please ensure that your joinery is protected right through the entire construction process.



## Powder Coating Maintenance

### **External - Maintenance Program:**

To extend the life of external powder coated articles and to comply with warranty requirements for powder coated aluminium joinery, a simple, regular maintenance program must be implemented.

The effects of ultra violet light, atmospheric pollution, dirt, grime and airborne salt deposits will all accumulate over time and must be removed or surface staining and weathering will occur, leading to an unsightly appearance.

For external coatings, cleaning should take place every six months. In areas where pollutants are more prevalent, such as beachfront houses and industrial or geothermal areas, then a cleaning program should be carried out on a more frequent basis ie. every one to three months.

Fences or Balustrades in close proximity to swimming pools must be washed down every six months, to clean off chlorine and salt deposits.

### **Cleaning your powder coating:**

1. Carefully remove any loose surface deposits with a wet sponge.
2. Use a soft brush (non abrasive) and a mild household detergent (do not use solvents) in warm water, remove dust, salt and other deposits.
3. Rinse off with clean fresh water.



### **Restoring weathered or scratched surfaces:**

Repair of Scuffed or Scratched surfaces  
Dulux Spray Cans are available in all colour card colours.

Repair of Small Scratches or Chips.  
Dulux Dabsticks are ideally suited for the repair of small scratches.  
Dabsticks may not be available in all colour card colours.

Repair of Weathered areas .  
Dulux Gloss Up is a light to medium cutting cream ideally suited for gloss restoration and has been specifically designed for this purpose.  
Gloss Up contains no waxes or silicone and is a one step system.



**Contact Dulux Powder Coatings , ph 0064 9 441 8244**

All pages © Copyright Juralco Aluminium Building Products Ltd, 2023



www.juralco.co.nz ph (09) 478 8018

**Juralco Viking® Balustrade System**

Issue 1-25 v1  
Page 73