


ICOMS 2.0 : Comments On UI/UX

- 1. Dashboard less information. need like now
- 2. Need as much information in the front page. more efficiency less beauty.
- 3. More info on laptop. Less info on phone to prevent clutter

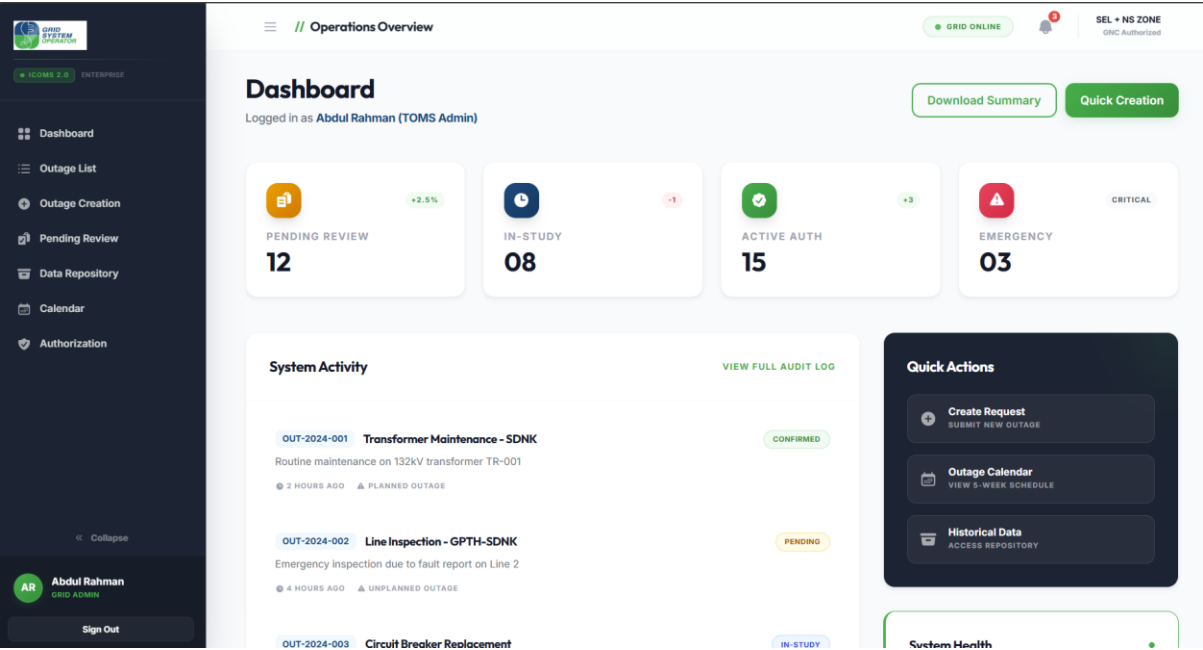

- 4. Info in the table needs to be there completely rather than pressing the arrow button
- 5. Table info same across all pages.

OUTAGE ID	TYPE	DATE & TIME	EQUIPMENT TYPE / EQUIPMENT	STATUS	UNDERSTUDY / REMARKS	PLANNER / TOMS / GNC
↑ OUT-2026-001	PLANNED	17 Mar 2026 08:00 — 16:00	TRANSFORMER TR-001 SDNK 132/33kV	CONFIRMED	No system constraint identified. Approved fo...	TOMS Approved
DESCRIPTION						
Routine maintenance and oil sampling on power transformer TR-001 at Substation Sendayan						
↓ OUT-2026-002	UNPLANNED	17 Mar 2026 02:15 — TBD	TRANSMISSION LINE GPTH-SDNK Line 2 132kV	IN-STUDY	Constraint analysis in progress. Awaiting load...	GNC Reviewing
↓ OUT-2026-003	PLANNED	18 Mar 2026 09:00 — 17:00	CIRCUIT BREAKER CB-132-05 GPTH	PENDING	Pending security assessment for N-1...	TOMS Pending
↓ OUT-2026-004	PLANNED	19 Mar 2026 22:00 — 06:00	BUS SECTION BS-275-01 OLKL	CONFIRMED	Night shift approved. No load transfer required.	TOMS Approved
↓ OUT-2026-005	UNPLANNED	16 Mar 2026 14:30 — 18:45	TRANSMISSION LINE KKSR-PKLG Line 1 275kV	COMPLETED	Clearance completed. Line re-energized at...	GNC Closed

6. Outage creation only 2 columns for fields. The information column by default is minimized but can be expanded. Font size can reduce a bit

Basic Information
Step 1

Equipment Selection
Step 2

Additional Details
Step 3

Basic Information

Zone

Select Zone

Station

Select Station

Voltage

Select Voltage

Equipment Type

Select Type

Line Filter

Single

Equipment

Select Equipment

Outage Type

☒ Planned

☐ Unplanned

☐ Emergency

Work Type

☒ Dead

☐ Live

PTW Required

☐

Start Date & Time

dd/mm/yyyy

08:00 AM

End Date & Time

dd/mm/yyyy

05:00 PM

← Previous Step

Continue Transaction →

Information

Single Line Diagram

Download SLD for selected station

Download SLD (PDF)

Conflicting Lines

No conflicting lines detected

✓ Safe to proceed

Equipment History

Last maintenance: 15 days ago

View History

Form Summary

Zone:

Not selected

Station:

Not selected

Equipment:

Not selected

Duration:

Not set

7. Authorization data better in table form

Authorization in Force

GRID ONLINE

SEL + NS ZONE
GNC Authorized

Authorization in Force

Real-time monitoring of active outage authorizations and execution status

All Zones

Manual Extension

AUTHORIZED

AUTH-2024-101

TR-001@SDNK

KL Zone • 132kV

Authorized At:

2024-04-10 08:30

Est. Restoration:

2024-04-10 17:00

Time Remaining:

04:15:22

Request Ext.

Authorize Restore

EXPIRING SOON

AUTH-2024-102

CB-102@GPTH

Selangor Zone • 275kV

Authorized At:

2024-04-10 09:15

Est. Restoration:

2024-04-10 13:00

Time Remaining:

00:15:10

Request Ext.

Authorize Restore

OVERDUE

AUTH-2024-103

Line A@SIDC

KL Zone • 500kV

Authorized At:

2024-04-10 07:00

Est. Restoration:

2024-04-10 15:00

Time Remaining:

-1:45:10

Request Ext.

Authorize Restore

Live Execution Timeline

TOTAL ACTIVE LOAD: 450.2 MW

75% System Margin