




Ochsner Medical Center - West Bank

2500 Belle Chasse Highway
Gretna, LA 70056

Life Safety Drawings 2025



HCT  **LLC.**
Your Healthcare Compliance Team
513 Memorial Blvd. #502
Springfield, TN 37172



Smoke Compartment



LIFE SAFETY LEGEND	
1 Hour Fire Barrier	1HR FIRE
2 Hour Fire Barrier	2HR FIRE
1 Hour Smoke Barrier	1HR SB
2 Hour Smoke Barrier	2HR SB
Smoke Partition	SMOKE
Exit Stairwell	
Exit Passageway	
Exit Access Corridor	
Suite	
Under Construction	
Hazardous Area	
Exterior Exit	EXIT
Trash/Linen Chute	
60 Day Work Order Item	###
Environment of Care	EC
Distance to Exit	XX
Distance to Smoke	XX

Floor:	File Name:
1st	OMCWB-LS-01
Drawn By:	Date:
CCW	05/09/2025

LS1.2

1st Floor - Existing Business Occupancy - Type II (222)


Compartment Id	Occupant Load	Building Sq. Ft.	Approved Automatic Sprinkler System	Use of Compartment	Distance to Exit	Distance to Smoke
1B.1	169	16,956	100%	Business Use	132'	Not Required
1B.2	57	5,797	100%	Business Use	112'	Not Required
Total	226	22,753				

1st Floor - Existing Healthcare Occupancy - Type II (222)

Compartment Id	Occupant Load	Building Sq. Ft.	Approved Automatic Sprinkler System	Use of Compartment	Distance to Exit	Distance to Smoke
1.3	48	11,650	100%	TREATMENT	123'	83'
1.4	60	14,503	100%	TREATMENT	197'	182'
1.5	53	12,851	100%	TREATMENT	96'	87'
1.6	59	14,314	100%	TREATMENT	139'	123'
1.7	66	15,944	100%	TREATMENT	112'	115'
Total	286	69,262				

1st Floor - Suite Schedule

Suite ID	Suite Sq. Ft.	Suite Description and Use of Space	Exits Required to Exit Access Doors	Distance to Exit Access
S1	7,665	NON SLEEPING	2	93'
S2	5,103	NON SLEEPING	2	78'
S3	1,331	NON SLEEPING	1	42'
S4	5,105	NON SLEEPING	2	58'
S5	900	NON SLEEPING	1	37'
S6	3,349	NON SLEEPING	2	76'
S7	1,261	NON SLEEPING	1	55'
S8	2,887	NON SLEEPING	2	?
S9	1,199	NON SLEEPING	1	42'
S10	7,295	NON SLEEPING	2	88'
S11	3,795	NON SLEEPING	2	48'
S12	4,846	NON SLEEPING	2	85'

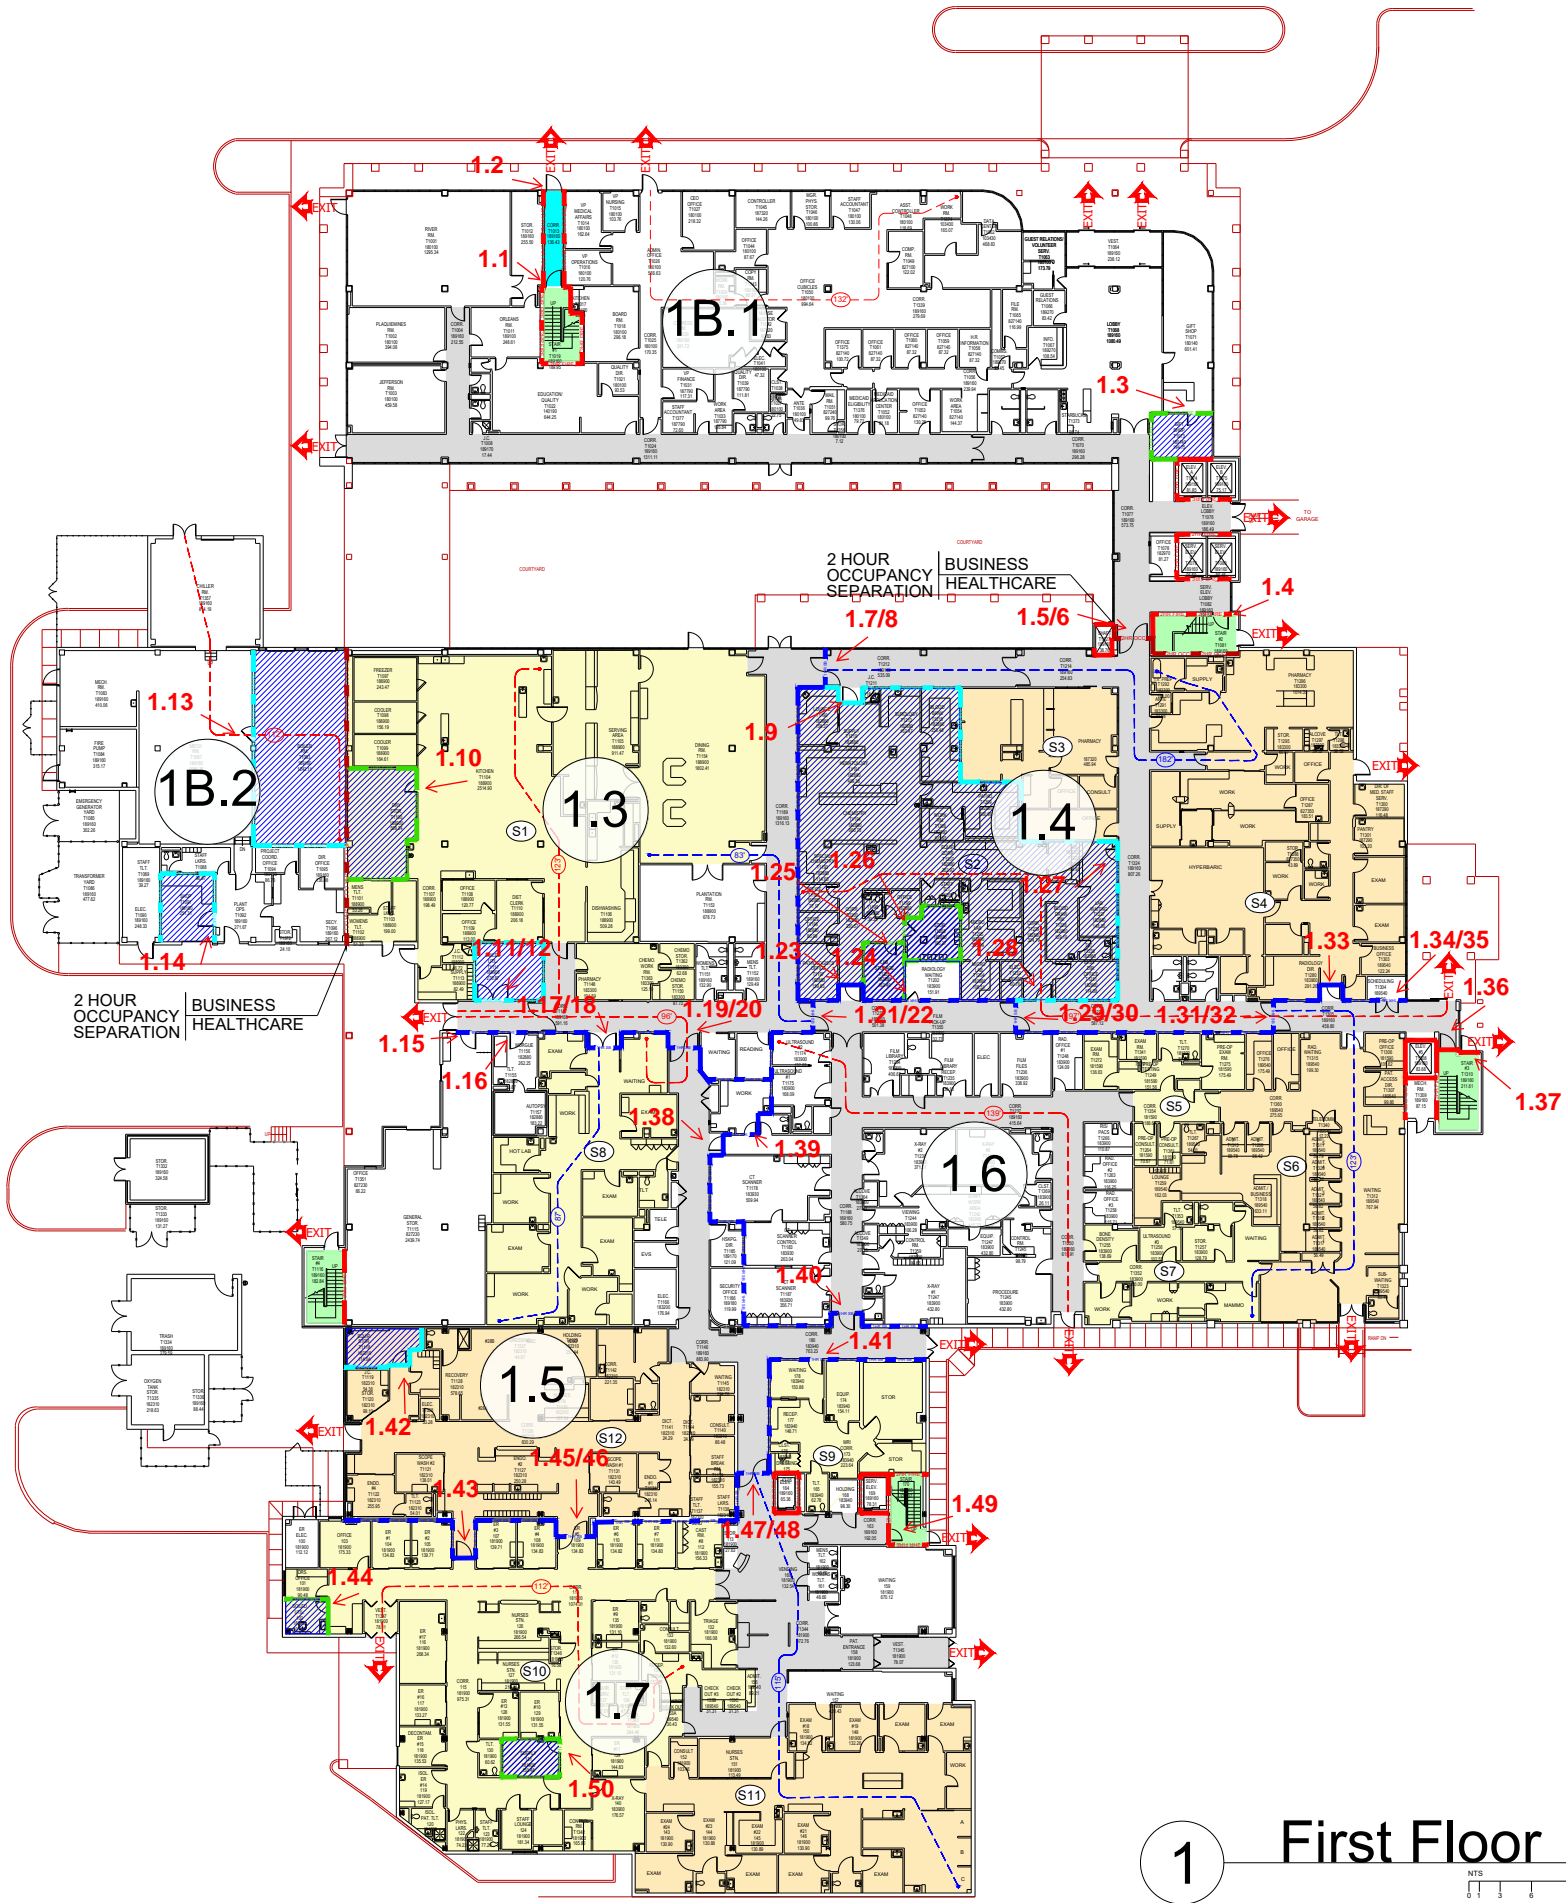


1 First Floor


NTS
0 3 6 9 12

2nd Floor - Existing Healthcare Occupancy - Type II (222)						
Compartment ID	Occupant Load	Building Sq. Ft.	Approved Automatic Sprinkler System	Use of Compartment	Distance to Exit	Distance to Smoke
2.1	79	9,573	100%	PATIENT SLEEPING	150'	110'
2.2	99	11,940	100%	PATIENT SLEEPING	193'	135'
2.3	42	4,926	100%	PATIENT SLEEPING	111'	68'
2.4	122	15,963	100%	PATIENT SLEEPING	125'	102'
2.5	75	18,070	100%	TREATMENT	198'	105'
2.6	48	11,546	100%	TREATMENT	162'	120'
2.7	164	19,771	100%	PATIENT SLEEPING	179'	185'
Total	629	90,527				

2nd Floor - Suite Schedule				
Suite ID	Suite Sq. Ft.	Suite Discription and Use of Space	Exits Required to Exit Access Doors	Distance to Exit Access
S1	3,237	SLEEPING	2	93'
S2	4,915	NON SLEEPING	2	78'
S3	5,717	NON SLEEPING	2	42'
S4	6,312	NON SLEEPING	2	40'
S5	6,394	NON SLEEPING	2	58'
S6	3,154	NON SLEEPING	2	37'
S7	4,592	SLEEPING	2	76'
S8	4,838	SLEEPING	2	55'

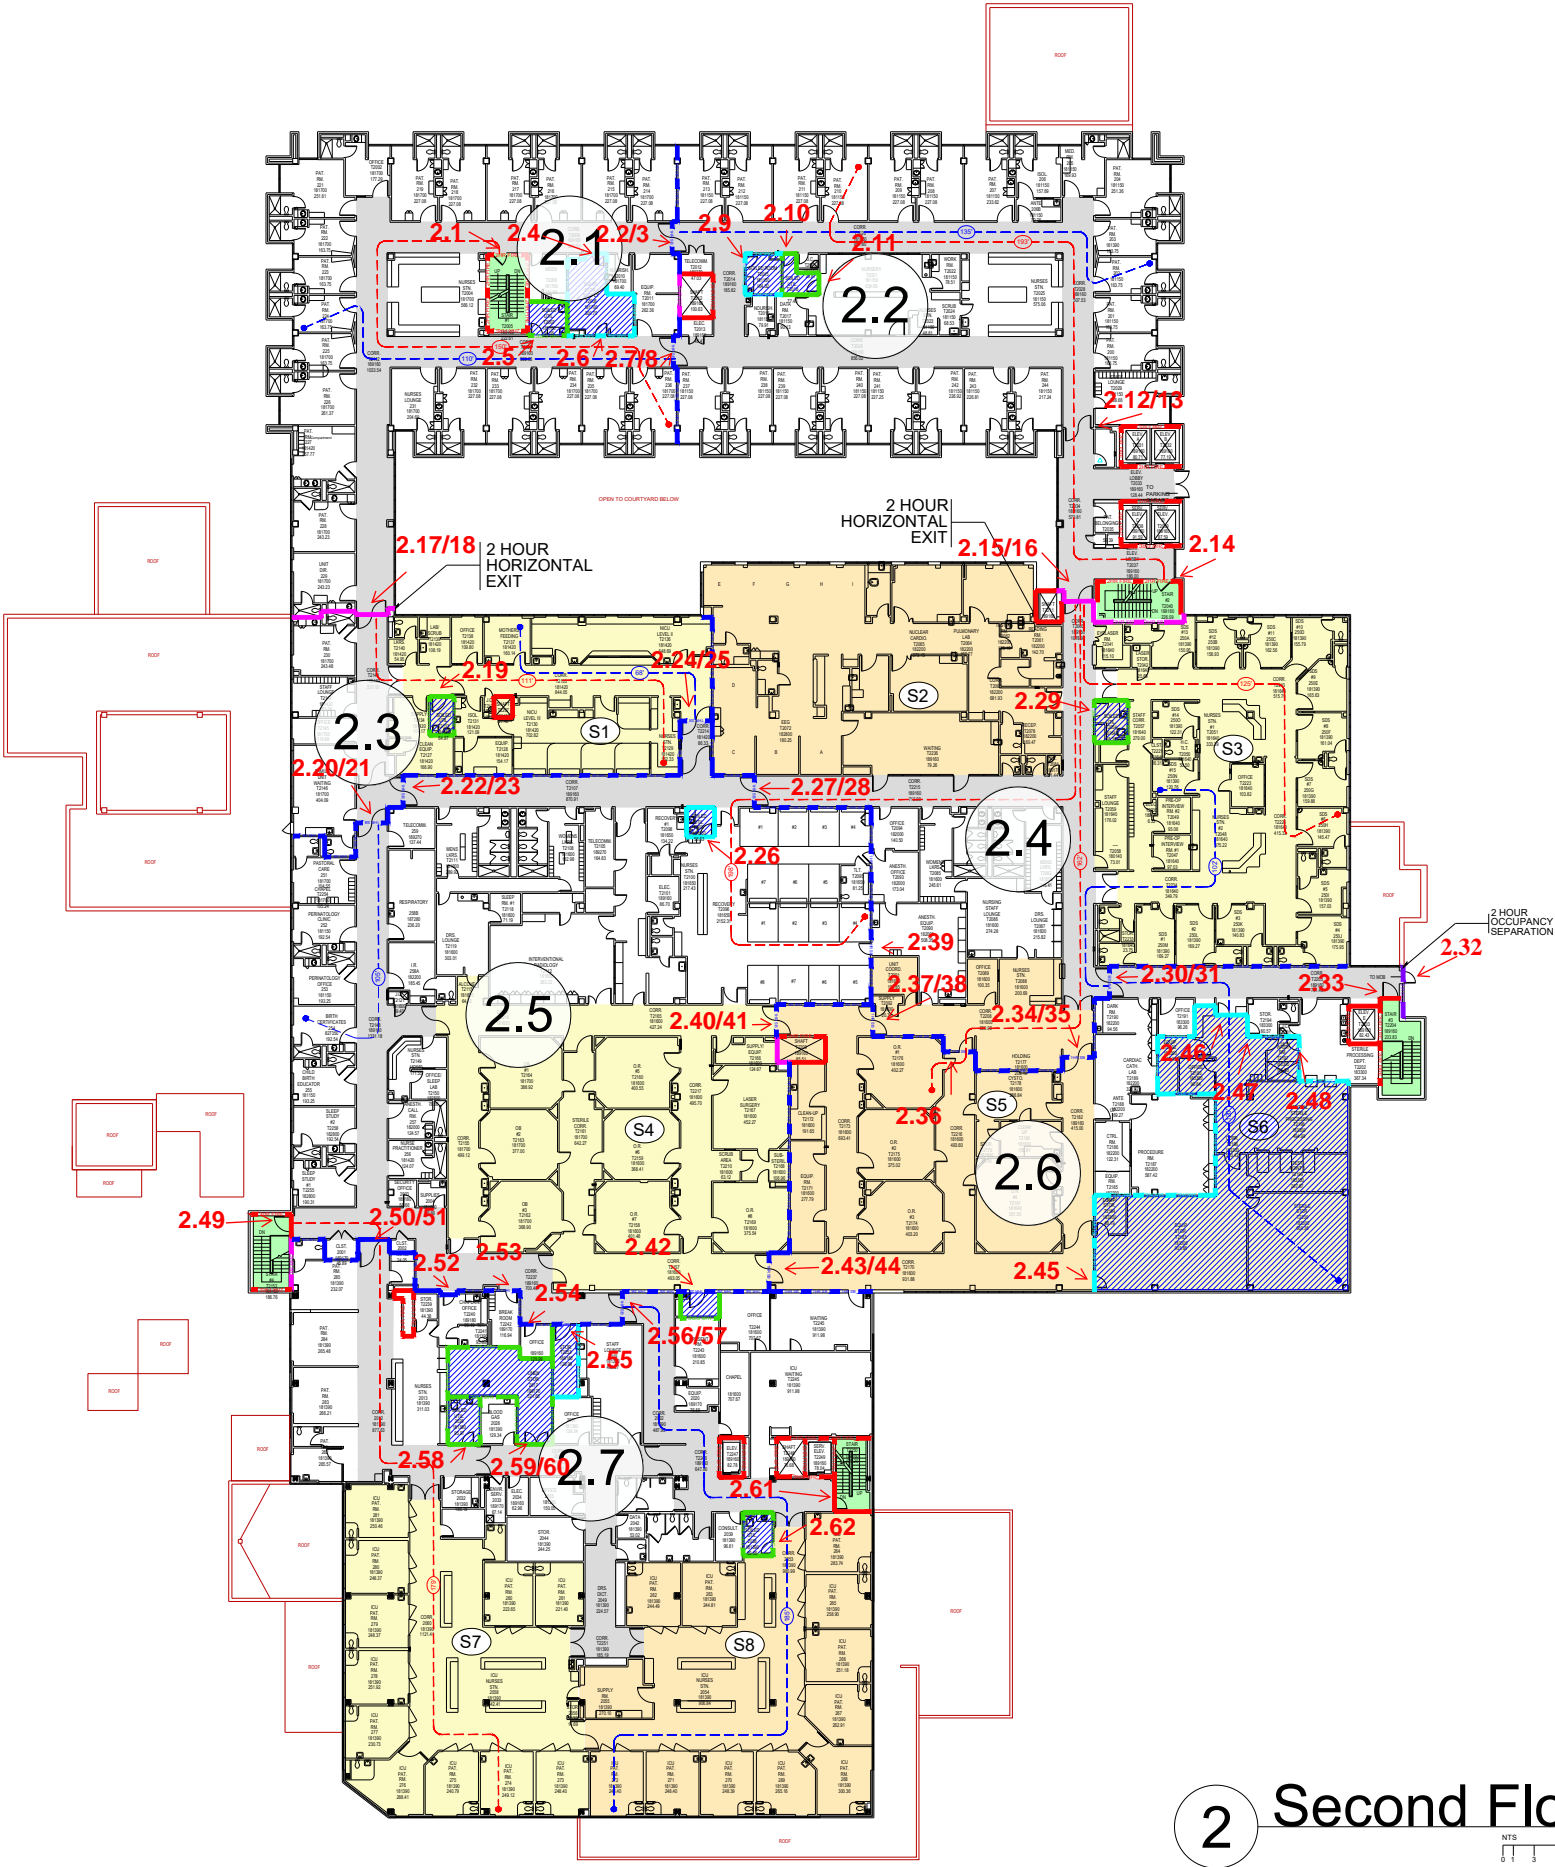

2 Second Floor



Smoke Compartment



LIFE SAFETY LEGEND	
1 Hour Fire Barrier	1HR FIRE
2 Hour Fire Barrier	2HR FIRE
1 Hour Smoke Barrier	1HR SB
2 Hour Smoke Barrier	2HR SB
2Hour Occupancy Barrier	2HR OCC
Exit Stairwell	
Exit Passageway	
Exit Access Corridor	
Suite	
Under Construction	
Hazardous Area	
Exterior Exit	EXIT
Trash/Linen Chute	
60 Day Work Order Item	###
Environment of Care	EC
Distance to Exit	XX
Distance to Smoke	XX

Floor:	File Name:
2nd	OMCWB-LS-02
Drawn By:	Date:
GLW	05/09/2025


LS2.2

3rd Floor - Existing Healthcare Occupancy - Type II (222)

Compartment Id	Occupant Load	Building Sq. Ft.	Approved Automatic Sprinkler System	Use of Compartment	Distance to Exit	Distance to Smoke
3.1	67	8,066	100%	Patient Sleeping	150'	107'
3.2	96	11,547	100%	Patient Sleeping	193'	135'
Total	163	19,613				

Life Safety Drawings

HCTLLC.
Your Healthcare Compliance Team
513 Memorial Blvd. #502
Springfield, TN 37172



Smoke Compartment




LIFE SAFETY LEGEND

1 Hour Fire Barrier	1HR FIRE
2 Hour Fire Barrier	2HR FIRE
1 Hour Smoke Barrier	1HR SB
2 Hour Smoke Barrier	2HR SB
2Hour Occupancy Barrier	2HR OCC
Exit Stairwell	
Exit Passageway	
Exit Access Corridor	
Suite	
Under Construction	
Hazardous Area	
Exterior Exit	EXIT
Trash/Linen Chute	
60 Day Work Order Item	###
Environment of Care	EC
Distance to Exit	XX
Distance to Smoke	XX

Floor:	File Name:
3rd	OMCWB-LS-03

Drawn By:	Date:
GLW	05/09/2025

LS3.2

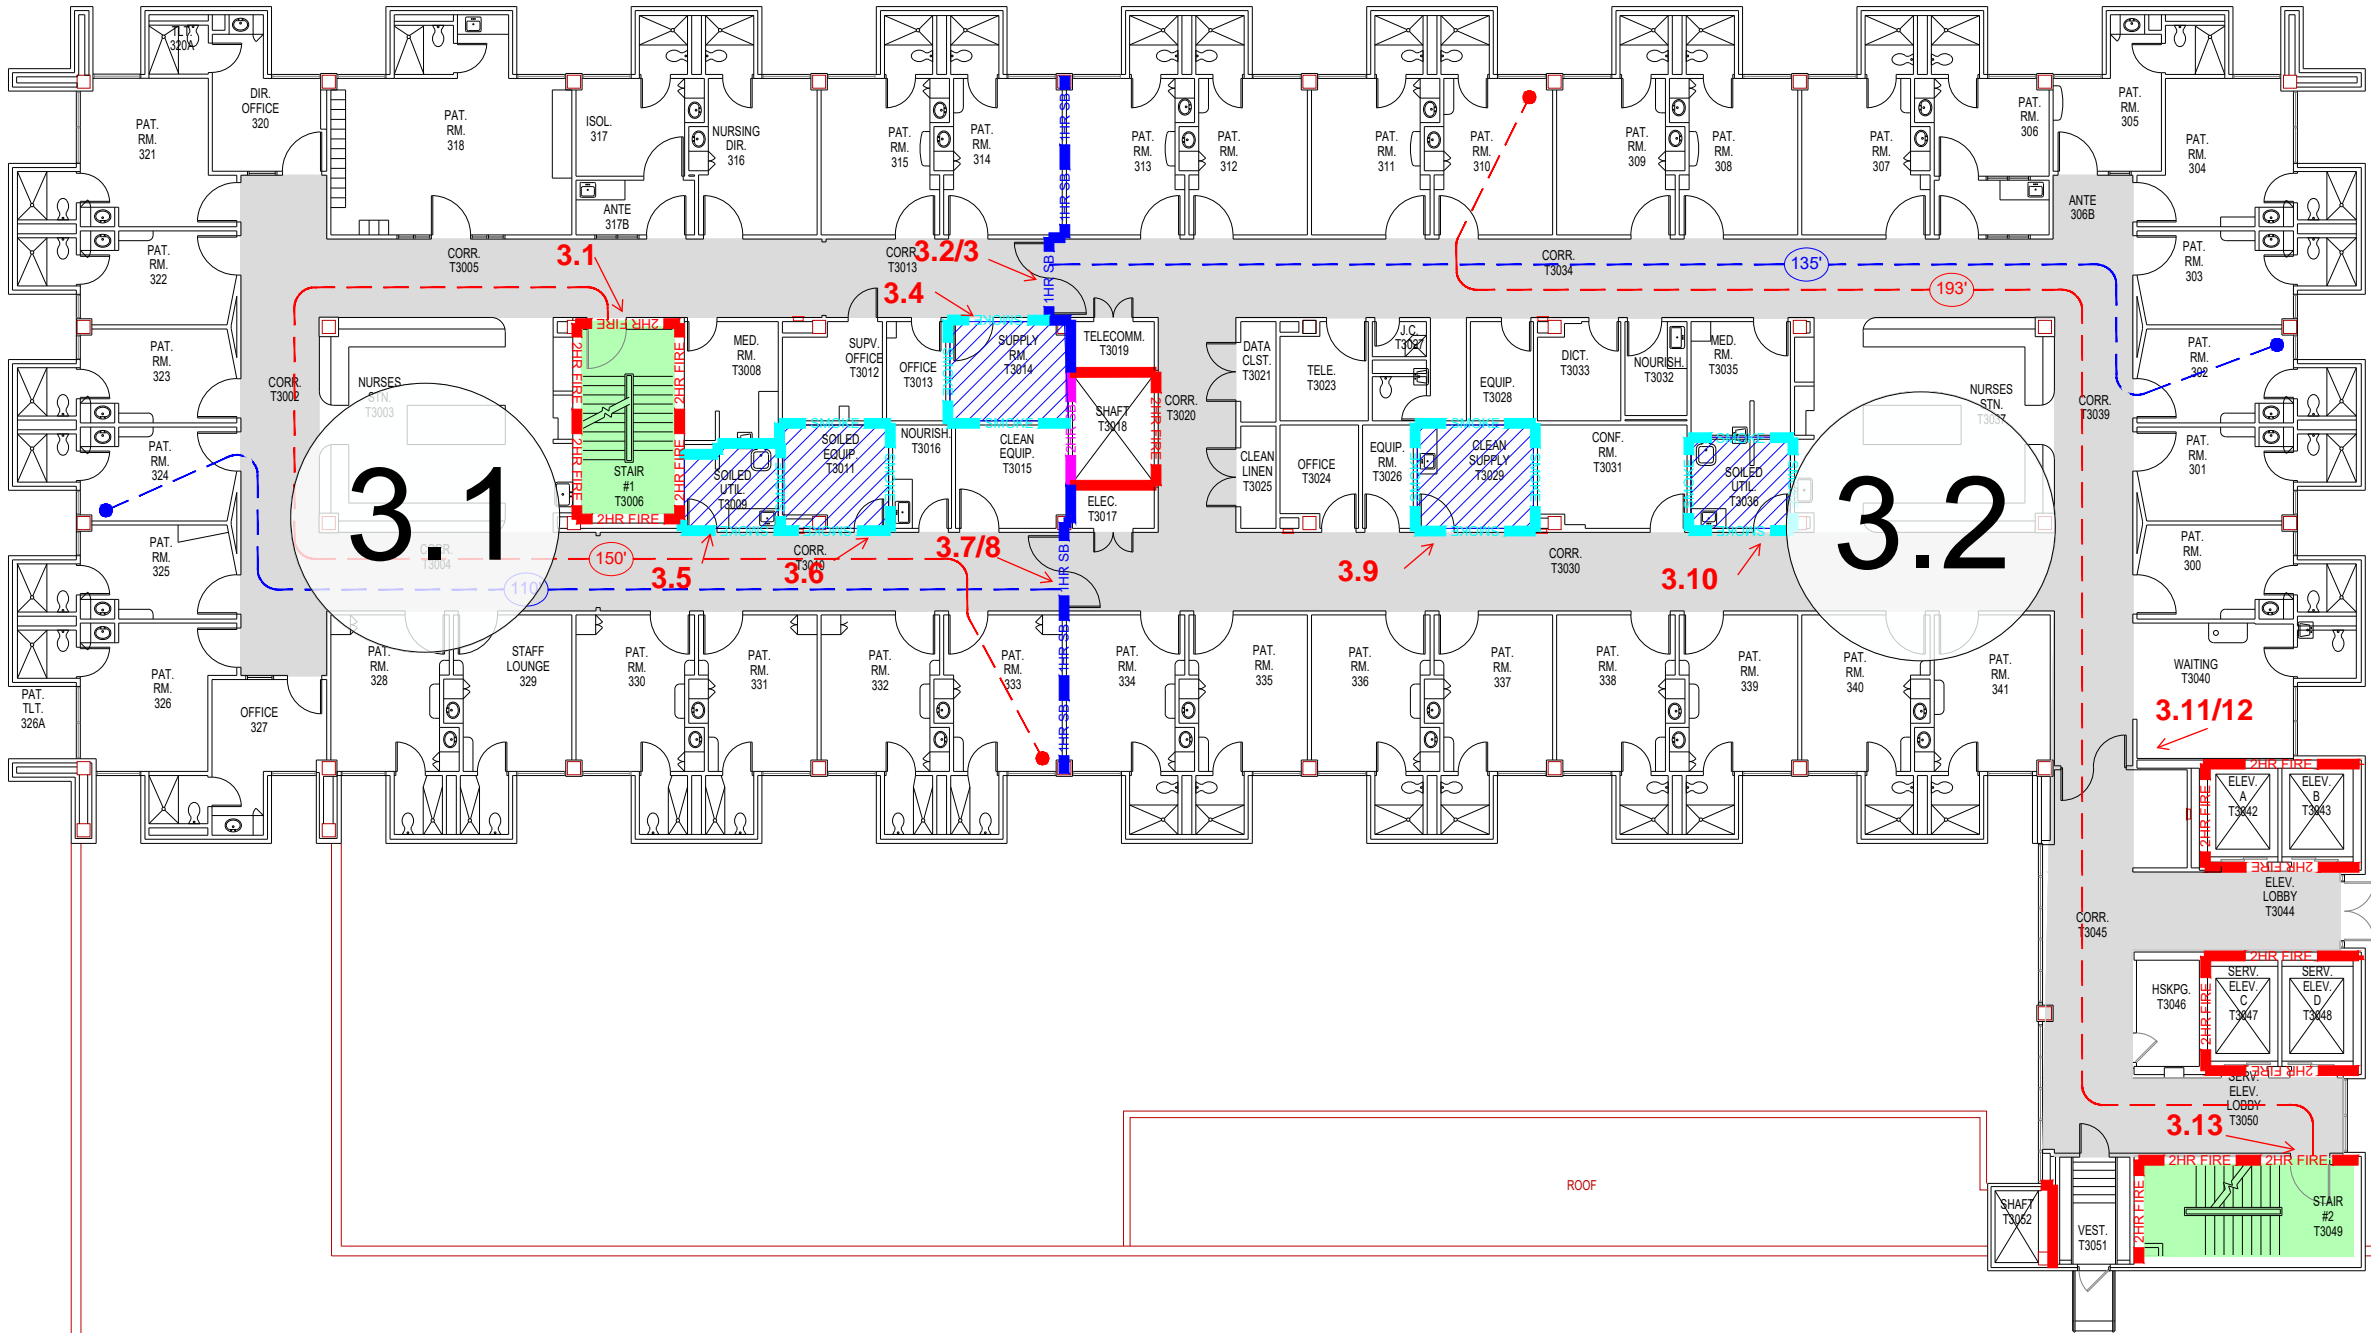

3 Third Floor




4th Floor - Existing Business Occupancy - Type II (222)

Compartment Id	Occupant Load	Building Sq. Ft.	Approved Automatic Sprinkler System	Use of Compartment	Distance to Exit	Distance to Smoke
4.1	67	8,066	100%	Patient Sleeping	150'	107'
4.2	96	11,547	100%	Patient Sleeping	193'	135'
Total	163	19,613				

Life Safety Drawings

HCTLLC.
Your Healthcare Compliance Team
513 Memorial Blvd. #502
Springfield, TN 37172



Smoke Compartment



LIFE SAFETY LEGEND

1 Hour Fire Barrier	1HR FIRE
2 Hour Fire Barrier	2HR FIRE
1 Hour Smoke Barrier	1HR SB
2 Hour Fire Smoke Barrier	2HR SB
Smoke Partition	SMOKE
Exit Stairwell	
Exit Passageway	
Exit Access Corridor	
Suite	
Under Construction	
Hazardous Area	
Exterior Exit	EXIT
Trash/Linen Chute	
60 Day Work Order Item	W.O.
Environment of Care	EC
Distance to Exit	XX
Distance to Smoke	XX

Floor:	File Name:
4th	OMCWB-LS-04

Drawn By:	Date:
CCW	05/09/2025

LS4.2

