


AMR PROGRESS PER MINISUB

MINISUB	RATING	BULK ON AMR	KIOSKS	SUPPLIES	INSTALLED	ORDERED	OUTSTANDING	DEFERRED	% ON AMR	
MS 01	500 kVA (800A)	Yes	12	54	0	0	54	0	0%	
MS 02	500 kVA (800A)	Yes	15	64	24	0	40	0	38%	
MS 03	315 kVA (450A)	Yes	18	106	0	0	106	0	0%	
MS 04	500 kVA (700A)	No	17	103	0	0	103	0	0%	
MS 05	800 kVA (1200A)	No	22	119	0	0	119	0	0%	
MS 06	315 kVA (450A)	Yes	12	70	23	46	0	1	33%	
MS 07	315 kVA (500A)	Yes	8	50	8	41	0	1	16%	
MS 08	315 kVA (450A)	Yes	4	18	0	0	18	0	0%	
MS 09	315 kVA (450A)	Yes	9	42	0	0	42	0	0%	
MS 10	315 kVA (450A)	Yes	10	50	0	0	50	0	0%	
MS 11	315 kVA (450A)	Yes	10	52	0	0	52	0	0%	
MS 12	315 kVA (450A)	Yes	12	49	0	0	49	0	0%	
MS 13	315 kVA (450A)	Yes	11	54	0	0	54	0	0%	
MS 14	315 kVA (450A)	Yes	11	53	0	0	53	0	0%	
TOTAL				884	55	87	740	2	6%	

KEY PLAN (from KMZ) – square colour: green = AMR started/complete, amber = in current order, red = not started

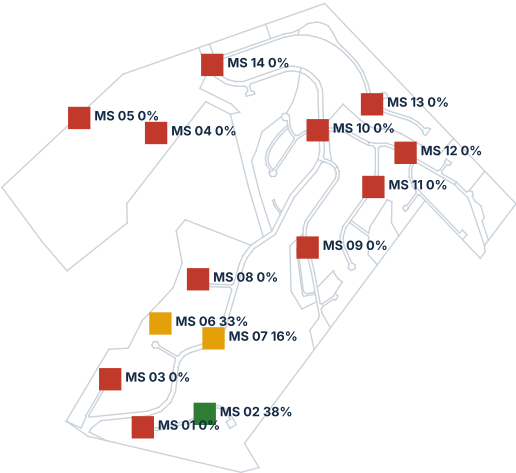

Notes: 1) Supply = one metered connection (1 probe). 511 Husk (MS 02) added from the AMR export – not in the reticulation sheet. 2) Kiosk feeds not stated in the sheet are inferred from the sheet layout (dashed) – verify against as-built SLDs.

3) Status colours: green = on AMR, amber = in Order 1, red = outstanding, grey = deferred (streetlight on MS 06/07 board).



AMR PROGRESS (supplies)

6% on AMR



Installed 55 Ordered 87 Outstanding 740 Deferred 2

ZULULAMI ESTATE

SITE OVERVIEW – AMR PROGRESS PER MINISUB

Supplies per minisub from the master hierarchy workbook. Order 1 = MS 07 + MS 06.

— feed per sheet - - - - - inferred from layout Rows: status · stand · S/N · ph · Q/C/V · port

DRAWING No. ZLM-SLD-00	REVISION A	
DATE 2026-10-09	SCALE NTS	
DRAWN Ruan van Heerden, Electrical Engineer		SHEET 1 of 15

MS 01

500 kVA (800A)

Bulk 63237040

Bulk on AMR

Direct from LV board:

■ Main Gatehouse · 60A · Double Connection · --

■ Contractors Gate · 60A · Double Connection · --

■ Streetlights · 60A · 82816209

250A

505 Aura K01

0/4

Main 200A · 4 sup · 8-probe

■ 505-01	84039740	B	O
■ 505-02	75091206	R	O
■ 505-03	84039751	R	O
■ 505-04	84039746	W	O

250A

505 Aura K02

0/4

Main 250A · 4 sup · 8-probe

■ 505-05	75091343	B	O
■ 505-06	75091296	W	O
■ 505-07	84039707	R	O
■ 505-08	62742631	W	O

250A

505 Aura K03

0/4

Main 250A · 4 sup · 8-probe

■ 505-09	47369314	B	O
■ 505-10	47369294	B	O
■ 505-11	75091021	R	O
■ 505-12	75091242	W	O

250A

505 Aura K08

0/6

Main 250A · 6 sup · 8-probe

■ 505-F1	85354288	B	O
■ 505-F2	85354624	R	O
■ 505-F3	85354356	W	O
■ 505-F4	85354293	W	O
■ 505-F5	85354298	R	O
■ 505-45	85354586	W	O

250A

505 Aura K09

0/4

Main 160A · 4 sup · 8-probe

■ 505-29	84340966	B	O
■ 505-30	84341038	R	O
■ 505-31	84341019	B	O
■ 505-32	84340990	W	O

505 Aura K10

0/4

Main 100A · 4 sup · 8-probe

■ 505-33	84340995	R	O
■ 505-34	84340900	W	O
■ 505-35	84340901	B	O
■ 505-36	84340949	R	O

505 Aura K11

0/4

Main 125A · 4 sup · 8-probe

■ 505-37	84340973	R	O
■ 505-38	84340996	W	O
■ 505-39	84340929	B	O
■ 505-40	84340924	W	O

505 Aura K12

0/4

Main 125A · 4 sup · 8-probe

■ 505-41	84340927	R	O
■ 505-42	84340905	W	O
■ 505-43	84340972	B	O
■ 505-44	84340948	B	O

KIOSK AMR SCHEDULE

KIOSK	SUP	ON AMR	ORD	OUT	UNIT
MS LV board	3	0	0	3	8-probe
505 Aura K08	6	0	0	6	8-probe
505 Aura K09	4	0	0	4	8-probe
505 Aura K10	4	0	0	4	8-probe
505 Aura K11	4	0	0	4	8-probe
505 Aura K12	4	0	0	4	8-probe
505 Aura K01	4	0	0	4	8-probe
505 Aura K02	4	0	0	4	8-probe
505 Aura K03	4	0	0	4	8-probe
505 Aura K04	5	0	0	5	8-probe
505 Aura K05	4	0	0	4	8-probe
505 Aura K06	4	0	0	4	8-probe
505 Aura K07	4	0	0	4	8-probe



AMR PROGRESS (supplies)

0% on AMR



■ Installed 0 ■ Ordered 0 ■ Outstanding 54 ■ Deferred 0

ZULULAMI ESTATE

MS 01 – LV RETICULATION & AMR STATUS

PowerTech · 500 kVA (800A) · mfd 10/2017 · bulk meter 63237040 (on AMR)

— feed per sheet - - - - - inferred from layout Rows: status · stand · S/N · ph · Q/C/V · port

DRAWING No.	REVISION	
ZLM-SLD-01	A	
DATE	SCALE	
2026-10-09	NTS	
DRAWN	SHEET	
Ruan van Heerden, Electrical Engineer	2 of 15	

MS 02


500 kVA (800A)


Bulk 63237017

Bulk on AMR

Direct from LV board:

Streetlights · 60A · 67021415

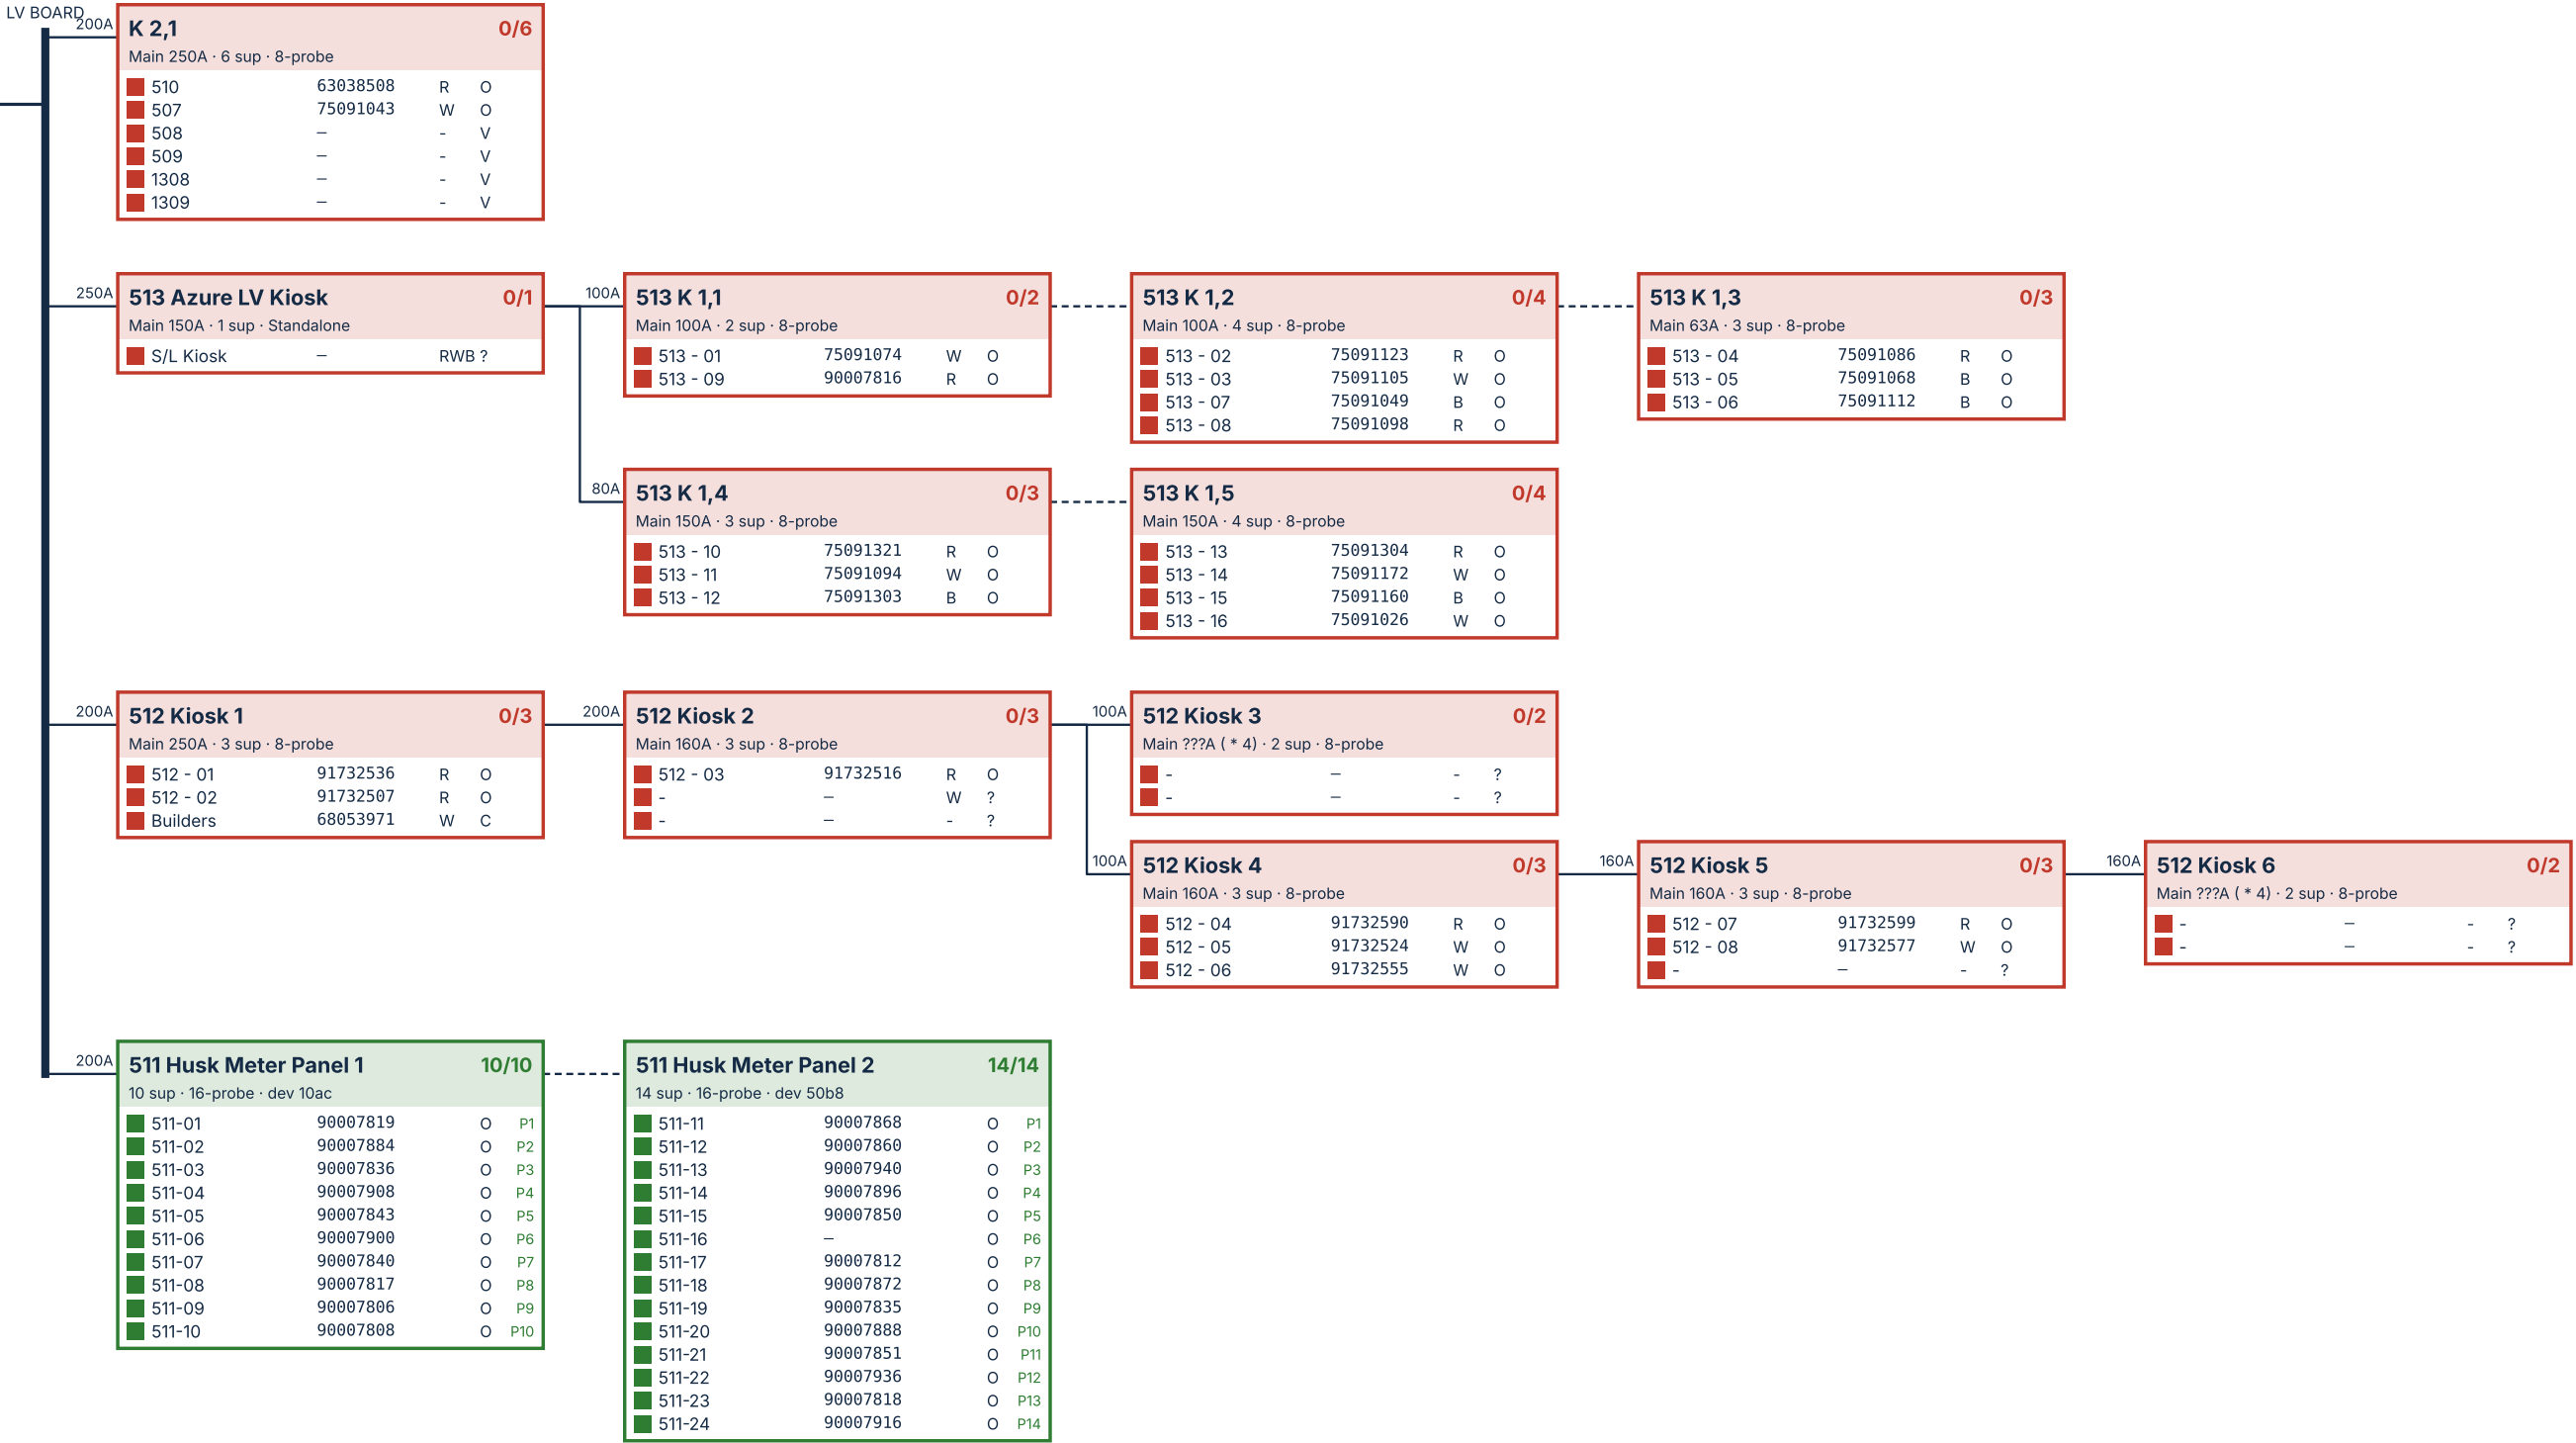

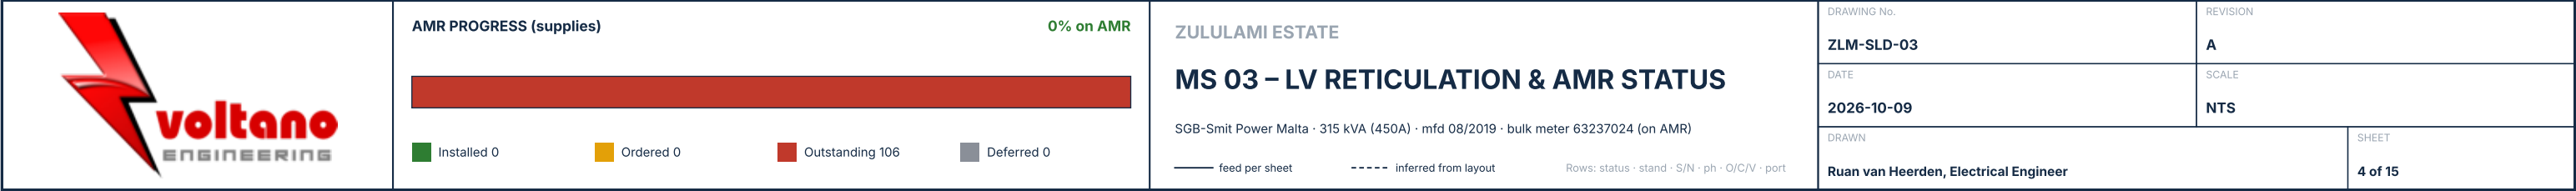



KIOSK

SUP

ON AMR

ORD

OUT

UNIT

K 1,1

5

0

0

5

8-probe

K 1,2

6

0

0

6

8-probe

K 1,3

6

0

0

6

8-probe

K 1,8

4

0

0

4

8-probe

K 1,9

5

0

0

5

8-probe

K G/H

1

0

0

1

Standalone

K 1,4

8

0

0

8

8-probe

K 1,6

9

0

0

9

16-probe

K 1,7

6

0

0

6

8-probe

K 1,10

7

0

0

7

8-probe

K 1,11

9

0

0

9

16-probe

K 1,15

5

0

0

5

8-probe

K 1,16

6

0

0

6

8-probe

K 1,17

6

0

0

6

8-probe

K 1,12

4

0

0

4

8-probe

K 1,13

9

0

0

9

16-probe

K 1,14

7

0

0

7

8-probe

0% on AMR

Installed 0

Ordered 0

Outstanding 103

Deferred 0

ZULULAMI ESTATE

MS 04 – LV RETICULATION & AMR STATUS

Electronic Assemblies (PTY) Ltd. · 500 kVA (700A) · mfd ??? · bulk meter 90915109 (not on AMR)

— feed per sheet

----- inferred from layout

Rows: status · stand · S/N · ph · Q/C/V · port

DRAWING No.

ZLM-SLD-04

DATE

2026-10-09

DRAWN

Ruan van Heerden, Electrical Engineer

REVISION

A

SCALE

NTS

SHEET

5 of 15

MS 06


315 kVA (450A)

Bulk 63237041

Bulk on AMR

Direct from LV board:

Streetlights · 32A · 47369899

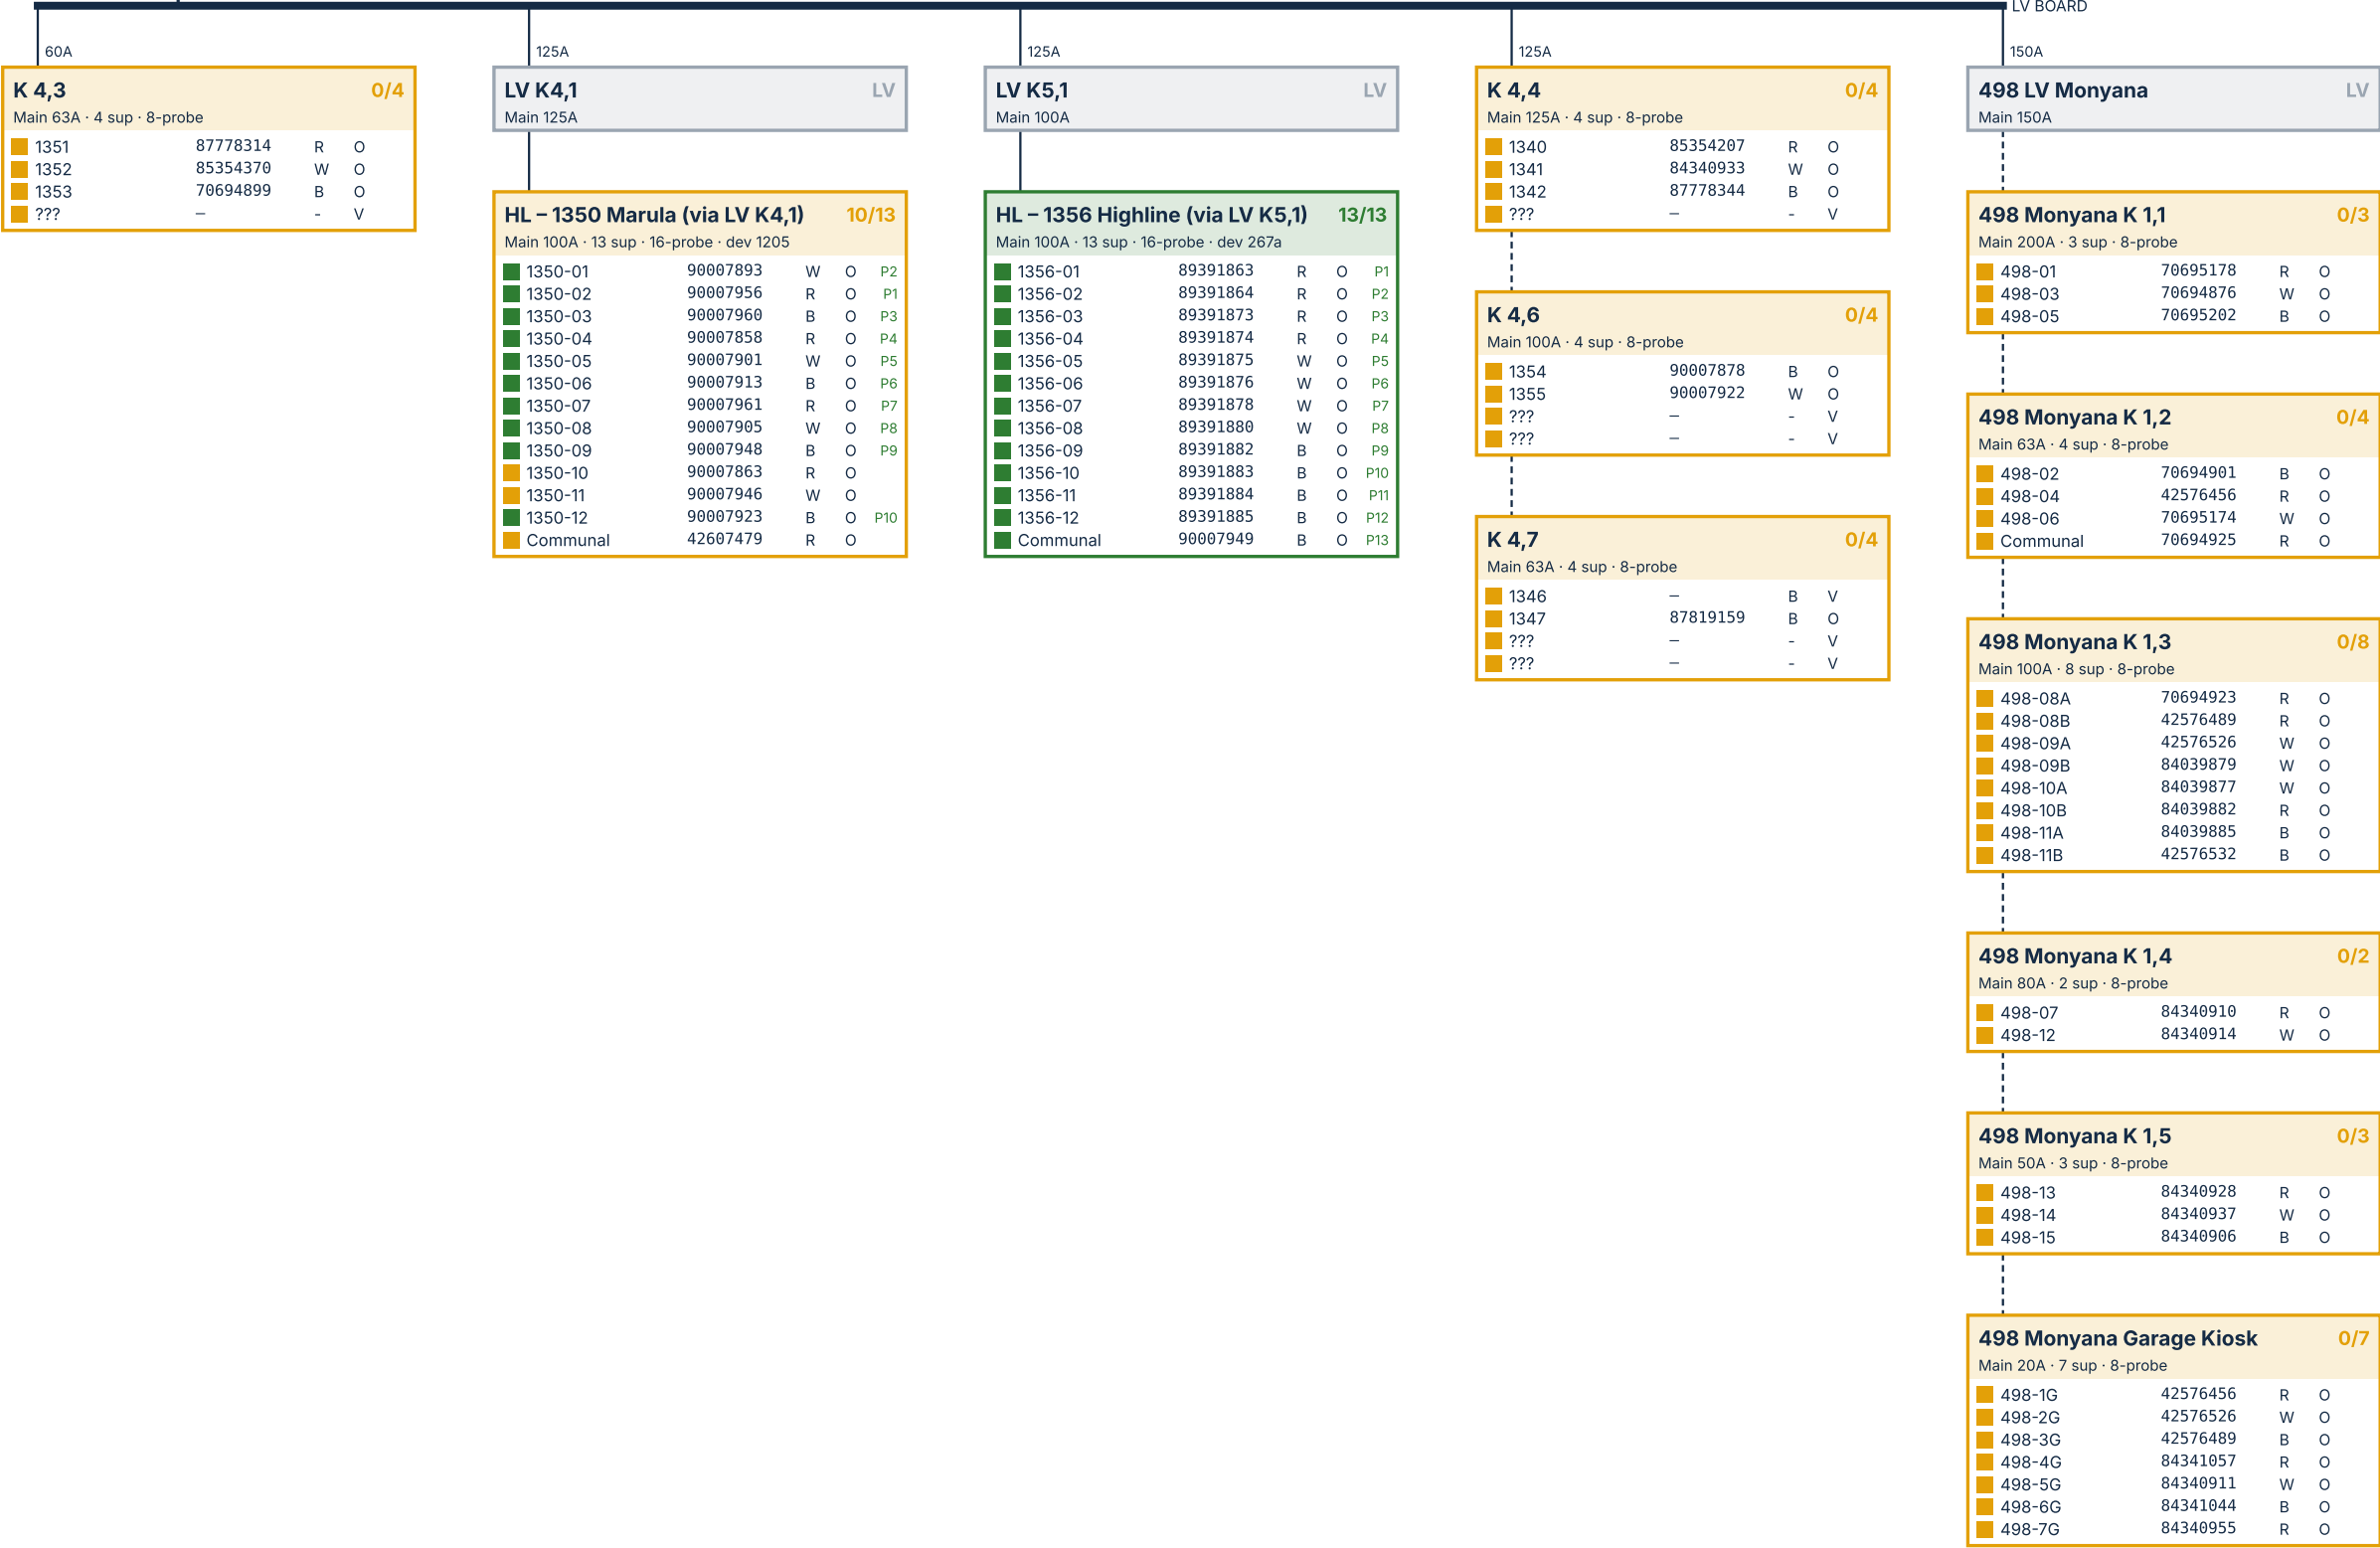

MS 07

315 kVA (500A)

Bulk 83014676

Bulk on AMR

Direct from LV board:

Streetlights · 63A · 82929432

LV BOARD

200A

Ptn 501 N/S LV Kiosk

LV

Main 200A

160A

K 1,1

0/5

Main 100A · 5 sup · 8-probe

Ptn 501/01	84340908	R	O
Ptn 501/02	84340913	W	O
Ptn 501/03	84340904	B	O
Ptn 501/04	84340686	R	O
Ptn 501/05	84340952	W	O

K 1,2

0/5

Main 100A · 5 sup · 8-probe

Ptn 501/06	—	W	C
Ptn 501/07	84340593	R	O
Ptn 501/08	84340708	W	O
Ptn 501/09	47369117	B	O
Ptn 501/10	46886469	R	O

160A

K 2,1

0/5

Main 100A · 5 sup · 8-probe

Ptn 501/11	91546482	R	O
Ptn 501/12	89392169	R	O
Ptn 501/13	87778358	B	O
Ptn 501/14	87778380	R	O
Ptn 501/15	87778386	B	O

K 2,2

0/5

Main 100A · 5 sup · 8-probe

Ptn 501/16	85353960	R	O
Ptn 501/17	85354417	R	O
Ptn 501/18	85354403	R	O
Ptn 501/19	84039931	B	O
Ptn 501/20	85354390	W	O

300A

Rem 501 V/V K1

0/10

Main 400A · 10 sup · 16-probe

REM 501/01	89391891	W	O
REM 501/02	89392157	B	O
REM 501/03	89392110	B	O
REM 501/04	89392103	B	O
REM 501/05	89392105	R	O
REM 501/06	89392101	W	O
REM 501/07	89392149	B	O
REM 501/08	89392113	W	O
REM 501/09	89392106	R	O
REM 501/10	89392117	R	O

Rem 501 V/V K2

0/8

Main 250A · 8 sup · 8-probe

REM 501/11	89392104	W	O
REM 501/12	89392131	R	O
REM 501/13	89392132	W	O
REM 501/14	89392109	B	O
REM 501/15	89392102	W	O
REM 501/16	89392136	B	O
REM 501/17	89392127	R	O
REM 501/18	89392140	R	O

Rem 501 V/V K3

8/8

Main 160A · 8 sup · 8-probe · dev 45cf

REM 501/19	89392139	W	O	P2
REM 501/20	90007952	B	O	P3
REM 501/21	90007857	B	O	P8
REM 501/22	89392173	R	O	P1
REM 501/23	89391877	B	O	P6
REM 501/24	89391866	W	O	P5
REM 501/25	89391865	R	O	P7
REM 501/26	89392135	R	O	P4

200A

Club House / Restaurant

0/3

Main 150A · 3 sup · 8-probe

Lounge DB	L - CH - 001	R	O
Basement DB	B - CH - 002	W	O
Upstairs DB	US - CH - 003	B	O

KIOSK AMR SCHEDULE

KIOSK	SUP	ON AMR	ORD	OUT	UNIT
MS LV board	1	0	0	1	deferred
K 1,1	5	0	5	0	8-probe
K 1,2	5	0	5	0	8-probe
K 2,1	5	0	5	0	8-probe
K 2,2	5	0	5	0	8-probe
Rem 501 V/V K1	10	0	10	0	16-probe
Rem 501 V/V K2	8	0	8	0	8-probe
Rem 501 V/V K3	8	8	0	0	existing
Club House / Restaurant	3	0	3	0	8-probe



AMR PROGRESS (supplies)

16% on AMR



Installed 8 Ordered 41 Outstanding 0 Deferred 1

ZULULAMI ESTATE

MS 07 – LV RETICULATION & AMR STATUS

PowerTech · 315 kVA (500A) · mfd 06/2016 · bulk meter 83014676 (on AMR)

— feed per sheet - - - - - inferred from layout Rows: status · stand · S/N · ph · Q/C/V · port

DRAWING No. ZLM-SLD-07	REVISION A	
DATE 2026-10-09	SCALE NTS	
DRAWN Ruan van Heerden, Electrical Engineer		SHEET 8 of 15



AMR PROGRESS (supplies)

0% on AMR



Installed 0

Ordered 0

Outstanding 18

Deferred 0

ZULULAMI ESTATE

MS 08 – LV RETICULATION & AMR STATUS

SGB-Smit Power Malta · 315 kVA (450A) · mfd 08/2020 · bulk meter 83014670 (on AMR)

— feed per sheet

----- inferred from layout

Rows: status · stand · S/N · ph · Q/C/V · port

DRAWING No.	REVISION	
ZLM-SLD-08	A	
DATE	SCALE	
2026-10-09	NTS	
DRAWN	SHEET	
Ruan van Heerden, Electrical Engineer		9 of 15


MS 09

315 kVA (450A)

Bulk 82929637

Bulk on AMR

- Direct from LV board:
- Sewer Pump Station · 100A · 83014662
 - Pump Station · 100A · 47369892
 - Streetlights · 60A · 47369910

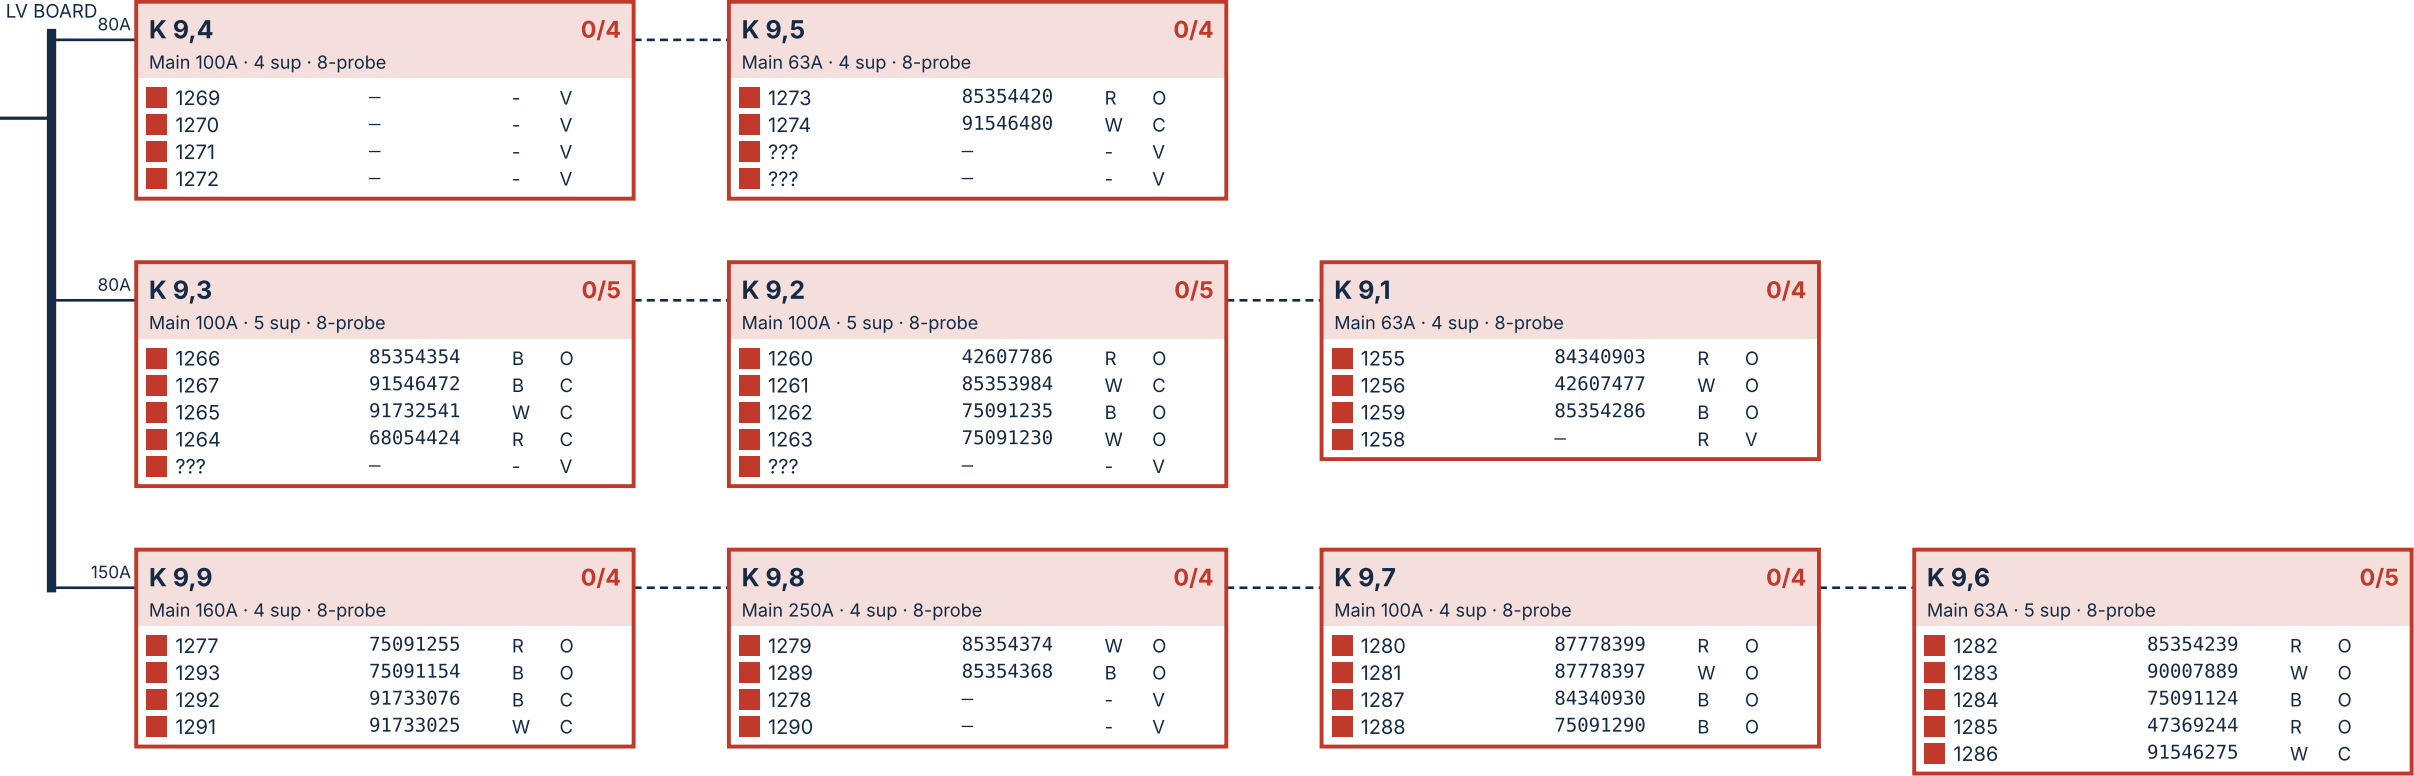

AMR PROGRESS (supplies)

0% on AMR



Installed 0 Ordered 0 Outstanding 42 Deferred 0

ZULULAMI ESTATE

MS 09 – LV RETICULATION & AMR STATUS

SGB-Smit Power Malta · 315 kVA (450A) · mfd 05/2019 · bulk meter 82929637 (on AMR)

— feed per sheet - - - - - inferred from layout Rows: status · stand · S/N · ph · Q/C/V · port

DRAWING No.	REVISION	
ZLM-SLD-09	A	
DATE	SCALE	
2026-10-09	NTS	
DRAWN	SHEET	
Ruan van Heerden, Electrical Engineer	10 of 15	

MS 10

315 kVA (450A)

Bulk 63237027

Bulk on AMR

- Direct from LV board:
- Sewer Pump Station · 200A · 83014678
 - Streetlights Kiosk · 63A · 42866560

LV BOARD

80A	K 10,1					0/4	
	Main 100A · 4 sup · 8-probe						
		1150	72404391	R	O		
		1151	84340925	W	O		
		1126	77308414	B	O		
		1127	91546311	R	C		

K 10,8

0/5

Main 63A · 5 sup · 8-probe

1152	72404386	W	O
1153	71205273	R	O
1154	—	-	V
1155	84340909	B	O
1156	—	-	V

100A

K 10,2

0/5

Main 100A · 5 sup · 8-probe

1706-01	75091289	R	O
1704	90151407	RWB	O
1143	—	-	V
1128	—	-	V
1706-02	91546074	W	O

K 10,3

0/6

Main 80A · 6 sup · 8-probe

1131	85354273	R	O
1130	—	-	V
1706-04	42576495	W	O
1145	—	-	V
1706-05	87819187	B	O
1706-03	91546492	B	O

K 10,4

0/4

Main 63A · 4 sup · 8-probe

1132	46884750	R	O
1133	84340951	W	O
1134	—	-	V
1135	—	-	V

100A	K 10,7				0/4	
Main 100A · 4 sup · 8-probe						
■	1146	—	-	V		
■	1147	91733399	W	O		
■	1148	84340935	B	O		
■	1149	—	-	V		

K 10,6

0/5

Main 63A · 5 sup · 8-probe

1139	84039918	R	O
1140	87778582	W	O
1141	75091224	B	O
1706 - 09	84340912	W	O
1706 - 08	42576436	R	O

K 10,5

0/5

Main 63A · 5 sup · 8-probe

1706-07	47369135	R	O
1706-06	47511107	W	O
1137	91546267	B	C
???	—	-	V
???	—	-	V

100A

K 10,9				0/5	
Main 100A · 5 sup · 8-probe					
	1121	—	-	V	
	1122	—	-	V	
	1123	87778406	B	O	
	1124	85353985	W	O	
	1125	—	-	V	

K 10,10

0/5

Main 63A · 5 sup · 8-probe

1116	71205179	R	O
1117	—	-	V
1118	47369121	B	O
1119	62627200	R	O
1120	84039727	B	C

KIOSK AMR SCHEDULE

KIOSK	SUP	ON AMR	ORD	OUT	UNIT
MS LV board	2	0	0	2	8-probe
K 10,1	4	0	0	4	8-probe
K 10,8	5	0	0	5	8-probe
K 10,2	5	0	0	5	8-probe
K 10,3	6	0	0	6	8-probe
K 10,4	4	0	0	4	8-probe
K 10,7	4	0	0	4	8-probe
K 10,6	5	0	0	5	8-probe
K 10,5	5	0	0	5	8-probe
K 10,9	5	0	0	5	8-probe
K 10,10	5	0	0	5	8-probe



AMR PROGRESS (supplies)

0% on AMR



Installed 0 Ordered 0 Outstanding 50 Deferred 0

ZULULAMI ESTATE

MS 10 – LV RETICULATION & AMR STATUS

SGB-Smit Power Malta · 315 kVA (450A) · mfd 05/2019 · bulk meter 63237027 (on AMR)

— feed per sheet - - - - - inferred from layout Rows: status · stand · S/N · ph · Q/C/V · port

DRAWING No. ZLM-SLD-10	REVISION A	
DATE 2026-10-09	SCALE NTS	
DRAWN Ruan van Heerden, Electrical Engineer		SHEET 11 of 15

MS 11


315 kVA (450A)

Bulk 63237016


Bulk on AMR

Direct from LV board:

Streetlights Kiosk · 63A · 47369736

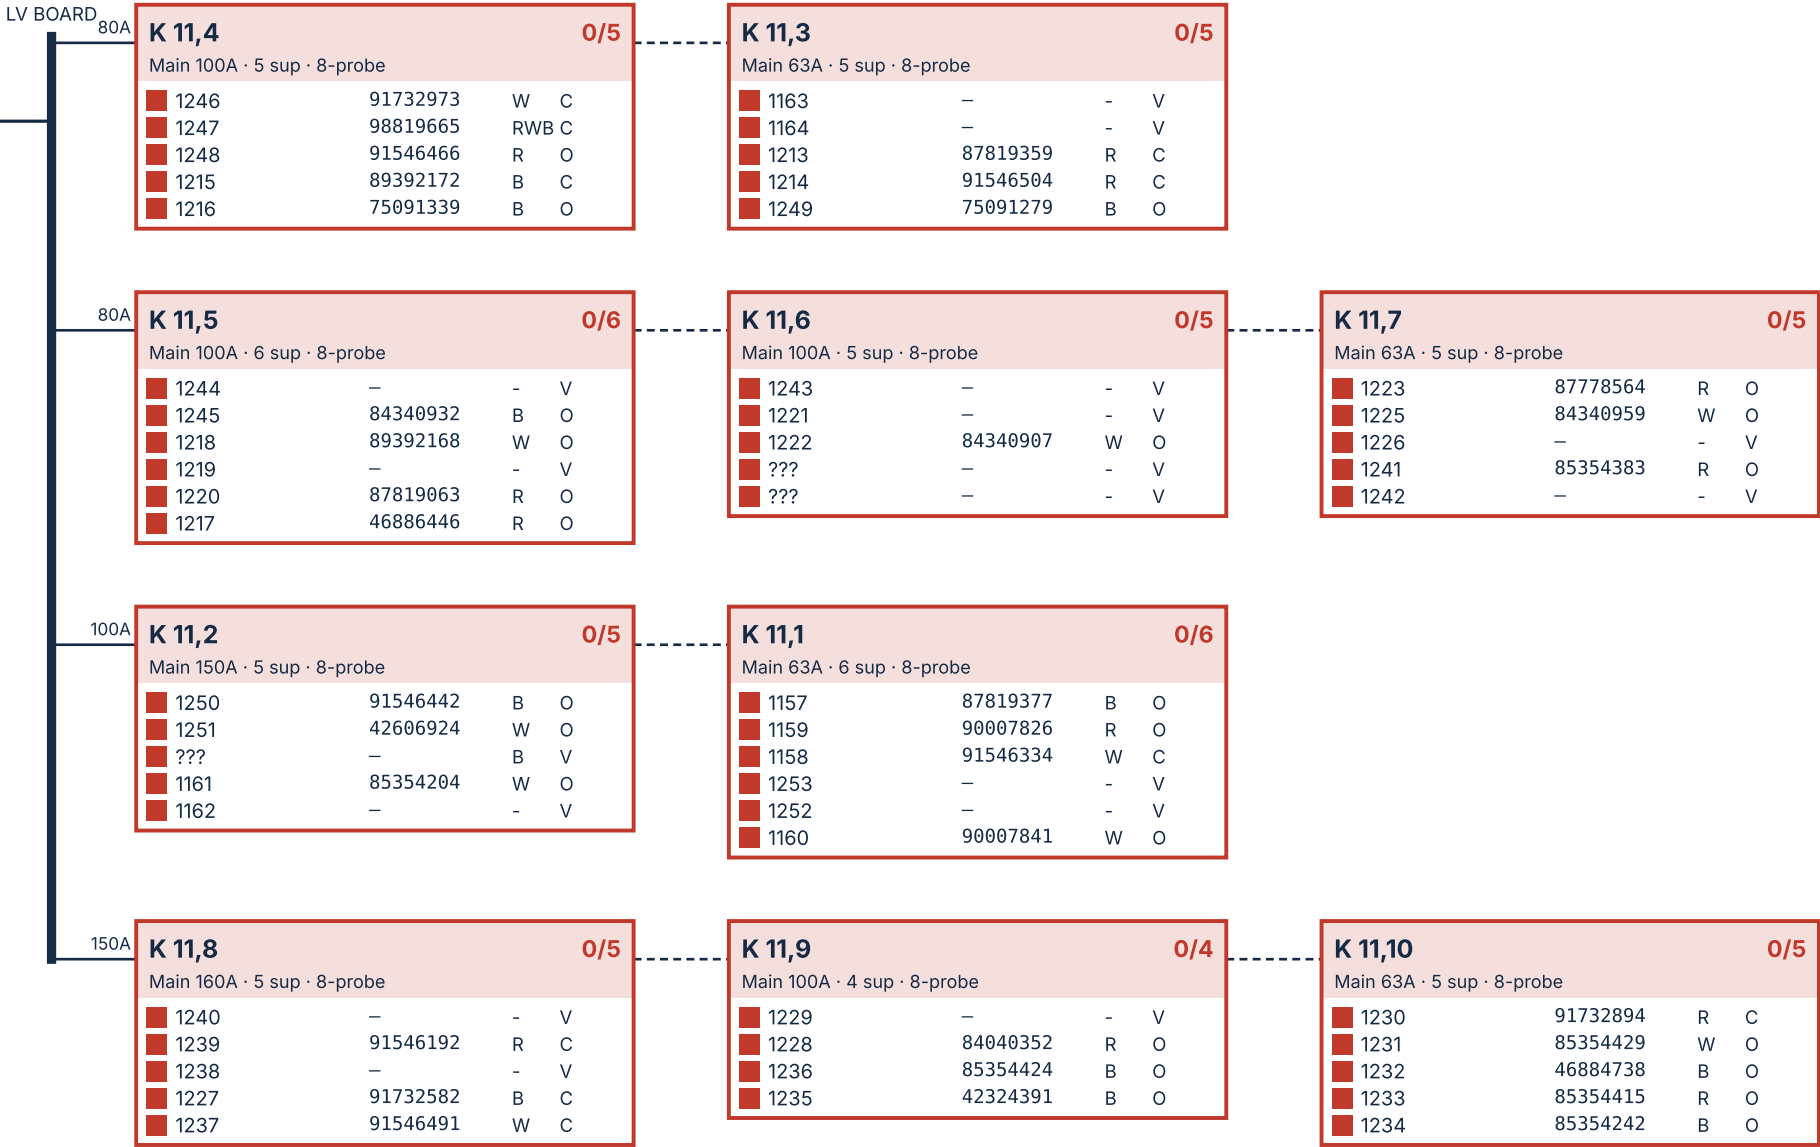

KIOSK AMR SCHEDULE					
KIOSK	SUP	ON AMR	ORD	OUT	UNIT
MS LV board	1	0	0	1	Standalone
K 11,4	5	0	0	5	8-probe
K 11,3	5	0	0	5	8-probe
K 11,5	6	0	0	6	8-probe
K 11,6	5	0	0	5	8-probe
K 11,7	5	0	0	5	8-probe
K 11,2	5	0	0	5	8-probe
K 11,1	6	0	0	6	8-probe
K 11,8	5	0	0	5	8-probe
K 11,9	4	0	0	4	8-probe
K 11,10	5	0	0	5	8-probe

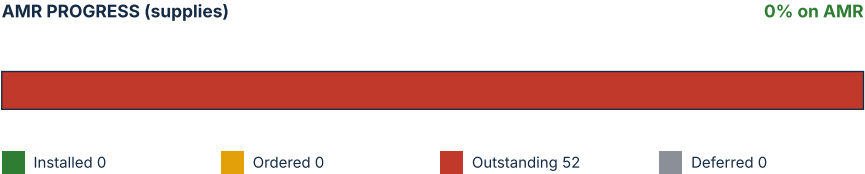

ZULULAMI ESTATE

MS 11 – LV RETICULATION & AMR STATUS

SGB-Smit Power Malta · 315 kVA (450A) · mfd 2019 · bulk meter 63237016 (on AMR)

— feed per sheet

----- inferred from layout

Rows: status · stand · S/N · ph · Q/C/V · port

DRAWING No.	REVISION	
ZLM-SLD-11	A	
DATE	SCALE	
2026-10-09	NTS	
DRAWN	SHEET	
Ruan van Heerden, Electrical Engineer	12 of 15	

MS 13


315 kVA (450A)

Bulk 83013672

Bulk on AMR

Direct from LV board:

Streetlights · 60A · 47369881

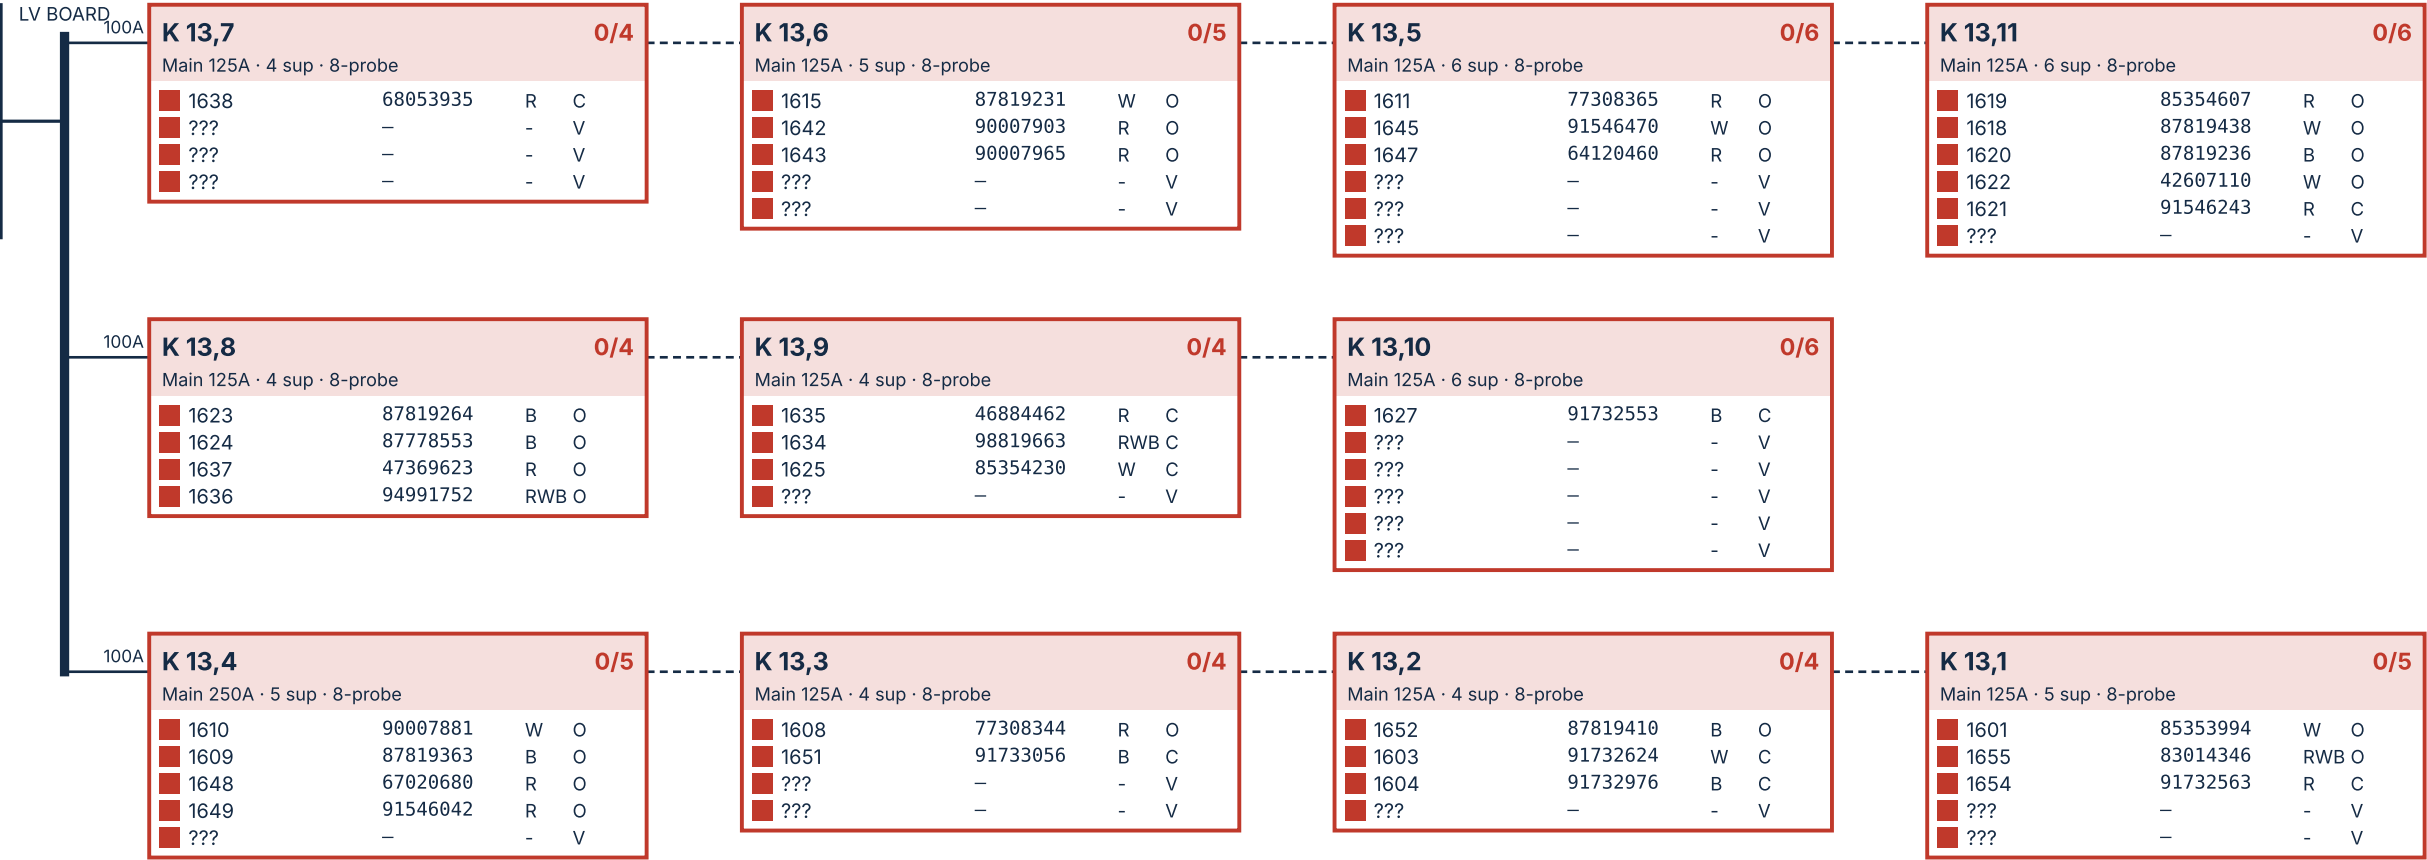

MS 14

315 kVA (450A)

Bulk 83013703

Bulk on AMR

Direct from LV board:

Streetlights · 63A · 42866655

