


AMR PROGRESS PER MINISUB

MINISUB	RATING	BULK ON AMR	KIOSKS	SUPPLIES	INSTALLED	ORDERED	OUTSTANDING	DEFERRED	% ON AMR	
MS 01	500 kVA (800A)	Yes	12	54	0	0	54	0	0%	
MS 02	500 kVA (800A)	Yes	15	64	24	0	40	0	38%	
MS 03	315 kVA (450A)	Yes	18	106	0	0	106	0	0%	
MS 06	315 kVA (450A)	Yes	12	70	23	46	0	1	33%	
MS 07	315 kVA (500A)	Yes	8	50	8	41	0	1	16%	
MS 08	315 kVA (450A)	Yes	4	18	0	0	18	0	0%	
MS 09	315 kVA (450A)	Yes	9	42	0	0	42	0	0%	
MS 10	315 kVA (450A)	Yes	10	50	0	0	50	0	0%	
MS 11	315 kVA (450A)	Yes	10	52	0	0	52	0	0%	
MS 12	315 kVA (450A)	Yes	12	49	0	0	49	0	0%	
MS 13	315 kVA (450A)	Yes	11	54	0	0	54	0	0%	
MS 14	315 kVA (450A)	Yes	11	53	0	0	53	0	0%	
TOTAL				662	55	87	518	2	8%	

KEY PLAN (from KMZ) – square colour: green = AMR started/complete, amber = in current order, red = not started

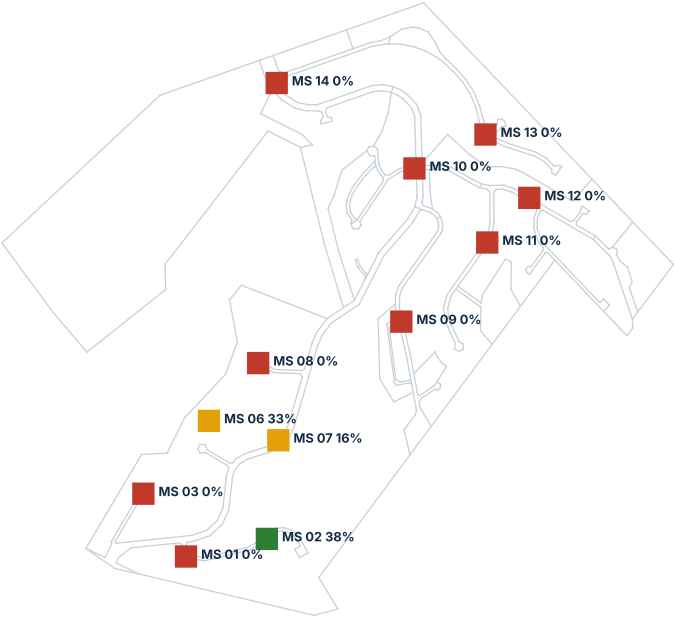

Notes: 1) Supply = one metered connection (1 probe). 511 Husk (MS 02) added from the AMR export – not in the reticulation sheet. Coral Cove (MS 04, MS 05) is issued as its own set. 2) Kiosk feeds not stated in the sheet are inferred from the sheet layout (dashed) – verify against as-built SLDs.

3) Status colours: green = on AMR, amber = on an open order, red = outstanding, grey = deferred.



AMR PROGRESS (supplies)

8% on AMR



Installed 55 Ordered 87 Outstanding 518 Deferred 2

ZULULAMI ESTATE

SITE OVERVIEW – AMR PROGRESS PER MINISUB

Supplies per minisub from the master hierarchy workbook.

— feed per sheet - - - - - inferred from layout Rows: status · stand · S/N · ph · Q/C/V · port

DRAWING No. ZLM-SLD-00	REVISION A	
DATE 2026-10-09	SCALE NTS	
DRAWN Ruan van Heerden, Electrical Engineer	SHEET 1 of 13	

MS 01

500 kVA (800A)

Bulk 63237040

Bulk on AMR

Direct from LV board:

Main Gatehouse · 60A · Double Connection · --

Contractors Gate · 60A · Double Connection · --

Streetlights · 60A · 82816209

250A

505 Aura K01

0/4

Main 200A · 4 sup · 8-probe

505-01	84039740	B	O
505-02	75091206	R	O
505-03	84039751	R	O
505-04	84039746	W	O

250A

505 Aura K02

0/4

Main 250A · 4 sup · 8-probe

505-05	75091343	B	O
505-06	75091296	W	O
505-07	84039707	R	O
505-08	62742631	W	O

250A

505 Aura K03

0/4

Main 250A · 4 sup · 8-probe

505-09	47369314	B	O
505-10	47369294	B	O
505-11	75091021	R	O
505-12	75091242	W	O

250A

505 Aura K08

0/6

Main 250A · 6 sup · 8-probe

505-F1	85354288	B	O
505-F2	85354624	R	O
505-F3	85354356	W	O
505-F4	85354293	W	O
505-F5	85354298	R	O
505-45	85354586	W	O

250A

505 Aura K09

0/4

Main 160A · 4 sup · 8-probe

505-29	84340966	B	O
505-30	84341038	R	O
505-31	84341019	B	O
505-32	84340990	W	O

505 Aura K10

0/4

Main 100A · 4 sup · 8-probe

505-33	84340995	R	O
505-34	84340900	W	O
505-35	84340901	B	O
505-36	84340949	R	O

505 Aura K11

0/4

Main 125A · 4 sup · 8-probe


505-37	84340973	R	O
505-38	84340996	W	O
505-39	84340929	B	O
505-40	84340924	W	O

505 Aura K12

0/4

Main 125A · 4 sup · 8-probe

505-41	84340927	R	O
505-42	84340905	W	O
505-43	84340972	B	O
505-44	84340948	B	O

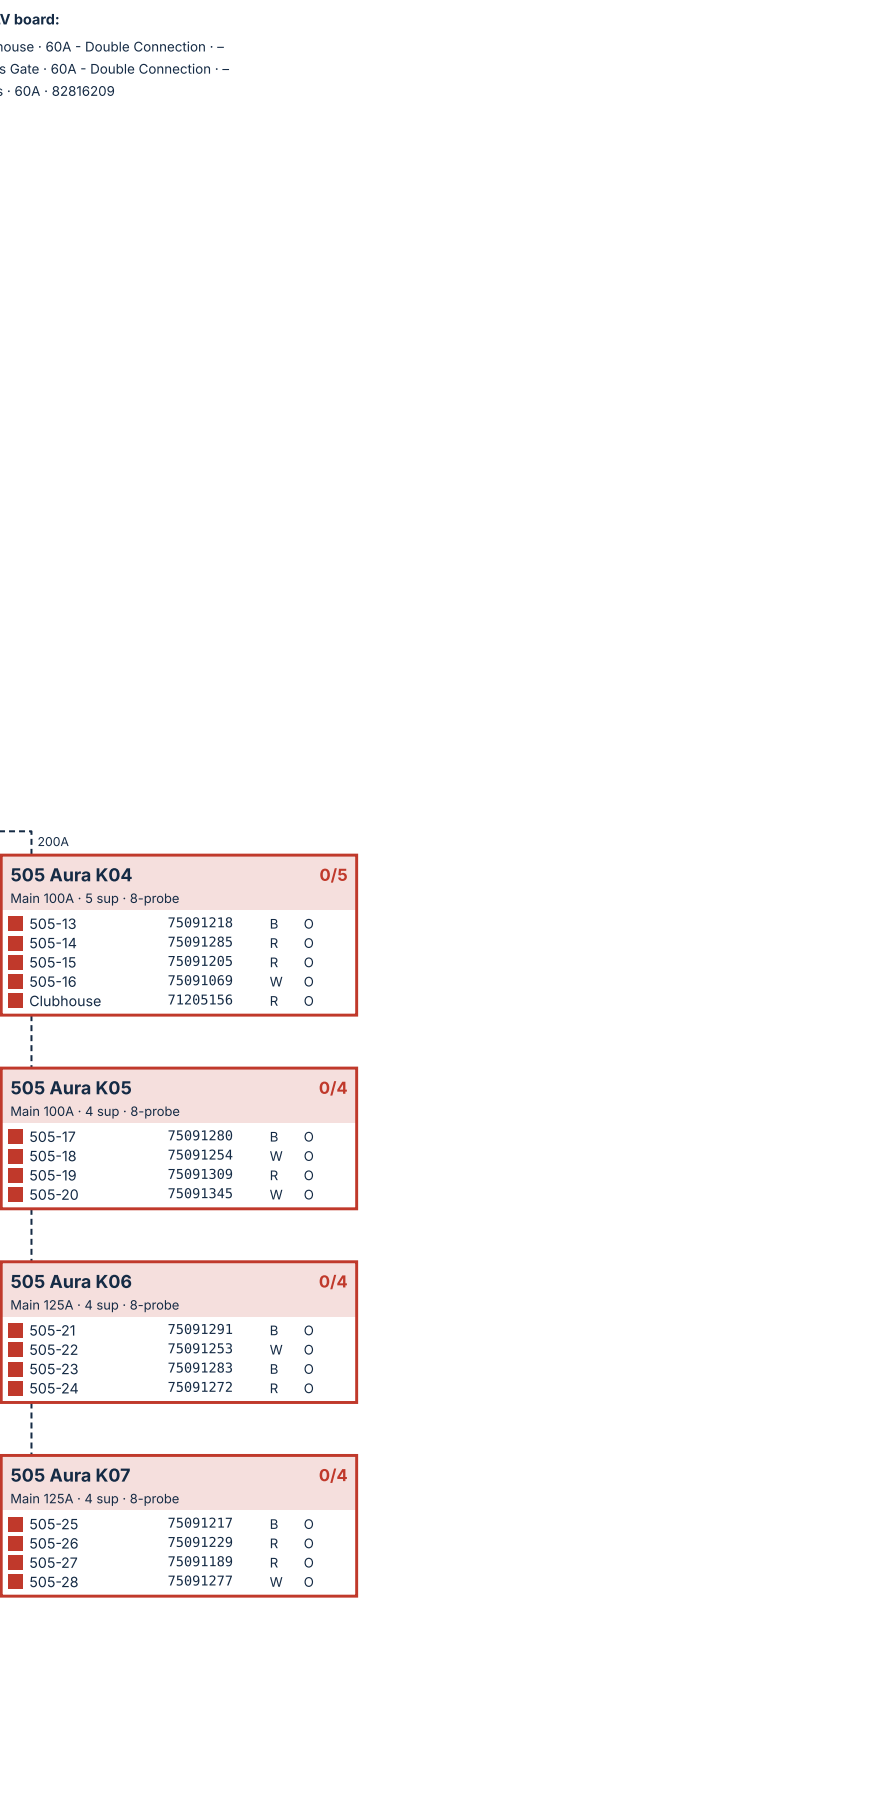

ZULULAMI ESTATE

MS 01 – LV RETICULATION & AMR STATUS

PowerTech · 500 kVA (800A) · mfd 10/2017 · bulk meter 63237040 (on AMR)

— feed per sheet

----- inferred from layout

Rows: status · stand · S/N · ph · Q/C/V · port

KIOSK AMR SCHEDULE					
KIOSK	SUP	ON AMR	ORD	OUT	UNIT
MS LV board	3	0	0	3	8-probe
505 Aura K08	6	0	0	6	8-probe
505 Aura K09	4	0	0	4	8-probe
505 Aura K10	4	0	0	4	8-probe
505 Aura K11	4	0	0	4	8-probe
505 Aura K12	4	0	0	4	8-probe
505 Aura K01	4	0	0	4	8-probe
505 Aura K02	4	0	0	4	8-probe
505 Aura K03	4	0	0	4	8-probe
505 Aura K04	5	0	0	5	8-probe
505 Aura K05	4	0	0	4	8-probe
505 Aura K06	4	0	0	4	8-probe
505 Aura K07	4	0	0	4	8-probe

MS 02


500 kVA (800A)

Bulk 63237017

Bulk on AMR

Direct from LV board:

Streetlights · 60A · 67021415

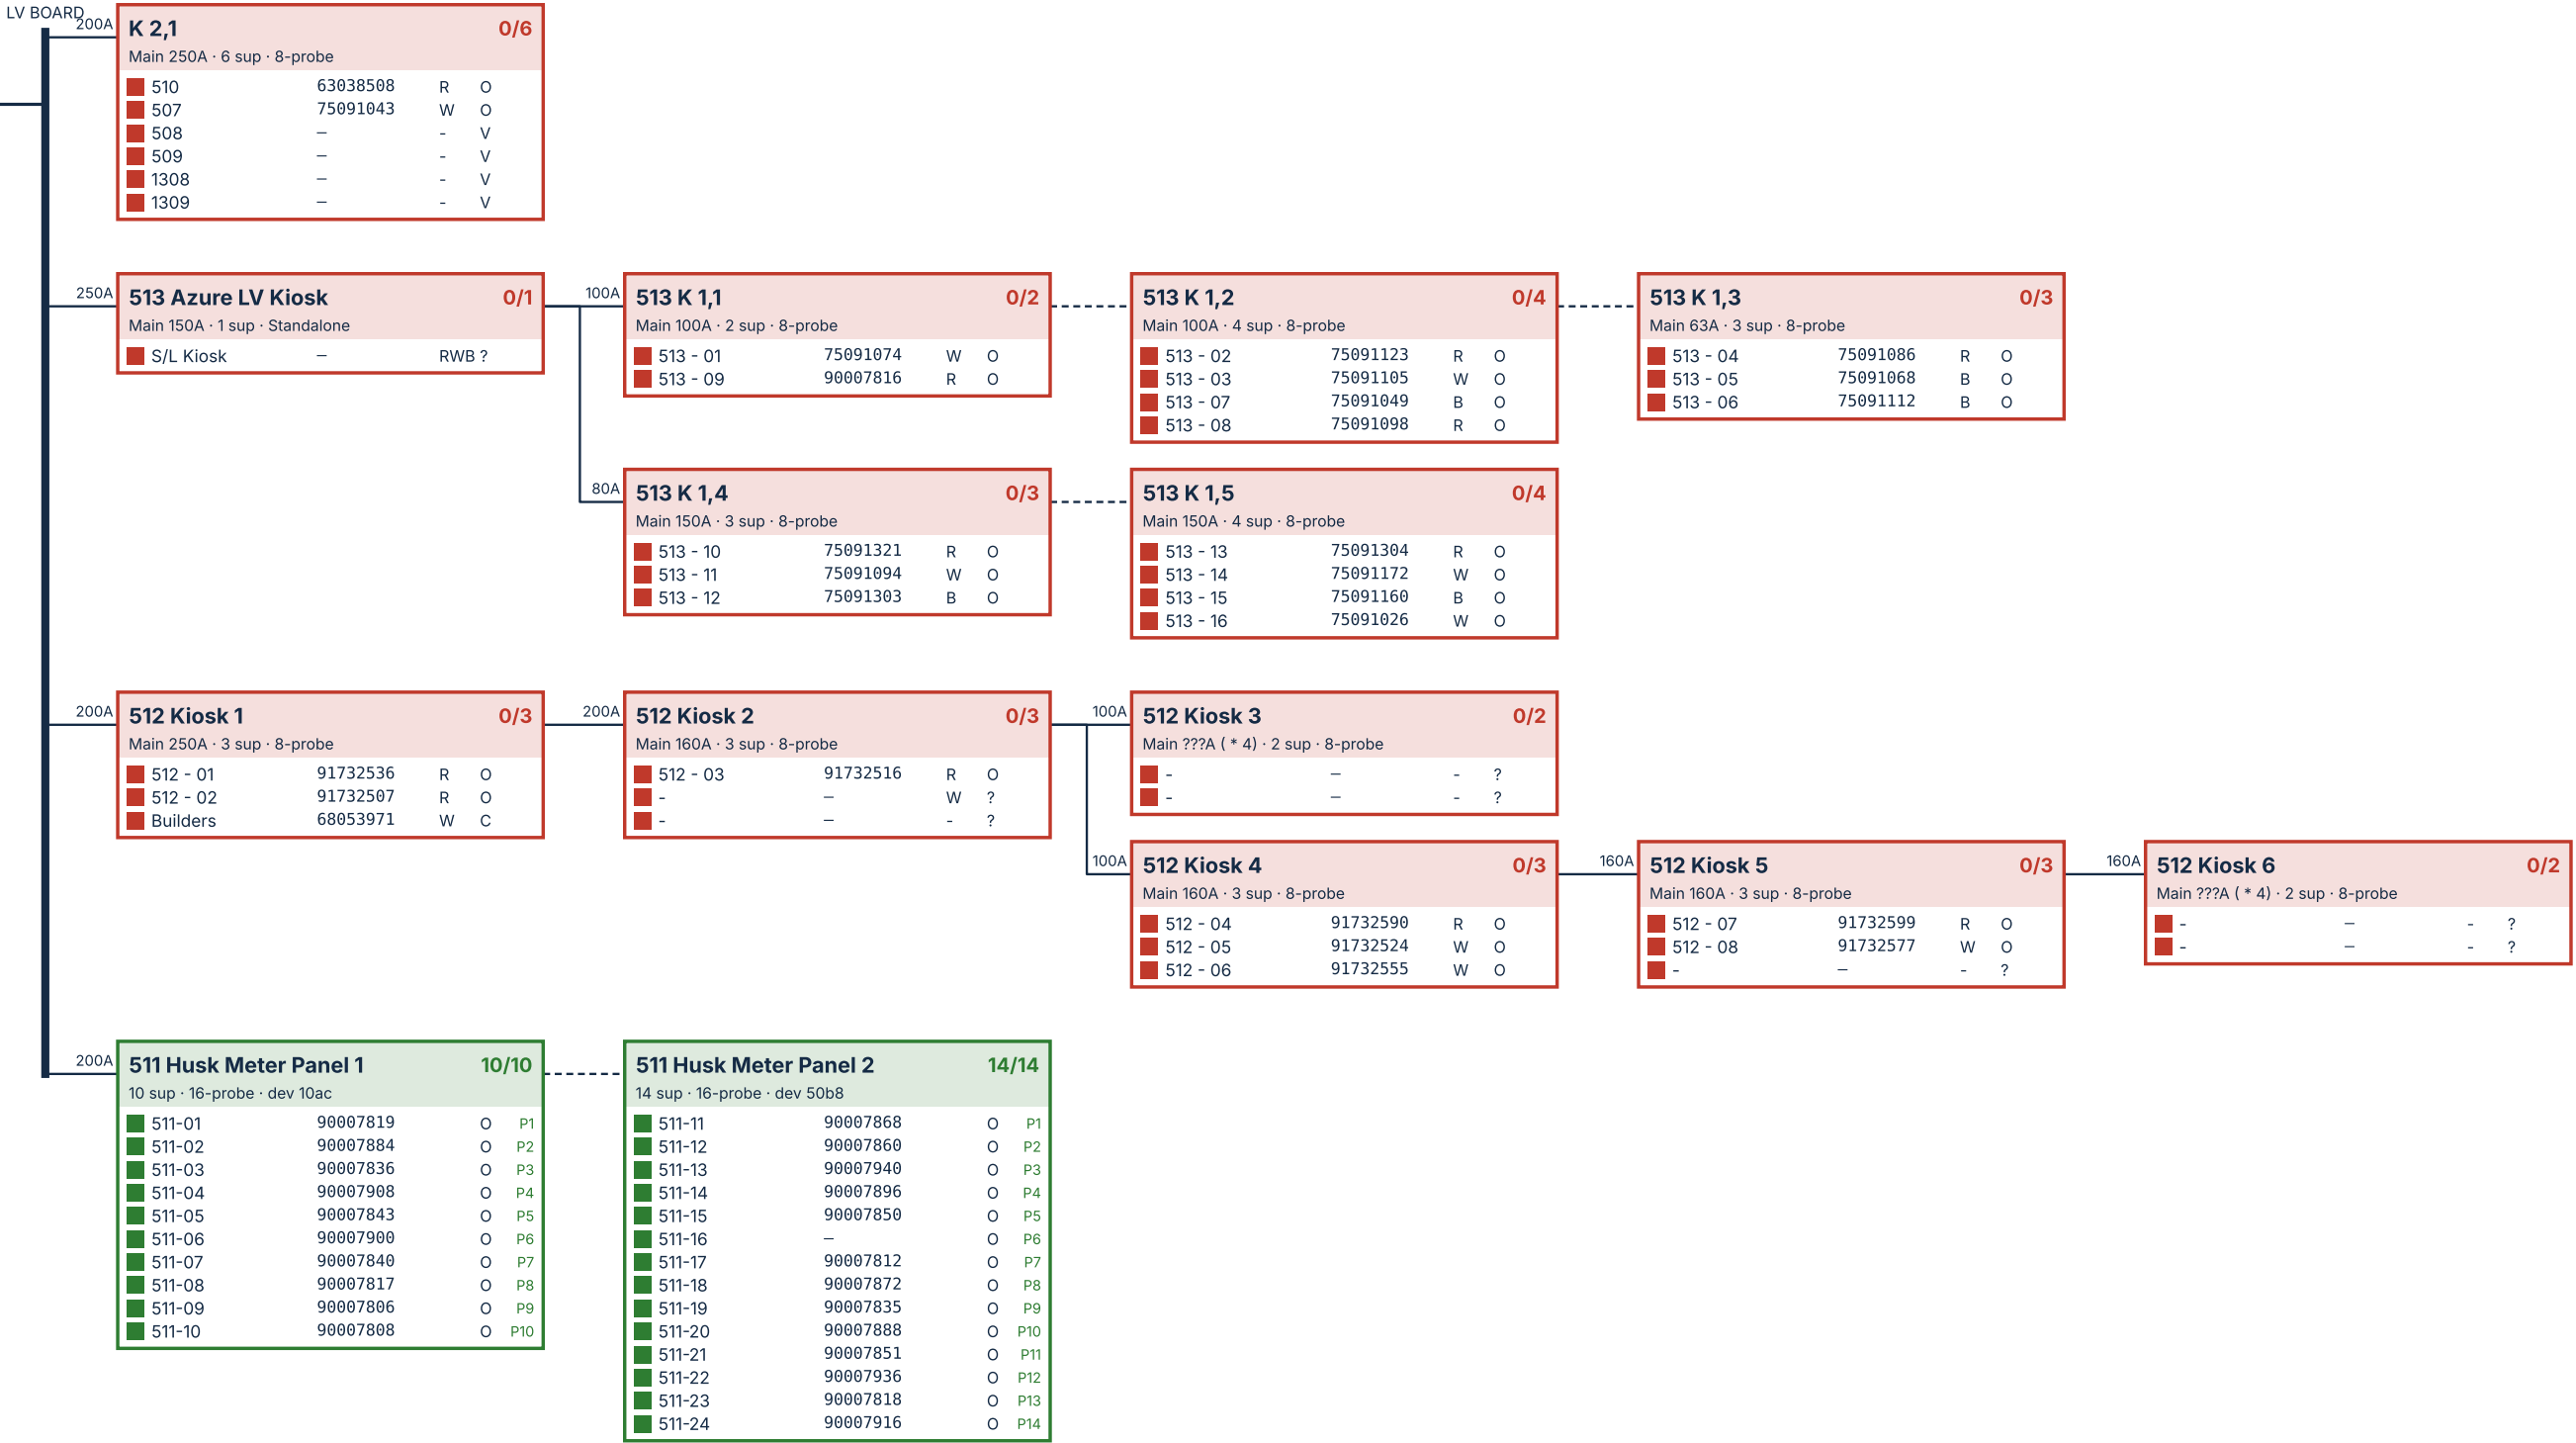

AMR PROGRESS (supplies)

38% on AMR



Installed 24 Ordered 0 Outstanding 40 Deferred 0

ZULULAMI ESTATE

MS 02 – LV RETICULATION & AMR STATUS

PowerTech · 500 kVA (800A) · mfd 10/2017 · bulk meter 63237017 (on AMR)

— feed per sheet - - - - - inferred from layout Rows: status · stand · S/N · ph · Q/C/V · port

DRAWING No.	REVISION	
ZLM-SLD-02	A	
DATE	SCALE	
2026-10-09	NTS	
DRAWN	SHEET	
Ruan van Heerden, Electrical Engineer	3 of 13	



MS 06


315 kVA (450A)

Bulk 63237041

Bulk on AMR

Direct from LV board:

Streetlights · 32A · 47369899

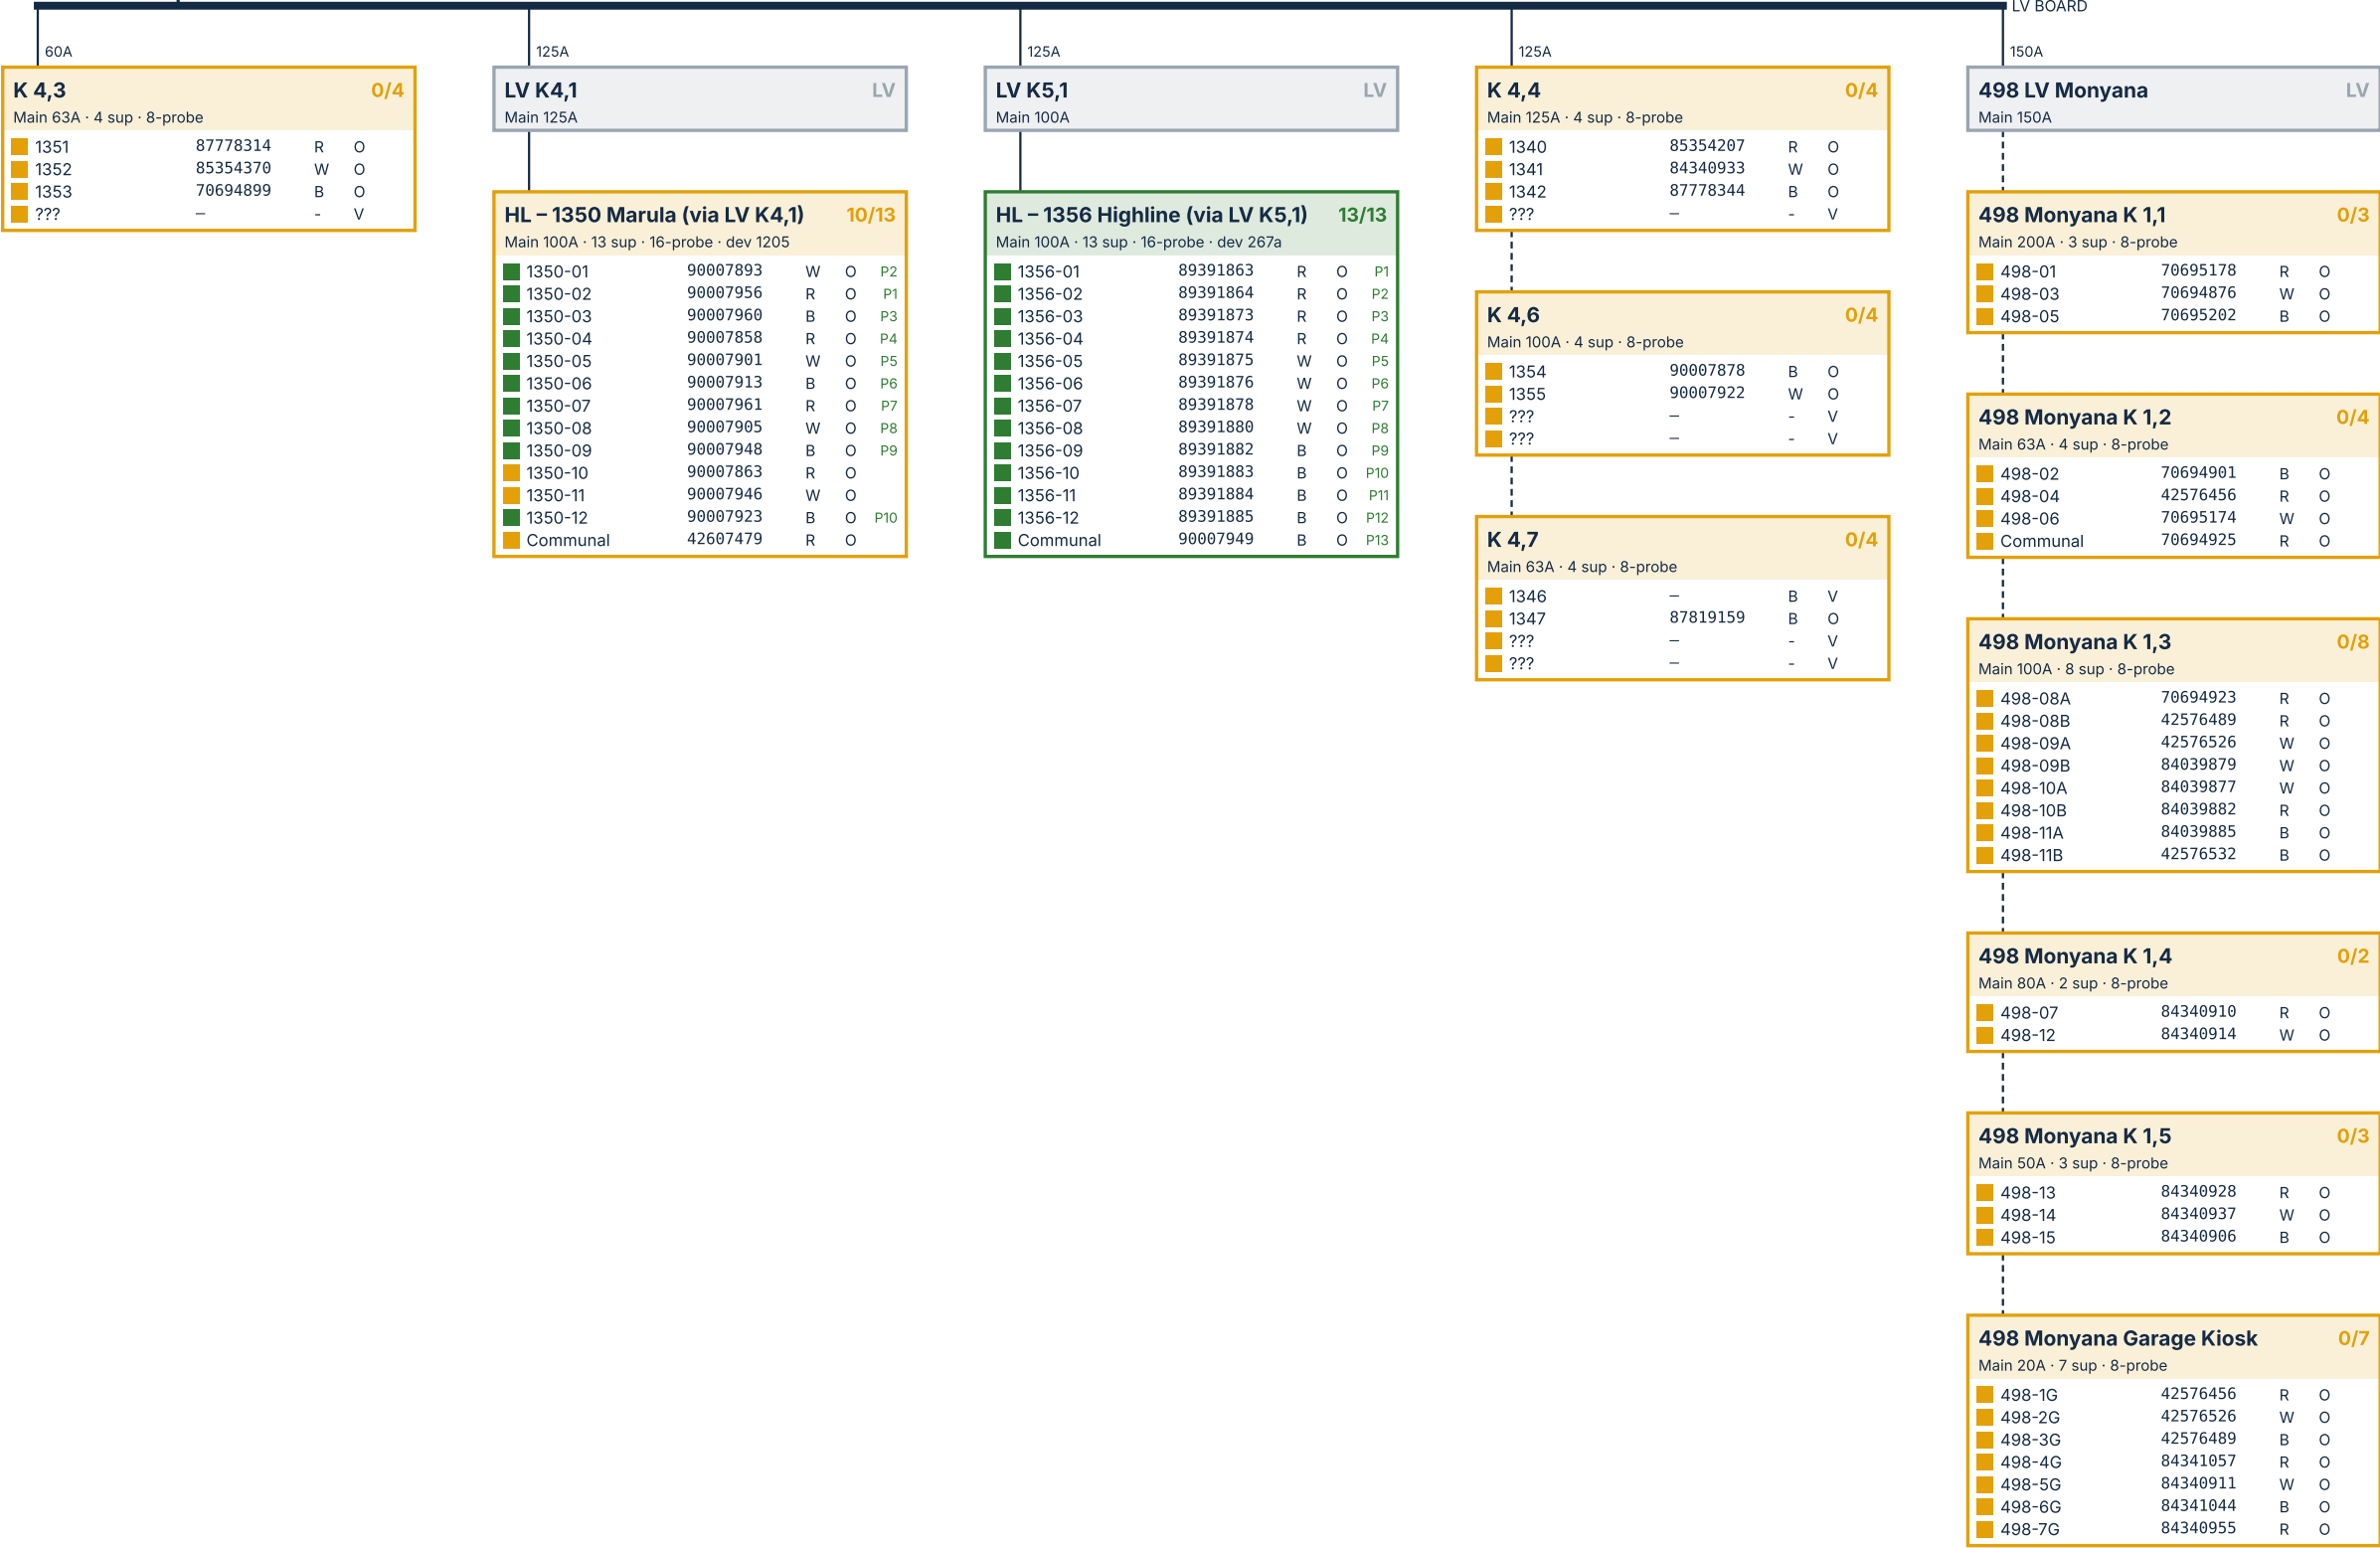

MS 07

315 kVA (500A)

Bulk 83014676

Bulk on AMR

Direct from LV board:

Streetlights · 63A · 82929432

LV BOARD

200A

Ptn 501 N/S LV Kiosk

LV

Main 200A

160A

K 1,1

0/5

Main 100A · 5 sup · 8-probe

Ptn 501/01	84340908	R	O
Ptn 501/02	84340913	W	O
Ptn 501/03	84340904	B	O
Ptn 501/04	84340686	R	O
Ptn 501/05	84340952	W	O

K 1,2

0/5

Main 100A · 5 sup · 8-probe

Ptn 501/06	—	W	C
Ptn 501/07	84340593	R	O
Ptn 501/08	84340708	W	O
Ptn 501/09	47369117	B	O
Ptn 501/10	46886469	R	O

160A

K 2,1

0/5

Main 100A · 5 sup · 8-probe

Ptn 501/11	91546482	R	O
Ptn 501/12	89392169	R	O
Ptn 501/13	87778358	B	O
Ptn 501/14	87778380	R	O
Ptn 501/15	87778386	B	O

K 2,2

0/5

Main 100A · 5 sup · 8-probe

Ptn 501/16	85353960	R	O
Ptn 501/17	85354417	R	O
Ptn 501/18	85354403	R	O
Ptn 501/19	84039931	B	O
Ptn 501/20	85354390	W	O

300A

Rem 501 V/V K1

0/10

Main 400A · 10 sup · 16-probe

REM 501/01	89391891	W	O
REM 501/02	89392157	B	O
REM 501/03	89392110	B	O
REM 501/04	89392103	B	O
REM 501/05	89392105	R	O
REM 501/06	89392101	W	O
REM 501/07	89392149	B	O
REM 501/08	89392113	W	O
REM 501/09	89392106	R	O
REM 501/10	89392117	R	O

Rem 501 V/V K2

0/8

Main 250A · 8 sup · 8-probe

REM 501/11	89392104	W	O
REM 501/12	89392131	R	O
REM 501/13	89392132	W	O
REM 501/14	89392109	B	O
REM 501/15	89392102	W	O
REM 501/16	89392136	B	O
REM 501/17	89392127	R	O
REM 501/18	89392140	R	O

Rem 501 V/V K3

8/8

Main 160A · 8 sup · 8-probe · dev 45cf

REM 501/19	89392139	W	O	P2
REM 501/20	90007952	B	O	P3
REM 501/21	90007857	B	O	P8
REM 501/22	89392173	R	O	P1
REM 501/23	89391877	B	O	P6
REM 501/24	89391866	W	O	P5
REM 501/25	89391865	R	O	P7
REM 501/26	89392135	R	O	P4

200A

Club House / Restaurant

0/3

Main 150A · 3 sup · 8-probe

Lounge DB	L - CH - 001	R	O
Basement DB	B - CH - 002	W	O
Upstairs DB	US - CH - 003	B	O

KIOSK AMR SCHEDULE

KIOSK	SUP	ON AMR	ORD	OUT	UNIT
MS LV board	1	0	0	1	deferred
K 1,1	5	0	5	0	8-probe
K 1,2	5	0	5	0	8-probe
K 2,1	5	0	5	0	8-probe
K 2,2	5	0	5	0	8-probe
Rem 501 V/V K1	10	0	10	0	16-probe
Rem 501 V/V K2	8	0	8	0	8-probe
Rem 501 V/V K3	8	8	0	0	existing
Club House / Restaurant	3	0	3	0	8-probe



AMR PROGRESS (supplies)

16% on AMR



Installed 8 Ordered 41 Outstanding 0 Deferred 1

ZULULAMI ESTATE

MS 07 – LV RETICULATION & AMR STATUS

PowerTech · 315 kVA (500A) · mfd 06/2016 · bulk meter 83014676 (on AMR)

— feed per sheet - - - - - inferred from layout Rows: status · stand · S/N · ph · Q/C/V · port

DRAWING No.	REVISION	
ZLM-SLD-07	A	
DATE	SCALE	
2026-10-09	NTS	
DRAWN	SHEET	
Ruan van Heerden, Electrical Engineer	6 of 13	



AMR PROGRESS (supplies)

0% on AMR



Installed 0 Ordered 0 Outstanding 18 Deferred 0

ZULULAMI ESTATE

MS 08 – LV RETICULATION & AMR STATUS

SGB-Smit Power Malta · 315 kVA (450A) · mfd 08/2020 · bulk meter 83014670 (on AMR)

— feed per sheet - - - - - inferred from layout Rows: status · stand · S/N · ph · Q/C/V · port

DRAWING No.	REVISION	
ZLM-SLD-08	A	
DATE	SCALE	
2026-10-09	NTS	
DRAWN	SHEET	
Ruan van Heerden, Electrical Engineer	7 of 13	


MS 09

315 kVA (450A)

Bulk 82929637

Bulk on AMR

- Direct from LV board:
- Sewer Pump Station · 100A · 83014662
 - Pump Station · 100A · 47369892
 - Streetlights · 60A · 47369910

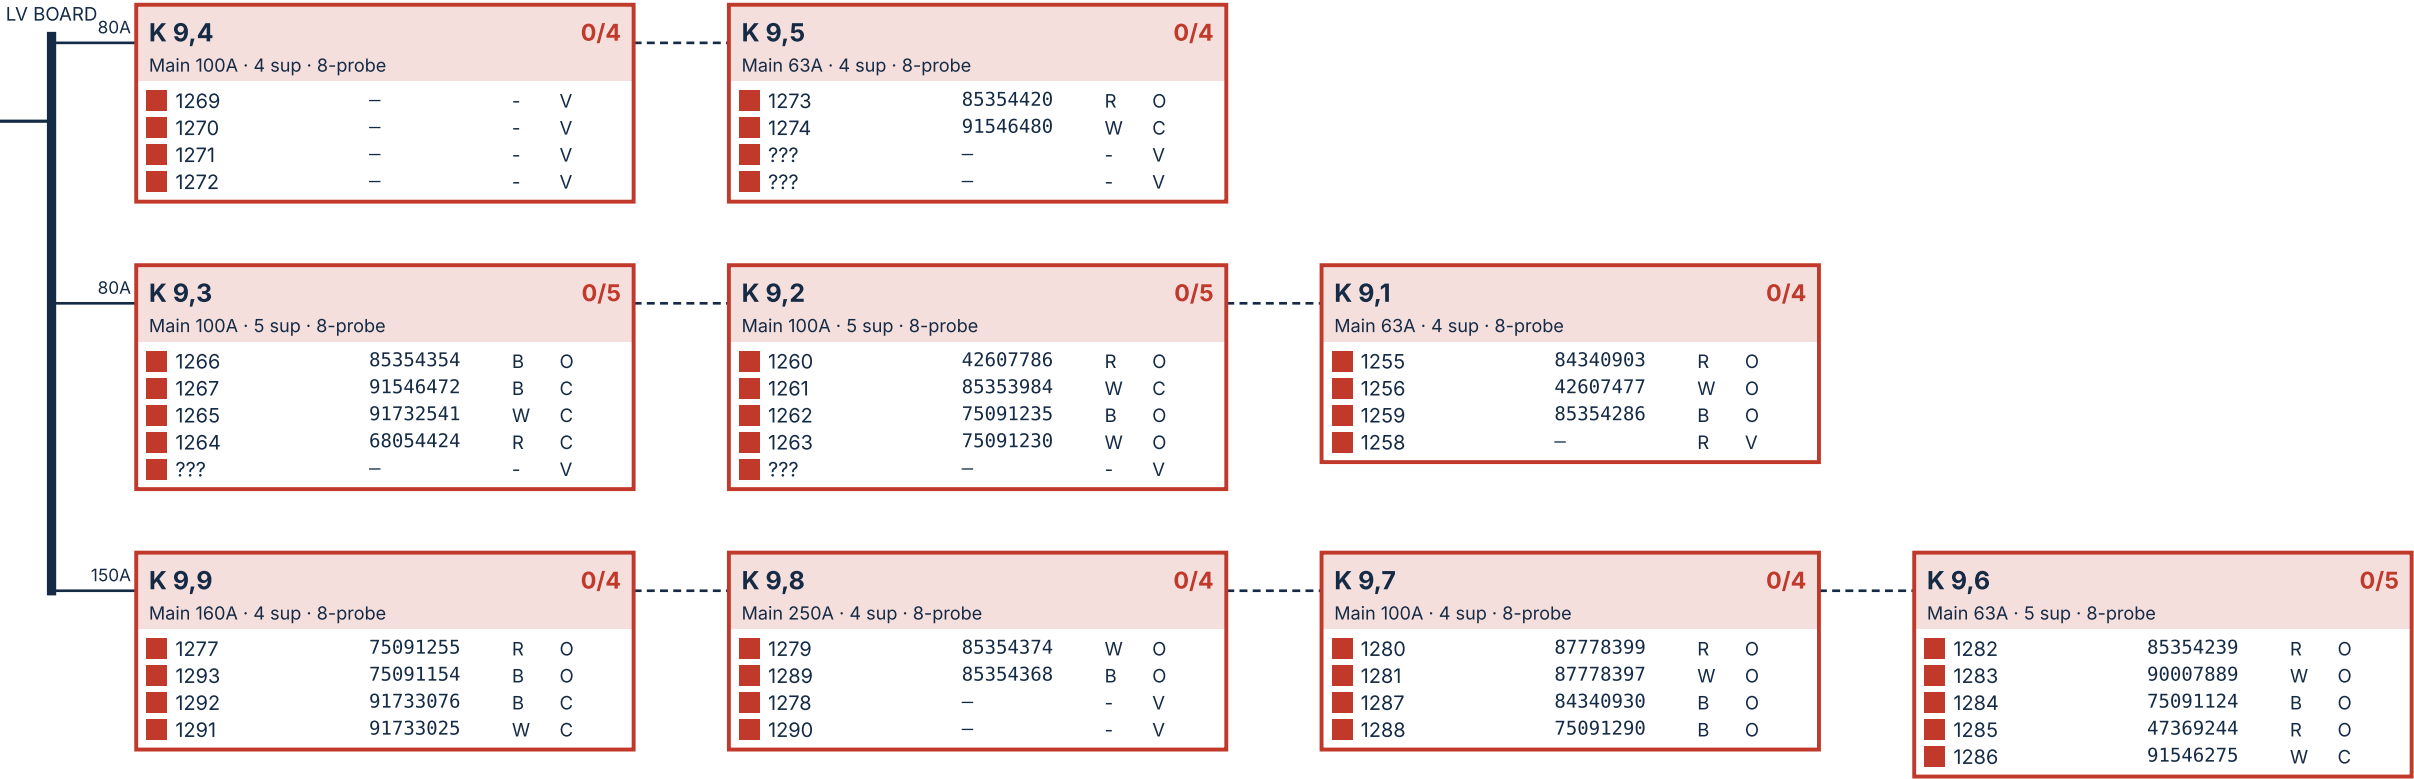

MS 10

315 kVA (450A)

Bulk 63237027

Bulk on AMR

- Direct from LV board:
- Sewer Pump Station · 200A · 83014678
 - Streetlights Kiosk · 63A · 42866560

LV BOARD

K 10,1

0/4

Main 100A · 4 sup · 8-probe

1150	72404391	R	O
1151	84340925	W	O
1126	77308414	B	O
1127	91546311	R	C

K 10,8

0/5

Main 63A · 5 sup · 8-probe

1152	72404386	W	O
1153	71205273	R	O
1154	—	-	V
1155	84340909	B	O
1156	—	-	V

K 10,2

0/5

Main 100A · 5 sup · 8-probe

1706-01	75091289	R	O
1704	90151407	RWB	O
1143	—	-	V
1128	—	-	V
1706-02	91546074	W	O

K 10,3

0/6

Main 80A · 6 sup · 8-probe

1131	85354273	R	O
1130	—	-	V
1706-04	42576495	W	O
1145	—	-	V
1706-05	87819187	B	O
1706-03	91546492	B	O

K 10,4

0/4

Main 63A · 4 sup · 8-probe

1132	46884750	R	O
1133	84340951	W	O
1134	—	-	V
1135	—	-	V

K 10,7

0/4

Main 100A · 4 sup · 8-probe

1146	—	-	V
1147	91733399	W	O
1148	84340935	B	O
1149	—	-	V

K 10,6

0/5

Main 63A · 5 sup · 8-probe

1139	84039918	R	O
1140	87778582	W	O
1141	75091224	B	O
1706 - 09	84340912	W	O
1706 - 08	42576436	R	O

K 10,5

0/5

Main 63A · 5 sup · 8-probe

1706-07	47369135	R	O
1706-06	47511107	W	O
1137	91546267	B	C
???	—	-	V
???	—	-	V

K 10,9

0/5

Main 100A · 5 sup · 8-probe

1121	—	-	V
1122	—	-	V
1123	87778406	B	O
1124	85353985	W	O
1125	—	-	V

K 10,10

0/5

Main 63A · 5 sup · 8-probe

1116	71205179	R	O
1117	—	-	V
1118	47369121	B	O
1119	62627200	R	O
1120	84039727	B	C

KIOSK AMR SCHEDULE

KIOSK	SUP	ON AMR	ORD	OUT	UNIT
MS LV board	2	0	0	2	8-probe
K 10,1	4	0	0	4	8-probe
K 10,8	5	0	0	5	8-probe
K 10,2	5	0	0	5	8-probe
K 10,3	6	0	0	6	8-probe
K 10,4	4	0	0	4	8-probe
K 10,7	4	0	0	4	8-probe
K 10,6	5	0	0	5	8-probe
K 10,5	5	0	0	5	8-probe
K 10,9	5	0	0	5	8-probe
K 10,10	5	0	0	5	8-probe



AMR PROGRESS (supplies)

0% on AMR



Installed 0 Ordered 0 Outstanding 50 Deferred 0

ZULULAMI ESTATE

MS 10 – LV RETICULATION & AMR STATUS

SGB-Smit Power Malta · 315 kVA (450A) · mfd 05/2019 · bulk meter 63237027 (on AMR)

— feed per sheet - - - - - inferred from layout Rows: status · stand · S/N · ph · Q/C/V · port

DRAWING No.	REVISION	
ZLM-SLD-10	A	
DATE	SCALE	
2026-10-09	NTS	
DRAWN	SHEET	
Ruan van Heerden, Electrical Engineer	9 of 13	

MS 11


315 kVA (450A)

Bulk 63237016


Bulk on AMR

Direct from LV board:

Streetlights Kiosk · 63A · 47369736

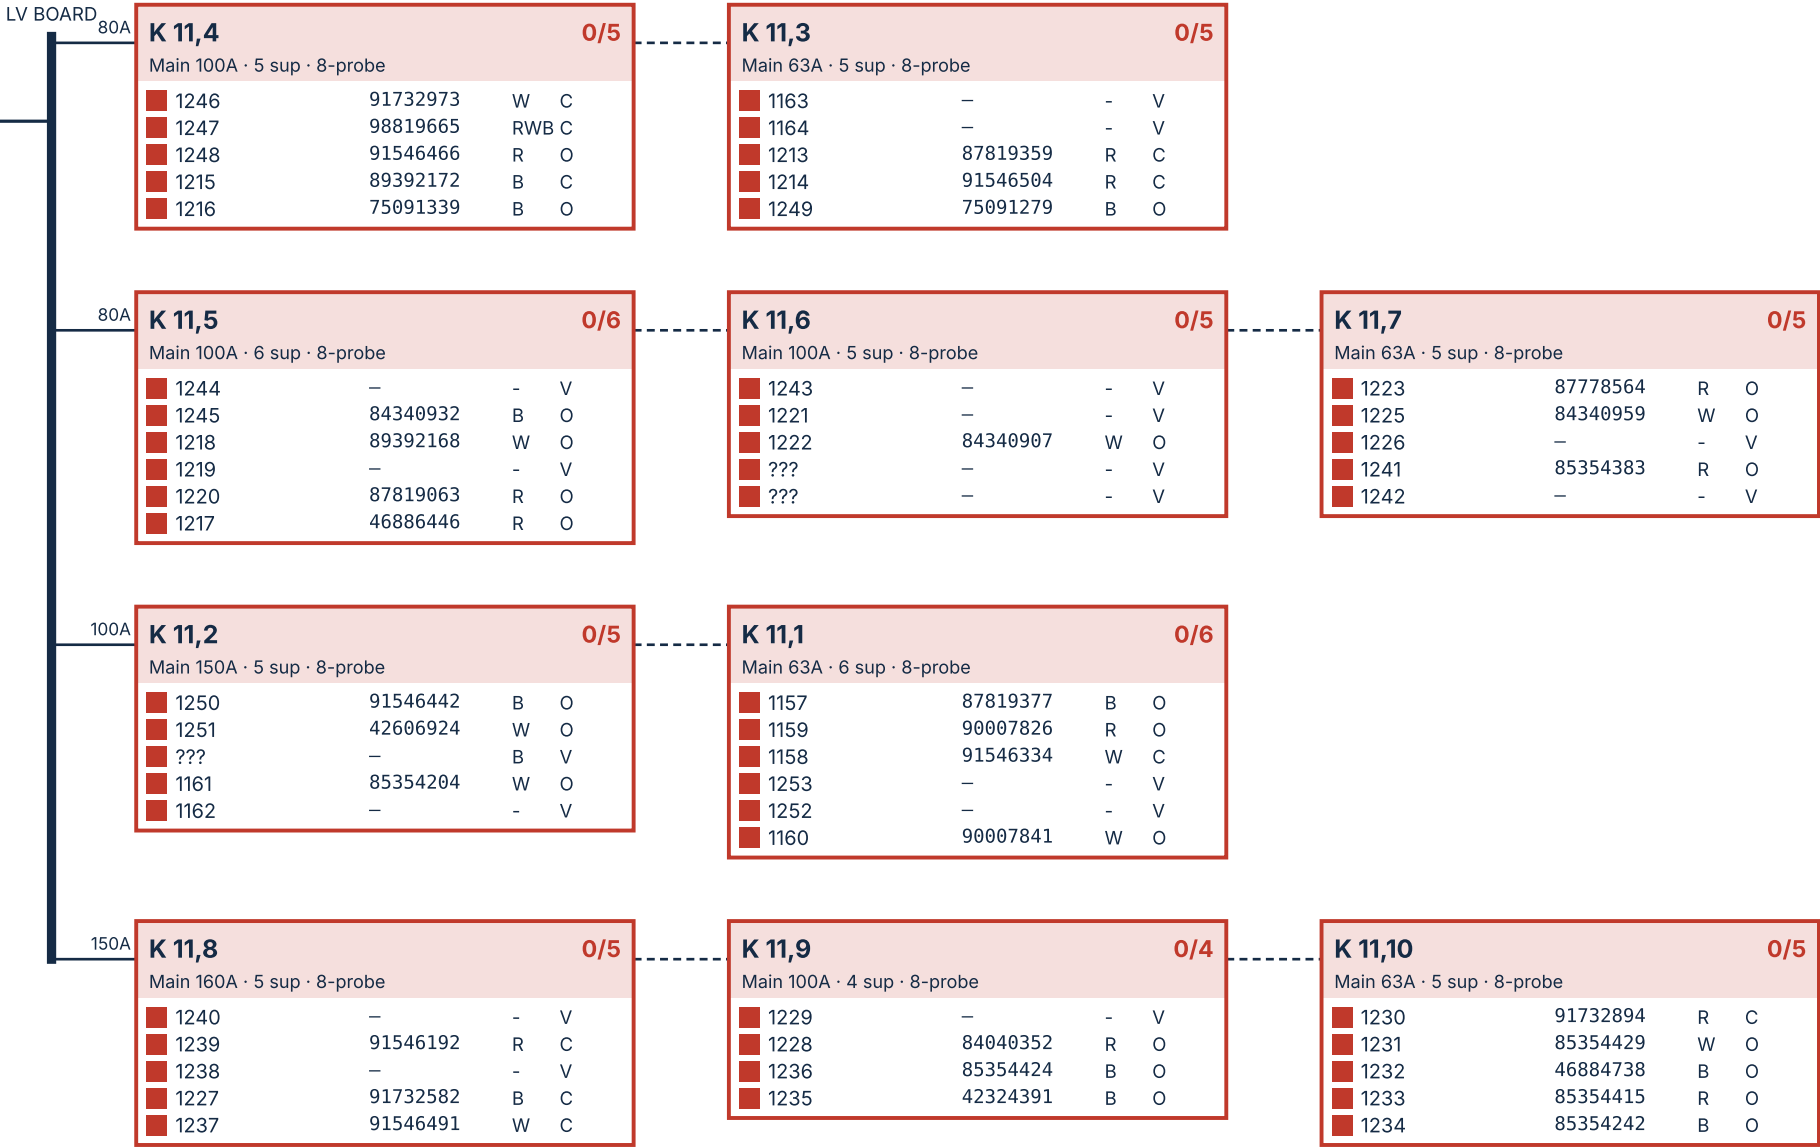

KIOSK AMR SCHEDULE					
KIOSK	SUP	ON AMR	ORD	OUT	UNIT
MS LV board	1	0	0	1	Standalone
K 11,4	5	0	0	5	8-probe
K 11,3	5	0	0	5	8-probe
K 11,5	6	0	0	6	8-probe
K 11,6	5	0	0	5	8-probe
K 11,7	5	0	0	5	8-probe
K 11,2	5	0	0	5	8-probe
K 11,1	6	0	0	6	8-probe
K 11,8	5	0	0	5	8-probe
K 11,9	4	0	0	4	8-probe
K 11,10	5	0	0	5	8-probe

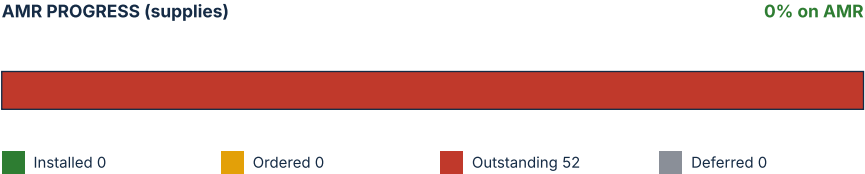

ZULULAMI ESTATE

MS 11 – LV RETICULATION & AMR STATUS

SGB-Smit Power Malta · 315 kVA (450A) · mfd 2019 · bulk meter 63237016 (on AMR)

— feed per sheet - - - - - inferred from layout Rows: status · stand · S/N · ph · Q/C/V · port

DRAWING No.	REVISION	
ZLM-SLD-11	A	
DATE	SCALE	
2026-10-09	NTS	
DRAWN	SHEET	
Ruan van Heerden, Electrical Engineer	10 of 13	

MS 13


315 kVA (450A)

Bulk 83013672

Bulk on AMR

Direct from LV board:

Streetlights · 60A · 47369881

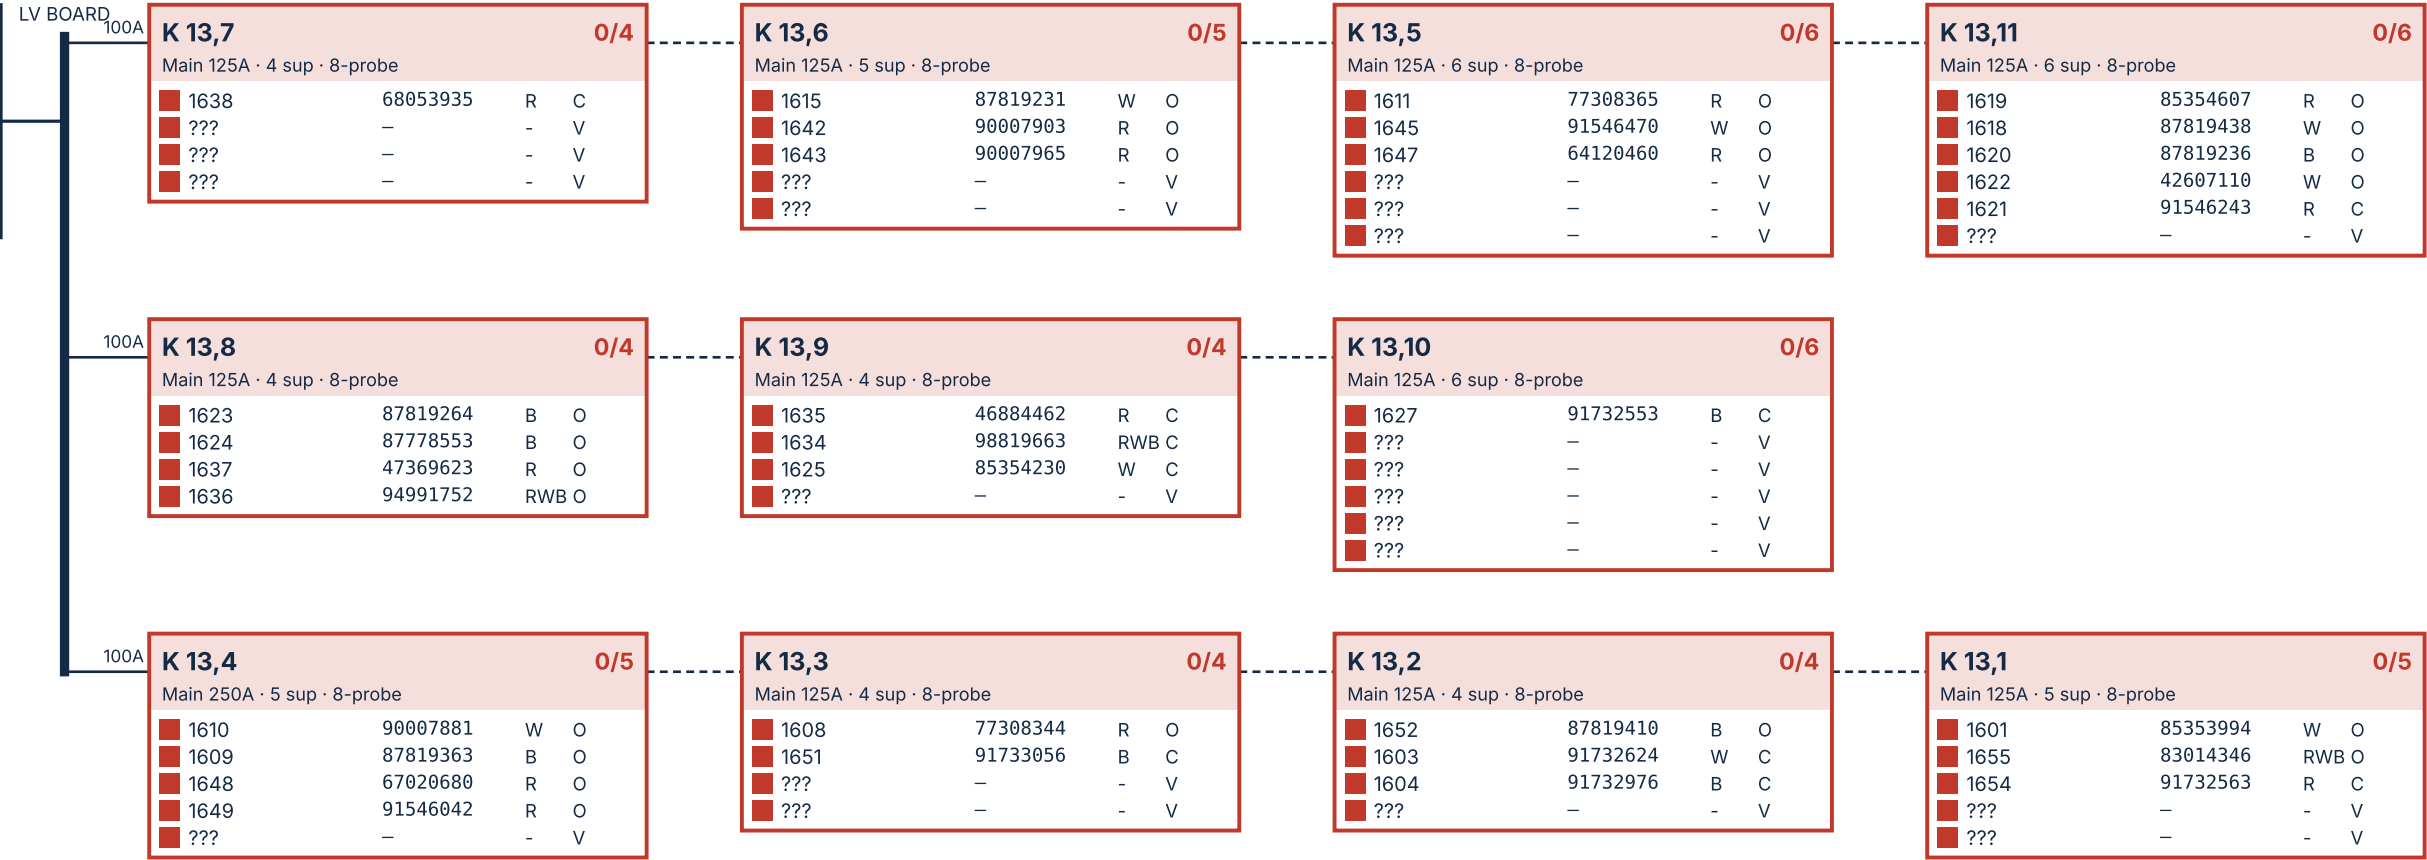

MS 14

315 kVA (450A)

Bulk 83013703

Bulk on AMR

Direct from LV board:

Streetlights · 63A · 42866655

