


AMR PROGRESS PER MINISUB

| MINISUB | RATING          | BULK ON AMR | KIOSKS | SUPPLIES | INSTALLED | ORDERED | OUTSTANDING | DEFERRED | % ON AMR |             |
|---------|-----------------|-------------|--------|----------|-----------|---------|-------------|----------|----------|-------------|
| MS 01   | 500 kVA (800A)  | Yes         | 12     | 54       | 0         | 0       | 54          | 0        | 0%       | <div></div> |
| MS 02   | 500 kVA (800A)  | Yes         | 15     | 64       | 24        | 0       | 40          | 0        | 38%      | <div></div> |
| MS 03   | 315 kVA (450A)  | Yes         | 18     | 106      | 0         | 0       | 106         | 0        | 0%       | <div></div> |
| MS 04   | 500 kVA (700A)  | No          | 17     | 103      | 0         | 0       | 103         | 0        | 0%       | <div></div> |
| MS 05   | 800 kVA (1200A) | No          | 22     | 119      | 0         | 0       | 119         | 0        | 0%       | <div></div> |
| MS 06   | 315 kVA (450A)  | Yes         | 12     | 70       | 23        | 46      | 0           | 1        | 33%      | <div></div> |
| MS 07   | 315 kVA (500A)  | Yes         | 8      | 50       | 8         | 41      | 0           | 1        | 16%      | <div></div> |
| MS 08   | 315 kVA (450A)  | Yes         | 4      | 18       | 0         | 0       | 18          | 0        | 0%       | <div></div> |
| MS 09   | 315 kVA (450A)  | Yes         | 9      | 42       | 0         | 0       | 42          | 0        | 0%       | <div></div> |
| MS 10   | 315 kVA (450A)  | Yes         | 10     | 50       | 0         | 0       | 50          | 0        | 0%       | <div></div> |
| MS 11   | 315 kVA (450A)  | Yes         | 10     | 52       | 0         | 0       | 52          | 0        | 0%       | <div></div> |
| MS 12   | 315 kVA (450A)  | Yes         | 12     | 49       | 0         | 0       | 49          | 0        | 0%       | <div></div> |
| MS 13   | 315 kVA (450A)  | Yes         | 11     | 54       | 0         | 0       | 54          | 0        | 0%       | <div></div> |
| MS 14   | 315 kVA (450A)  | Yes         | 11     | 53       | 0         | 0       | 53          | 0        | 0%       | <div></div> |
| TOTAL   |                 |             |        | 884      | 55        | 87      | 740         | 2        | 6%       |             |

KEY PLAN (from KMZ) – square colour: green = AMR started/complete, amber = in current order, red = not started

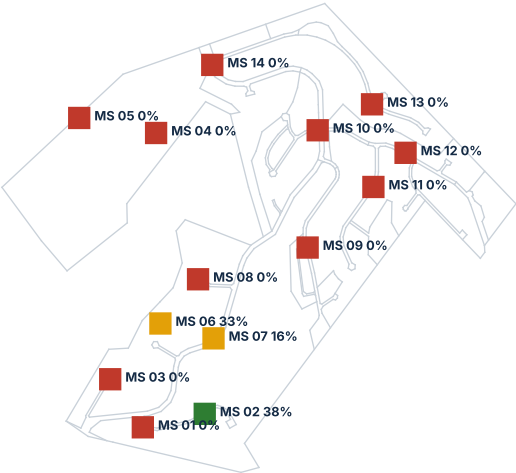

Notes: 1) Supply = one metered connection (1 probe). 511 Husk (MS 02) added from the AMR export – not in the reticulation sheet. 2) Kiosk feeds not stated in the sheet are inferred from the sheet layout (dashed) – verify against as-built SLDs.

3) Status colours: green = on AMR, amber = in Order 1, red = outstanding, grey = deferred (streetlight on MS 06/07 board).

VOLTANO  
METERING

AMR PROGRESS (supplies)

6% on AMR



Installed 55    Ordered 87    Outstanding 740    Deferred 2

ZULULAMI ESTATE

SITE OVERVIEW – AMR PROGRESS PER MINISUB

Supplies per minisub from the master hierarchy workbook. Order 1 = MS 07 + MS 06.

— feed per sheet    - - - - - inferred from layout    Rows: status · stand · S/N · ph · Q/C/V · port

|                                                       |                      |                         |
|-------------------------------------------------------|----------------------|-------------------------|
| DRAWING No.<br><b>ZLM-SLD-00</b>                      | REVISION<br><b>A</b> |                         |
| DATE<br><b>2026-10-06</b>                             | SCALE<br><b>NTS</b>  |                         |
| DRAWN<br><b>Ruan van Heerden, Electrical Engineer</b> |                      | SHEET<br><b>1 of 15</b> |

MS 01

500 kVA (800A)

Bulk 63237040

Bulk on AMR

- Direct from LV board:
- Main Gatehouse · 60A · Double Connection · -
  - Contractors Gate · 60A · Double Connection · -
  - Streetlights · 60A · 82816209

250A

505 Aura K01

0/4

Main 200A · 4 sup · 8-probe

|        |          |   |   |
|--------|----------|---|---|
| 505-01 | 84039740 | B | O |
| 505-02 | 75091206 | R | O |
| 505-03 | 84039751 | R | O |
| 505-04 | 84039746 | W | O |

250A

505 Aura K02

0/4

Main 250A · 4 sup · 8-probe

|        |          |   |   |
|--------|----------|---|---|
| 505-05 | 75091343 | B | O |
| 505-06 | 75091296 | W | O |
| 505-07 | 84039707 | R | O |
| 505-08 | 62742631 | W | O |

250A

505 Aura K03

0/4

Main 250A · 4 sup · 8-probe

|        |          |   |   |
|--------|----------|---|---|
| 505-09 | 47369314 | B | O |
| 505-10 | 47369294 | B | O |
| 505-11 | 75091021 | R | O |
| 505-12 | 75091242 | W | O |

250A

505 Aura K08

0/6

Main 250A · 6 sup · 8-probe

|        |          |   |   |
|--------|----------|---|---|
| 505-F1 | 85354288 | B | O |
| 505-F2 | 85354624 | R | O |
| 505-F3 | 85354356 | W | O |
| 505-F4 | 85354293 | W | O |
| 505-F5 | 85354298 | R | O |
| 505-45 | 85354586 | W | O |

250A

505 Aura K09

0/4

Main 160A · 4 sup · 8-probe

|        |          |   |   |
|--------|----------|---|---|
| 505-29 | 84340966 | B | O |
| 505-30 | 84341038 | R | O |
| 505-31 | 84341019 | B | O |
| 505-32 | 84340990 | W | O |

505 Aura K10

0/4

Main 100A · 4 sup · 8-probe

|        |          |   |   |
|--------|----------|---|---|
| 505-33 | 84340995 | R | O |
| 505-34 | 84340900 | W | O |
| 505-35 | 84340901 | B | O |
| 505-36 | 84340949 | R | O |

505 Aura K11

0/4

Main 125A · 4 sup · 8-probe

|        |          |   |   |
|--------|----------|---|---|
| 505-37 | 84340973 | R | O |
| 505-38 | 84340996 | W | O |
| 505-39 | 84340929 | B | O |
| 505-40 | 84340924 | W | O |

505 Aura K12

0/4

Main 125A · 4 sup · 8-probe

|        |          |   |   |
|--------|----------|---|---|
| 505-41 | 84340927 | R | O |
| 505-42 | 84340905 | W | O |
| 505-43 | 84340972 | B | O |
| 505-44 | 84340948 | B | O |

200A

505 Aura K04

0/5

Main 100A · 5 sup · 8-probe

|           |          |   |   |
|-----------|----------|---|---|
| 505-13    | 75091218 | B | O |
| 505-14    | 75091285 | R | O |
| 505-15    | 75091205 | R | O |
| 505-16    | 75091069 | W | O |
| Clubhouse | 71205156 | R | O |

505 Aura K05

0/4

Main 100A · 4 sup · 8-probe

|        |          |   |   |
|--------|----------|---|---|
| 505-17 | 75091200 | B | O |
| 505-18 | 75091254 | W | O |
| 505-19 | 75091309 | R | O |
| 505-20 | 75091345 | W | O |

505 Aura K06

0/4

Main 125A · 4 sup · 8-probe

|        |          |   |   |
|--------|----------|---|---|
| 505-21 | 75091291 | B | O |
| 505-22 | 75091253 | W | O |
| 505-23 | 75091283 | B | O |
| 505-24 | 75091272 | R | O |

505 Aura K07

0/4

Main 125A · 4 sup · 8-probe

|        |          |   |   |
|--------|----------|---|---|
| 505-25 | 75091217 | B | O |
| 505-26 | 75091229 | R | O |
| 505-27 | 75091189 | R | O |
| 505-28 | 75091277 | W | O |

KIOSK AMR SCHEDULE

| KIOSK        | SUP | ON AMR | ORD | OUT | UNIT    |
|--------------|-----|--------|-----|-----|---------|
| MS LV board  | 3   | 0      | 0   | 3   | 8-probe |
| 505 Aura K08 | 6   | 0      | 0   | 6   | 8-probe |
| 505 Aura K09 | 4   | 0      | 0   | 4   | 8-probe |
| 505 Aura K10 | 4   | 0      | 0   | 4   | 8-probe |
| 505 Aura K11 | 4   | 0      | 0   | 4   | 8-probe |
| 505 Aura K12 | 4   | 0      | 0   | 4   | 8-probe |
| 505 Aura K01 | 4   | 0      | 0   | 4   | 8-probe |
| 505 Aura K02 | 4   | 0      | 0   | 4   | 8-probe |
| 505 Aura K03 | 4   | 0      | 0   | 4   | 8-probe |
| 505 Aura K04 | 5   | 0      | 0   | 5   | 8-probe |
| 505 Aura K05 | 4   | 0      | 0   | 4   | 8-probe |
| 505 Aura K06 | 4   | 0      | 0   | 4   | 8-probe |
| 505 Aura K07 | 4   | 0      | 0   | 4   | 8-probe |

AMR PROGRESS (supplies)

0% on AMR



Installed 0Ordered 0Outstanding 54Deferred 0

ZULULAMI ESTATE

MS 01 – LV RETICULATION & AMR STATUS

PowerTech · 500 kVA (800A) · mfd 10/2017 · bulk meter 63237040 (on AMR)

feed per sheetinferred from layoutRows: status · stand · S/N · ph · Q/C/V · port

|                                       |          |  |
|---------------------------------------|----------|--|
| DRAWING No.                           | REVISION |  |
| ZLM-SLD-01                            | A        |  |
| DATE                                  | SCALE    |  |
| 2026-10-06                            | NTS      |  |
| DRAWN                                 | SHEET    |  |
| Ruan van Heerden, Electrical Engineer | 2 of 15  |  |







VOLTANO

METERING

AMR PROGRESS (supplies)

0% on AMR

Installed 0

Ordered 0

Outstanding 103

Deferred 0

ZULULAMI ESTATE

MS 04 – LV RETICULATION & AMR STATUS

Electronic Assemblies (PTY) Ltd. · 500 kVA (700A) · mfd ??? · bulk meter 90915109 (not on AMR)

— feed per sheet

----- inferred from layout

Rows: status · stand · S/N · ph · Q/C/V · port

DRAWING No.

ZLM-SLD-04

DATE

2026-10-06

DRAWN

Ruan van Heerden, Electrical Engineer

REVISION

A

SCALE

NTS

SHEET

5 of 15

KIOSK AMR SCHEDULE

| KIOSK  | SUP | ON AMR | ORD | OUT | UNIT       |
|--------|-----|--------|-----|-----|------------|
| K 1,1  | 5   | 0      | 0   | 5   | 8-probe    |
| K 1,2  | 6   | 0      | 0   | 6   | 8-probe    |
| K 1,3  | 6   | 0      | 0   | 6   | 8-probe    |
| K 1,8  | 4   | 0      | 0   | 4   | 8-probe    |
| K 1,9  | 5   | 0      | 0   | 5   | 8-probe    |
| K G/H  | 1   | 0      | 0   | 1   | Standalone |
| K 1,4  | 8   | 0      | 0   | 8   | 8-probe    |
| K 1,6  | 9   | 0      | 0   | 9   | 16-probe   |
| K 1,7  | 6   | 0      | 0   | 6   | 8-probe    |
| K 1,10 | 7   | 0      | 0   | 7   | 8-probe    |
| K 1,11 | 9   | 0      | 0   | 9   | 16-probe   |
| K 1,15 | 5   | 0      | 0   | 5   | 8-probe    |
| K 1,16 | 6   | 0      | 0   | 6   | 8-probe    |
| K 1,17 | 6   | 0      | 0   | 6   | 8-probe    |
| K 1,12 | 4   | 0      | 0   | 4   | 8-probe    |
| K 1,13 | 9   | 0      | 0   | 9   | 16-probe   |
| K 1,14 | 7   | 0      | 0   | 7   | 8-probe    |

MS 05

800 kVA (1200A)

Bulk 91074243

Bulk NOT on AMR

Direct from LV board:

■ Streetlights 2,1 · 60A · –

LV BOARD

200A

K 2,5

0/9

Main 250A · 9 sup · 16-probe

|                |   |     |   |
|----------------|---|-----|---|
| ■ 1            | – | –   | C |
| ■ 8            | – | –   | C |
| ■ 35           | – | –   | C |
| ■ 36           | – | –   | C |
| ■ 37           | – | –   | C |
| ■ Streetlights | – | RWB | O |
| ■ Unit (??)    | – | –   | O |
| ■ Unit (??)    | – | –   | O |
| ■ Plant Room   | – | RWB | O |

K 2,6

0/7

Main 120A · 7 sup · 8-probe

|      |   |   |   |
|------|---|---|---|
| ■ 9  | – | – | C |
| ■ 10 | – | – | C |
| ■ 11 | – | – | C |
| ■ 12 | – | – | C |
| ■ 31 | – | – | C |
| ■ 33 | – | – | C |
| ■ 34 | – | – | C |

K 2,7

0/9

Main 100A · 9 sup · 16-probe

|       |   |   |   |
|-------|---|---|---|
| ■ 15  | – | – | C |
| ■ 16  | – | – | C |
| ■ 17  | – | – | C |
| ■ 32  | – | – | C |
| ■ 32B | – | – | C |
| ■ 27  | – | – | C |
| ■ 28  | – | – | C |
| ■ 29  | – | – | C |
| ■ 30  | – | – | C |

K 2,8

0/9

Main 60A · 9 sup · 16-probe

|      |   |   |   |
|------|---|---|---|
| ■ 18 | – | – | C |
| ■ 19 | – | – | C |
| ■ 20 | – | – | C |
| ■ 21 | – | – | C |
| ■ 22 | – | – | C |
| ■ 23 | – | – | C |
| ■ 24 | – | – | C |
| ■ 25 | – | – | C |
| ■ 26 | – | – | C |

250A

K 2,9

0/6

Main 250A · 6 sup · 8-probe

|      |          |    |   |
|------|----------|----|---|
| ■ 38 | 91732547 | ?? | O |
| ■ 39 | –        | –  | C |
| ■ 40 | –        | –  | C |
| ■ 88 | 91732521 | ?? | O |
| ■ 89 | 91732584 | ?? | O |
| ■ 90 | 91732583 | –  | O |

K 2,14

0/3

Main 250A · 3 sup · 8-probe

|      |          |    |   |
|------|----------|----|---|
| ■ 91 | 91732665 | ?? | O |
| ■ 92 | 91732605 | ?? | O |
| ■ 93 | 91732666 | ?? | O |

K 2,15

0/5

Main 250A · 5 sup · 8-probe

|      |          |    |   |
|------|----------|----|---|
| ■ 94 | 91732613 | ?? | O |
| ■ 95 | 91732603 | ?? | O |
| ■ 96 | 91732641 | ?? | O |
| ■ 97 | 91732640 | ?? | O |
| ■ 98 | 91732615 | ?? | O |

K 2,16

0/4

Main 250A · 4 sup · 8-probe

|       |          |    |   |
|-------|----------|----|---|
| ■ 99  | 91732612 | ?? | O |
| ■ 100 | 91732638 | ?? | O |
| ■ 101 | 91732610 | ?? | O |
| ■ 102 | 91732607 | ?? | O |

60A

K 2,19

0/4

Main 60A · 4 sup · 8-probe

|       |          |    |   |
|-------|----------|----|---|
| ■ 107 | 91732647 | ?? | O |
| ■ 108 | 91732651 | ?? | O |
| ■ 109 | 91732561 | ?? | O |
| ■ 110 | 91732611 | ?? | O |

100A

K 2,17

0/5

Main 125A · 5 sup · 8-probe

|      |          |    |   |
|------|----------|----|---|
| ■ 73 | 91732539 | ?? | O |
| ■ 74 | 91732543 | ?? | O |
| ■ 76 | –        | –  | C |
| ■ 77 | –        | –  | C |
| ■ 86 | –        | –  | C |

60A

K 2,18

0/8

Main 60A · 8 sup · 8-probe

|       |   |   |   |
|-------|---|---|---|
| ■ 53B | – | – | C |
| ■ 78  | – | – | C |
| ■ 79  | – | – | C |
| ■ 81  | – | – | C |
| ■ 82  | – | – | C |
| ■ 83  | – | – | C |
| ■ 84  | – | – | C |
| ■ 85  | – | – | C |

60A

K 2,20

0/5

Main 60A · 5 sup · 8-probe

|       |          |   |   |
|-------|----------|---|---|
| ■ 75  | 91732508 | – | O |
| ■ 103 | 91733009 | – | O |
| ■ 104 | 91732500 | – | O |
| ■ 105 | 91732601 | – | O |
| ■ 106 | 91732544 | – | O |

200A

K 2,10

0/7

Main 250A · 7 sup · 8-probe

|       |          |    |   |
|-------|----------|----|---|
| ■ 41  | –        | –  | C |
| ■ 42  | –        | –  | C |
| ■ 43  | –        | –  | C |
| ■ 44A | –        | –  | C |
| ■ 64  | 91732512 | ?? | O |
| ■ 65  | 91732567 | ?? | O |
| ■ 66  | 91732585 | ?? | O |

K 2,11A

0/7

Main 60A · 7 sup · 8-probe

|                |          |     |   |
|----------------|----------|-----|---|
| ■ 67           | 91732548 | ??  | O |
| ■ 68           | 91732556 | ??  | O |
| ■ 69           | 91732572 | ??  | O |
| ■ 70           | 91732568 | ??  | O |
| ■ 71           | 91732626 | ??  | O |
| ■ 72           | 91732622 | ??  | O |
| ■ Streetlights | –        | RWB | O |

K 2,11

0/3

Main 125A · 3 sup · 8-probe

|                |   |     |   |
|----------------|---|-----|---|
| ■ 44B          | – | –   | C |
| ■ 45           | – | –   | C |
| ■ Streetlights | – | RWB | ? |

K 2,12

0/6

Main 125A · 6 sup · 8-probe

|      |   |   |   |
|------|---|---|---|
| ■ 48 | – | – | C |
| ■ 49 | – | – | C |
| ■ 50 | – | – | C |
| ■ 57 | – | – | C |
| ■ 58 | – | – | C |
| ■ 59 | – | – | C |

K 2,13

0/7

Main 60A · 7 sup · 8-probe

|      |   |   |   |
|------|---|---|---|
| ■ 51 | – | – | C |
| ■ 52 | – | – | C |
| ■ 53 | – | – | C |
| ■ 54 | – | – | C |
| ■ 55 | – | – | C |
| ■ 56 | – | – | C |
| ■ 80 | – | – | C |

FEED NOT CONFIRMED IN SHEET – placement only

K 2,3 – Block B

0/2

Main 200A · 2 sup · 8-probe

|              |   |     |   |
|--------------|---|-----|---|
| ■ DB-B-01    | – | 70m | ? |
| ■ Plant Room | – | 25m | ? |

K 2,4 – Block A

0/1

Main ??A · 1 sup · Standalone

|           |   |     |   |
|-----------|---|-----|---|
| ■ DB-A-01 | – | Cab | ? |
|-----------|---|-----|---|

K 2,21

0/3

Main 800A · 3 sup · 8-probe

|                |          |     |   |
|----------------|----------|-----|---|
| ■ Care Centre  | 93005964 | RWB | O |
| ■ Utilities    | 94991686 | RWB | O |
| ■ Streetlights | –        | RWB | O |

K 2,1

0/4

Main 350A · 4 sup · 8-probe

|              |          |     |   |
|--------------|----------|-----|---|
| ■ Pavillion  | 91073894 | RWB | O |
| ■ Borehole   | –        | RWB | O |
| ■ HW         | –        | RWB | O |
| ■ Plant Room | –        | RWB | O |

K 2,2

0/4

Main 500A · 4 sup · 8-probe

|                |          |     |   |
|----------------|----------|-----|---|
| ■ Wellness Cen | 67021439 | RWB | O |
| ■ Streetlights | –        | RWB | O |
| ■ Care Centre  | –        | RWB | O |
| ■ Plant Room   | –        | RWB | O |

# VOLTANO

## METERING

AMR PROGRESS (supplies)

0% on AMR



■ Installed 0    ■ Ordered 0    ■ Outstanding 119    ■ Deferred 0

ZULULAMI ESTATE

## MS 05 – LV RETICULATION & AMR STATUS

Electronic Assemblies (PTY) Ltd. · 800 kVA (1200A) · mfd 2024 · bulk meter 91074243 (not on AMR)

— feed per sheet

----- inferred from layout

Rows: status · stand · S/N · ph · Q/C/V · port

DRAWING No.

ZLM-SLD-05

DATE

2026-10-06

DRAWN

Ruan van Heerden, Electrical Engineer

REVISION

A

SCALE

NTS

SHEET

6 of 15

MS 06


315 kVA (450A)

Bulk 63237041

Bulk on AMR

Direct from LV board:

Streetlights · 32A · 47369899

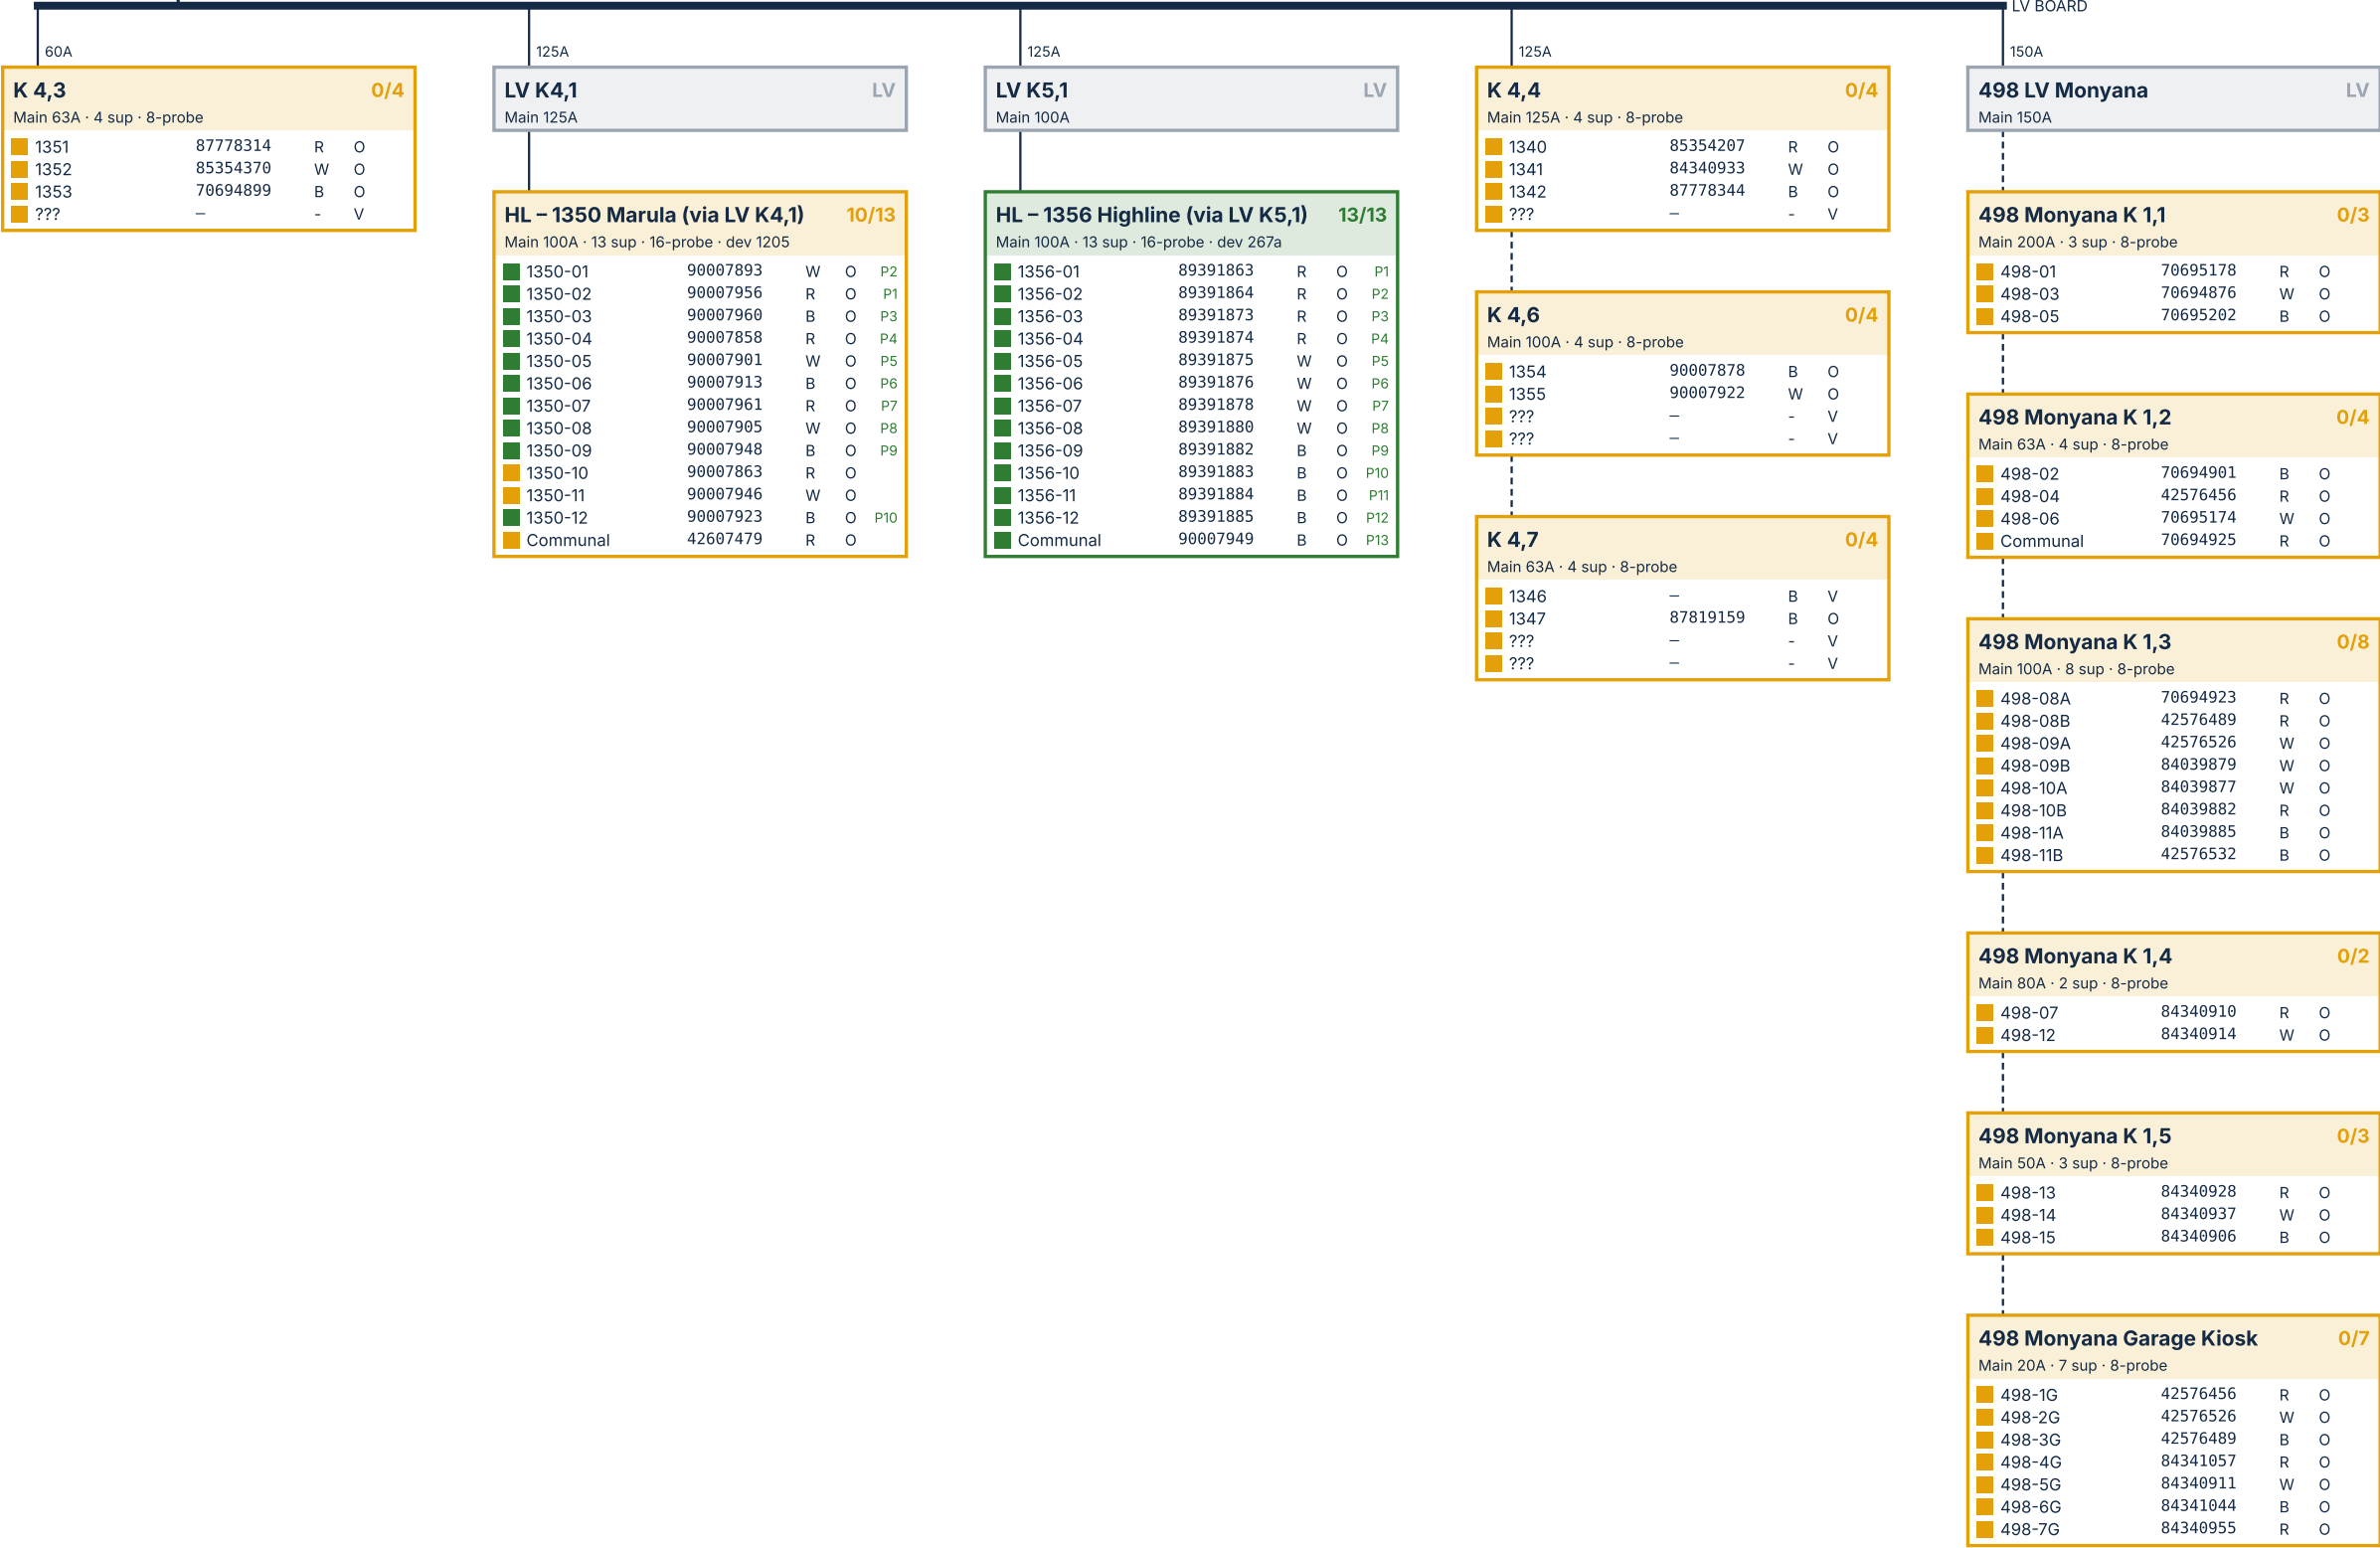

MS 07

315 kVA (500A)

Bulk 83014676

Bulk on AMR

Direct from LV board:

Streetlights · 63A · 82929432

LV BOARD

200A

Ptn 501 N/S LV Kiosk

LV

Main 200A

160A

K 1,1

0/5

Main 100A · 5 sup · 8-probe

|            |          |   |   |
|------------|----------|---|---|
| Ptn 501/01 | 84340908 | R | O |
| Ptn 501/02 | 84340913 | W | O |
| Ptn 501/03 | 84340904 | B | O |
| Ptn 501/04 | 84340686 | R | O |
| Ptn 501/05 | 84340952 | W | O |

K 1,2

0/5

Main 100A · 5 sup · 8-probe

|            |          |   |   |
|------------|----------|---|---|
| Ptn 501/06 | —        | W | C |
| Ptn 501/07 | 84340593 | R | O |
| Ptn 501/08 | 84340708 | W | O |
| Ptn 501/09 | 47369117 | B | O |
| Ptn 501/10 | 46886469 | R | O |

160A

K 2,1

0/5

Main 100A · 5 sup · 8-probe

|            |          |   |   |
|------------|----------|---|---|
| Ptn 501/11 | 91546482 | R | O |
| Ptn 501/12 | 89392169 | R | O |
| Ptn 501/13 | 87778358 | B | O |
| Ptn 501/14 | 87778380 | R | O |
| Ptn 501/15 | 87778386 | B | O |

K 2,2

0/5

Main 100A · 5 sup · 8-probe

|            |          |   |   |
|------------|----------|---|---|
| Ptn 501/16 | 85353960 | R | O |
| Ptn 501/17 | 85354417 | R | O |
| Ptn 501/18 | 85354403 | R | O |
| Ptn 501/19 | 84039931 | B | O |
| Ptn 501/20 | 85354390 | W | O |

300A

Rem 501 V/V K1

0/10

Main 400A · 10 sup · 16-probe

|            |          |   |   |
|------------|----------|---|---|
| REM 501/01 | 89391891 | W | O |
| REM 501/02 | 89392157 | B | O |
| REM 501/03 | 89392110 | B | O |
| REM 501/04 | 89392103 | B | O |
| REM 501/05 | 89392105 | R | O |
| REM 501/06 | 89392101 | W | O |
| REM 501/07 | 89392149 | B | O |
| REM 501/08 | 89392113 | W | O |
| REM 501/09 | 89392106 | R | O |
| REM 501/10 | 89392117 | R | O |

Rem 501 V/V K2

0/8

Main 250A · 8 sup · 8-probe

|            |          |   |   |
|------------|----------|---|---|
| REM 501/11 | 89392104 | W | O |
| REM 501/12 | 89392131 | R | O |
| REM 501/13 | 89392132 | W | O |
| REM 501/14 | 89392109 | B | O |
| REM 501/15 | 89392102 | W | O |
| REM 501/16 | 89392136 | B | O |
| REM 501/17 | 89392127 | R | O |
| REM 501/18 | 89392140 | R | O |

Rem 501 V/V K3

8/8

Main 160A · 8 sup · 8-probe · dev 45cf

|            |          |   |   |    |
|------------|----------|---|---|----|
| REM 501/19 | 89392139 | W | O | P2 |
| REM 501/20 | 90007952 | B | O | P3 |
| REM 501/21 | 90007857 | B | O | P8 |
| REM 501/22 | 89392173 | R | O | P1 |
| REM 501/23 | 89391877 | B | O | P6 |
| REM 501/24 | 89391866 | W | O | P5 |
| REM 501/25 | 89391865 | R | O | P7 |
| REM 501/26 | 89392135 | R | O | P4 |

200A

Club House / Restaurant

0/3

Main 150A · 3 sup · 8-probe

|             |               |   |   |
|-------------|---------------|---|---|
| Lounge DB   | L - CH - 001  | R | O |
| Basement DB | B - CH - 002  | W | O |
| Upstairs DB | US - CH - 003 | B | O |

KIOSK AMR SCHEDULE

| KIOSK                   | SUP | ON AMR | ORD | OUT | UNIT     |
|-------------------------|-----|--------|-----|-----|----------|
| MS LV board             | 1   | 0      | 0   | 1   | deferred |
| K 1,1                   | 5   | 0      | 5   | 0   | 8-probe  |
| K 1,2                   | 5   | 0      | 5   | 0   | 8-probe  |
| K 2,1                   | 5   | 0      | 5   | 0   | 8-probe  |
| K 2,2                   | 5   | 0      | 5   | 0   | 8-probe  |
| Rem 501 V/V K1          | 10  | 0      | 10  | 0   | 16-probe |
| Rem 501 V/V K2          | 8   | 0      | 8   | 0   | 8-probe  |
| Rem 501 V/V K3          | 8   | 8      | 0   | 0   | existing |
| Club House / Restaurant | 3   | 0      | 3   | 0   | 8-probe  |

VOLTANO

METERING

AMR PROGRESS (supplies)

16% on AMR



Installed 8    Ordered 41    Outstanding 0    Deferred 1

ZULULAMI ESTATE

MS 07 – LV RETICULATION & AMR STATUS

PowerTech · 315 kVA (500A) · mfd 06/2016 · bulk meter 83014676 (on AMR)

— feed per sheet    - - - - - inferred from layout    Rows: status · stand · S/N · ph · Q/C/V · port

|                                       |          |  |
|---------------------------------------|----------|--|
| DRAWING No.                           | REVISION |  |
| ZLM-SLD-07                            | A        |  |
| DATE                                  | SCALE    |  |
| 2026-10-06                            | NTS      |  |
| DRAWN                                 | SHEET    |  |
| Ruan van Heerden, Electrical Engineer | 8 of 15  |  |




MS 09

315 kVA (450A)

Bulk 82929637

Bulk on AMR

- Direct from LV board:
- Sewer Pump Station · 100A · 83014662
  - Pump Station · 100A · 47369892
  - Streetlights · 60A · 47369910

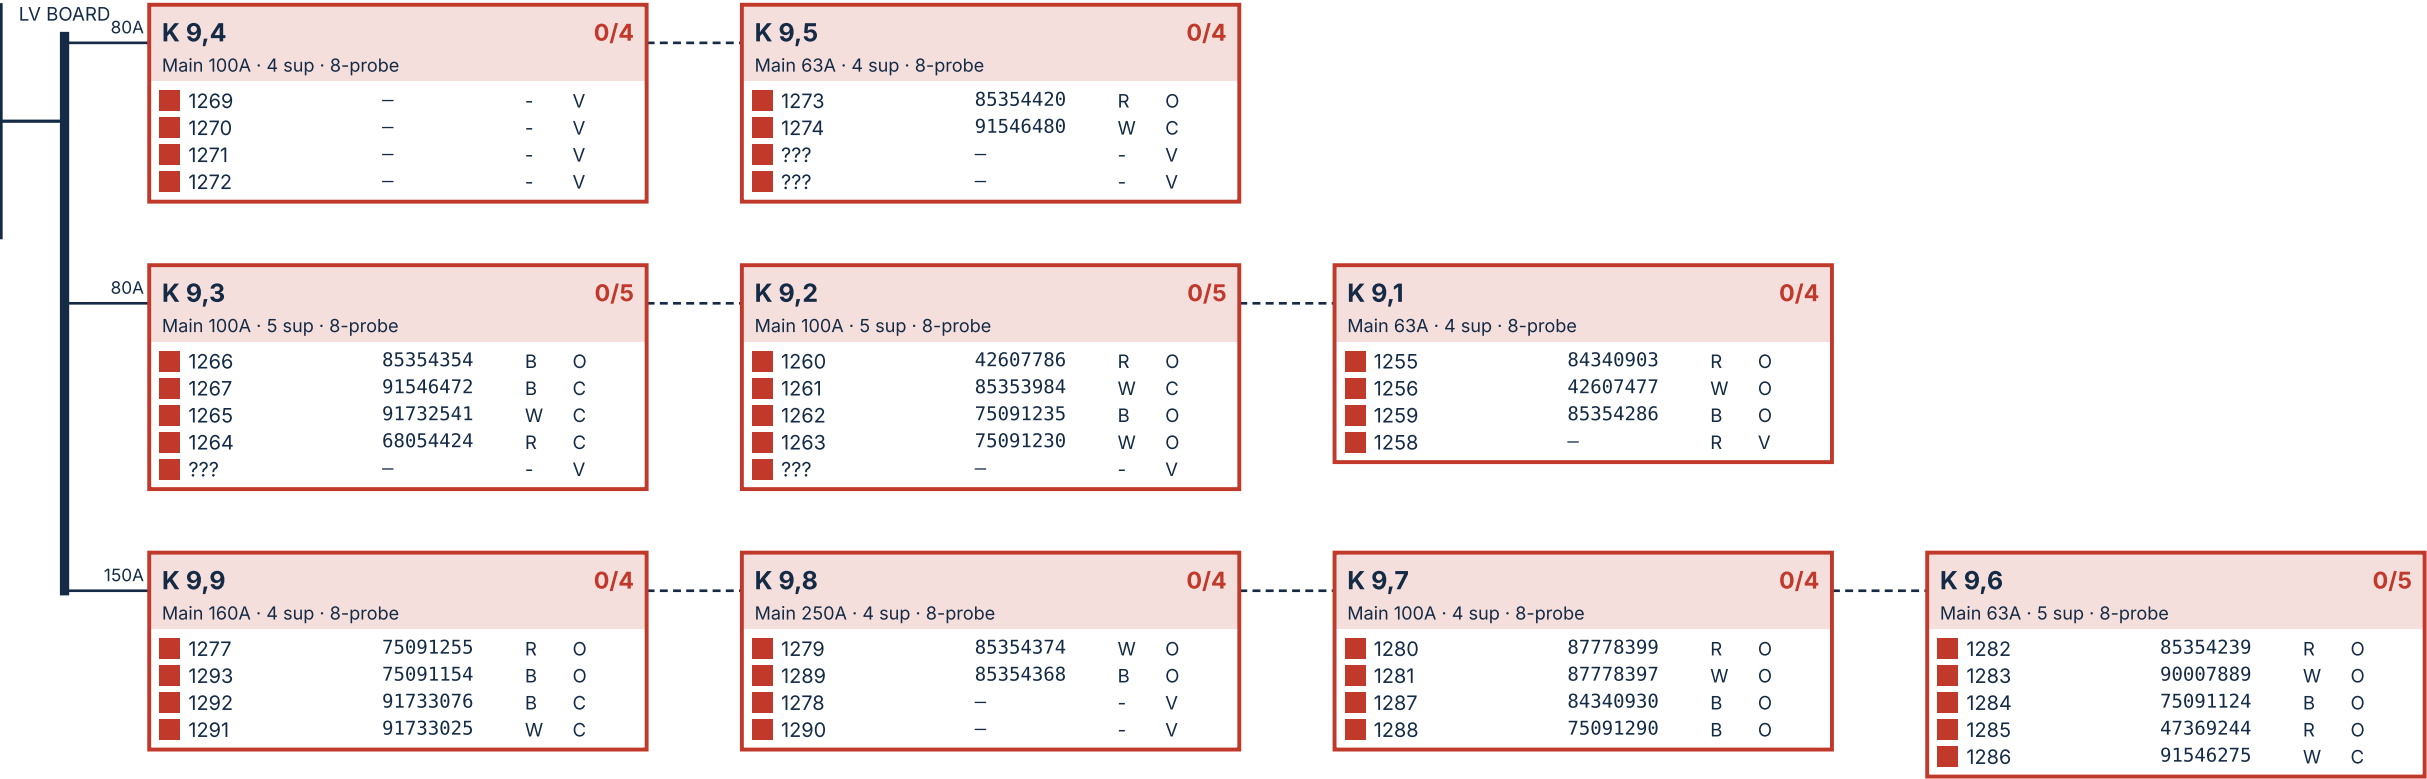


MS 10

315 kVA (450A)

Bulk 63237027

Bulk on AMR

- Direct from LV board:
- Sewer Pump Station · 200A · 83014678
  - Streetlights Kiosk · 63A · 42866560

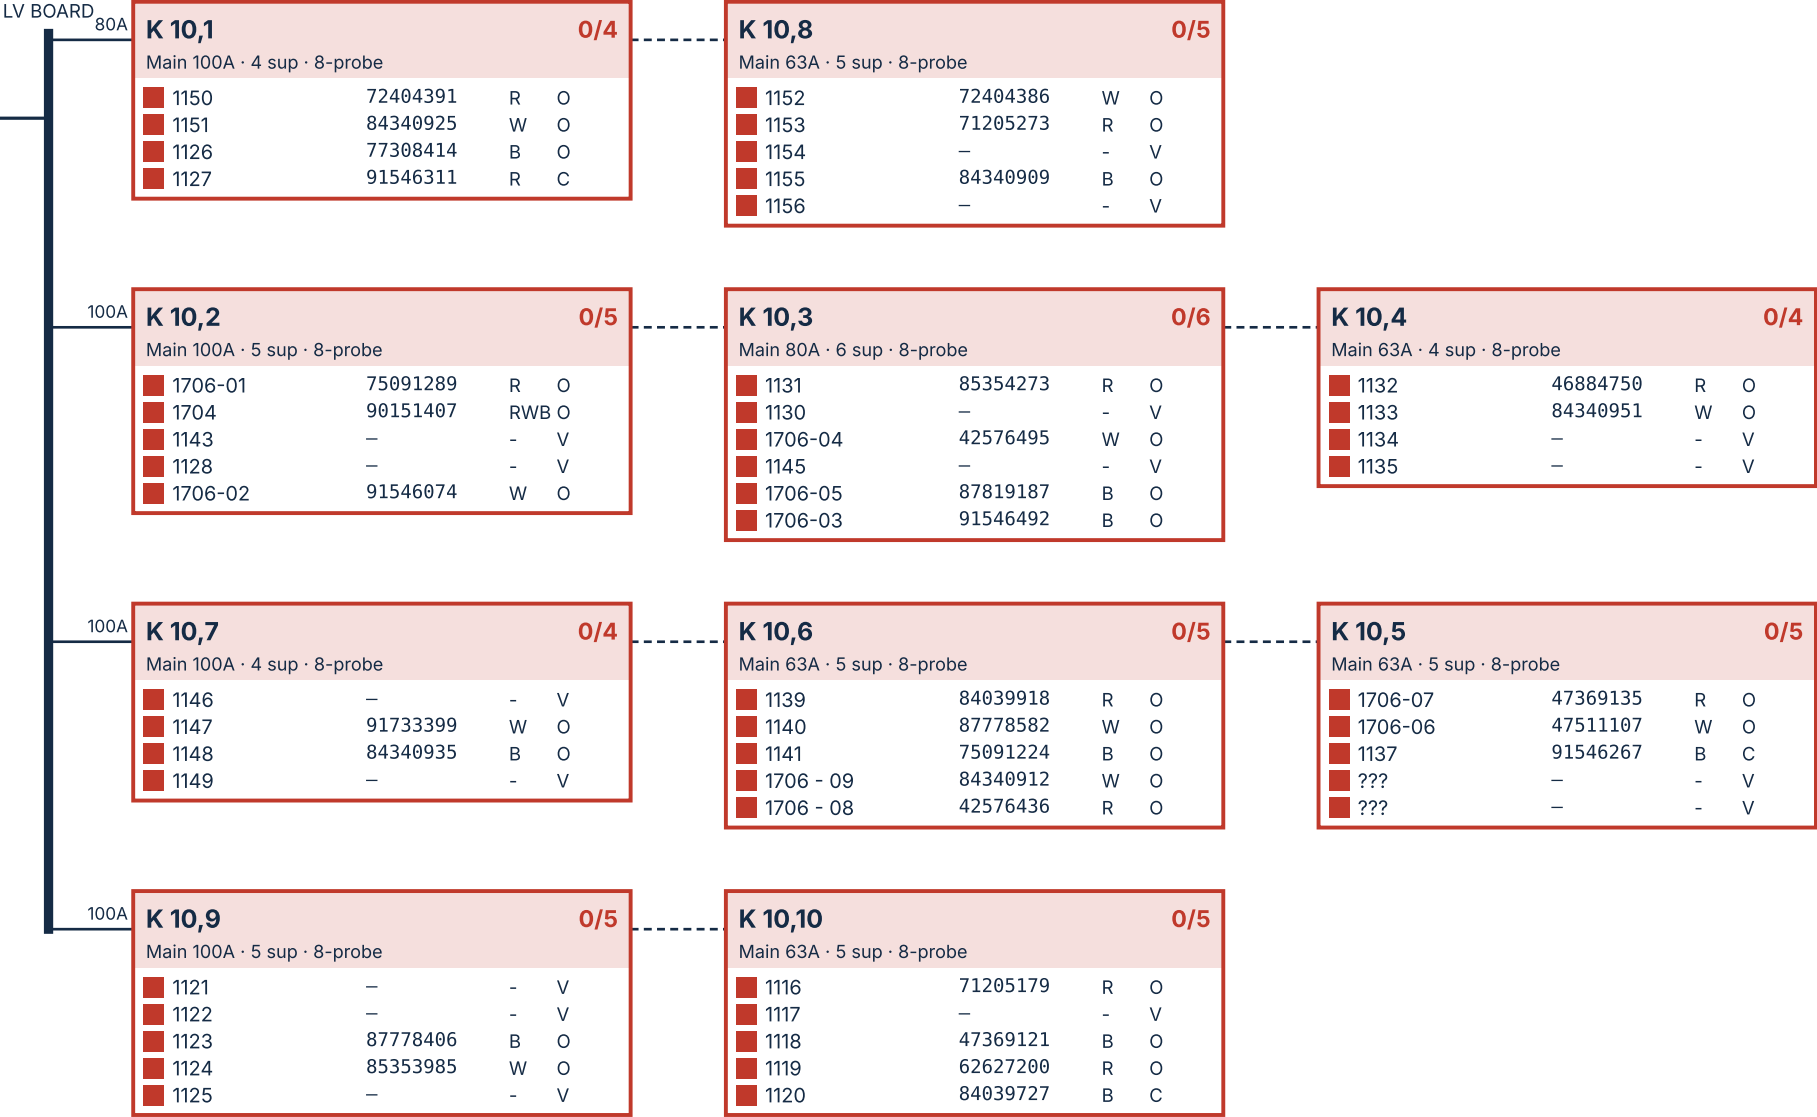

MS 11


315 kVA (450A)

Bulk 63237016

Bulk on AMR

Direct from LV board:

Streetlights Kiosk · 63A · 47369736

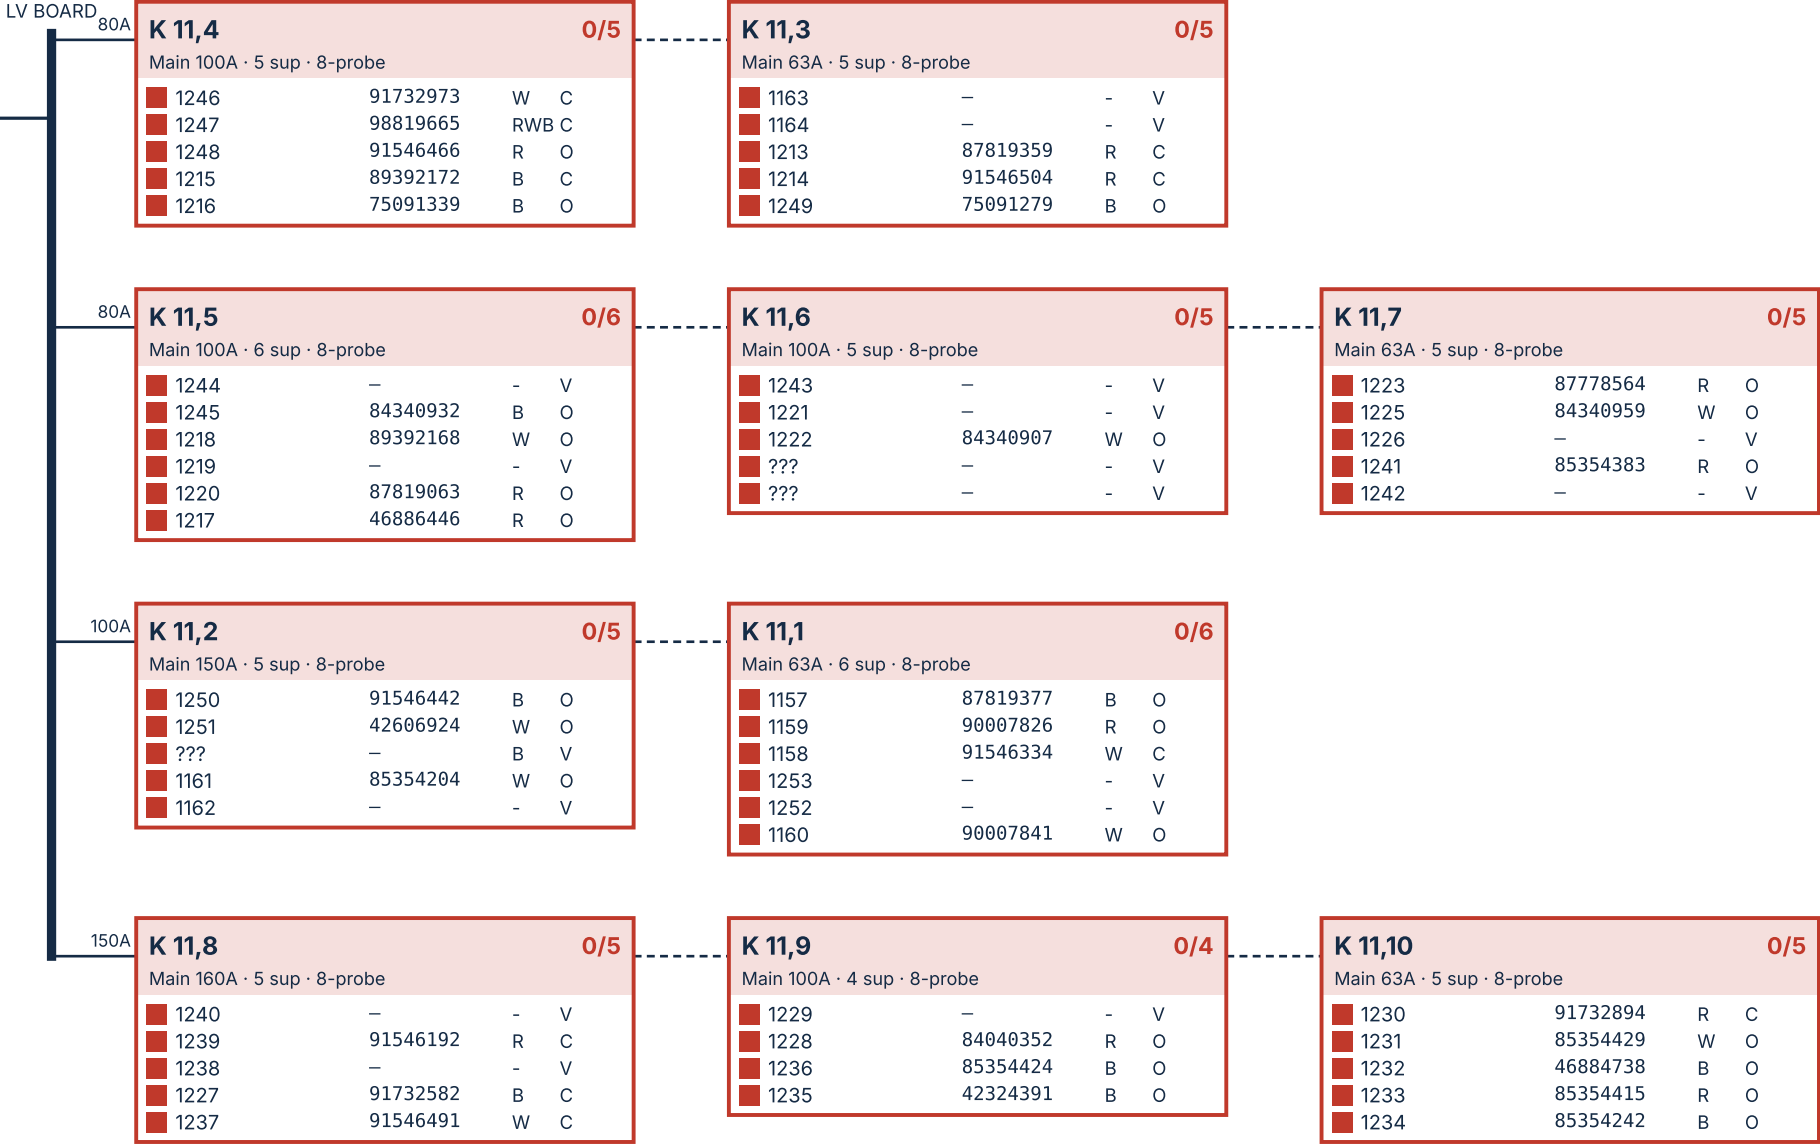



MS 13


315 kVA (450A)

Bulk 83013672

Bulk on AMR

Direct from LV board:

Streetlights · 60A · 47369881

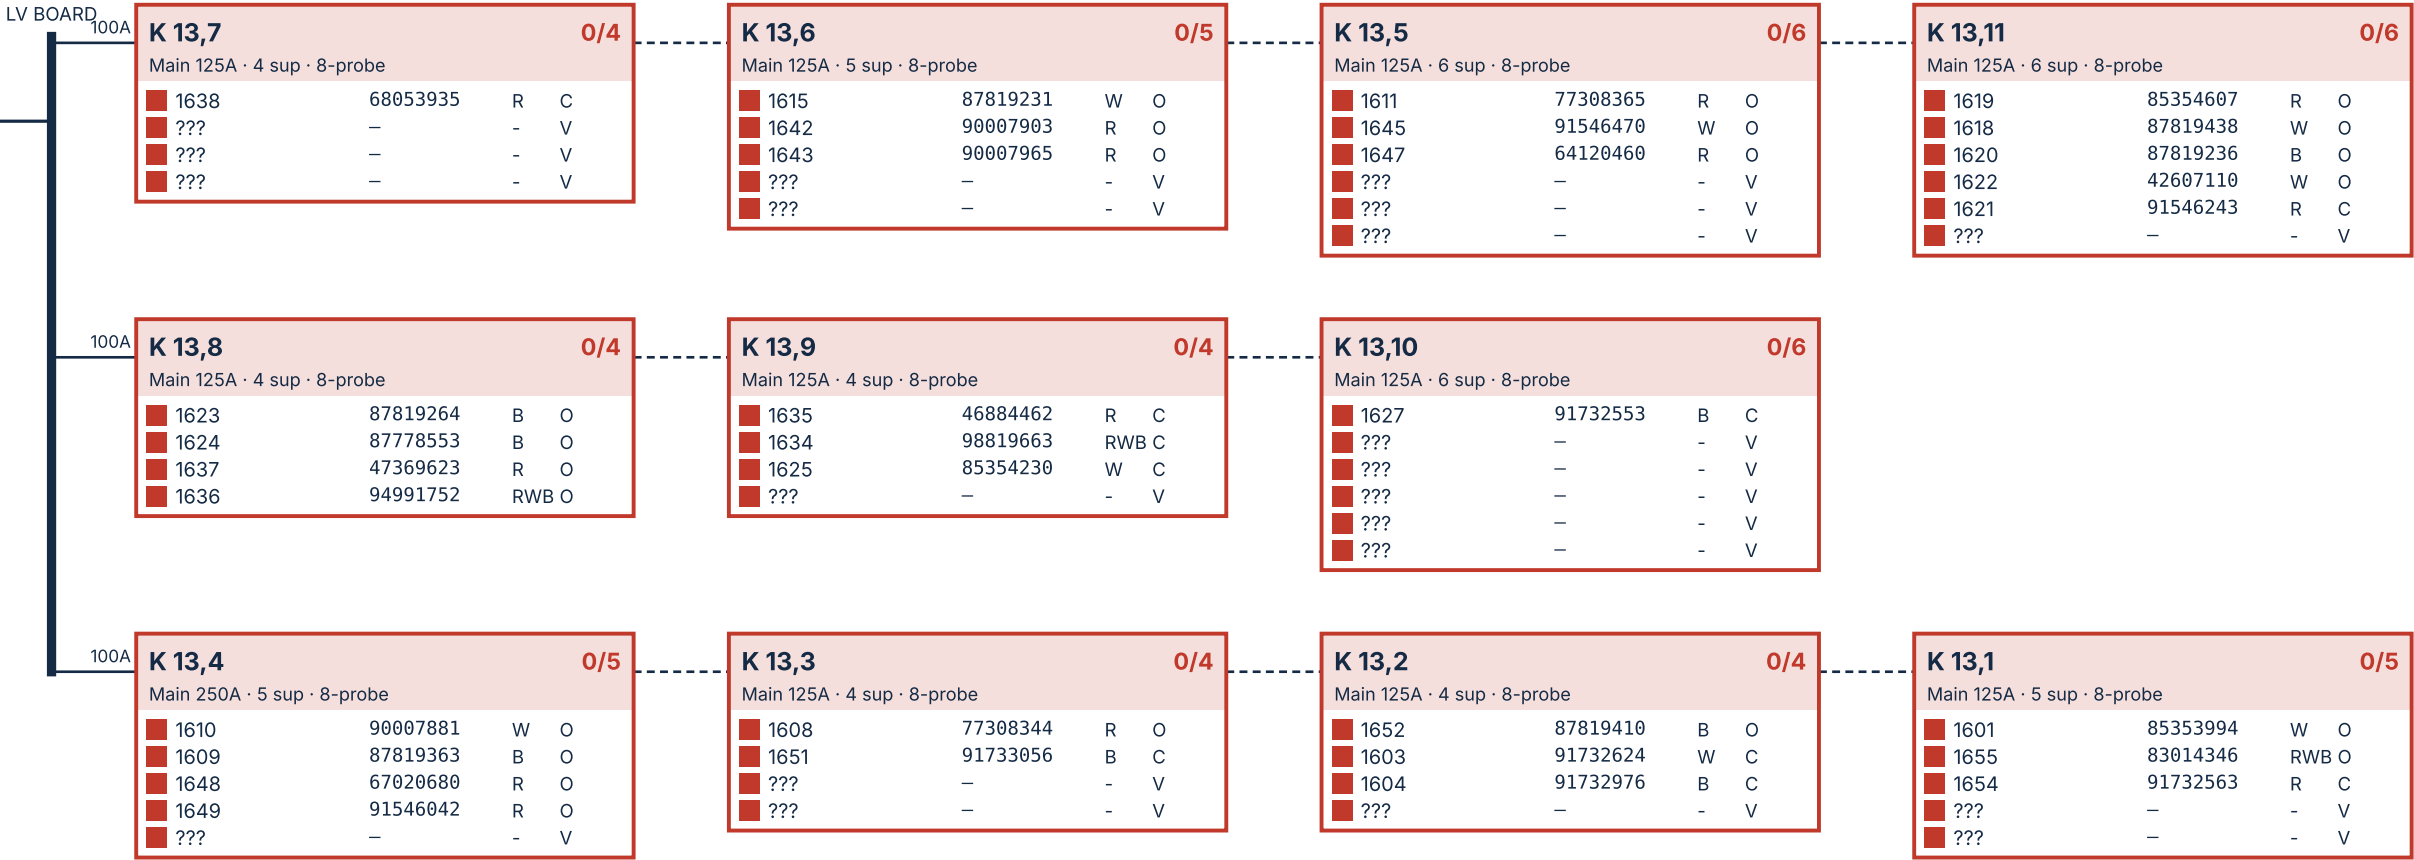

MS 14

315 kVA (450A)

Bulk 83013703

Bulk on AMR

Direct from LV board:

Streetlights · 63A · 42866655



| K 14,9                             |          |   |   | 0/6 |
|------------------------------------|----------|---|---|-----|
| Main 250A (? *4) · 6 sup · 8-probe |          |   |   |     |
| 1661                               | 85353973 | R | O |     |
| 1662                               | 90008041 | W | O |     |
| 1705_03                            | 46884021 | W | O |     |
| 1660                               | 91546248 | R | C |     |
| ???                                | —        | - | V |     |
| ???                                | —        | - | V |     |

| K 14,9 A                           |          |   |   | 0/5 |
|------------------------------------|----------|---|---|-----|
| Main 100A (? *4) · 5 sup · 8-probe |          |   |   |     |
| 1705-04                            | 67020973 | B | O |     |
| 1705-01                            | 91546309 | R | O |     |
| 1705-02                            | 91733103 | W | O |     |
| 1705-06                            | 91732997 | R | O |     |
| 1705-05                            | 91546211 | B | C |     |

| K 14,9 B                           |          |   |   | 0/4 |
|------------------------------------|----------|---|---|-----|
| Main 100A (? *4) · 4 sup · 8-probe |          |   |   |     |
| 1705 DEV                           | 91733069 | R | C |     |
| -                                  | —        | - | V |     |
| -                                  | —        | - | V |     |
| -                                  | —        | - | V |     |

| K 14,10                            |          |   |   | 0/5 |
|------------------------------------|----------|---|---|-----|
| Main 125A (? *4) · 5 sup · 8-probe |          |   |   |     |
| 1658                               | 91073494 | B | O |     |
| 1659                               | 91546494 | R | C |     |
| ???                                | —        | - | V |     |
| ???                                | —        | - | V |     |
| ???                                | —        | - | V |     |

| K 14,10 A                          |          |   |   | 0/4 |
|------------------------------------|----------|---|---|-----|
| Main 100A (? *4) · 4 sup · 8-probe |          |   |   |     |
| 1705-18                            | 91546219 | W | C |     |
| -                                  | —        | - | V |     |
| -                                  | —        | - | V |     |
| -                                  | —        | - | V |     |

| K 14,11                            |          |   |   | 0/4 |
|------------------------------------|----------|---|---|-----|
| Main 125A (? *4) · 4 sup · 8-probe |          |   |   |     |
| 1656                               | 90008070 | B | O |     |
| 1705_20                            | 90008093 | W | O |     |
| 1657                               | 91732517 | R | C |     |
| 1600                               | 91733001 | W | C |     |

| K 14,5                             |          |   |   | 0/4 |
|------------------------------------|----------|---|---|-----|
| Main 125A (? *4) · 4 sup · 8-probe |          |   |   |     |
| 1580                               | 90008067 | W | O |     |
| 1579                               | 91733082 | R | C |     |
| ???                                | —        | - | V |     |
| ???                                | —        | - | V |     |

| K 14,4                             |          |   |   | 0/6 |
|------------------------------------|----------|---|---|-----|
| Main 125A (? *4) · 6 sup · 8-probe |          |   |   |     |
| 1577                               | 90007925 | W | O |     |
| 1666                               | 91733375 | R | O |     |
| 1573                               | 91732540 | B | C |     |
| 1575                               | 90007912 | R | O |     |
| ???                                | —        | - | V |     |
| ???                                | —        | - | V |     |

| K 14,3                             |          |     |   | 0/4 |
|------------------------------------|----------|-----|---|-----|
| Main 125A (? *4) · 4 sup · 8-probe |          |     |   |     |
| 1572                               | 47369883 | W   | O |     |
| 1667                               | 94992077 | RWB | O |     |
| ???                                | —        | -   | V |     |
| ???                                | —        | -   | V |     |

| K 14,2                             |          |   |   | 0/5 |
|------------------------------------|----------|---|---|-----|
| Main 125A (? *4) · 5 sup · 8-probe |          |   |   |     |
| 1674                               | 85354375 | B | O |     |
| ???                                | —        | - | V |     |
| ???                                | —        | - | V |     |
| ???                                | —        | - | V |     |
| ???                                | —        | - | V |     |

| K 14,1                             |          |   |   | 0/5 |
|------------------------------------|----------|---|---|-----|
| Main 125A (? *4) · 5 sup · 8-probe |          |   |   |     |
| 1675                               | 91732616 | B | O |     |
| 1680                               | 91733385 | R | C |     |
| 1679                               | 90007864 | B | O |     |
| ???                                | —        | - | V |     |
| ???                                | —        | - | V |     |

| KIOSK AMR SCHEDULE |     |        |     |     |            |
|--------------------|-----|--------|-----|-----|------------|
| KIOSK              | SUP | ON AMR | ORD | OUT | UNIT       |
| MS LV board        | 1   | 0      | 0   | 1   | Standalone |
| K 14,9 A           | 5   | 0      | 0   | 5   | 8-probe    |
| K 14,9 B           | 4   | 0      | 0   | 4   | 8-probe    |
| K 14,10 A          | 4   | 0      | 0   | 4   | 8-probe    |
| K 14,9             | 6   | 0      | 0   | 6   | 8-probe    |
| K 14,10            | 5   | 0      | 0   | 5   | 8-probe    |
| K 14,11            | 4   | 0      | 0   | 4   | 8-probe    |
| K 14,5             | 4   | 0      | 0   | 4   | 8-probe    |
| K 14,4             | 6   | 0      | 0   | 6   | 8-probe    |
| K 14,3             | 4   | 0      | 0   | 4   | 8-probe    |
| K 14,2             | 5   | 0      | 0   | 5   | 8-probe    |
| K 14,1             | 5   | 0      | 0   | 5   | 8-probe    |

VOLTANO

METERING

AMR PROGRESS (supplies)

0% on AMR



Installed 0    Ordered 0    Outstanding 53    Deferred 0

ZULULAMI ESTATE

MS 14 – LV RETICULATION & AMR STATUS

Electronic Assemblies (PTY) Ltd. · 315 kVA (450A) · mfd 2021 · bulk meter 83013703 (on AMR)

— feed per sheet    - - - - - inferred from layout    Rows: status · stand · S/N · ph · Q/C/V · port

|                                       |          |  |
|---------------------------------------|----------|--|
| DRAWING No.                           | REVISION |  |
| ZLM-SLD-14                            | A        |  |
| DATE                                  | SCALE    |  |
| 2026-10-06                            | NTS      |  |
| DRAWN                                 | SHEET    |  |
| Ruan van Heerden, Electrical Engineer | 15 of 15 |  |