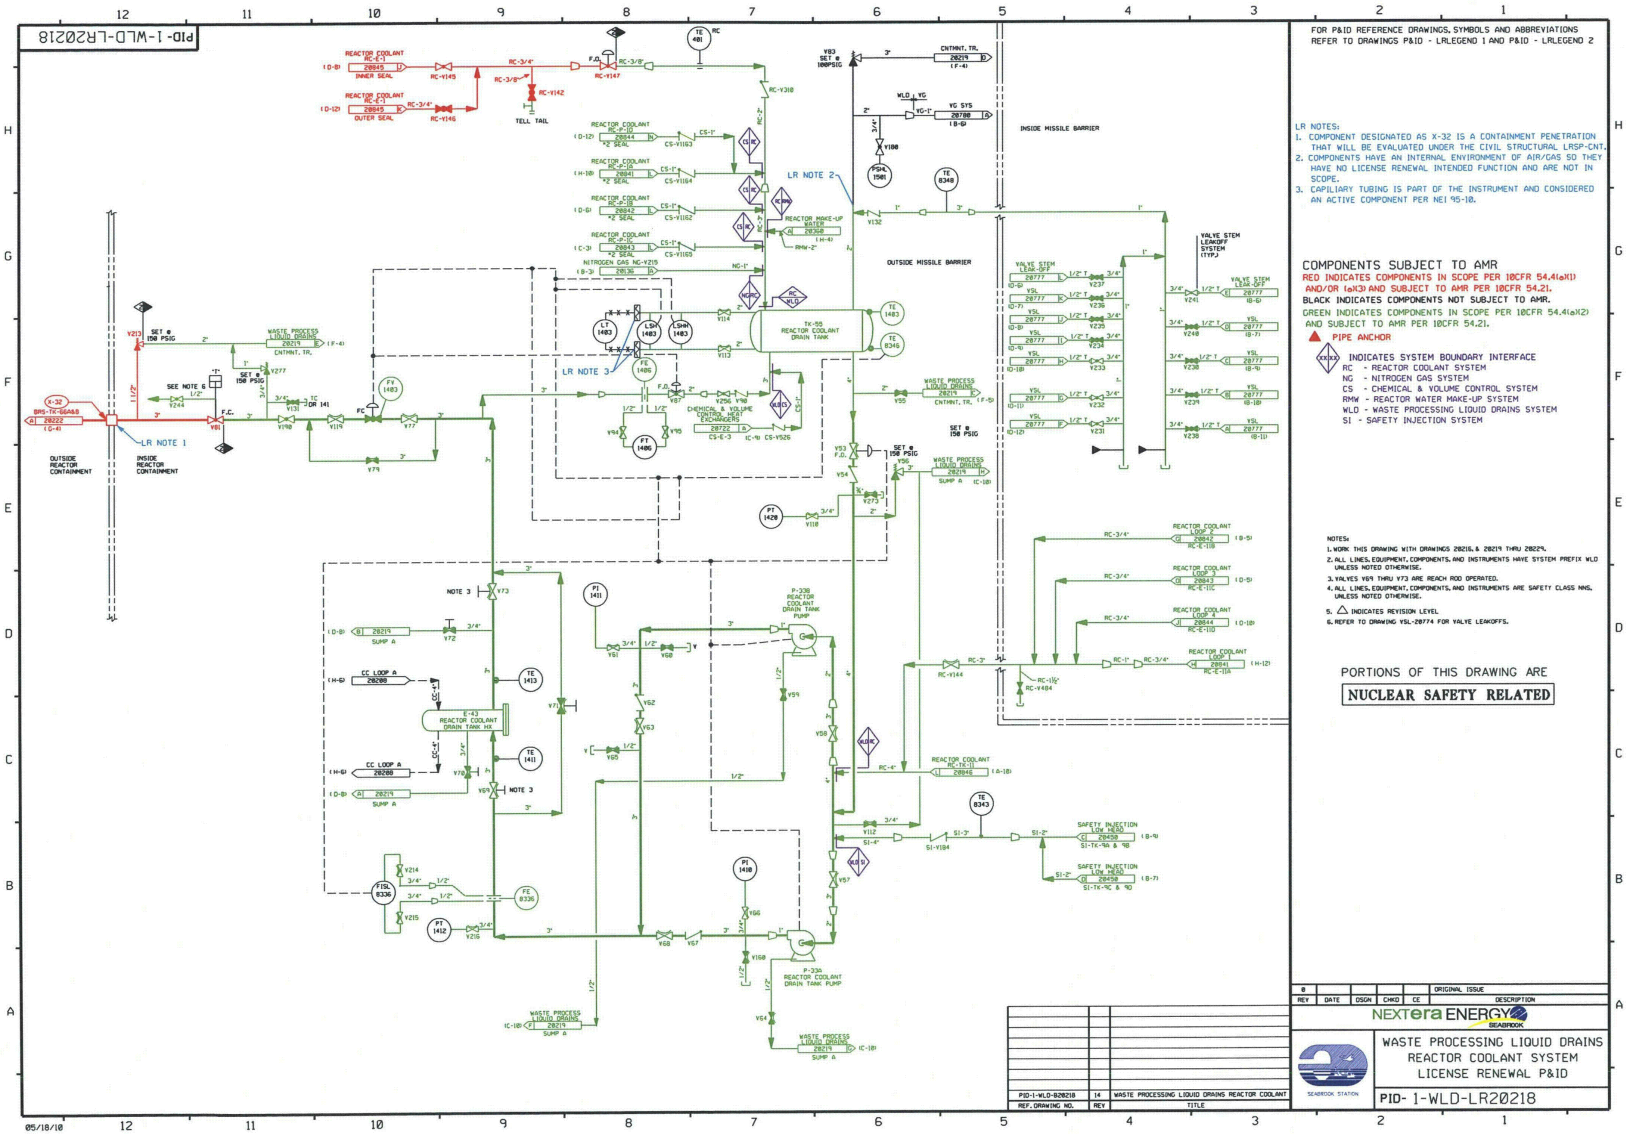

PID- 1-WLD-LR20218
FOR P&ID REFERENCE DRAWINGS, SYMBOLS AND ABBREVIATIONS REFER TO DRAWINGS P&ID - LRLEGEND 1 AND P&ID - LRLEGEND 2
LR NOTES:
1. COMPONENT DESIGNATED AS X-32 IS A CONTAINMENT PENETRATION THAT WILL BE EVALUATED UNDER THE CIVIL STRUCTURAL LRSP-CNT.
2. COMPONENTS HAVE AN INTERNAL ENVIRONMENT OF AIR/GAS SO THEY HAVE NO LICENSE RENEWAL INTENDED FUNCTION AND ARE NOT IN SCOPE.
3. CAPILIARY TUBING IS PART OF THE INSTRUMENT AND CONSIDERED AN ACTIVE COMPONENT PER NEI 95-10.
COMPONENTS SUBJECT TO AMR
RED INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(1) AND/OR (a)(3) AND SUBJECT TO AMR PER 10CFR 54.21.
BLACK INDICATES COMPONENTS NOT SUBJECT TO AMR.
GREEN INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(2) AND SUBJECT TO AMR PER 10CFR 54.21.
PIPE ANCHOR
INDICATES SYSTEM BOUNDARY INTERFACE
RC - REACTOR COOLANT SYSTEM
NG - NITROGEN GAS SYSTEM
CS - CHEMICAL & VOLUME CONTROL SYSTEM
RMW - REACTOR WATER MAKE-UP SYSTEM
WLD - WASTE PROCESSING LIQUID DRAINS SYSTEM
SI - SAFETY INJECTION SYSTEM
NOTES:
1. WORK THIS DRAWING WITH DRAWINGS 20216 & 20219 THRU 20229.
2. ALL LINES, EQUIPMENT, COMPONENTS, AND INSTRUMENTS HAVE SYSTEM PREFIX WLD UNLESS NOTED OTHERWISE.
3. VALVES Y69 THRU Y73 ARE REACH ROD OPERATED.
4. ALL LINES, EQUIPMENT, COMPONENTS, AND INSTRUMENTS ARE SAFETY CLASS NNS, UNLESS NOTED OTHERWISE.
5. △ INDICATES REVISION LEVEL
6. REFER TO DRAWING VSL-20774 FOR VALVE LEAKOFFS.
PORTIONS OF THIS DRAWING ARE
NUCLEAR SAFETY RELATED
REV DATE DSGN CHKD CE DESCRIPTION
8 ORIGINAL ISSUE
NEXTera ENERGY SEABROOK
SEABROOK STATION
WASTE PROCESSING LIQUID DRAINS
REACTOR COOLANT SYSTEM
LICENSE RENEWAL P&ID
PID- 1-WLD-LR20218
PID-1-WLD-B20218 | 14 | WASTE PROCESSING LIQUID DRAINS REACTOR COOLANT
REF. DRAWING NO. | REV | TITLE
05/18/10