
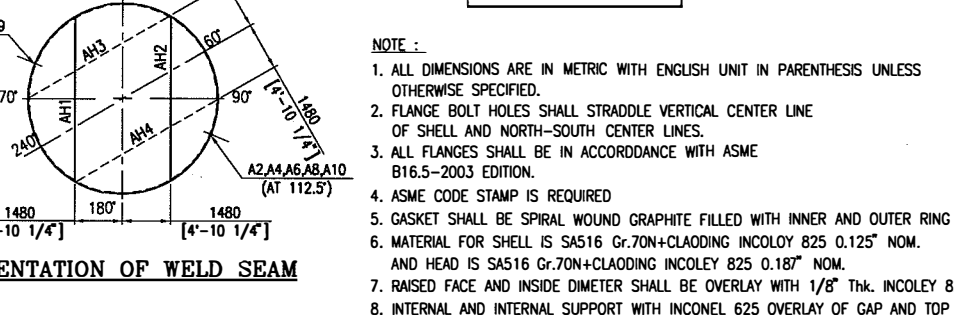
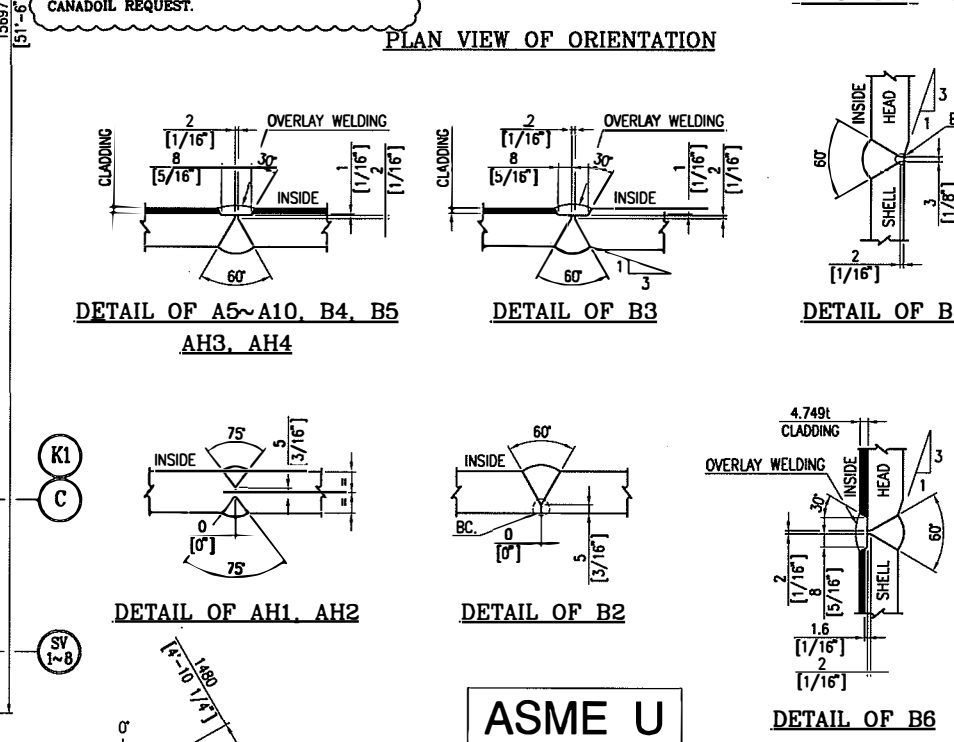
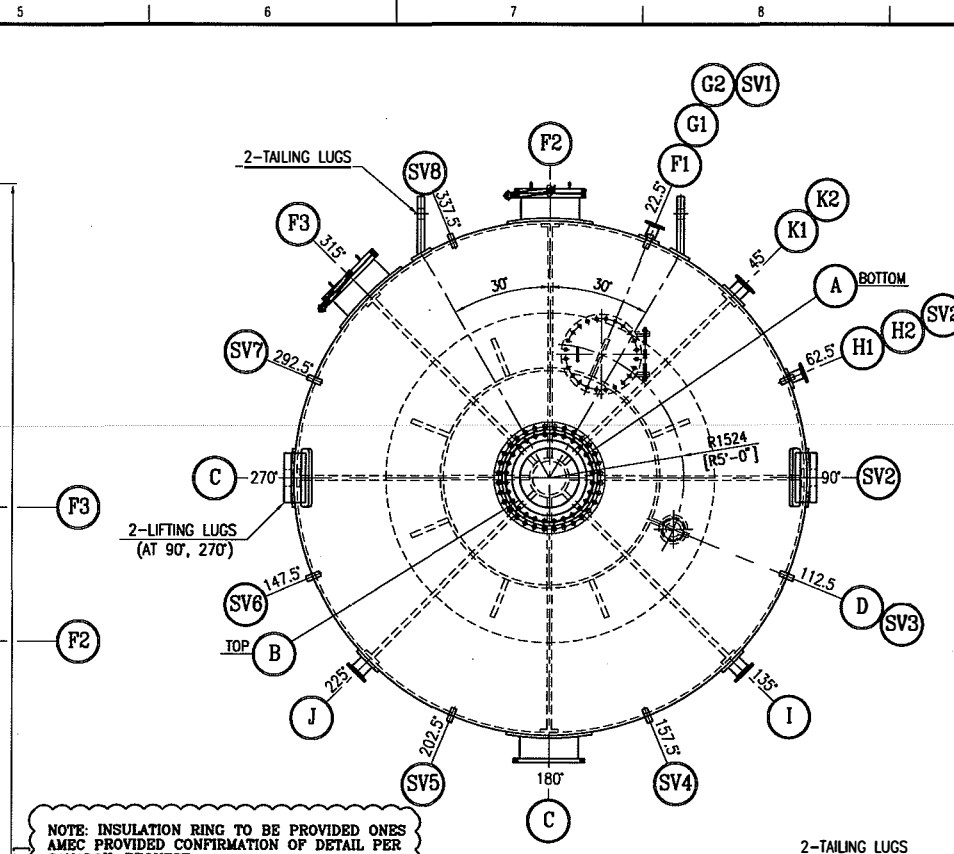


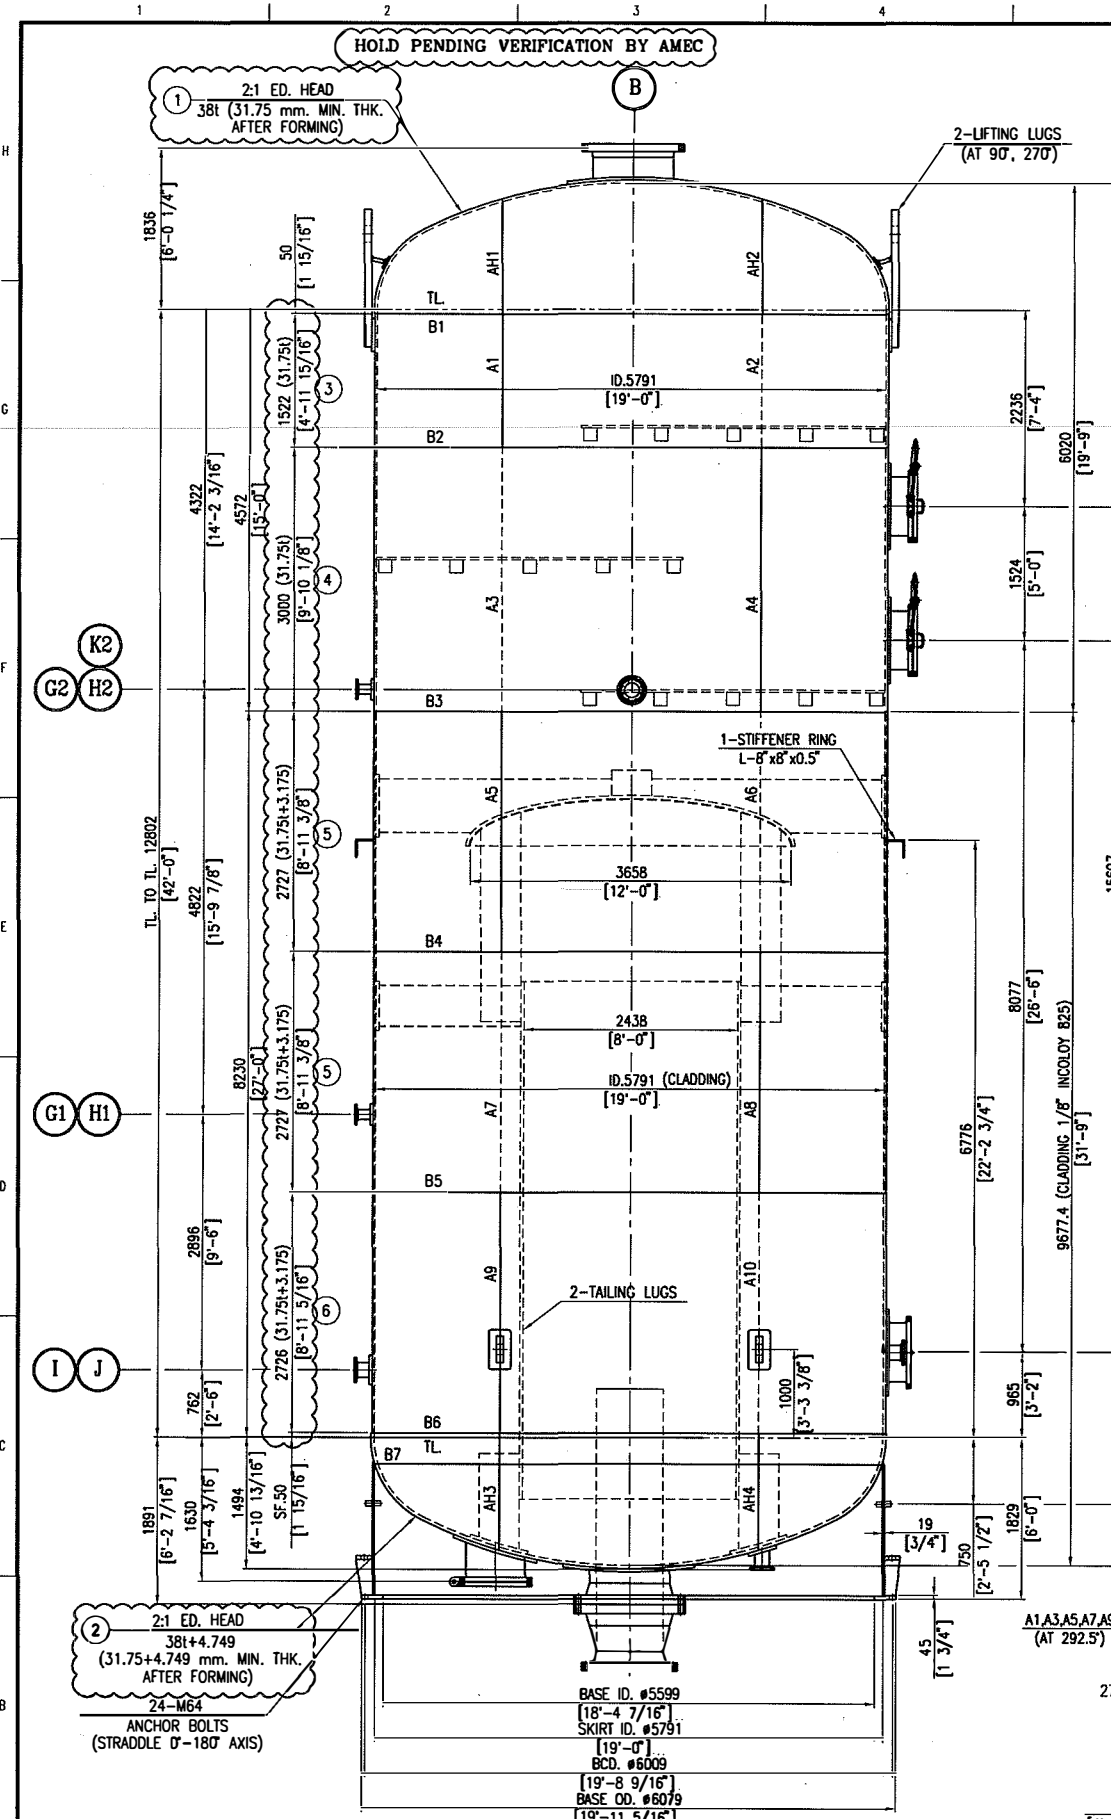

DESIGN SPECIFICATION			
DESIGN CODE	ASME SEC. VIII DIV.1, 2007 EDITION, 2008 ADDENDA		
DESIGN PRESSURE (INT/EXT)	689.47/FV	KPa (g)	(100/FV. Psig)
DESIGN TEMPERATURE (INT/EXT)	177/66	°C	(350/150 °F)
OPERATING PRESSURE	159	KPa (g)	(23 Psig)
OPERATING TEMPERATURE	137	°C	(279 °F)
CONTENT	LP BRINE-STEAM SEPARATOR/CRYSTALLIZER	DENSITY	1140 kg/m³
HYDRO. TEST PRESSURE AT SHOP (HORIZ.)	1579.8	KPa	AT ABM
AT SITE (VERT.)	1474.215	KPa	AT ABM
MAXIMUM ALLOWABLE WORKING PRESSURE (MAWP)		982.81	KPa AT 177 °C
MAXIMUM ALLOWABLE EXTERNAL WORKING PRESSURE (MAEP)		-	KPa AT 177 °C
MINIMUM DESIGN METAL TEMPERATURE (MDMT)		0	°C @ 689 KPa
SPECIAL SERVICE : NO			
RADIOGRAPH FOR SHELL		FULL	JOINT EFFICIENCY FOR SHELL : 1.00
FOR HEAD		FULL	FOR HEAD : 1.00
CORROSION ALLOWANCE : TOP SHELL = 0.375" NOM.CA, BOTTOM SHELL = 0.0" NOM.CA			
: TOP HEAD = 0.375" NOM.CA, BOTTOM HEAD = 0.0" NOM.CA			
POSTWELD HEAT TREATMENT		NO	IMPACT TEST : NO
LETHAL SERVICE		NO	FIRE PROOF : NO
INSULATION		5"	SEISMIC ZONE : 4 (UBC)
WIND PRESSURE		80 mph (UBC)	
HEAD TYPE		ELLIPSOIDAL 2:1	NOMINAL CAPACITY : 389 M³
WEIGHT : FABRICATION		139,938	kgs.
EMPTY		139,938	kgs.
OPERATING		596,671	kgs.
TEST		528,391	kgs.
MATERIAL SPECIFICATION			
TOP SHELL/HEAD		SA516 Gr.70N	GASKET : NOTE 5
BOTTOM SHELL/HEAD		SA516 Gr.70N + NOTE 6	STUD BOLT/NUT (EXT.) : SA193 B7/SA194 2H
FLANGE		SA105N & SB-564 N08825	STUD BOLT/NUT (INT.) : -
NOZZLE NECK		SA516 Gr.70N & SB-423 N08825 OTHERS	SEE DWG.
INTERNAL		SEE DWG.	
PAINTING SYSTEM			
CARBOZINC OR EQUAL			

NOZZLE SCHEDULE									
MARK	SERVICE	SIZE	Q'TY	NOZZLE NECK	FLANGE	REMARK			
				SCH.	MATERIAL	TYPE	CLASS	MATERIAL	
A	INLET BRINE (ID#861.4)	NPS 36	1	22+3.175	SA516 Gr.70N+WOL	WN.RF	300	SA105N+WOL	B16.47-A
B	VAPOR OUTLET (ID#862.4)	NPS 36	1	22+3.175	SA516 Gr.70N+WOL	WN.RF	300	SA105N+WOL	B16.47-A
C	BRINE OUTLET (ID#600.6)	NPS 24	1	-	-	LWN.RF	150	SA105N+WOL	-
D	DRAIN (ID#154.05)	NPS 6	1	40S	SB-423 N08825	SO.RF	150	SB-564 N08825	-
F1	MANWAY (ID#600.6)	NPS 24	1	-	-	LWN.RF	150	SA105N+WOL	W/BLIND&HNGE
F2, F3	MANWAY (ID#609.6)	NPS 24	2	-	-	LWN.RF	150	SA105N	W/BLIND&DWTS
G1, G2	LEVEL (ID#102.26)	NPS 4	2	40S	SB-423 N08825	SO.RF	150	SB-564 N08825	-
H1, H2	LEVEL (ID#102.26)	NPS 4	2	40S	SB-423 N08825	SO.RF	150	SB-564 N08825	-
I	DRAIN (ID#154.05)	NPS 6	1	40S	SB-423 N08825	SO.RF	150	SB-564 N08825	-
J	DILUTION WATER INLET (ID#154.05)	NPS 6	1	40S	SB-423 N08825	WN.RF	150	SB-564 N08825	-
K1, K2	SPARE (ID#154.05)	NPS 6	2	40S	SB-423 N08825	SO.RF	150	SB-564 N08825	W/BLIND
SV1~6	SPARE (ID#154.05)	NPS 2	6	40	SA106 Gr.B	-	-	-	-

BILL OF MATERIAL				
NO. PART	DESCRIPTION	MATERIAL	Q'TY	REMARK
1	TOP HEAD 2:1 ELLIP 38" (965.1 mm. MIN. THK. AFTER FORMING)	SA516 Gr.70N	1	
2	BOTTOM HEAD 2:1 ELLIP 38" (965.1 mm. MIN. THK. AFTER FORMING)	SA516 Gr.70N	1	
3	SHELL {PL-31.75" (806.6 mm.) x 1522.2" (38611 mm.) x 9147" (232755 mm.)	SA516 Gr.70N	2	
4	SHELL {PL-31.75" (806.6 mm.) x 3000" (76200 mm.) x 9147" (232755 mm.)	SA516 Gr.70N	2	
5	SHELL {PL-31.75" (806.6 mm.) x 2727" (69381 mm.) x 9142" (231702 mm.)	SA516 Gr.70N+NOTE6	4	
6	SHELL {PL-31.75" (806.6 mm.) x 2725.8" (69341 mm.) x 9142" (231702 mm.)	SA516 Gr.70N+NOTE6	2	

HOLD PENDING VERIFICATION BY AMEC			
CLIENT :			
CLIENT PROJECT NAME :			
CLIENT PO.No. : -		CLIENT PROJECT No. : -	TAG No. : -
NATIONAL BOARD REGISTRATION :			


DRAWN BY :	WATTANA	TITLE	
DESIGN BY :	UDOMSAK	LP CRYSTALLIZER	
REVIEW BY :	ITTIPON	ITEM No. LPC-VP-2301	
APPROVED BY :	PICHET	GENERAL ARRANGEMENT AND DETAIL DRAWING	
CASA PO No.		DRAWING No.:	SHT. REV.
-		GA-LPC-VP-2301	1/1 4

DD-LPC-VP-2301-04	SKIRT AND LIFTING LUG DETAIL DRAWING
DD-LPC-VP-2301-03	NOZZLE DETAIL DRAWING 3/3
DD-LPC-VP-2301-02	NOZZLE DETAIL DRAWING 2/3
DD-LPC-VP-2301-01	NOZZLE DETAIL DRAWING 1/3
DRAWING No.	DESCRIPTION
REFERENCE DRAWING	
DD-LPC-VP-2301-06	INTERNAL DETAIL DRAWING 2/2
DD-LPC-VP-2301-05	INTERNAL DETAIL DRAWING 1/2
DRAWING No.	DESCRIPTION
REFERENCE DRAWING	


4	15/06/2010	FOR APPROVAL	WATTANA	UDOMSAK	ITTIPON	PICHET
3	11/05/2010	FOR APPROVAL	WATTANA	UDOMSAK	ITTIPON	PICHET
2	6/05/2010	FOR APPROVAL	WATTANA	UDOMSAK	ITTIPON	PICHET
1	29/04/2010	FOR APPROVAL	WATTANA	UDOMSAK	ITTIPON	PICHET
0	28/04/2010	FOR APPROVAL	WATTANA	UDOMSAK	ITTIPON	PICHET
REV.	DATE	REVISION NOTE	DRAWN	DESIGN	REVIEW	APPROVED

NOTE :


- ALL DIMENSIONS ARE IN METRIC WITH ENGLISH UNIT IN PARENTHESIS UNLESS OTHERWISE SPECIFIED.
- FLANGE BOLT HOLES SHALL STRADDLE VERTICAL CENTER LINE OF SHELL AND NORTH-SOUTH CENTER LINES.
- ALL FLANGES SHALL BE IN ACCORDANCE WITH ASME B16.5-2003 EDITION.
- ASME CODE STAMP IS REQUIRED
- GASKET SHALL BE SPIRAL WOUND GRAPHITE FILLED WITH INNER AND OUTER RING SS316L.
- MATERIAL FOR SHELL IS SA516 Gr.70N+CLADDING INCOLOY 825 0.125" NOM. AND HEAD IS SA516 Gr.70N+CLADDING INCOLEY 825 0.187" NOM.
- RAISED FACE AND INSIDE DIMETER SHALL BE OVERLAY WITH 1/8" THK. INCOLEY 825.
- INTERNAL AND INTERNAL SUPPORT WITH INCONEL 625 OVERLAY OF GAP AND TOP TUBE.

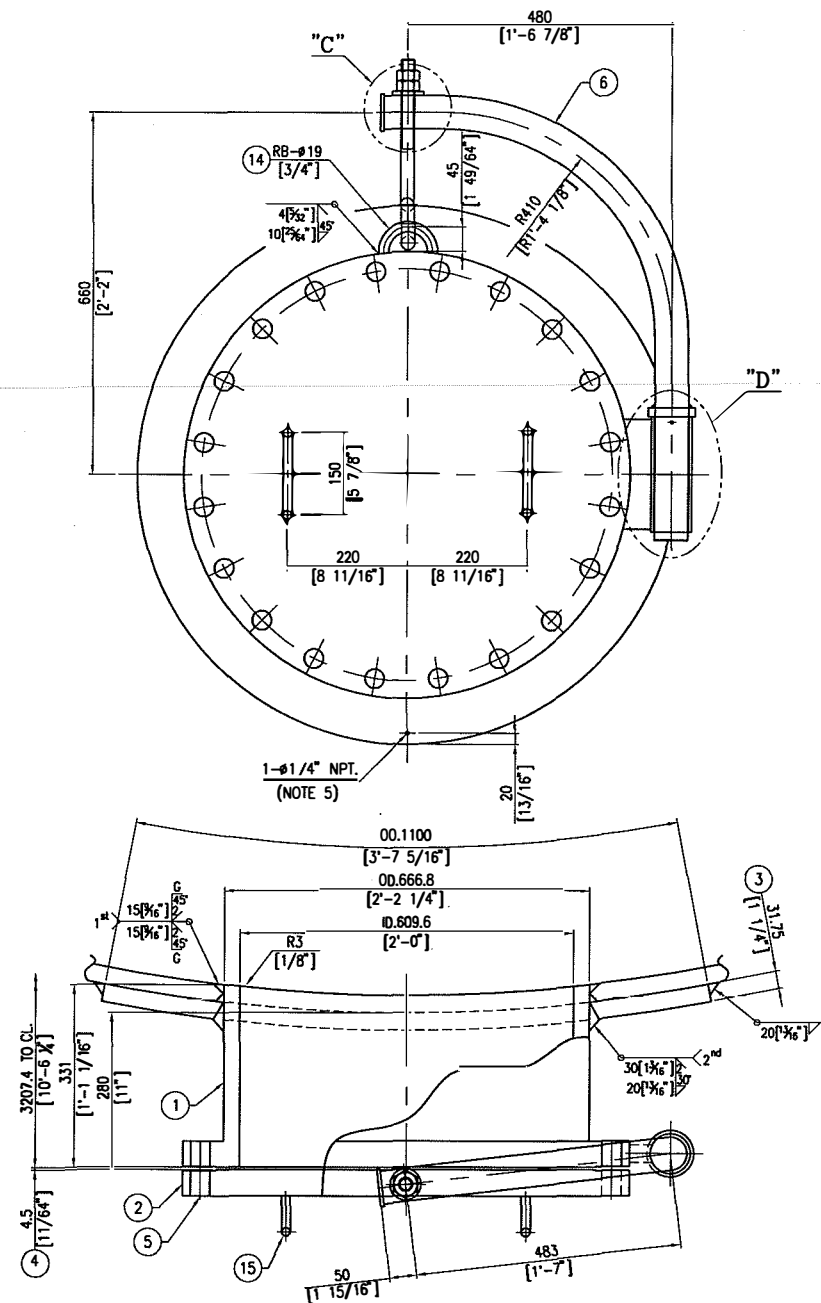


DETAIL OF NOZZLE (F2 F3)

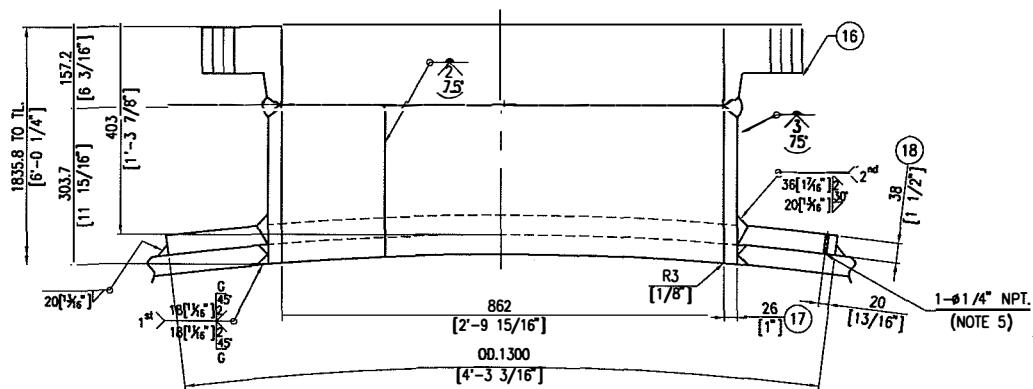


DETAIL OF NOZZLE (B)




DETAIL "A"

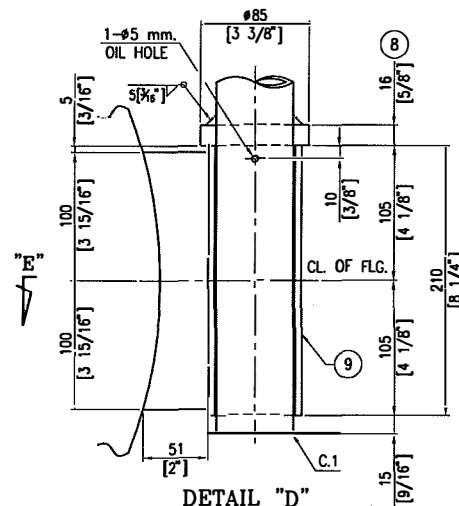


DETAIL "D"

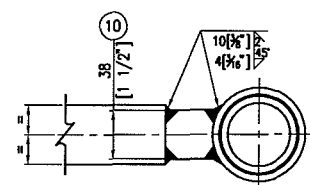


SECTION "E"

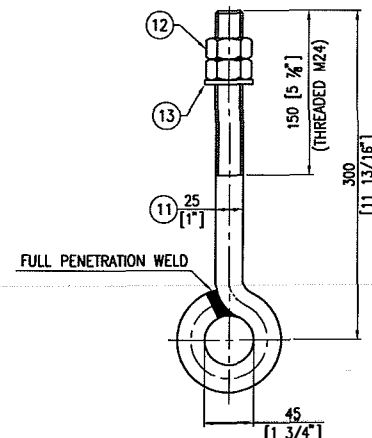


DETAIL OF EYE BOLT

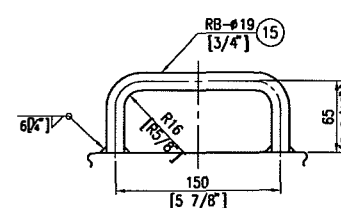

DETAIL OF HANDLE

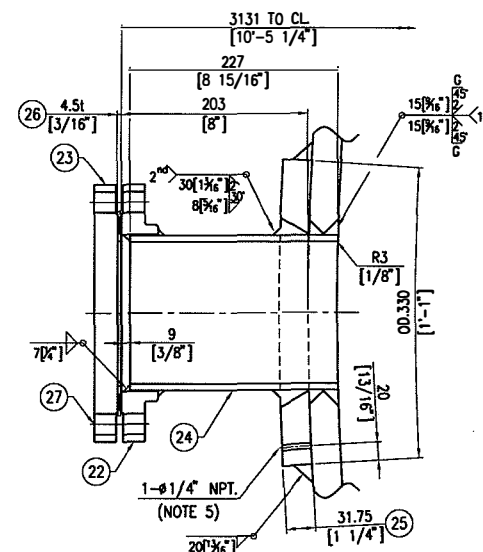

DETAIL OF NOZZLE (K2)

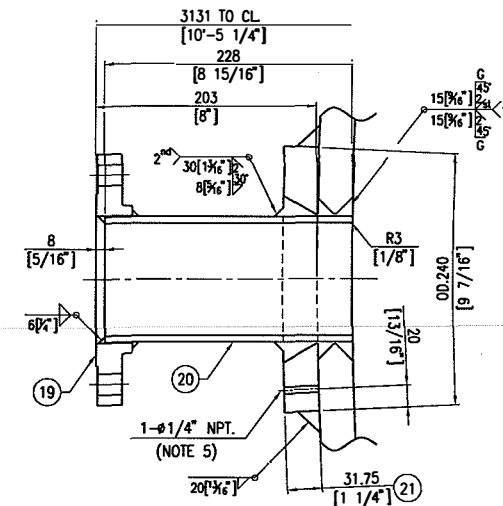

DETAIL OF NOZZLE (G2 H2)

ASME U

NOTE :

1. ALL DIMENSIONS ARE IN METRIC WITH ENGLISH UNIT IN PARENTHESIS UNLESS OTHERWISE SPECIFIED.
2. FLANGE BOLT HOLES SHALL STRADDLE VERTICAL CENTER LINE OF SHELL AND NORTH-SOUTH CENTER LINES.
3. ALL FLANGES SHALL BE IN ACCORDANCE WITH ASME B16.5-2003 EDITION.
4. GASKET SHALL BE SPIRAL WOUND GRAPHITE FILLED WITH INNER AND OUTER RING SS316L.
5. THE TELL-TALE HOLE SHALL BE LOCATED AT LOWEST POINT.

REV.	DATE	FOR APPROVAL	REVISION NOTE	DRAWN	DESIGN	REVIEW	APPROVED
0	14/06/2010						

PART NO.	DESCRIPTION	MATERIAL	Q'TY	REMARK
27	STUD BOLT/2 NUTS $\phi 3/4"$ -10UNC x 105[4 1/8"]L	SA193 B7/SA194 2H	B	
26	GASKET 4.5t FOR NPS 6 CLASS 150 RF.	NOTE 4	1	
25	REINF. PAO PL-31.75[1 1/4"]t x OD.330[1'-1"] x ID.170[6 1/2"]	SA516 Gr.70N	1	
24	NOZZLE NECK PIPE NPS 6" Sch.40S x 227[8 15/16"]L	SB-423 N08825	1	
23	BLIND FLANGE NPS 6 CLASS 150 SO.RF.	SB-564 N08825	1	
22	FLANGE NPS 6 CLASS 150 SO.RF.	SB-564 N08825	1	
21	REINF. PAO PL-31.75[1 1/4"]t x OD.240[9 1/2"] x ID.118[4 3/4"]	SA516 Gr.70N	2	
20	NOZZLE NECK PIPE NPS 4" Sch.40S x 227[8 15/16"]L	SB-423 N08825	2	
19	FLANGE NPS 4 CLASS 150 SO.RF.	SB-564 N08825	2	
18	REINF. PAO PL-38[1 1/2"]t x OD.130[4'-3 3/8"] x ID.915[3'-0"]	SA516 Gr.70N	1	
17	NOZZLE NECK PL-26[1"]t x 304[11 1/2"] x 2791[9'-1 1/2"]	SA516 Gr.70N	1	
16	FLANGE NPS 36 CLASS 150 WN.RF. BORE 862[2'-9 1/2"]	SA105N	1	
15	HANDLE RB-19[3/4"] x 260[10 1/2"]L	SS 400	4	
14	HOOK RB-19[3/4"] x 145[5 1/2"]L	SS 400	2	
13	WASHER PL-4.5[3/8"]t x OD.44[1 3/4"] x ID.26[1"]	CS.	2	
12	HEX. NUT M24	SA194-2H	4	
11	EYE BOLT RB-25[1"] x 472[1'-6 1/2"]	SS400	2	
10	SUPPORT PL-35[1 1/8"]t x 51[2"] x 200[7 7/8"]	SA516 Gr.70N	2	
9	PIPE SLEEVE PIPE NPS 2 1/2" Sch.40 x 210[8 1/4"]L	SA106 Gr.B	2	
8	COLLAR PL-16[5/8"]t x OD.85[3 1/2"] x ID.63[2 1/2"]	SS400	2	
7	END PLATE PL-6[1/4"]t x 668[2 1/2"]	SS400	2	
6	DAVIT ARM PIPE NPS 2" Sch.80 x 1137[3'-8 3/4"]L	SA106 Gr.B	2	
5	STUD BOLT/2 NUTS $\phi 1 1/2"$ -BUN x 185[7 1/2"]L	SA193 B7/SA194 2H	40	
4	GASKET 4.5t FOR NPS 24 CLASS 150 RF.	NOTE 4	2	
3	REINF. PAO PL-31.75[1 1/4"]t x OD.1100[3'-7 3/8"] x ID.670[2'-2 1/8"]	SA516 Gr.70N	2	
2	BLIND FLANGE NPS 24 CLASS 150 RF.	SA105N	2	
1	FLANGE NPS 24 CLASS 150 LWN.RF. BORE 609.6[2'-0"] x 339[1'-1 1/8"]L	SA105N	2	

BILL OF MATERIAL


CLIENT :

CLIENT PROJECT NAME :

CLIENT PO.No. : - CLIENT PROJECT No. : - TAG No. : -

NATIONAL BOARD REGISTRATION :

DRAWN BY :	WATTANA	TITLE	LP CRYSTALLIZER
DESIGN BY :	UDOMSAK	ITEM No.	LPC-VP-2301
REVIEW BY :	ITTIPON	NOZZLE DETAIL DRAWING	1/3
APPROVED BY :	PICHET	CASIA PO No.	DRAWING No.:
		-	DD-LPC-VP-2301-01
		SHT.	REV.
		1/1	0

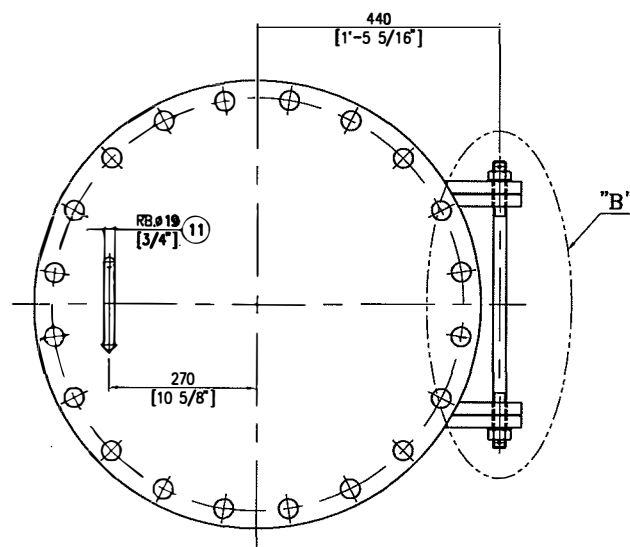

3.1751 [6]
(INCOLEG 825 WOL)

140
[5 1/2"]

R6 [3/4"]

4
[3/16"] 1.5
[1/16"]

R3 [3/8"]

2.5
[1/8"]

4.5
[3/16"]

6

27.5
[1 1/16"]

R40
[R1 9/16"]

93
[3 1/4"]

7

1
[1/4"]

41 [3/16"]
(INCOLEG 825 WOL)

4
[3/16"] 2.5
[1/8"]

1.5
[1/16"]

7

27.5
[1 1/16"]

R40
[R1 9/16"]

89
[3 3/4"]

126
[4 15/16"]

[illegible][illegible]

Technical drawing of a 60L Split Pin (Fig. 10). The drawing shows a vertical split pin with two threaded ends. Key dimensions and callouts include:





- Top End:**
 - Callout 10: $\varnothing 5.5$ HOLE
 - Callout 9: $\varnothing 5 \times 60L$ SPLIT PIN
 - Dimension: 100 [3 $\frac{1}{16}$ "] (THREADED M30)
- Bottom End:**
 - Callout 9: $\varnothing 5 \times 60L$ SPLIT PIN
 - Callout 10: $\varnothing 5.5$ HOLE
- Central Section:**
 - Callout 8: RB $\varnothing 25$ [1"]
 - Dimension: 520 (mm)
 - Dimension: 100 [3 $\frac{1}{16}$ "] (THREADED M24)

ASME U

14	REINF. PAD	PL-31.75[1½"]t x OD.330[1'-1"] x ID.170[6⅝"]	SA516 Gr.70N	1
13	NOZZLE NECK	PIPE NPS 6" Sch.40S x 290[11⅞"]L.	SB-423 N08825	1
12	FLANGE	NPS 6 CLASS 150 SO.RF.	SB-564 N08825	1
11	HANDLE	RB-ø19[¾"] x 260[10⅞"]L.	SS400	1
10	SPLIT PIN	ø5[⅜"] x 60[2⅜"]L.	CS.	2
9	HEX. NUT/WASHER	M24	SA194-2H	2 SETS
8	EYE BOLT	RB-ø25[1"] x 520[1'-8½"]L.	SS400	1
7	COVER HINGE	PL-22[⅞"]t x 89[3⅝"] x 126[4⅞"]	SS400	2
6	MANHOLE HINGE	PL-22[⅞"]t x 93[3⅞"] x 140[5½"]	SS400	2
5	STUD BOLT/2 NUTS	ø1½"-8UN x 185[7⅞"]L.	SA193 B7/SA194 2H	20
4	GASKET	4.5t FOR NPS 24 CLASS 150 RF.	NOTE 4	1
3	REINF. PAD	PL-31.75[1½"]t x OD.980[3'-2⅜"] x ID.614[2'-⅞"]	SA516 Gr.70N	1
2	BLIND FLANGE	NPS 24 CLASS 150 RF.	SA105N+NOTE 5	1
1	FLANGE	NPS 24 CLASS 150 LWN.RF. BORE 609.6[2'-0"] x 522[1'-8⅞"]L.	SA105N+NOTE 5	1
PART NO.	DESCRIPTION		MATERIAL	Q'TY
				REMARK

CASIA PO No.	DRAWING No.:	SHT.	RE
—	DD-LPC-VP-2301-02	1/1	0

0	14/06/2010	FOR APPROVAL			
REV.	DATE	REVISION NOTE	DRAWN	DESIGN	REVIEW APPROVED

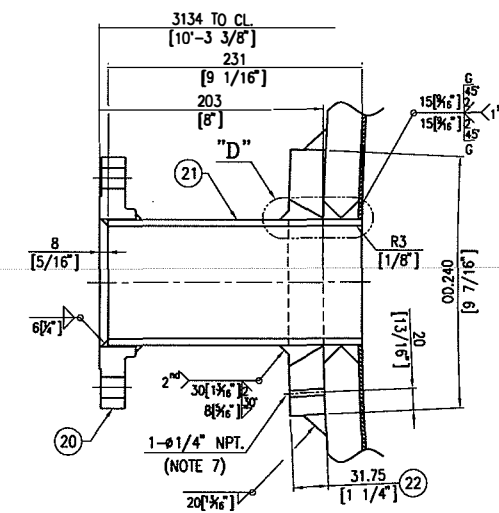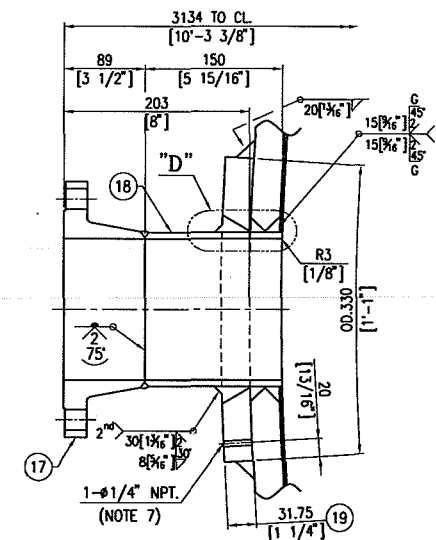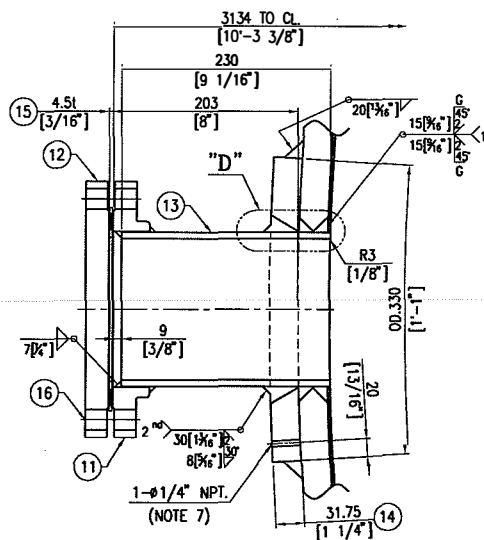
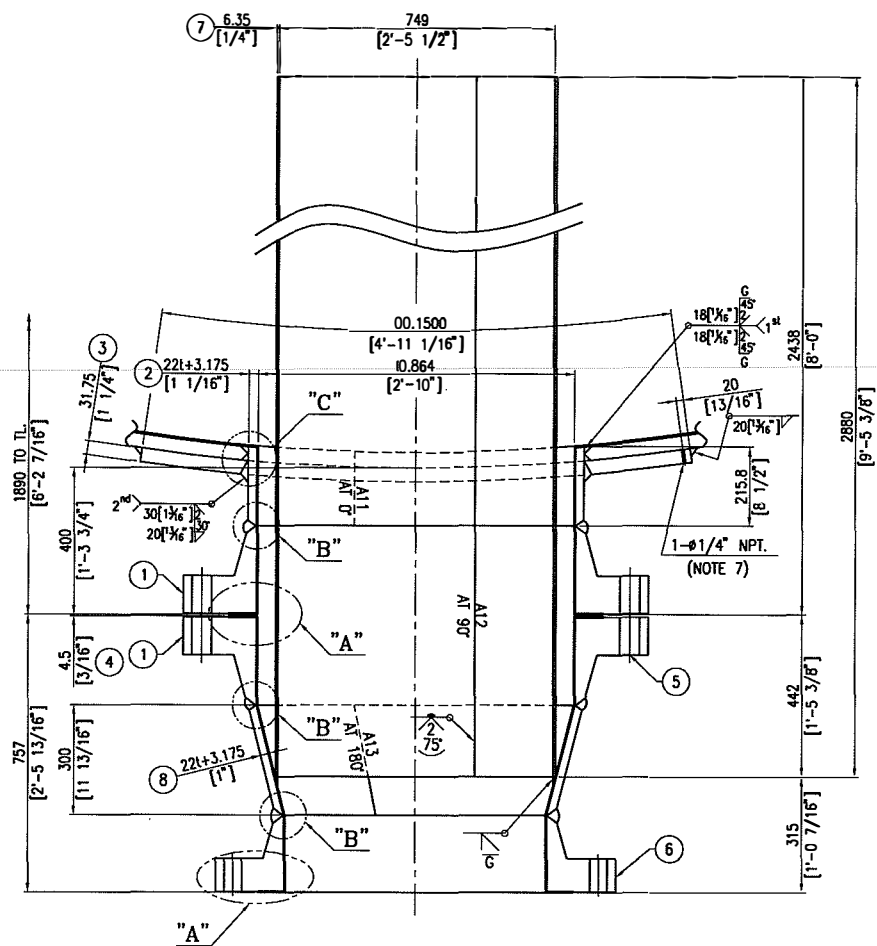


DETAIL OF NOZZLE (K1) PART NO. 12, 15 AND 16 FOR NOZZLE K1 ONLY

DETAIL OF NOZZLE (J)



DETAIL OF NOZZLE (G1 H1)

ASME U

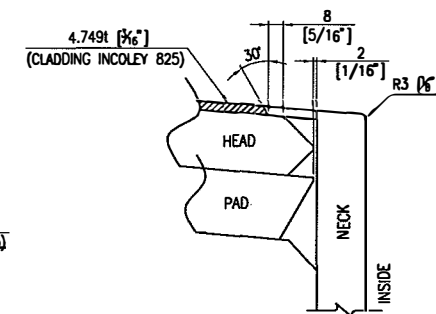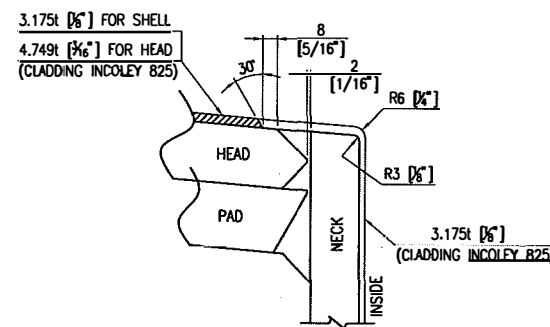


DETAIL "C"

DETAIL "D"

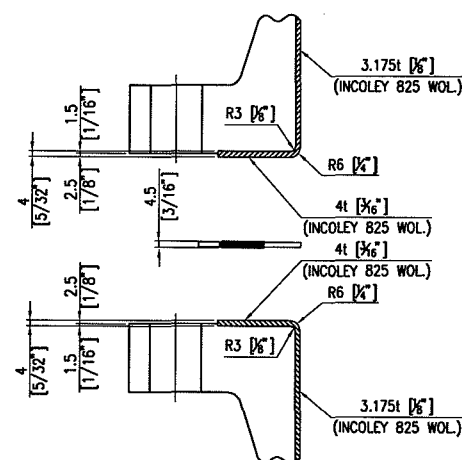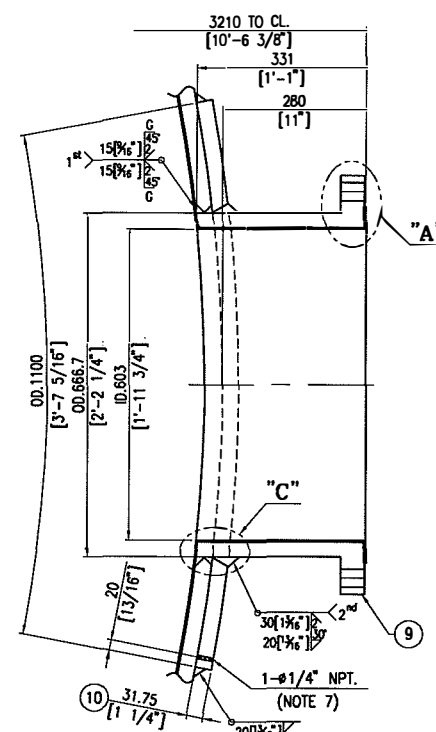

DETAIL "A"

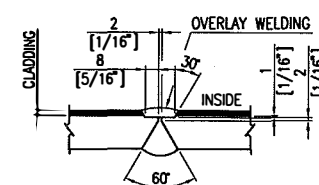

DETAIL OF A11, A13

NOTE :

1. ALL DIMENSIONS ARE IN METRIC WITH ENGLISH UNIT IN PARENTHESIS UNLESS OTHERWISE SPECIFIED.
2. FLANGE BOLT HOLES SHALL STRADDLE VERTICAL CENTER LINE OF SHELL AND NORTH-SOUTH CENTER LINES.
3. ALL FLANGES SHALL BE IN ACCORDANCE WITH ASME B16.5-2003 EDITION.
4. GASKET SHALL BE SPIRAL WOUND GRAPHITE FILLED WITH INNER AND OUTER RING SS316L.
5. MATERIAL FOR CONICAL AND NOZZLE NECKS IS SA516 Gr.70N+CLADDING INCONEL 825 3.175 (0.125") NOM.
6. MATERIAL FOR FLANGES IS INCONEL 825 WOL. 3.175 (0.125") NOM.
7. THE TELL-TALE HOLE SHALL BE LOCATED AT LOWEST POINT.

REV.	DATE	FOR APPROVAL	REVISION NOTE	DRAWN	DESIGN	REVIEW	APPROVED
0	14/06/2010						


PART NO.	DESCRIPTION	MATERIAL	QTY	REMARK
22	REINF. PAD PL-31.75[1 1/4"] x OD.240[9 3/8"] x ID.118[4 5/8"]	SA516 Gr.70N	2	
21	NOZZLE NECK PIPE NPS 4" Sch.40S x 231[9 1/8"] L.	SB-423 N08825	2	
20	FLANGE NPS 4 CLASS 150 SO.RF.	SB-564 N08825	2	
19	REINF. PAD PL-31.75[1 1/4"] x OD.330[1'-1"] x ID.170[6 5/8"]	SA516 Gr.70N	1	
18	NOZZLE NECK PIPE NPS 6" Sch.40S x 150[5 7/8"] L.	SB-423 N08825	1	
17	FLANGE NPS 6 CLASS 150 WN.RF. Sch.40S	SB-564 N08825	1	
16	STUD BOLT/2 NUTS 3/4"-10UNC x 105[4 1/8"] L.	SA193 B7/SA194 2H	8	FOR NOZ. K1
15	GASKET 4.5t FOR NPS 6 CLASS 150 RF.	NOTE 4	1	FOR NOZ. K1
14	REINF. PAD PL-31.75[1 1/4"] x OD.330[1'-1"] x ID.170[6 5/8"]	SA516 Gr.70N	2	
13	NOZZLE NECK PIPE NPS 6" Sch.40S x 230[9 1/8"] L.	SB-423 N08825	2	
12	BLIND FLANGE NPS 6 CLASS 150 SO.RF.	SB-564 N08825	1	FOR NOZ. K1
11	FLANGE NPS 6 CLASS 150 SO.RF.	SB-564 N08825	2	
10	REINF. PAD PL-31.75[1 1/4"] x OD.1100[3'-7 1/8"] x ID.670[2'-2 3/8"]	SA516 Gr.70N		
9	FLANGE NPS 24 CLASS 150 LWN.RF. BORE 609.6[2'-0"] x 331[1'-1"] L.	SA105N+NOTE 6	1	
8	CONICAL PL-22[3/8"] x 300[11 1/2"] x 2875[9'-5 1/8"]	SA516 Gr.70N+NOTE 5	1	
7	INTERNAL PIPE PL-6.35[1/4"] x 2374[7'-9 3/8"] x 2834[9'-3 3/8"]	INCONEL 625	1	
6	FLANGE NPS 30 CLASS 300 WN.RF. BORE 718[2'-4 1/8"] ASME B16.47 Series A	SA105N+NOTE 6	1	
5	STUD BOLT/2 NUTS 2 1/2"-8UN x 355[1'-2"] L.	SA193 B7/SA194 2H	32	
4	GASKET 4.5t FOR NPS 36 CLASS 300 RF.	NOTE 4	1	
3	REINF. PAD PL-31.75[1 1/4"] x OD.1500[4'-11 1/8"] x ID.915[3'-0"]	SA516 Gr.70N	1	
2	NOZZLE NECK PL-22[3/8"] x 216[8 1/2"] x 2793[9'-1 1/8"]	SA516 Gr.70N+NOTE 5	1	
1	FLANGE NPS 36 CLASS 300 WN.RF. BORE 870.4[2'-9 1/8"] ASME B16.47 Series A	SA105N+NOTE 6	2	

BILL OF MATERIAL


CLIENT :		
CLIENT PROJECT NAME : -		
CLIENT PO.No. : -	CLIENT PROJECT No. : -	TAG No. : -

NATIONAL BOARD REGISTRATION :


DRAWN BY :	WATTANA	TITLE	LP CRYSTALLIZER		
DESIGN BY :	UDOMSAK		ITEM No. LPC-VP-2301		
			NOZZLE DETAIL DRAWING 3/3		
REVIEW BY :	ITTIPON				
APPROVED BY :	PICHET	CASIA PO No.	DRAWING No.:	SHT.	REV.
		-	DD-LPC-VP-2301-03	1/1	0

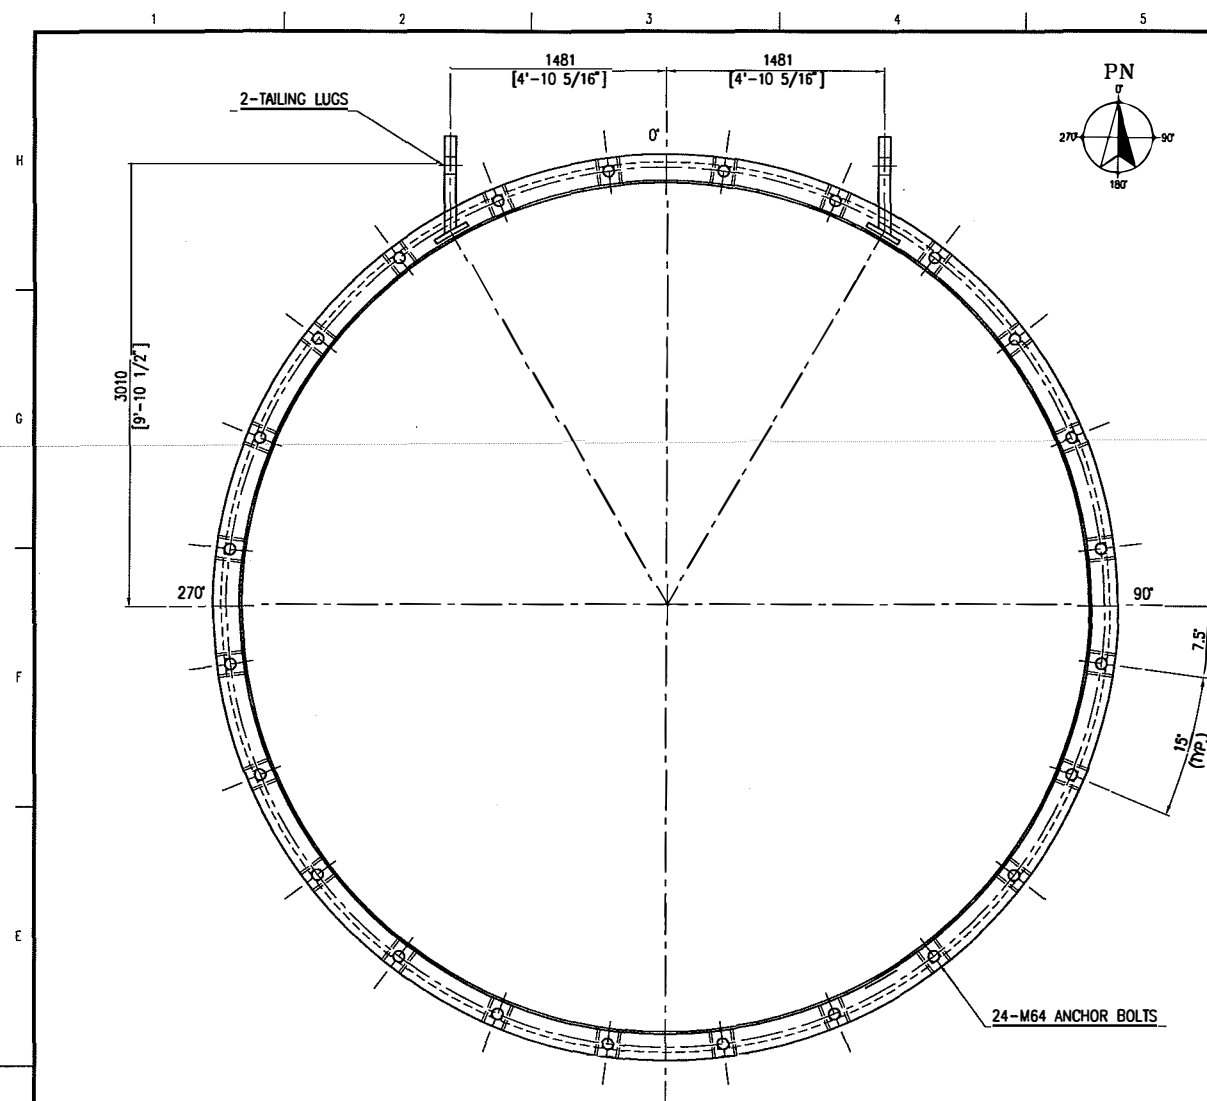


ORIENTATION OF ANCHOR BOLT

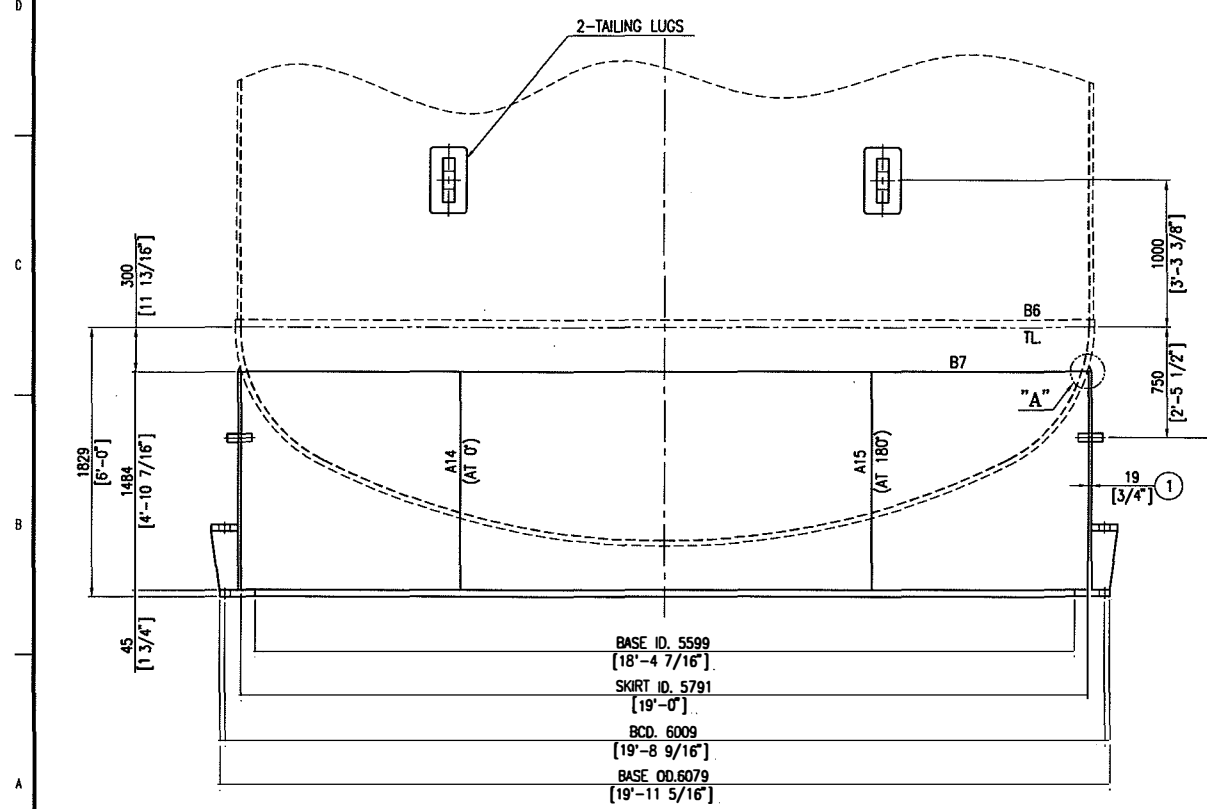


DETAIL OF SKIRT

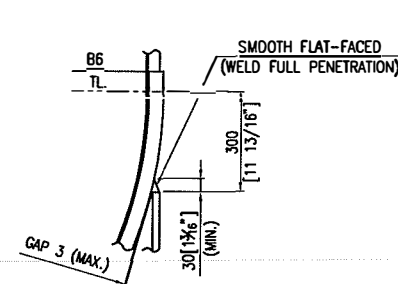


DETAIL "A"

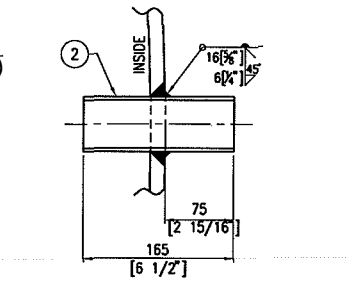

DETAIL OF SKIRT VENT

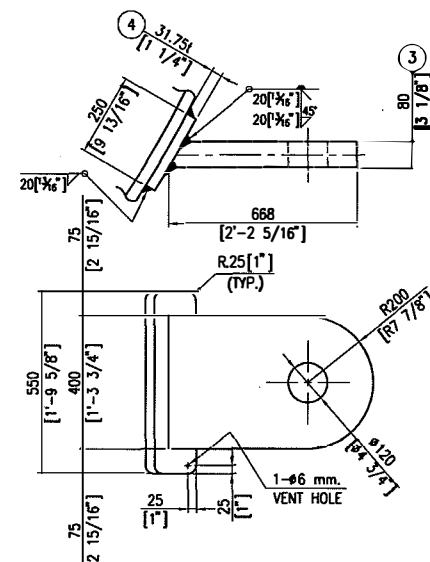

DETAIL OF TAILING LUG



DETAIL OF A14, A15

NOTE :
1. ALL DIMENSIONS ARE IN METRIC WITH ENGLISH UNIT IN PARENTHESIS UNLESS OTHERWISE SPECIFIED.

PART NO.	DESCRIPTION	MATERIAL	Q'TY	REMARK
11	PAD	PL-31.75[1 1/4\"	2	
10	PAD	PL-38[1 1/2\"	2	
9	SUPPORT	PL-42[1 3/8\"	2	
8	LIFTING LUG	PL-80[3/8\"	2	
7	CUSSET	PL-16[5/8\"	48	
6	COMPRESSION RING	PL-45[1 1/8\"	1	
5	BASE PLATE	PL-45[1 1/8\"	1	
4	PAD	PL-31.75[1 1/4\"	2	
3	TAILING LUG	PL-80[3/8\"	2	
2	SKIRT VENT	PIPE NPS 2\"	8	
1	SKIRT	PL-19[3/4\"	2	

BILL OF MATERIAL

CLIENT :
CLIENT PROJECT NAME :
CLIENT PO.No. : - CLIENT PROJECT No. : - TAG No. : -

NATIONAL BOARD REGISTRATION :

DRAWN BY : WATTANA	TITLE
DESIGN BY : UDOMSAK	LP CRYSTALLIZER
REVIEW BY : ITTIPON	ITEM No. LPC-VP-2301
APPROVED BY : PICHET	SKIRT AND LIFTING LUG DETAIL DRAWING
CASIA PO No.	DRAWING No.:
-	DD-LPC-VP-2301-04
SHT.	REV.
1/1	0

REV.	DATE	FOR APPROVAL	REVISION NOTE	DRAWN	DESIGN	REVIEW	APPROVED
0	14/06/2010						

