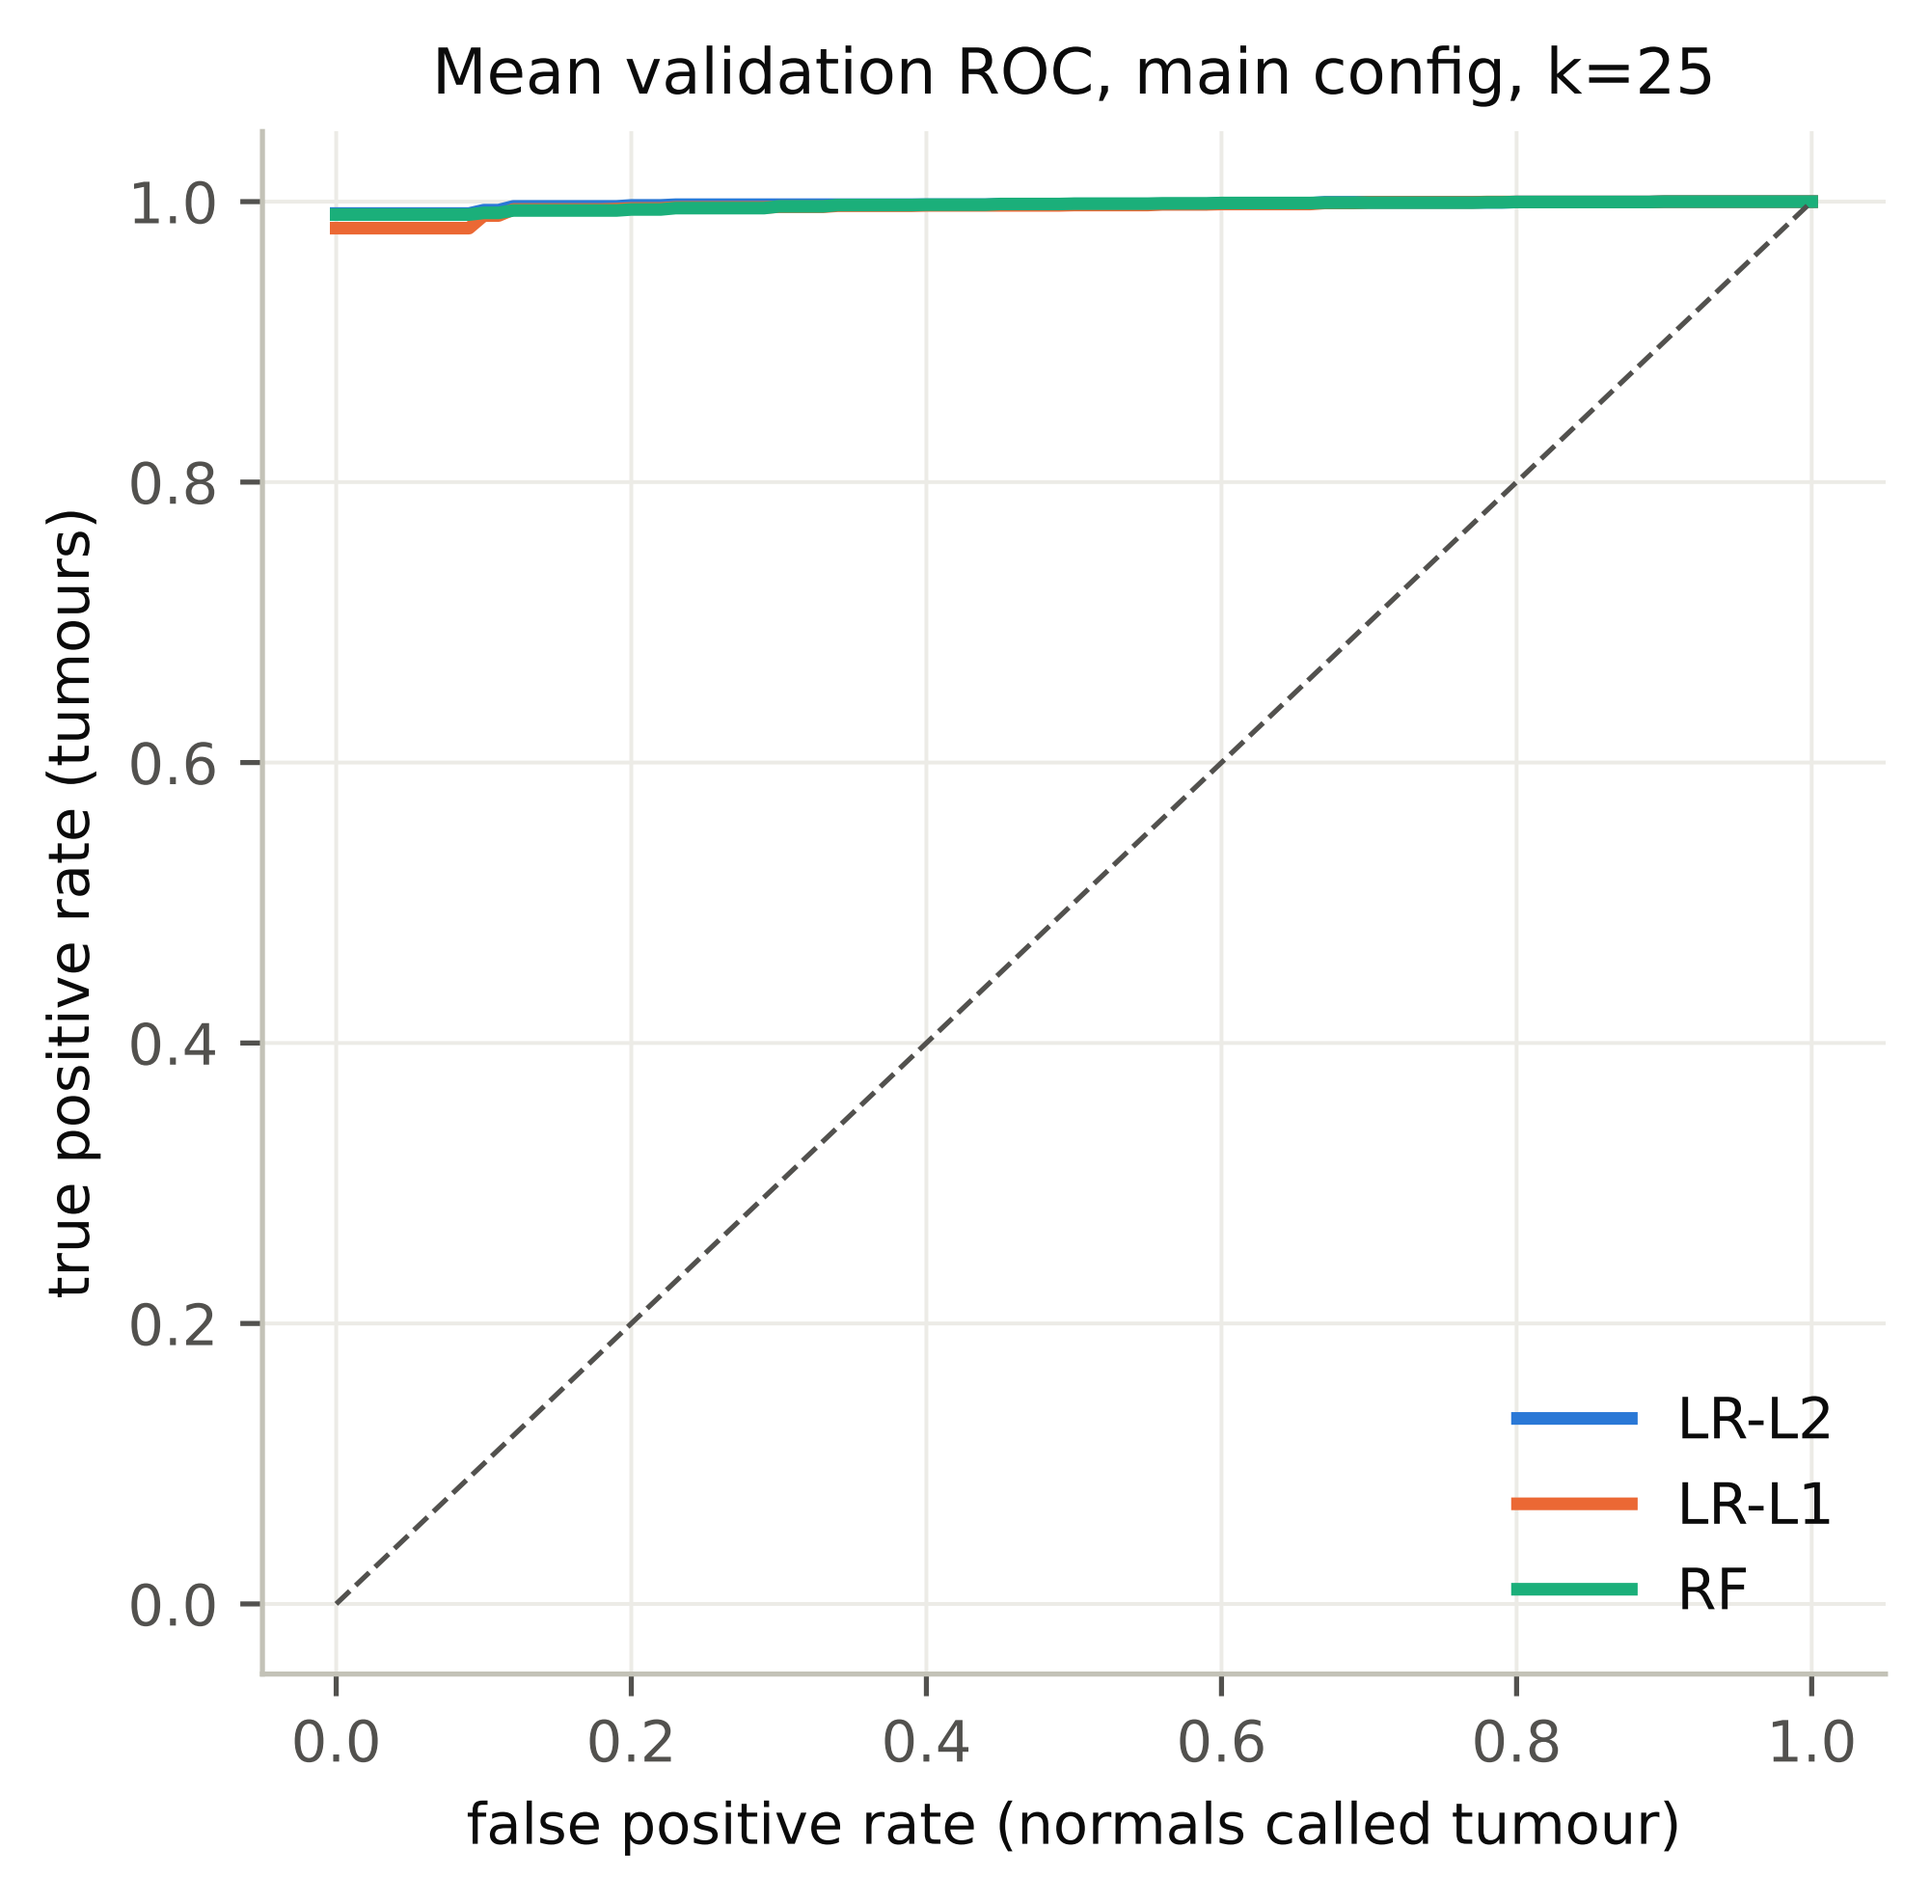
Mean validation ROC, main config, k=25
true positive rate (tumours)
1.0
0.8
0.6
0.4
0.2
0.0
0.0
0.2
0.4
0.6
0.8
1.0
false positive rate (normals called tumour)
LR-L2
LR-L1
RF