NORTHERN WOLVES AIR CONDITIONING

Mechanical Contractor | New York & New Jersey

SUBMITTAL
#002

DUCTWORK WRAP INSULATION

Spec Section: 23 07 13 — Duct Insulation

Fiberglass Duct Wrap — R-6 Value

TRANSMITTAL INFORMATION

Project Name:	[PROJECT NAME]	**Date:**	March 22, 2026
Project Location:	[PROJECT LOCATION]	**Submitted By:**	Northern Wolves AC
General Contractor:	[GC NAME]	**Attention:**	[ENGINEER / ARCHITECT]
Architect / Engineer:	[A/E FIRM]	**Submittal Type:**	Initial Submission

DESCRIPTION OF SUBMITTAL

Fiberglass duct wrap insulation for exterior of HVAC ductwork systems.
Project requires minimum installed R-value of R-6.
Product: Type 75, 2-1/5" (56mm) labeled thickness — Installed R-value = 6.0.
FSK (Foil-Scrim-Kraft) vapor barrier facing with 2" stapling tab.

PRODUCT INFORMATION

Manufacturer:	Johns Manville
Product:	Microlite FSK Formaldehyde-Free Duct Wrap
Type / Density:	Type 75 — 0.75 pcf (12 kg/m³)
Thickness:	2-1/5" (56mm) labeled thickness
Installed R-Value:	R-6.0 (per recommended stretch-outs)
Facing:	FSK — Aluminum foil/fiberglass scrim/kraft
Vapor Permeance:	0.02 perms max (ASTM E96)
Fire Rating:	FHC 25/50 per ASTM E84, UL 723
Spec Compliance:	ASTM C1290, NFPA 90A & 90B, NYC MEA 40-75-M

NOTES

- Installed R-value of 6.0 based on material compressed max 25% per recommended stretch-outs.
- HIGHLIGHTED items on attached data sheets indicate submitted type and thickness.

Johns Manville
A Berkshire Hathaway Company

HVAC INSULATION

MICROLITE® FSK

FSK-FACED FORMALDEHYDE-FREE™ FIBERGLASS DUCT WRAP

DATA SHEET

DESCRIPTION

Microlite® FSK Formaldehyde-free™ duct wrap insulation is a lightweight, highly resilient, blanket-type thermal insulation. The insulation blanket is manufactured from rotary-process fiberglass bonded with a formaldehyde-free resin.

AVAILABLE FORMS

Microlite Formaldehyde-free™ insulation is available in a variety of densities, thicknesses and roll lengths. It is supplied with an FSK (foil-scrim-kraft) vapor barrier facing to meet installed performance requirements, with a 2" (51 mm) stapling tab. Microlite FSK is 48" (1219mm) wide.

USES

Microlite insulation is recommended as thermal insulation for the exterior of HVAC systems or other spaces or surfaces where temperature control is required.

LIMITATION

Microlite FSK duct wrap is not recommended for use on duct systems in service at temperatures above 250°F (121°C). It should not be used in weather-exposed applications without proper protection.

STORAGE

Microlite FSK duct wrap should be kept clean and dry during storage, transport, installation, and system operation.

FACING INFORMATION

FSK Aluminum Foil
Reinforced with fiber glass scrim laminated to UL-rated kraft.
Permeance: 0.02 perms*

*Per ASTM E96, Procedure A for facing material prior to lamination. After lamination, permeance values may be higher.

GENERAL PROPERTIES

Temperature (max.) – ASTM C411	250°F (121°C)
Water vapor sorption – ASTM C1104	<5% by weight
Corrosivity with steel – ASTM C665	Does not accelerate
Fungi resistance – ASTM C1338	Does not breed or promote

STANDARD THICKNESSES AND PACKAGING

	100' Roll (31 m)	75' Roll (23 m)	50' Roll (15 m)	45' Roll (13.7 m)	35' Roll (10.6 m)	30' Roll (9.14 m)
TYPE 75 — 2-1/5" (56mm) THICKNESS						
75	1 (24)*, 1 ½ (38)	2⅕ (56)	3 (76),	4 2/5 (112)	5 ¾ (146)	7 (178)
100	1 ½ (38)	2 (51)	_			
150	_	1 ½ (38)	2 (51)			

**1" for Canadian use only*
Note: Additional thicknesses, widths and other lengths available on special order. Contact Regional Sales Office for availability.

RECYCLED CONTENT

CERTIFIED RECYCLED CONTENT® SCS GLOBAL SERVICES

AVERAGE 24% RECYCLED CONTENT
POST-CONSUMER

SURFACE BURNING CHARACTERISTICS

Microlite insulation meets the Surface Burning Characteristics and Limited Combustibility of the following standards:

Standard/Test Method
- ASTM E84
- UL 723
- NFPA 90A and 90B
- UL Guide No. 40 U8.3. Card R3711
- CAN/ULC S102

Maximum Flame Spread Index	25
Maximum Smoke Developed Index	50

Note: Faced materials are tested as composite products (insulation, adhesive and facing).

SPECIFICATION COMPLIANCE

ASTM C1290	Type 75, 100, & 150
ASTM C553*	
Type I, Type II	Type 75 & 100
Type I, Type II, Type III	Type 150

**For faced material: 250°F (121°C) maximum temperature.*

ASTM C1136s†	
Type II	FSK Facing

†Replaces HH-B-100B, Type II.

Canada: CGSB 51-GP-11M
NYC MEA 40-75-M

SUSTAINABLE BUILDING CERTIFICATIONS

GREENGUARD®	Certified
GREENGUARD® GOLD	Certified
FORMALDEHYDE FREE	Validated

GREENGUARD® Certified products have been screened for more than 10,000 volatile organic compounds (VOCs) and meet stringent standards for low chemical emissions based on established criteria from key public health agencies. This product is also a UL Validated Formaldehyde-Free product, meeting recommendations established by the California Air Resources Board and the EPA to use building materials and insulation made without formaldehyde.

UL GREENGUARD
PRODUCT CERTIFIED FOR LOW CHEMICAL EMISSIONS
UL.COM/GG
UL 2818
GOLD

UL VALIDATED
PRODUCT IS FORMALDEHYDE FREE
UL.COM/ECV

MICROLITE® FSK

FSK-FACED FORMALDEHYDE-FREE™ FIBERGLASS DUCT WRAP

DATA SHEET

APPLICATION RECOMMENDATIONS

The R-value will vary depending upon how much the insulation is compressed during installation. To obtain the published installed R-values, the insulation stretch-out should be determined using the following table:

Duct Wrap Stretch-outs

Labeled Thick. (in)	Installed Compressed Thickness (in)	Round	Square	Rectangular
1	0.75	P+ 7.0"	P+ 6.0"	P+ 5.0"
2 ⅕	1.65	P+ 13.0"	P+ 11.0"	P+ 8.5"
3	2.25	P+ 17.0"	P+ 14.5"	P+ 11.5"
4 2/5	3.30	P+ 24.5"	P+ 21.0"	P+ 19.0"
5 ¾	4.31	P+ 30.0"	P+ 27.0"	P+ 25.0"
7	5.25	P+ 36.0"	P+ 33.0"	P+ 31.0"

2-1/5" STRETCH-OUT DIMENSIONS

Stretch-outs include 2" (51 mm) for overlap. P = perimeter of duct to be insulated.

Prepare overlap by removing approximately 2" (51 mm) of insulation from facing.

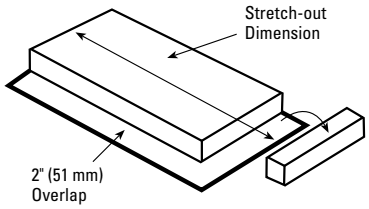

Before applying duct wrap, sheet metal duct shall be clean, dry and tightly sealed at all joints and seams.

Wrap insulation around duct with facing to the outside so the 2" (51 mm) flap completely overlaps facing and insulation at the other end of stretch-out. Insulation shall be snugly butted.

Secure seams with outward clinching staples placed approximately 6" (152mm) on center or tape tabs of 8" or longer. If required, seal seam with pressure-sensitive tape designed for use with duct insulation. Insulation on the underside of ducts spanning 24" (610 mm) or greater shall be secured with mechanical fasteners and speed clips spaced approximately 18" (457 mm) on center. Fasteners should be cut off flush after the speed clips are installed, and when required, sealed with the same tape as specified above.

Adjacent sections of duct wrap insulation shall be snugly butted with the circumferential 2" (51 mm) tape flap overlapping and secured as recommended for the longitudinal seam. When a vapor seal is required, two coats of vapor retarder mastic reinforced with one layer of 4" (102 mm) wide, open-weave glass fabric may be used in lieu of pressure-sensitive tape.

GUIDE SPECIFICATIONS

Insulation for Metal Ducts. All ducts shall be insulated on the outside with a Formaldehyde-free™, flexible glass fiber blanket. Microlite Formaldehyde-free™ fiber glass duct wrap insulation should have a minimum installed R-value* of _____, and a Type_____ facing. Insulation shall be furnished with a factory-applied facing with a composite UL FHC rating of 25/50.

**The minimum insulation installed R-value should be determined in accordance to the duct operating and ambient conditions.*

THERMAL CONDUCTIVITY (ASTM C518)

Type	k* Compressed Thickness Btu•in/(hr•ft²•°F)	W/m•°C	k Labeled Thickness Btu•in/(hr•ft²•°F)	W/m•°C
75	0.27	0.039	0.29	0.042
100	0.25	0.036	0.27	0.039
150	0.24	0.035	0.25	0.036

Conductivity at 75°F (24°C) mean temperature.
**Tested with material thickness compressed 25%.*

INSTALLED R-VALUES

Type	Labeled Thickness in	mm	Installed "R"** (hr•ft²•°F)/Btu	m²•°C/W	Out-of-Package "R" (hr•ft²•°F)/Btu	m²•°C/W
Type 75 - 0.75 pcf (12kg/m³)						
75	1	25	3.0	0.53	3.8	.67
	1½	38	4.2	0.74	5.2	0.92
	2 ⅕	56	6.0	1.08	7.5	1.33
	3	76	8.3	1.46	10.[illegible]	[illegible]
	4 2/5	112	12.0	2.16	15.[illegible]	[illegible]
	5 ¾	146	16.0	2.82	20.0	3.52
	7	178	19.0	3.35	23.0	4.05
Type 100 - 1.00 pcf (16kg/m³)						
100	1½	38	4.5	0.79	5.6	0.99
	2	51	6.0	1.06	7.4	1.30
Type 150 - 1.5 pcf (24kg/m³)						
150	1½	38	4.7	0.83	6.0	1.06
	2	51	6.3	1.11	8.0	1.41

TYPE 75 SECTION

R-6.0 INSTALLED VALUE

***Installed R-value calculated with a material thickness compressed to a maximum of 25% following recommended duct wrap stretch-outs.*

Johns Manville

717 17th St.
Denver, CO 80202
800-654-3103
www.JM.com

North American Sales Offices, Insulation Systems

Eastern Region & Canada
P.O. Box 158
Defiance, OH 43512
800-334-2399
Fax: 419-784-7866

Western Region & Outside North America
P.O. Box 5108
Denver, CO 80217
800-368-4431
Fax: 303-978-4661

Technical specifications as shown in this literature are intended to be used as general guidelines only. Please refer to the Safety Data Sheet and product label prior to using this product. The physical and chemical properties of Microlite FSK listed herein represent typical, average values obtained in accordance with accepted test methods and are subject to normal manufacturing variations. They are supplied as a technical service and are subject to change without notice. Any references to numerical flame spread or smoke developed ratings are not intended to reflect hazards presented by these or any other materials under actual fire conditions.

All Johns Manville products are sold subject to Johns Manville's standard Terms and Conditions, which includes a Limited Warranty and Limitation of Remedy. For a copy of the Johns Manville standard Terms and Conditions or for information on other Johns Manville thermal insulation and systems, visit www.jm.com/terms-conditions or call (800) 654-3103.

© 2024 Johns Manville All Rights Reserved