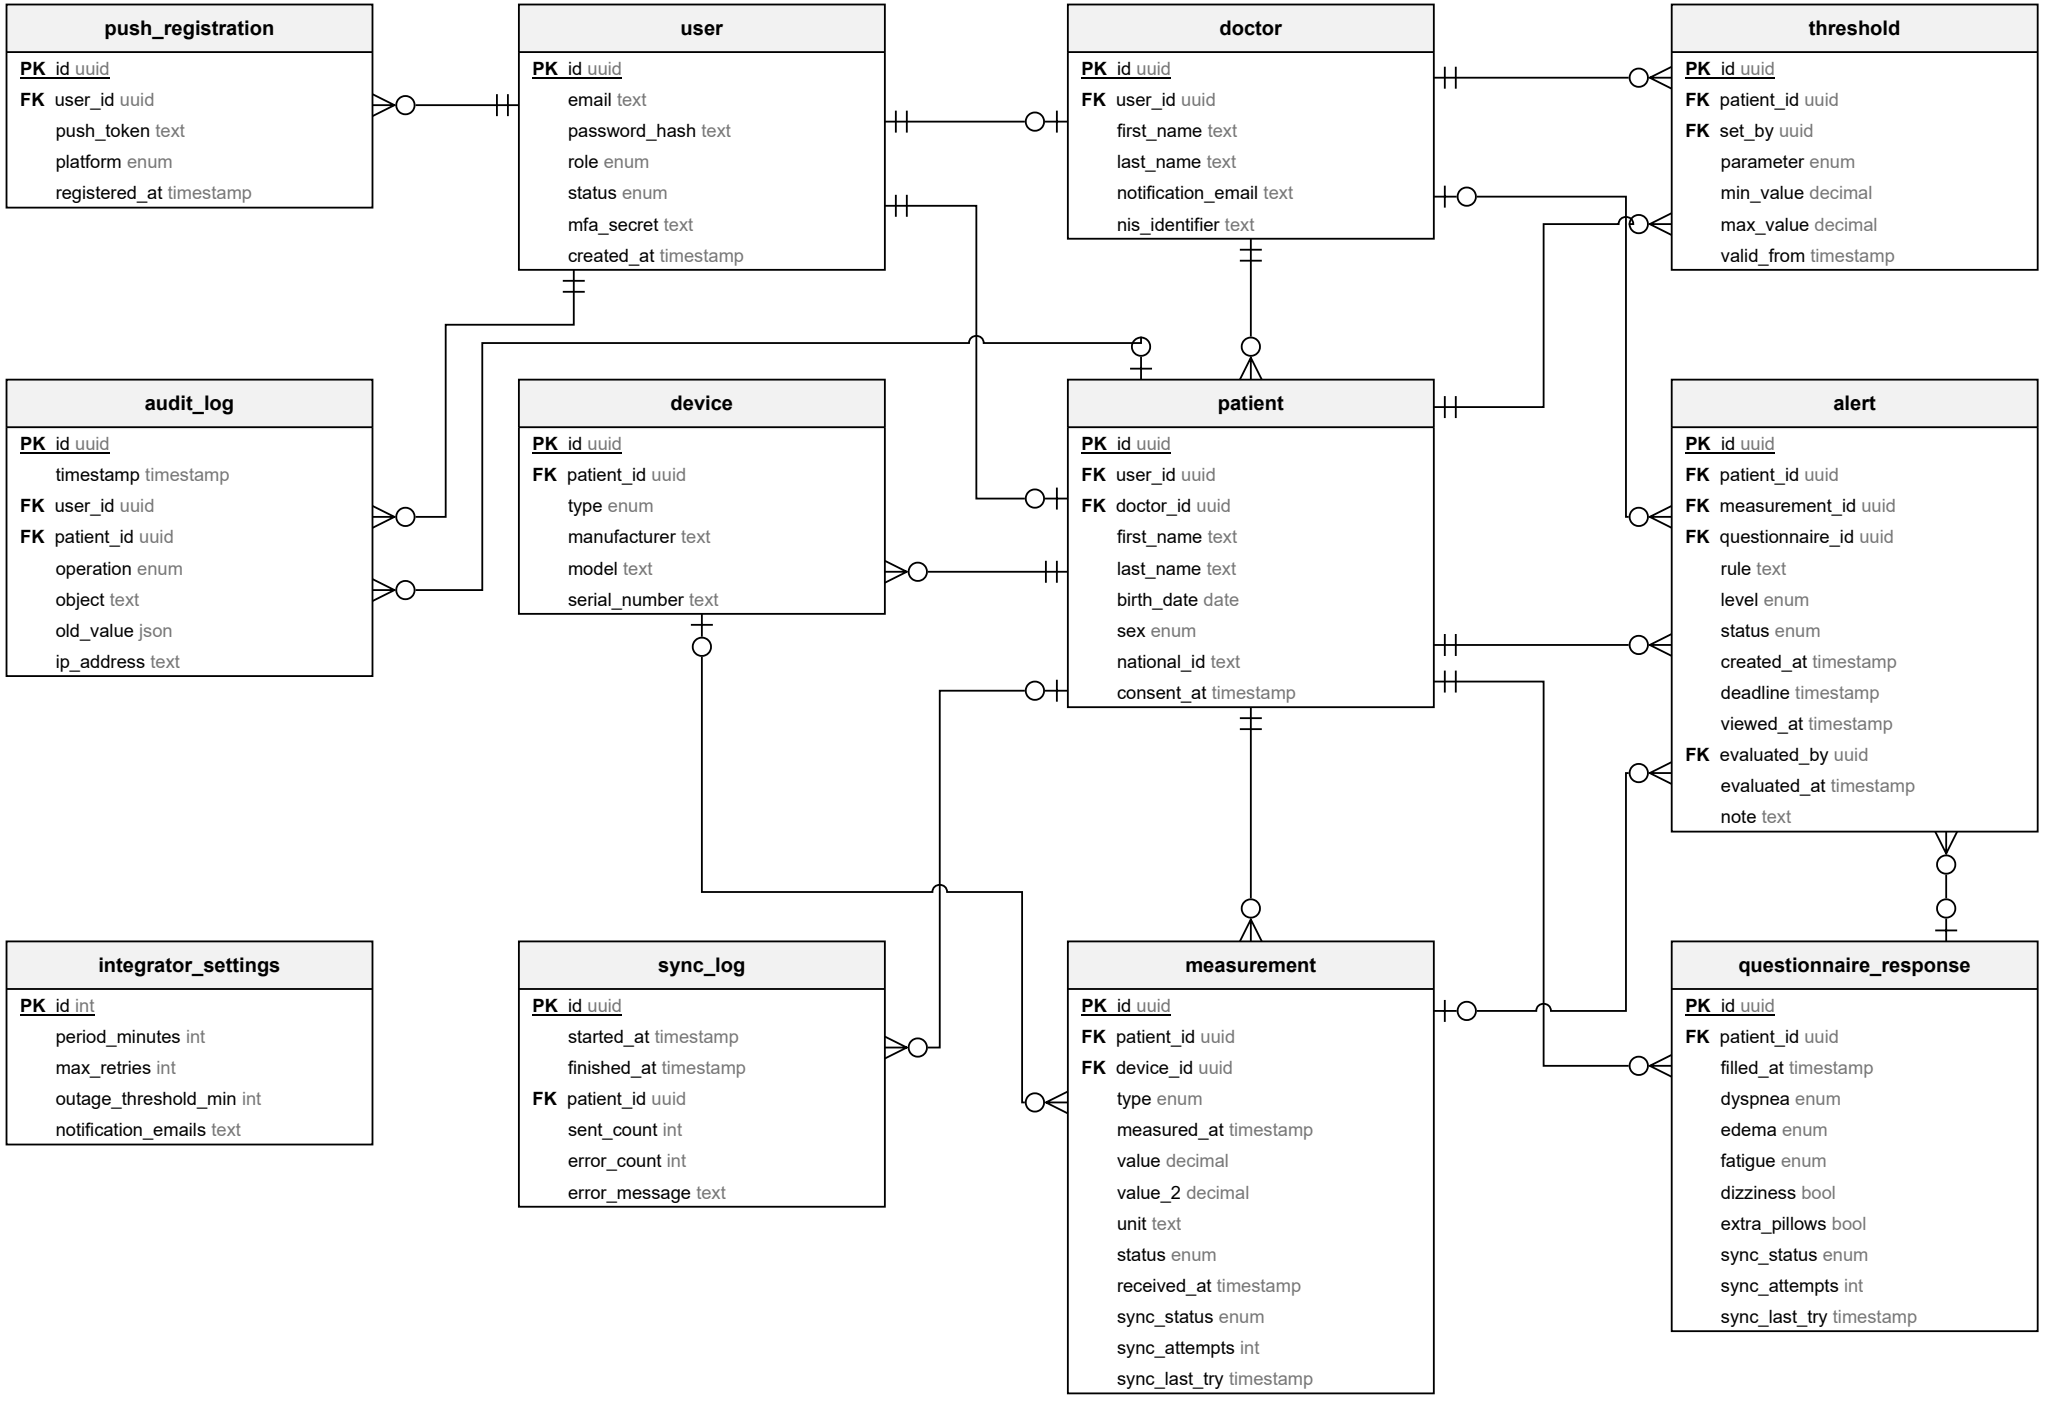

push_registration
PK id uuid
FK user_id uuid
push_token text
platform enum
registered_at timestamp
user
PK id uuid
email text
password_hash text
role enum
status enum
mfa_secret text
created_at timestamp
doctor
PK id uuid
FK user_id uuid
first_name text
last_name text
notification_email text
nis_identifier text
threshold
PK id uuid
FK patient_id uuid
FK set_by uuid
parameter enum
min_value decimal
max_value decimal
valid_from timestamp
audit_log
PK id uuid
timestamp timestamp
FK user_id uuid
FK patient_id uuid
operation enum
object text
old_value json
ip_address text
device
PK id uuid
FK patient_id uuid
type enum
manufacturer text
model text
serial_number text
patient
PK id uuid
FK user_id uuid
FK doctor_id uuid
first_name text
last_name text
birth_date date
sex enum
national_id text
consent_at timestamp
alert
PK id uuid
FK patient_id uuid
FK measurement_id uuid
FK questionnaire_id uuid
rule text
level enum
status enum
created_at timestamp
deadline timestamp
viewed_at timestamp
FK evaluated_by uuid
evaluated_at timestamp
note text
integrator_settings
PK id int
period_minutes int
max_retries int
outage_threshold_min int
notification_emails text
sync_log
PK id uuid
started_at timestamp
finished_at timestamp
FK patient_id uuid
sent_count int
error_count int
error_message text
measurement
PK id uuid
FK patient_id uuid
FK device_id uuid
type enum
measured_at timestamp
value decimal
value_2 decimal
unit text
status enum
received_at timestamp
sync_status enum
sync_attempts int
sync_last_try timestamp
questionnaire_response
PK id uuid
FK patient_id uuid
filled_at timestamp
dyspnea enum
edema enum
fatigue enum
dizziness bool
extra_pillows bool
sync_status enum
sync_attempts int
sync_last_try timestamp