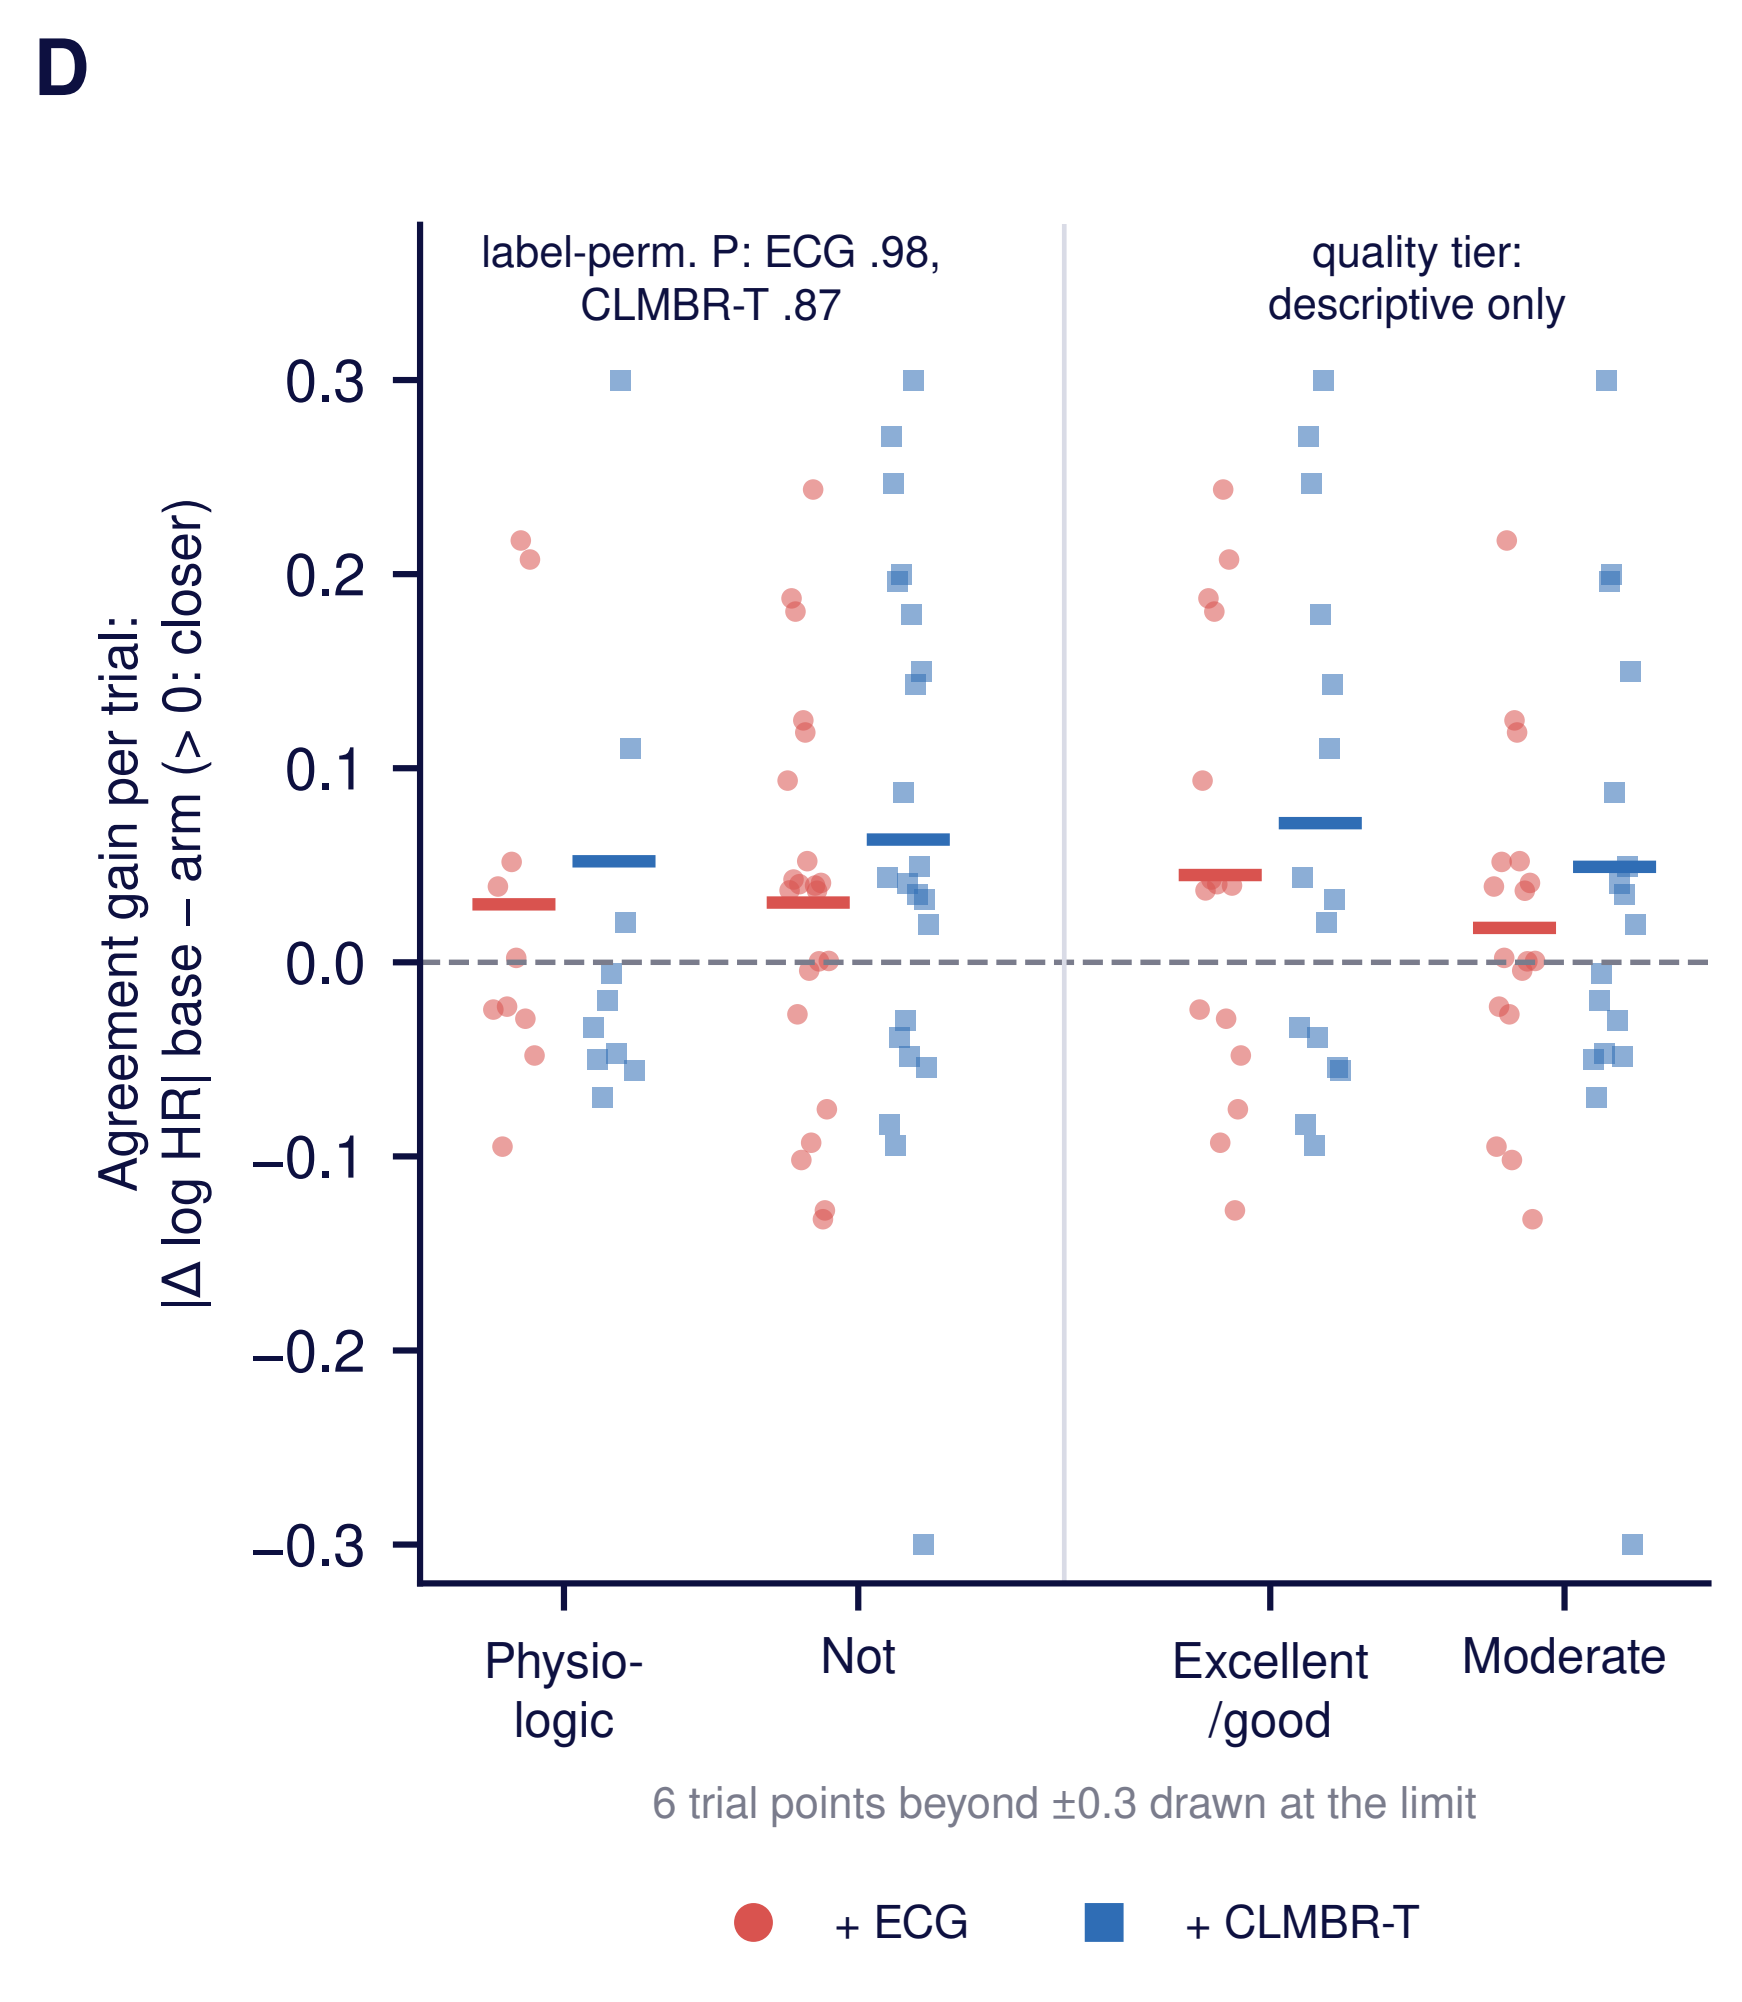
D
label-perm. P: ECG .98, CLMBR-T .87
quality tier: descriptive only
Agreement gain per trial: |Δ log HR| base – arm (> 0: closer)
0.3
0.2
0.1
0.0
−0.1
−0.2
−0.3
Physio-logic
Not
Excellent /good
Moderate
6 trial points beyond ±0.3 drawn at the limit
+ ECG
+ CLMBR-T