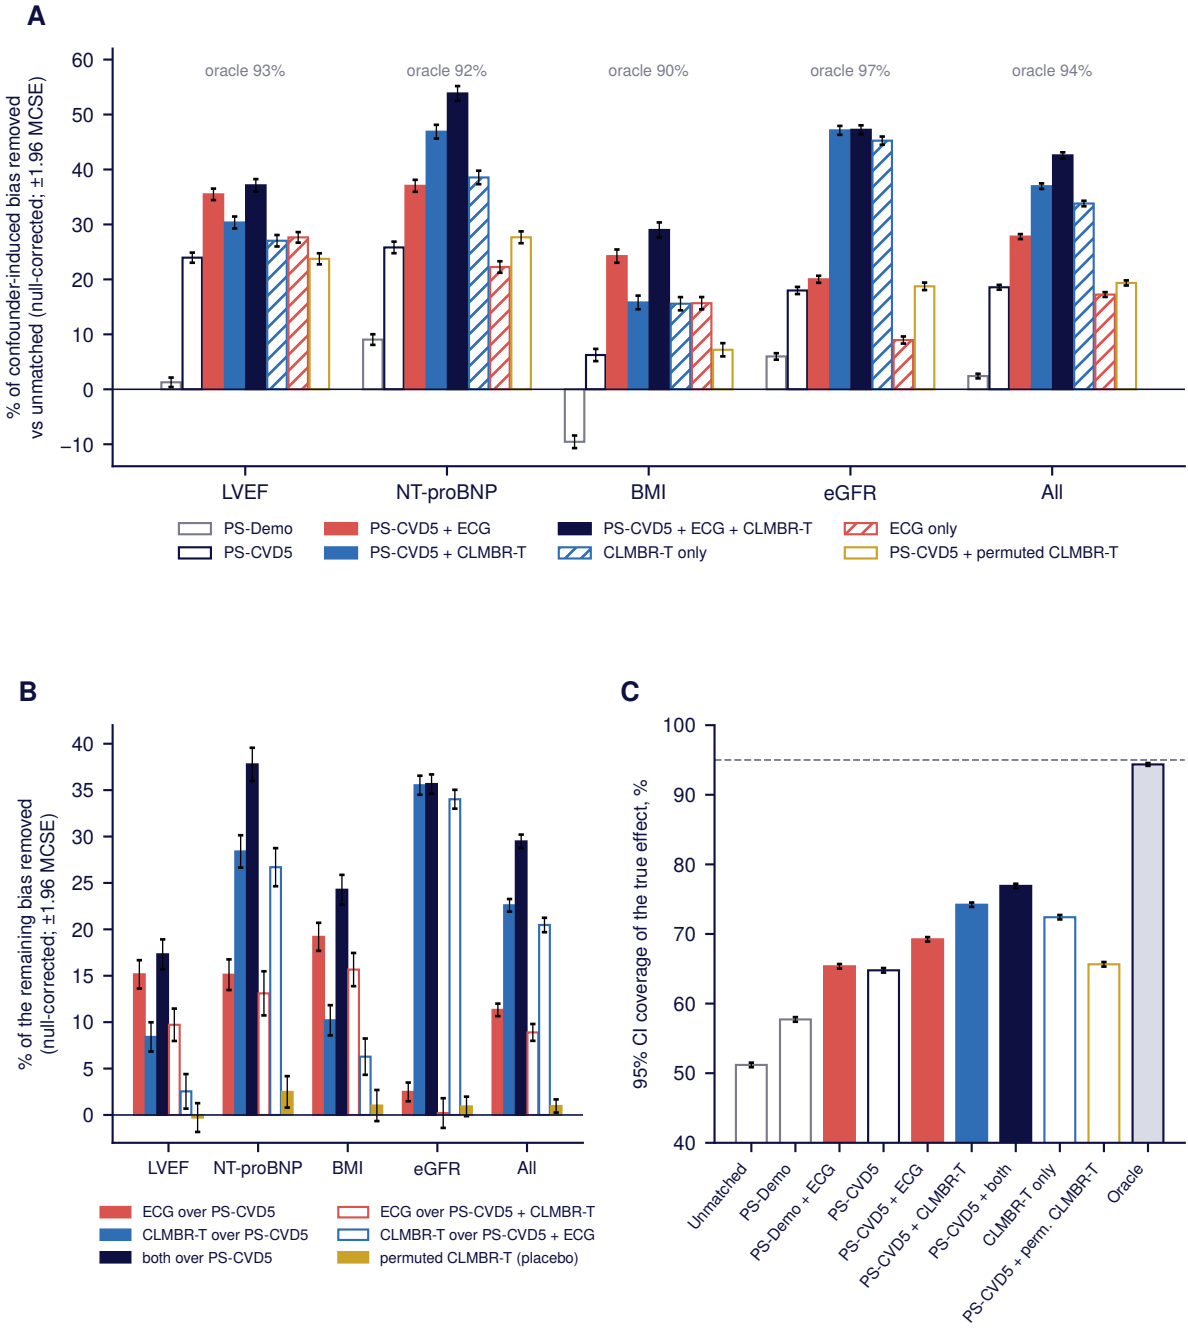
A
oracle 93%
oracle 92%
oracle 90%
oracle 97%
oracle 94%
% of confounder-induced bias removed
vs unmatched (null-corrected; ±1.96 MCSE)
60
50
40
30
20
10
0
−10
LVEF
NT-proBNP
BMI
eGFR
All
PS-Demo
PS-CVD5
PS-CVD5 + ECG
PS-CVD5 + CLMBR-T
PS-CVD5 + ECG + CLMBR-T
CLMBR-T only
ECG only
PS-CVD5 + permuted CLMBR-T
B
% of the remaining bias removed
(null-corrected; ±1.96 MCSE)
40
35
30
25
20
15
10
5
0
LVEF
NT-proBNP
BMI
eGFR
All
ECG over PS-CVD5
CLMBR-T over PS-CVD5
both over PS-CVD5
ECG over PS-CVD5 + CLMBR-T
CLMBR-T over PS-CVD5 + ECG
permuted CLMBR-T (placebo)
C
95% CI coverage of the true effect, %
100
90
80
70
60
50
40
Unmatched
PS-Demo
PS-Demo + ECG
PS-CVD5
PS-CVD5 + ECG
PS-CVD5 + CLMBR-T
PS-CVD5 + both
CLMBR-T only
PS-CVD5 + perm. CLMBR-T
Oracle