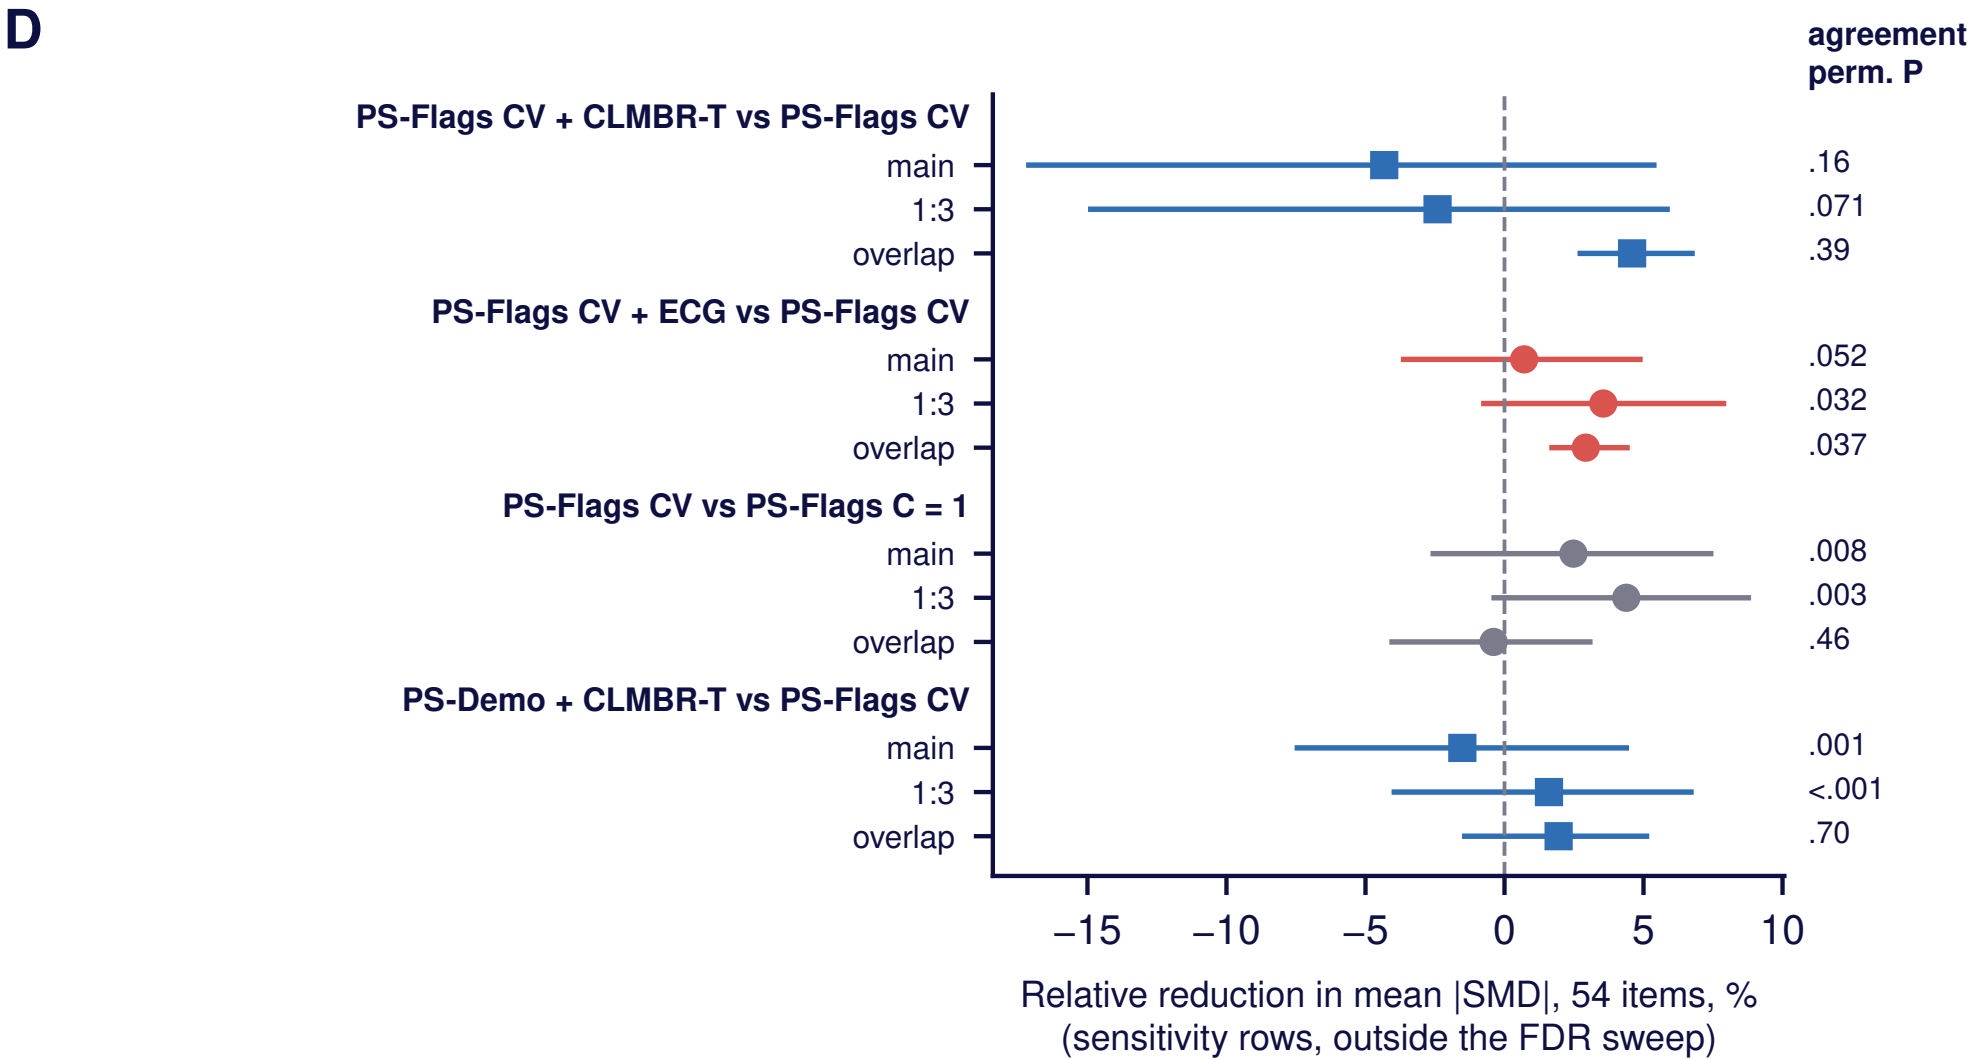
D
agreement
perm. P
PS-Flags CV + CLMBR-T vs PS-Flags CV
main
1:3
overlap
.16
.071
.39
PS-Flags CV + ECG vs PS-Flags CV
main
1:3
overlap
.052
.032
.037
PS-Flags CV vs PS-Flags C = 1
main
1:3
overlap
.008
.003
.46
PS-Demo + CLMBR-T vs PS-Flags CV
main
1:3
overlap
.001
<.001
.70
−15
−10
−5
0
5
10
Relative reduction in mean |SMD|, 54 items, %
(sensitivity rows, outside the FDR sweep)