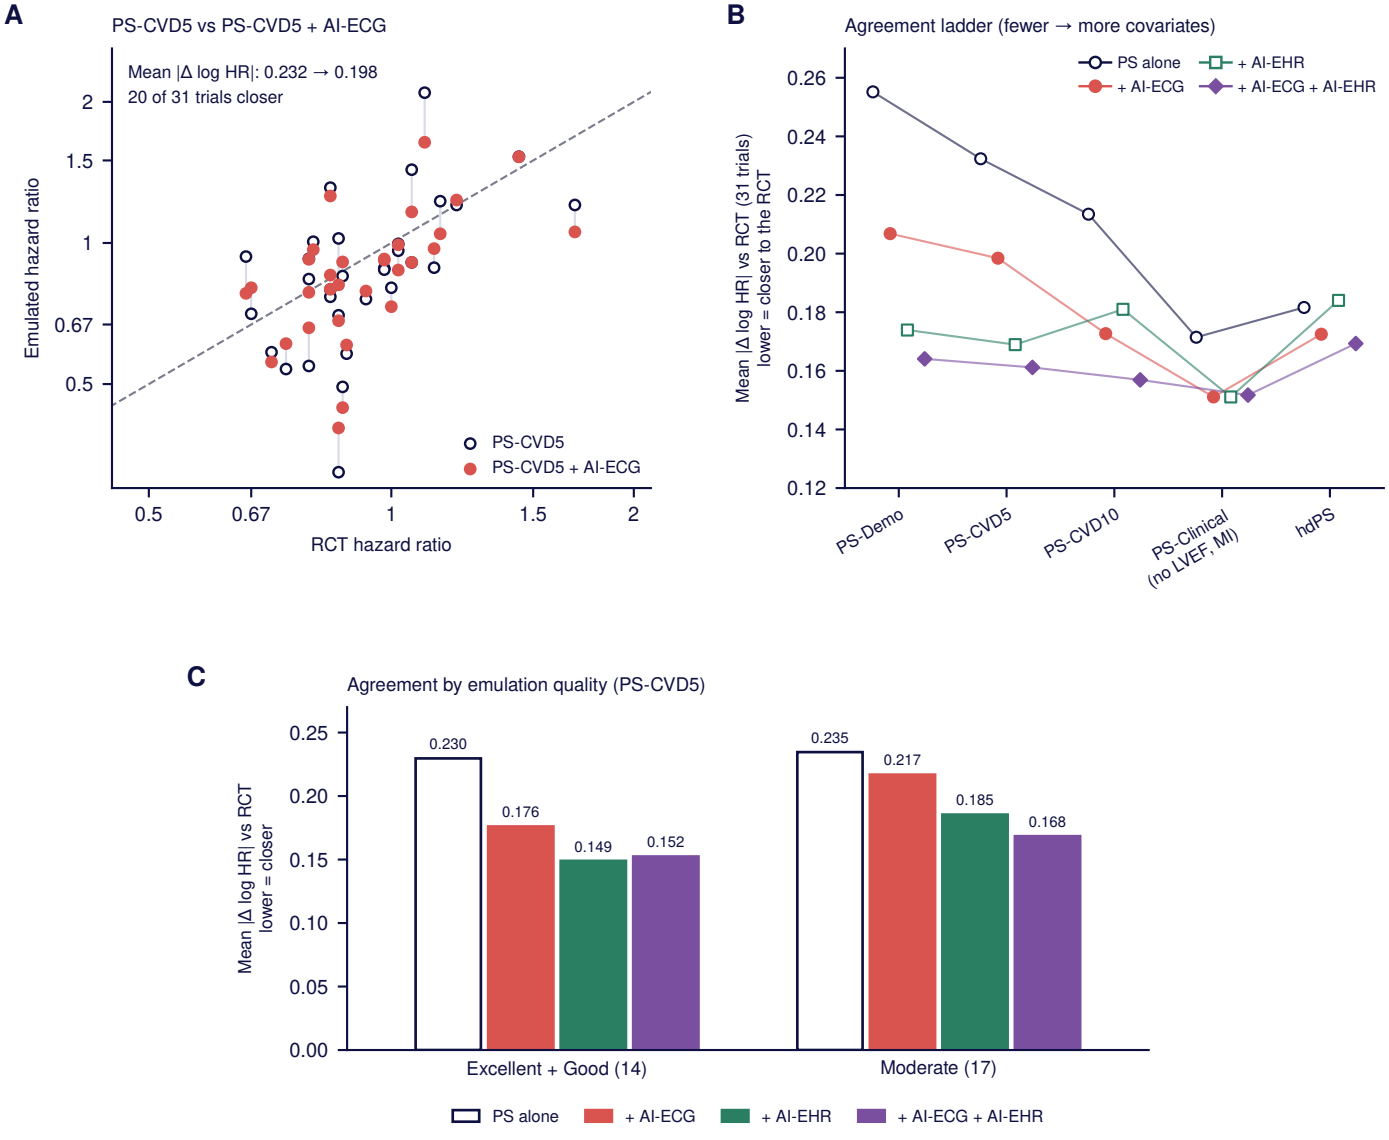
A
PS-CVD5 vs PS-CVD5 + AI-ECG
Mean |Δ log HR|: 0.232 → 0.198
20 of 31 trials closer
Emulated hazard ratio
RCT hazard ratio
2
1.5
1
0.67
0.5
PS-CVD5
PS-CVD5 + AI-ECG
B
Agreement ladder (fewer → more covariates)
Mean |Δ log HR| vs RCT (31 trials)
lower = closer to the RCT
0.26
0.24
0.22
0.20
0.18
0.16
0.14
0.12
PS alone
+ AI-ECG
+ AI-EHR
+ AI-ECG + AI-EHR
PS-Demo
PS-CVD5
PS-CVD10
PS-Clinical
(no LVEF, MI)
hdPS
C
Agreement by emulation quality (PS-CVD5)
Mean |Δ log HR| vs RCT
lower = closer
0.25
0.20
0.15
0.10
0.05
0.00
0.230
0.176
0.149
0.152
0.235
0.217
0.185
0.168
Excellent + Good (14)
Moderate (17)
PS alone
+ AI-ECG
+ AI-EHR
+ AI-ECG + AI-EHR