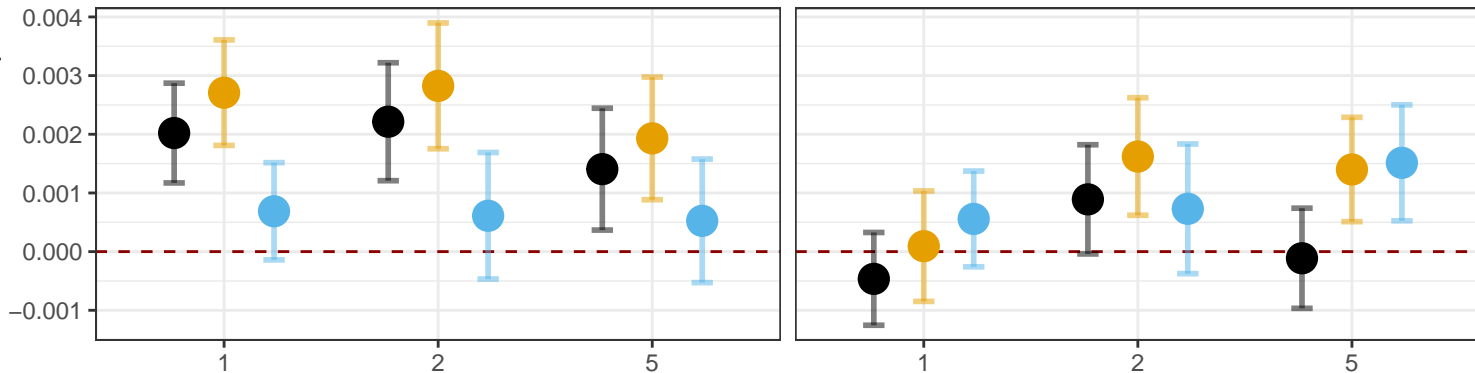Difference in power between starting thresholds by number of CV steps

Points denote averages with intervals for +/− two standard errors