Native measurement-slot availability

Twelve source units; four requested native components per unit

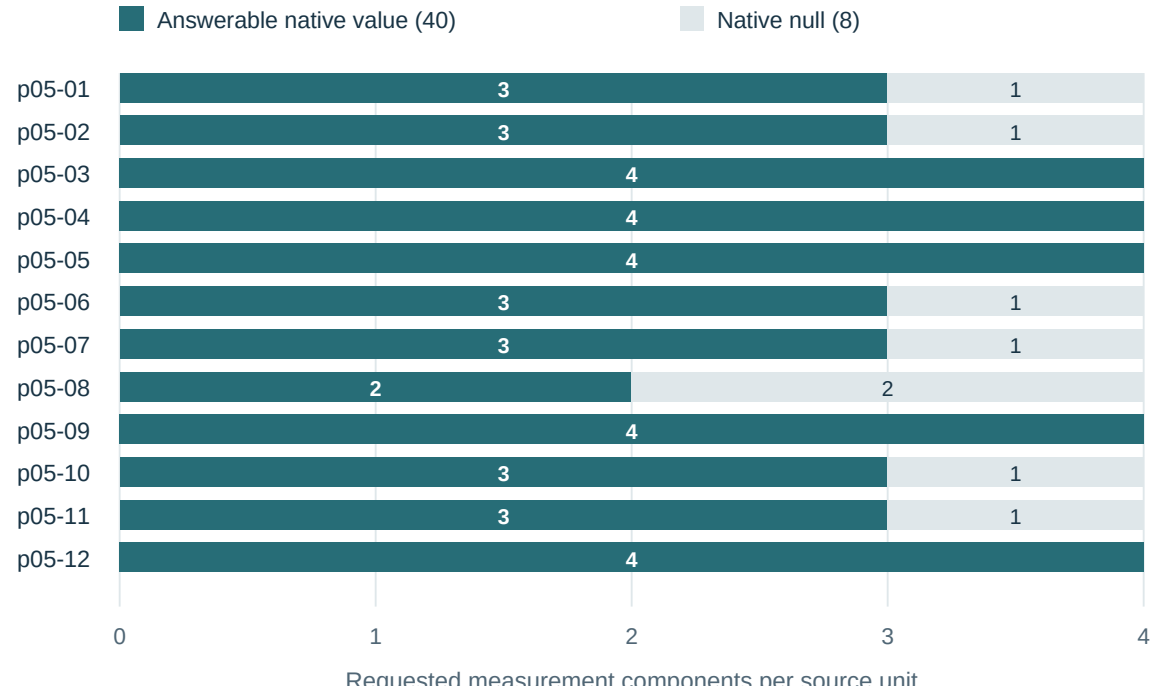

40/48 slots answerable; native nulls are excluded from reporting denominators.

One measurement group per unit; no independent-study or biological inference.