



Situation Context



DISCLAIMER

THIS MODULE IS DESIGNED TO TEST AND REFINE YOUR DECISION MAKING.

THE MODULE USES GENERAL PROCEDURES, REFER TO YOUR RESPECTIVE BUILDING PROTOCOLS AND ADHERE TO THEM DURING DUTY

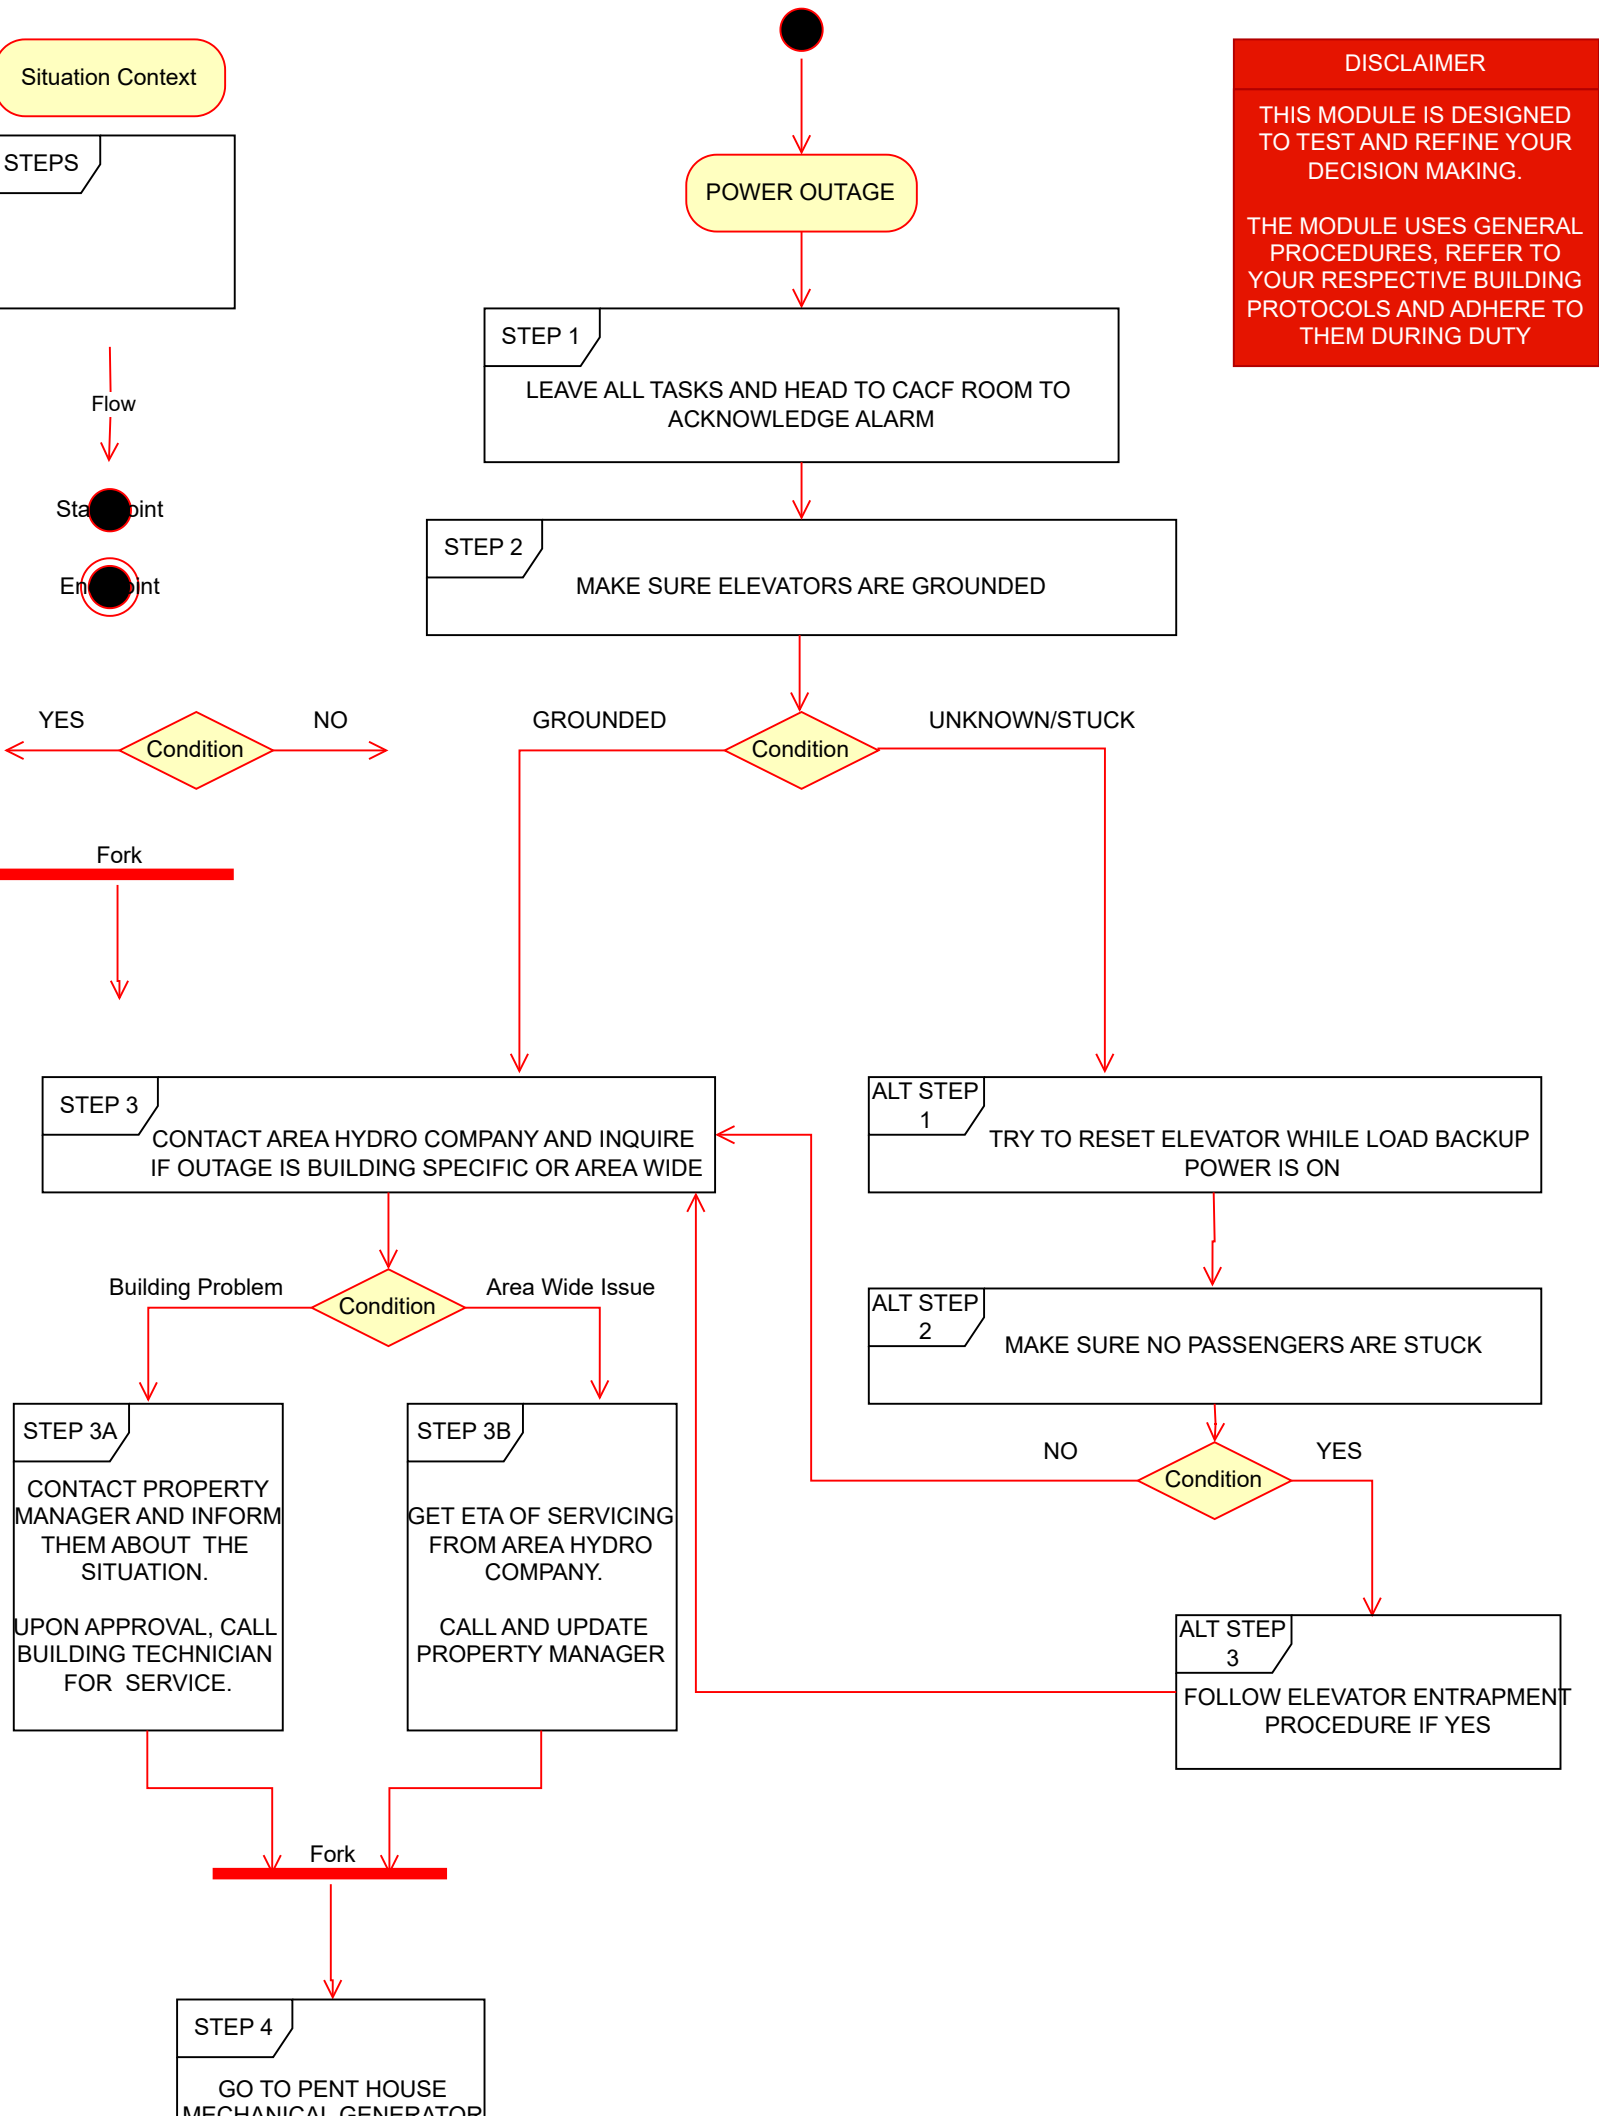

MECHANICAL GENERATOR
ROOM AND CONFIRM
IF BACKUP GENERATOR
IS FUNCTIONAL.

Functional

Not Functional

Condition

STEP 5

STANDBY AND ASSIST ANY
RESIDENTS IN NEED

ALT STEP
4

CALL AND UPDATE PROPERTY
MANAGER ABOUT FAILED
GENERATOR.
UPON APPROVAL, CALL THE
RESPECTIVE CONTRACTORS
TO FIX THE BACKUP
GENERATOR.

STEP 5

STANDBY AND ASSIST ANY
RESIDENTS IN NEED

Fork

STEP 6

UPON RESTORATION OF POWER IN THE BUILDING,
RESET FIRE PANEL.

STEP 7

RESET ELEVATORS & MAGLOCKS IF ANY

STEP 8

MAKE A DETAILED INCIDENT REPORT WITH TIME STAMPS
OF EVERY STEP.

