


Per-field ablation: effect of corrupting individual telemetry fields (r=0.6)

(a) Zero-shot: accuracy when corrupting one field



(b) CoT: accuracy when corrupting one field

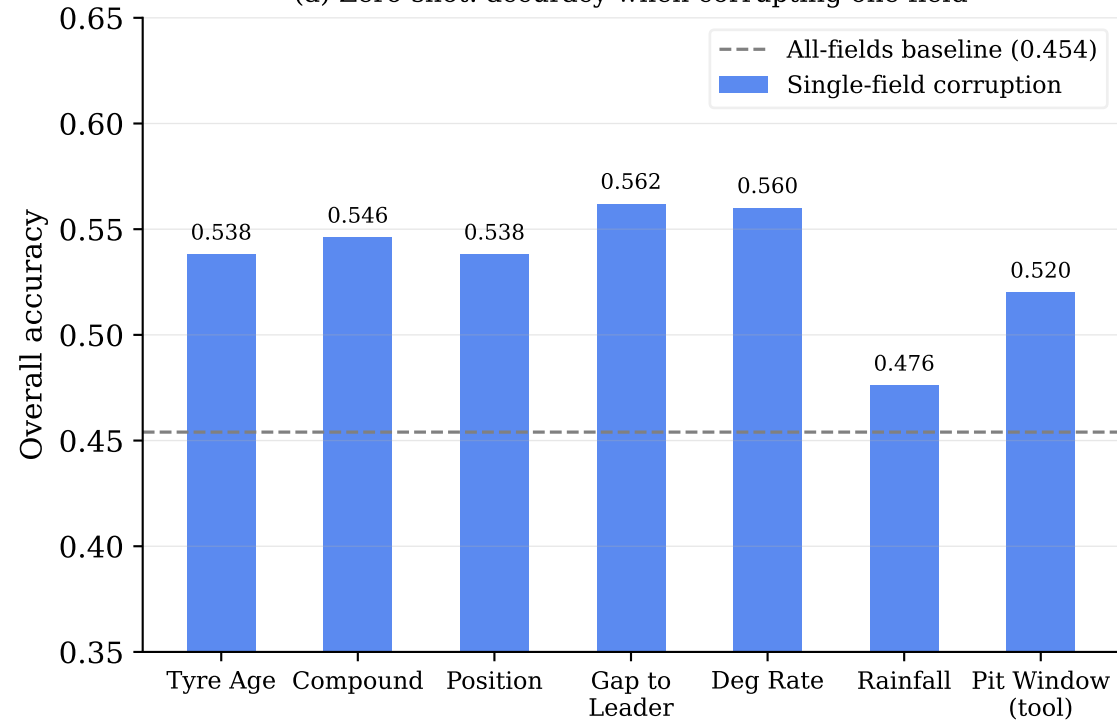