

FOR CONSTRUCTION

LOT 9 - 4 TENTH AVENUE AUSTRAL
PROPOSED CONSTRUCTION OF A SINGLE STOREY DWELLING



BASIX COMMITMENTS		Certificate number: 1865209S_02 Date of issue:Wednesday, 16 September 2026
WATER		
LANDSCAPE	79m2	
TOILETS	4 STARS	
KITCHEN TAPS	4 STARS	
SHOWER HEADS	4 STARS (>4.5 but <=6 Umin)	
BASIN TAPS	4 STARS	
ALTERNATIVE WATER	1500L RAINWATER TANK	
ROOF WATER TO TANK	199m2	
ALT.WATER USES- TANK	LAUNDRY	
ALT. WATER USES - RETIC	ALL TOILETS + ONE OUTDOOR TAP	
SWIMMING POOL	N/A	
ENERGY		
HOT WATER	GAS INSTANTANEOUS - 5 STAR	
AIR-CON (HEATING)	3 PHASE DUCTED - EER 3.0-3.5	
AIR-CON (COOLING)	3 PHASE DUCTED - EER 3.0-3.5	
VENTILATION - BATHROOM	NONE/ NATURAL VENTILATION	
VENTILATION - KITCHEN	DUCTED - MANUAL SWITCH	
VENTILATION - LAUNDRY	NONE/ NATURAL VENTILATION	
PV SYSTEM	N/A	
COOKTOP	GAS	
OVEN	ELECTRIC	
CLOTHES DRYING	OUTDOOR CLOTHESLINE	
LIGHTING	DEDICATED LED	

GENERAL LEGEND

AC	AIR CONDITIONING UNIT
AL	POWDERCOATED ALUMINIUM DOOR/ WINDOW
BAL	BALUSTRADE TYPE
BG	BOX GUTTER
BR1, BR2, etc.	BRICK FACE TYPE
CAP	METAL CAPPING
CD1, CD2, etc.	WALL CLADDING
CONC.	CONCRETE FLOOR
CPT	CARPET
CRT	CONCRETE ROOF TILES
CR1, CR2, etc.	CEMENT RENDER TYPE/ COLOUR
DP/S	DOWN PIPE
DW	DISH WASHER
ED	ENTRY DOOR
F	FRIDGE
FAS	FASCIA
FET	FEATURE TILE
FT, FT1, FT2, etc.	FLOOR TILES
FW	FLOOR WASTE
GD	GARAGE DOOR
GUT	GUTTER
HWU	HOT WATER UNIT
HYB	HYBRID FLOOR
L	LINEN
MR	METAL ROOF
MW	MICROWAVE OVEN
NGL	NATURAL GROUND LEVEL
OBS	OBSCURED GLASS
P	PANTRY
R	ROBE
RL	REDUCED LEVEL
RWH	RAIN WATER HEAD
RWT	RAIN WATER TANK
S	STORAGE
TOW	TOP OF WALL
TL	TIMBER LAMINATE
WC	WATER CLOSET
WM	WASHING MACHINE
SD	SMOKE DETECTOR

Sheet List			
Sheet No.	Sheet Name	Current Revision Date	Revision
CDC.01	COVER SHEET	31-08-2026	CDC ISSUE
CDC.02A	GENERAL NOTES	31-08-2026	CDC ISSUE
CDC.02B	GENERAL NOTES 02	31-08-2026	CDC ISSUE
CDC.03	LOCATION PLAN AND SITE PLAN	31-08-2026	CDC ISSUE
CDC.04	SITE ANALYSIS AND SEDIMENT CONTROL	31-08-2026	CDC ISSUE
CDC.05	GROUND FLOOR PLAN	31-08-2026	CDC ISSUE
CDC.07	ROOF PLAN	31-08-2026	CDC ISSUE

Sheet List			
Sheet No.	Sheet Name	Current Revision Date	Revision
CDC.08	ELEVATION 01	31-08-2026	CDC ISSUE
CDC.09	ELEVATION 02	31-08-2026	CDC ISSUE
CDC.10	SECTIONS	31-08-2026	CDC ISSUE
CDC.11	FLOOR AREA PLAN	31-08-2026	CDC ISSUE
CDC.12	RENTABLE AREA PLAN	31-08-2026	CDC ISSUE
CDC.14	COLOR SCHEDULE	31-08-2026	CDC ISSUE
CDC.15	LANDSCAPE PLAN	31-08-2026	CDC ISSUE
CDC.18	WATERPROOFING DETAILS	31-08-2026	CDC ISSUE
CDC.20	CUT/FILL PLAN	31-08-2026	CDC ISSUE

NOTE.: ALL IMAGES ARE FOR ILLUSTRATION ONLY AND ARE SUBJECT TO VARIATION AS PER SITE CONDITION, STRUCTURAL ELEMENT AND TO AVAILABILITY OF MATERIALS.

4	31-08-2026	CDC ISSUE	
3	16-06-2026	Area increased to 160 Sq.m Living room, Bedroom and WIR extended and Linen area also incorporated next to WIR. - Ekta	
2	12-06-2026	Area Increased by 5 Sq.m to 153 Sq.m. Living Room Increased to 4.5m, WIR added to M.Bed, All Bedroom Sizes reduced to accomodate the size increase - Ekta/Roshan	
1	10-06-2026	Concept Issue	
REV	DATE	DESCRIPTION	BY



THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:
LOT 9 - 4 Tenth Ave

4 Tenth Avenue Austral

DRAWING TITLE:
COVER SHEET

NORTH:

LOT NO:
9

DRAWN BY:
AS

DRAFTED BY:
RS

DATE:
22-09-2026

CHECKED BY:
RH

SCALE:

As indicated

DRAWING No:
CDC.01

REV:
4

ISSUED BY:

CLIENT NAME:
GOVINDA PRASAD GAUDEL & PRATIVA KHAREL GAUDEL

CDC ISSUE

A3

BUILDING SPECIFICATIONS

**National Construction Code – Volume 2,
Amendment 1 – Building Code of Australia 2022
& Housing Provisions Standard 2022**

SITE PREPARATION

- PART 3.1 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022

EARTHWORKS

- TO BE CARRIED OUT IN ACCORDANCE WITH THE REQUIREMENTS OF THE ENVIRONMENTAL PLANNING & ASSESSMENT ACT 1979 AND DEVELOPMENT CONSENT CONDITIONS
- PART 3.2 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 4678:2002 - EARTH-RETAINING STRUCTURES

DRAINAGE

- PART 3.3 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS/NZS 3500.1:2021 - PLUMBING & DRAINAGE - WATER SERVICES
- AS/NZS 3500.2:2021 - PLUMBING & DRAINAGE - SANITARY PLUMBING & DRAINAGE
- AS/NZS 3500.3:2021 - PLUMBING & DRAINAGE - STORMWATER DRAINAGE
- AS/NZS 3500.4:2021 - PLUMBING & DRAINAGE - HEATED WATER SERVICES

STRUCTURAL WORK

- Part 2.2 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 4100:2020 - STEEL STRUCTURES CODES
- AS/NZS 1170.0:2002 - GENERAL PRINCIPLES
- AS/NZS 1170.1:2002 - PARTS 1 PERMANENT, IMPOSED AND OTHER ACTIONS
- AS/NZS 1170.2:2021 - PART 2 WIND ACTIONS
- AS 3700:2018 - SAA MASONRY CODE
- AS 1684.3:2021 - RESIDENTIAL TIMBER FRAMED CONSTRUCTION

FOOTINGS & SLABS

- PART 4 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 2159:2009 - PILING - DESIGN & INSTALLATION
- AS 2870:2011 - RESIDENTIAL SLABS & FOOTINGS
- AS 3600:2018 - CONCRETE STRUCTURES

MASONRY

- PART 5 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 3700:2018 - MASONRY STRUCTURES
- PART 6 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 1684.2:2021 - RESIDENTIAL TIMBER-FRAMED CONSTRUCTION - NON-CYCLONIC AREAS
- AS 1720.1:2010 - TIMBER STRUCTURES - DESIGN METHODS
- AS 4100:2020 - STEEL STRUCTURES
- AS 3660.1:2014 - TERMITE MANAGEMENT SYSTEM

ROOF & WALL CLADDING

- PART 7 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 1273:1991 - UNPLASTICIZED PVC (UPVC) DOWNPIPES & FITTINGS FOR RAINWATER
- AS 1562.1:2018 - DESIGN & INSTALLATION OF SHEET ROOF & WALL CLADDING - METAL
- AS/NZS 1562.3:2006 - DESIGN & INSTALLATION OF SHEET ROOF & WALL CLADDING - PLASTIC
- AS 2049:2002 - ROOF TILES
- AS 2050:2018 - INSTALLATION OF ROOF TILES
- AS 4285:2019 - ROOFLIGHTS

GLAZING

- PART 8 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 1288:2021 - GLASS IN BUILDINGS - SELECTION & INSTALLATION
- AS 2047:2014 - WINDOWS & EXTERNAL GLAZED DOORS IN BUILDINGS
- AS/NZS 2208:1996 - SAFETY GLAZING MATERIALS IN BUILDINGS

FIRE SAFETY

- PART 9 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 3786:2014 - SMOKE ALARMS USING SCATTERED LIGHT, TRANSMITTED LIGHT OR IONIZATION

HEALTH & AMENITY

- PART 10 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS/NZS ISO 717.1:2004 - ACOUSTICS - RATING OF SOUND INSULATION IN BUILDINGS & OF BUILDING ELEMENTS - AIRBORNE SOUND INSULATION
- AS ISO 717.2:2004 - ACOUSTICS - RATING OF SOUND INSULATION IN BUILDINGS & OF BUILDING ELEMENTS - IMPACT SOUND INSULATION
- AS 1668.2:2012 - THE USE OF VENTILATION & AIR CONDITIONING IN BUILDINGS - MECHANICAL VENTILATION IN BUILDINGS
- AS 1668.4:2012 - THE USE OF VENTILATION & AIR CONDITIONING IN BUILDINGS - NATURAL VENTILATION OF BUILDINGS
- AS/NZS 1680.0:2009 - INTERIOR LIGHTING - SAFE MOVEMENT
- AS 3740:2021 - WATERPROOFING OF DOMESTIC WET AREAS
- AS 3000:2018 - ELECTRICAL INSTALLATION
- BCA Part 10.8.1, AS4200.1 & AS4200.2 - PLIABLE BUILDING MEMBRANE INSTALLED.

WATERPROOFING

- PART 10.2 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022
- AS 3740:2021 - WATERPROOFING TO WET AREA
- AS 4654:2012 - EXTERNAL WET AREAS

SAFE MOVEMENT & ACCESS

- PART 11 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 1428.1:2009 - DESIGN FOR ACCESS & MOBILITY - GENERAL REQUIREMENTS FOR ACCESS - NEW BUILDING WORK
- AS 1657:2018 - FIXED PLATFORMS, WALKWAYS, STAIRWAYS & LADDERS - DESIGN, CONSTRUCTION & INSTALLATION

HANDRAILS & BALUSTRADE

- PART 11.3.3 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- PART 11.3.4 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- PART 11.3.5 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 1170.1:2002 - BALUSTRADE INSTALLATION

PROTECTION OF OPENABLE WINDOW


PART 11.3.7 AND 11.3.8 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.

ENERGY EFFICIENCY

- PART 13 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022 & BASIX CERTIFICATE.

MECHANICAL VENTILATION

- EXHAUST FROM A BATHROOM, SANITARY COMPARTMENT TO DISCHARGE DIRECTLY TO OUTDOOR AIR WITH MINIMUM FLOW RATE OF 25L/S & MAKE-UP AIR VIA OPENINGS TO AN ADJACENT ROOM WITH A FREE AREA OF 14,000 MM². THIS EXHAUST SYSTEM MUST BE INTERLOCKED WITH LIGHT SWITCH AND INCLUDE RUN-ON TIMER SO THAT THE EXHAUST SYSTEM CONTINUES TO OPERATE FOR 10 MINUTES AFTER THE LIGHT SWITCH IS OFF.
- ANY INSTALLED - KITCHEN RANGEHOOD EXHAUST TO DISCHARGE DIRECTLY OR VIA DUCT TO OUTDOOR AIR WITH MINIMUM FLOW RATE OF 40L/S & MAKE-UP AIR VIA OPENINGS TO AN ADJACENT ROOM WITH A FREE AREA OF 14,000 MM².
- LAUNDRY EXHAUST TO DISCHARGE DIRECTLY OR VIA DUCT TO OUTDOOR AIR WITH MINIMUM FLOW RATE OF 40L/S & MAKE-UP AIR VIA OPENINGS TO AN ADJACENT ROOM WITH A FREE AREA OF 14,000 MM².

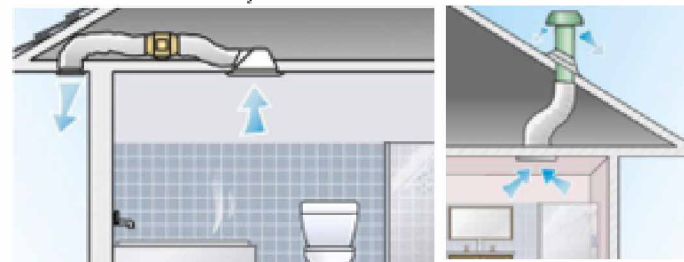

REV	DATE	DESCRIPTION	BY
4	31-08-2026	CDC ISSUE	



THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:	DRAWING TITLE:	NORTH:	LOT NO:	DATE:	SCALE:	DRAWING No:	REV:
LOT 9 - 4 Tenth Ave	GENERAL NOTES		9	22-09-2026	1 : 2	CDC.02A	4
4 Tenth Avenue Austral			DRAWN BY:	CHECKED BY:			ISSUED BY:
			AS	RH			
			DRAFTED BY:	CLIENT NAME:			
			RS	GOVINDA PRASAD GAUDEL & PRATIVA KHAREL GAUDEL			

TERMITE SHEET

- TERMITE SHEET EXTENDS THROUGH THE ENTIRE MASONRY LEAF AND IS VISIBLE AT THE FINISHED FACE OF THE WALL.


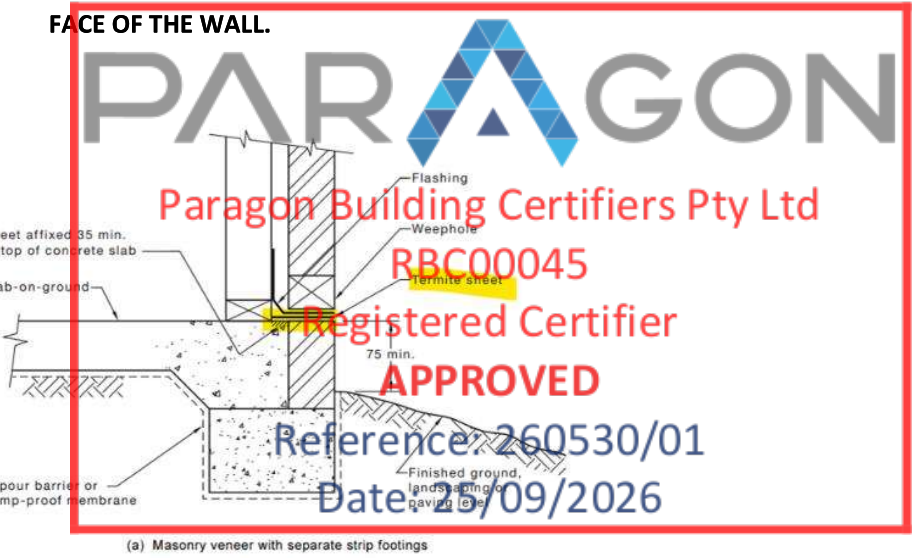





FIGURE 5.5 (in part) TYPICAL SHEET INSTALLATION TO EXTERNAL WALL WITH CONCRETE FLOOR SLAB

DPC FOR BRICKS


DAMP-PROOF COURSE (DPC) TO EXTENDS THROUGH THE ENTIRE MASONRY LEAF AND NEED TO BE VISIBLE AT THE FINISHED FACE OF THE WALL FROM OUTSIDE

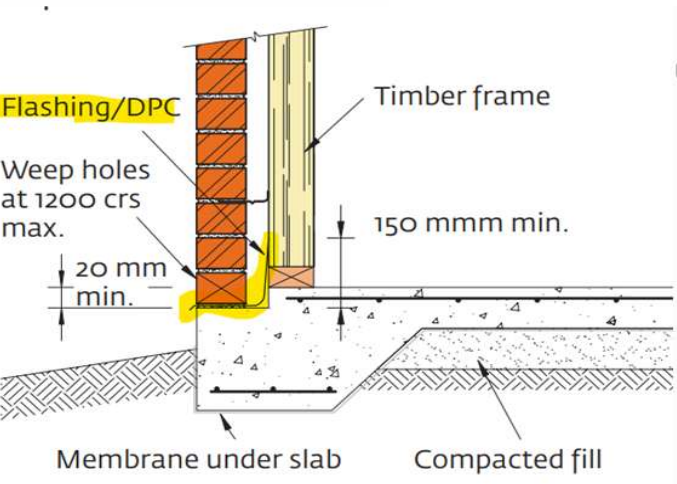

WATERPROOFING
FALL TO FLOOR WASTE TO BE MINIMUM 1:80 TO MAXIMUM 1:50

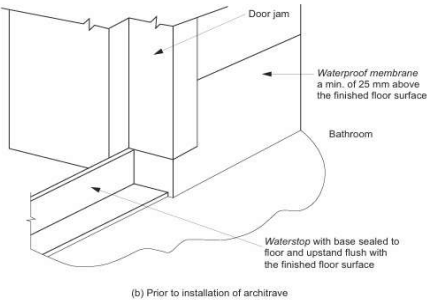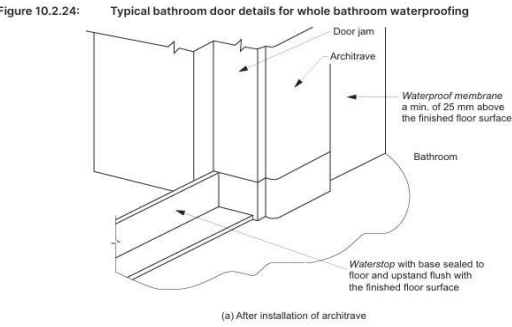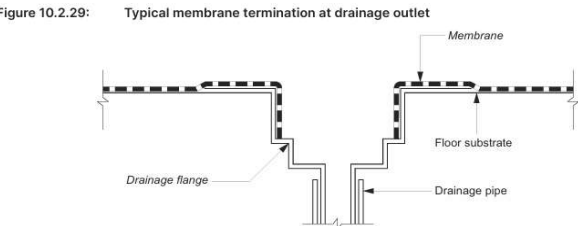

BASIN & BATHTUB:

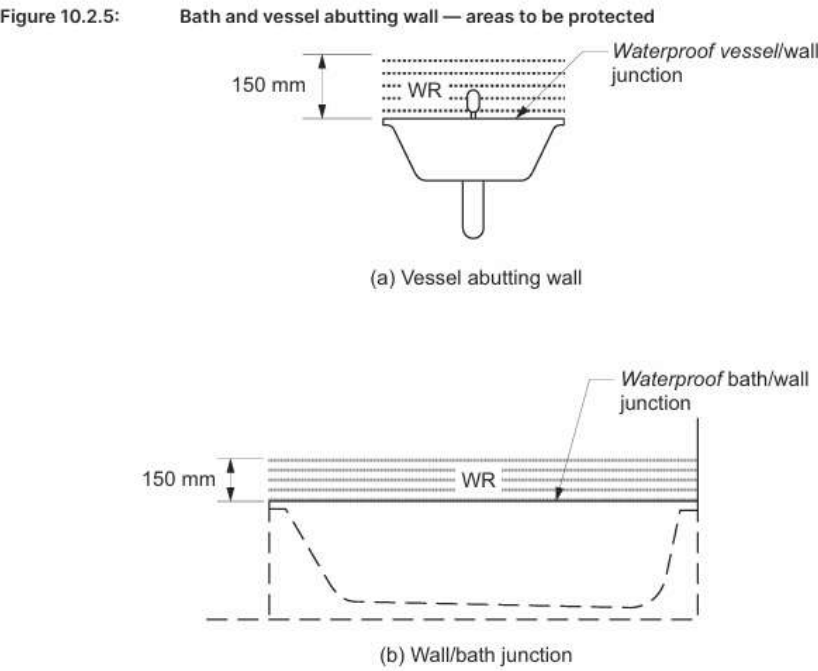

PLANTER BOX

REFER BELOW DETAILS FOR PLANTER BOX.


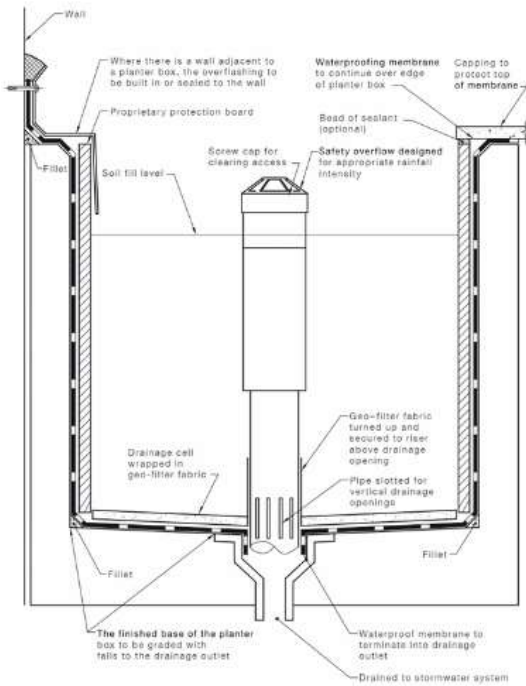


FIGURE 2.17 TYPICAL PLANTER BOX CONSTRUCTION

ENCLOSED SHOWER AREA




REV	DATE	DESCRIPTION	BY
4	31-08-2026	CDC ISSUE	

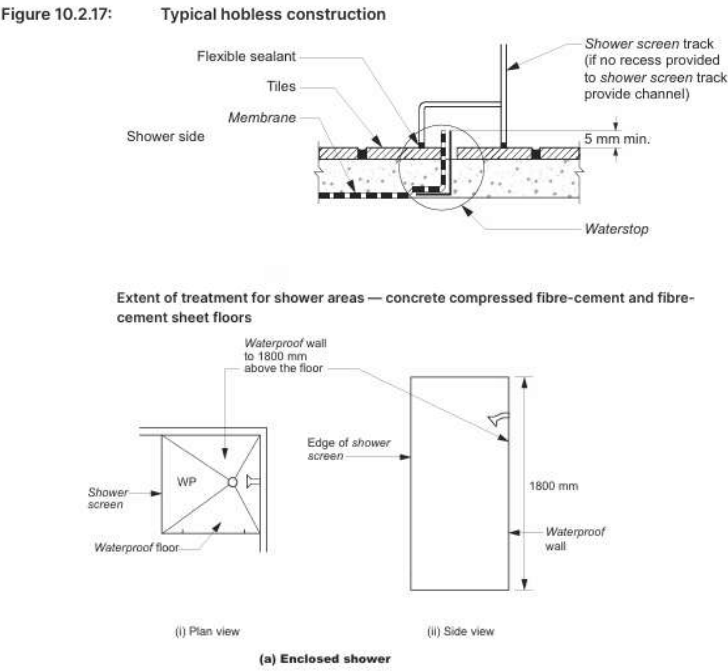

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:	DRAWING TITLE:	NORTH:	LOT NO:	DATE:	SCALE:	DRAWING No:	REV:
LOT 9 - 4 Tenth Ave	GENERAL NOTES		9	22-09-2026	1 : 2	CDC.02B	4
4 Tenth Avenue Austral	02		DRAWN BY:	CHECKED BY:			ISSUED BY:
			AS	RH			
			DRAFTED BY:	CLIENT NAME:			
			RS	GOVINDA PRASAD GAUDEL & PRATIVA KHAREL GAUDEL			


BAL – 12.5

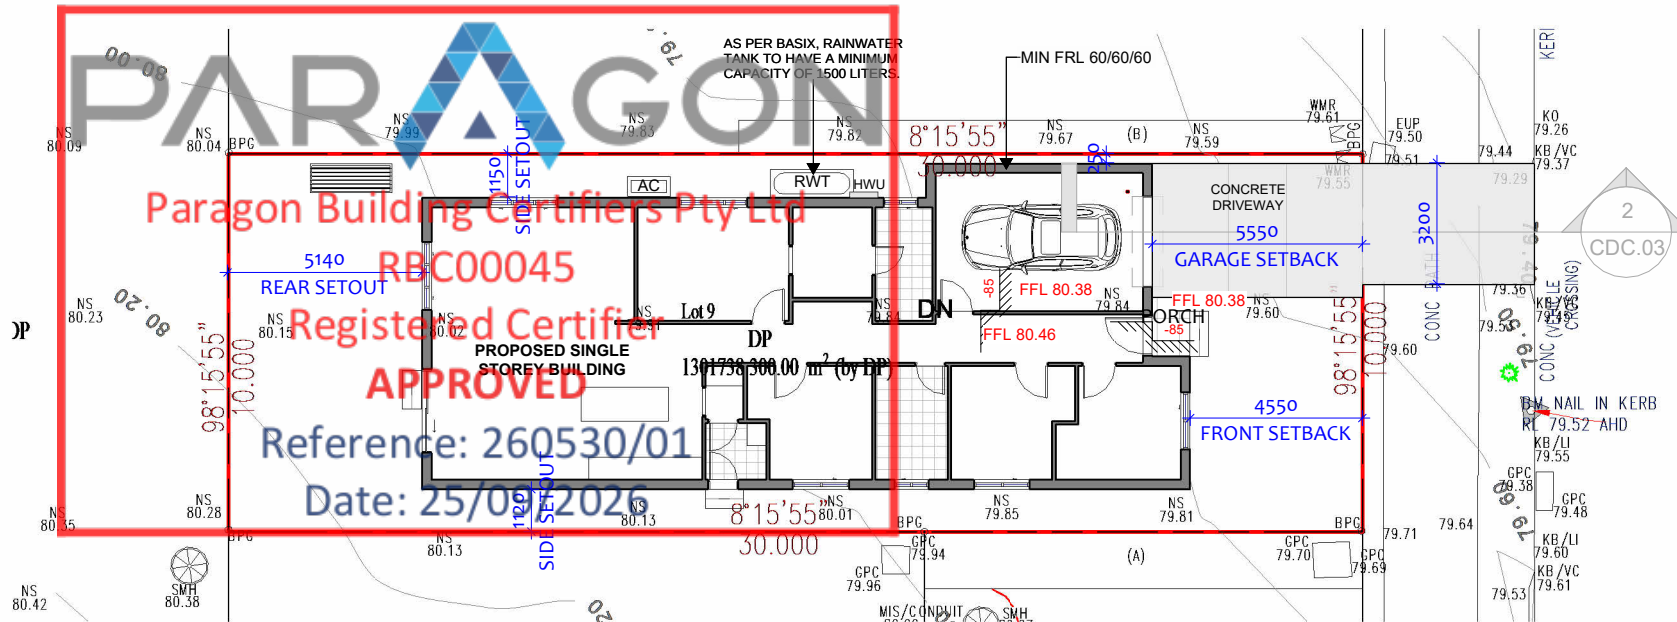

CDC - SITE PLAN

1

1 : 200

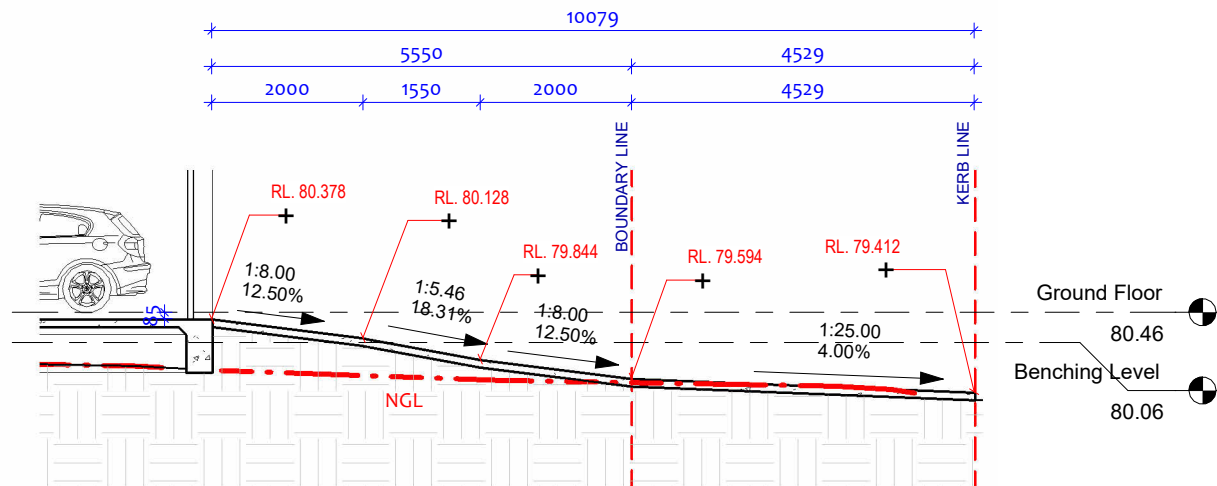

DRIVEWAY SECTION

2

1 : 100

Construction Requirements for BAL 12.5

Construction to comply with Section 3 and Clause 5.2 to 5.8 of AS 3959:2018 & Planning for Bushfire Protection. For full construction requirements, refer to AS 3959:2018 & Planning for Bushfire Protection 2019.

Floor:

- Concrete slab on ground

Walls:

- Wall that are less than 400mm from the ground or decks to be of masonry veneer or precast/in situ walls of concrete or aerated concrete or cladding fixed to timber framed and is non-combustible material or fibre-cement with minimum 6mm thickness.

Joints:

- All joint in the external surface material of wall to be covered, sealed, overlapped, backed or butt jointed.

Vents and Weepholes:

- Vents and weepholes in external walls shall be screened with a mesh made of corrosion-resistant steel, bronze or aluminium.

External glazed elements, assemblies and doors:

- Window glazing less than 400mm from the ground or decks to be Grade A safety glass of minimum 4mm thickness.
- Fitted with screens made from steel, bronze or aluminium to openable portion of windows.
- Window frame less than 400mm from the ground or decks to be made from metal or bushfire resisting timber.
- External Door to be of non-combustible or solid timber, laminated timber or reconstituted timber, having a minimum thickness of 35 mm for the first 400 mm above the threshold or hollow core, solid timber, laminated timber or reconstituted timber with a non-combustible kickplate on the outside for the first 400 mm above the threshold.
- Door frame to be of bushfire resisting timber or metals. Where doors incorporate glazing, the glazing shall be Grade A safety glass a minimum of 4 mm in thickness
- Seals and weather strips Weather strips, draught excluders or draught seals shall be installed.
- Sliding door frame to be of metal.
- Garage door within 400mm of ground to be of non-combustible construction and protected with suitable weather strips or brushes.

Roof:

- Roof tiles/sheet to be non-combustible.
- Roof/wall and roof/roof junctions to be sealed.
- Roof ventilation opening to be fitted with ember guards made of non-combustible material.
- Tile roof to be fully sharked.
- Sheet roof
 - Sheet roofs shall:
 - a. be fully sarked in accordance with Clause 5.6.2, except that foil-backed insulation blankets may be installed over the battens; or
 - b. have any gaps sealed at the fascia or wall line, hips and ridges by:
 - i) a mesh or perforated sheet that conforms with Clause 3.6 and that is made of corrosion-resistant steel, bronze or aluminium; or
 - ii) mineral wool; or
 - iii) other non-combustible material; or
 - iv) a combination of any of Items (i), (ii) or (iii).
- Roof penetrations, including roof lights, roof ventilators, roof-mounted evaporative cooling units, aerials, vent pipes and supports for solar collectors or the like, shall be sealed. The material used to seal the penetration shall be non-combustible.
- Glazed elements in roof lights and skylights may be of polymer provided a Grade A safety glass diffuser, that conforms with AS 1288, is installed under the glazing. Where glazing is an insulating glazing unit (IGU), Grade A toughened safety glass of minimum 4 mm in thickness shall be used in the outer pane of the IGU.
- Eaves ventilation openings shall be fitted with ember guards in accordance with Clause 3.6 and made of corrosion-resistant steel, bronze or aluminium.

Decks:

- Decking, stair treads and the trafficable surfaces of ramps and landings less than 300 mm (measured horizontally at deck level) from glazed elements that are less than 400 mm (measured vertically) from the surface of the deck (see Figure D2, Appendix D) shall be made from non-combustible material or bushfire-resisting timber.

Water and gas supply pipes:

- Above-ground, exposed water supply pipes shall be metal. External gas pipes and fittings above ground shall be of steel or copper construction having a minimum wall thickness in accordance with gas regulations or 0.9 mm whichever is the greater. The metal pipe shall extend a minimum of 400 mm within the building and 100 mm below ground.

- At the commencement of building works and in perpetuity, the approved Asset Protection Zone should be managed as per Appendix 4 of Planning for Bush Fire Protection 2019.

- All fences in bush fire prone areas should be made from either hardwood or non-combustible material. However, in circumstances where the fence connects directly to the dwelling, or in areas of BAL-29 or greater, they should be made of non-combustible material.

AREA SCHEDULE (RENTABLE)

NAME	AREA (m2)
LOT AREA	300
GROUND FLOOR	124
GARAGE	20
PRIVATE OPEN SPACE	16
DRIVEWAY	20
FRONT LANDSCAPE	28
REAR LANDSCAPE	51.4

GREENFIELD HOUSING CODE COMPLIANCE TABLE

DESCRIPTION		COMPLIANCE		COMMENT
ELEMENT	CODE CONTROL	REQUIREMNT	PROPOSED	
LOAND ZONE	1 GENERAL RESIDENTIAL			
LOT NO	LOT 9			
LOT AREA	300 m2			
LOT WIDTH	Standard Lot Min. 6m at Building Line facing primary road	6.0m	10 m	YES
HEIGHT	MAX. Height	8.5m	4.45m	YES
FRONT SETBACK	FRONT SET BACK (Min. Setback from Primary Road) For 300-350 sqm. Lot	4.5 m	4.55m	YES
REAR SET BACK (MIN.)	GROUND FLOOR	3m	5.14m	YES
	FIRST FLOOR	6m	NA	
SIDE SET BACK (MIN.)	GROUND FLOOR	0/0.9m	0.25/1.12m	YES
	FIRST FLOOR	1.2/0.9m	NA	
FLOOR SPACE RATIO (FSR)	75% of lot area	225.00m2	126 m2	YES
GROSS FLOOR AREA PLAN	GROUND FLOOR		124 m2	
	FIRST FLOOR		NA	
TOTAL FLOOR AREA			144 m2	
ROOF AREA			199 m2	
GARAGE			20m2	
PRIVATE OPEN SPACE	<=10m Lot width	16m2	16 m2	YES
LANDSCAPE AREA	10 % of TOTAL LAND AREA	30 m2	79 m2	YES

CDC ISSUE

REV	DATE	DESCRIPTION	BY
4	31-08-2026	CDC ISSUE	

RUBY HOMES

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:
LOT 9 - 4 Tenth Ave
4 Tenth Avenue Austral

DRAWING TITLE:
LOCATION PLAN AND SITE PLAN

NORTH:

LOT NO: 9	DATE: 22-09-2026	SCALE: As indicated	DRAWING No: CDC.03	REV: 4
DRAWN BY: AS	CHECKED BY: RH	CLIENT NAME: GOVINDA PRASAD GAUDEL & PRATIVA KHAREL GAUDEL	ISSUED BY:	
DRAFTED BY: RS				

BAL - 12.5







CDC - SITE ANALYSIS AND SEDIMENT CONTROL PLAN

1

1 : 200

SD 5-7 STABILISED SITE ACCESS

- 1) STRIP TOPSOIL AND LEVEL SITE.
- 2) COMPACT SUBGRADE.
- 3) COVER AREA WITH GEOTEXILE.
- 4) CONSTRUCT 200 mm THICK PAD OVER GEOTEXILE USING ROADBASE OR 30 mm AGGREGATE. Min 15 m LONG OR TO BUILDING ALIGNMENT. Min 3 m WIDE.
- 5) CONSTRUCT HUMPS IMMEDIATELY WITHIN BOUNDARY TO DIVERT WATER TO A SEDIMENT FENCE OR OTHER SEDIMENT TRAP.

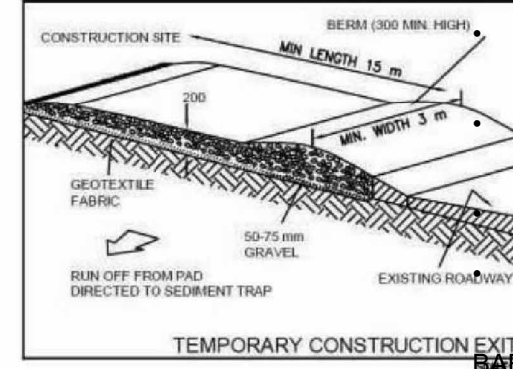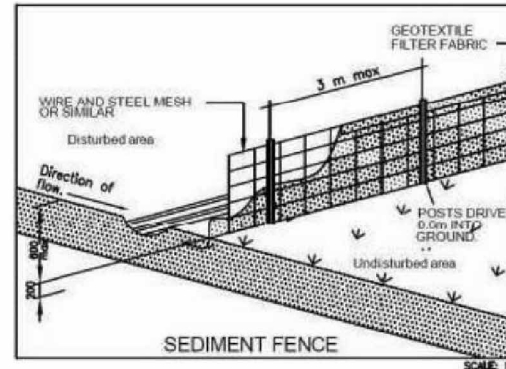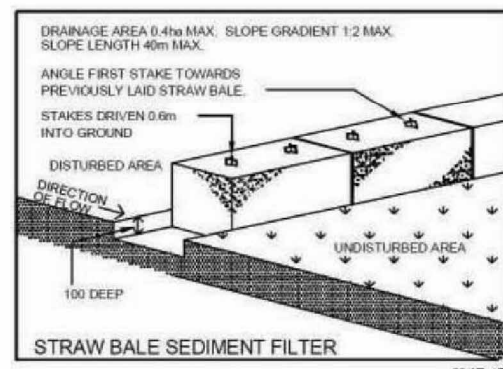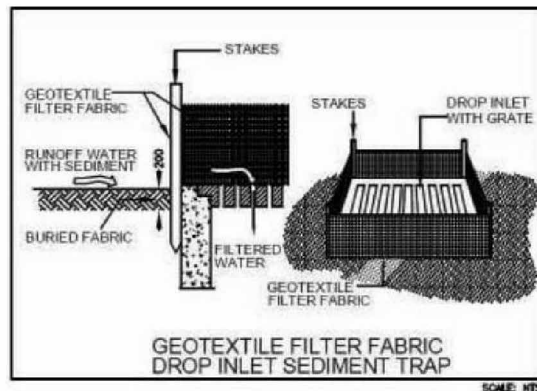

SD 6-9 GEOTEXTILE INLET FILTER

- 1) FABRICATE A SEDIMENT BARRIER MADE FROM GEOTEXILE. REFER SD6-7 FOR DETAILS.
- 2) SUPPORT GEOTEXILE WITH MESH TIED TO POSTS AT 1 m Ctrs.
- 3) DO NOT COVER INLET WITH GEOTEXILE.

SITE WORKS NOTES

1. ORIGIN OF LEVELS PROVIDED BY SURVEYOR
2. THE BUILDER SHALL VERIFY ALL DIMENSIONS AND EXISTING LEVELS ON SITE PRIOR TO THE COMMENCEMENT OF WORK AND ANY DISCREPANCIES SHALL BE REPORTED TO THE SURVEYOR / ENGINEER.
3. TOPSOIL SHALL BE STRIPPED FROM THE CONSTRUCTION AREA AND STOCKPILED ON SITE, TO BE LATER SPREAD OR DISPOSED OFF SITE, AS DIRECTED BY SUPERVISOR / ENGINEER.
4. ALL TRENCH BACKFILL MATERIAL SHALL BE COMPACTED TO THE SAME DENSITY AS THE ADJACENT MATERIAL.
5. ALL SERVICE TRENCHES UNDER VEHICULAR PAVEMENTS SHALL BE BACKFILLED WITH SAND OR APPROVED GRANULAR MATERIALS, TO THE UNDERSIDE OF THE PAVEMENT, AND COMPACTED TO 98% STANDARD MAXIMUM DRY DENSITY, IN ACCORDANCE WITH AS 1289E1.1.

TEMPORARY 1.8M HIGH WIRE MESH FENCE WITH DUSTPROOF MESH APPLIED TO FULL HEIGHT TO BOUNDARIES AS REQUIRED

LOCATION OF WASTE BINS

SEDIMENT FENCE AS REQUIRED

GRAVEL ACCESS

SITE ACCESS AREA TO BE USED FOR WASHDOWN AREA

FOOTPATH CLEAN AND CLEAR AT ALL TIMES

LOCATION OF STOCKPILE MATERIAL

MATERIAL STORAGE AREA

TEMPORARY TOILETS

INSTALL TEMPORARY SEDIMENT BARRIERS TO ALL INLET PITS LIKELY TO COLLECT SILT LADEN WATER, TO COUNCIL'S REQUIREMENTS.

SEDIMENT AND EROSION NOTES:

- THIS PLAN TO BE READ IN CONJUNCTION WITH SEDIMENT AND EROSION CONTROL DETAILS AS ATTACHED.
- THE CONTRACTOR SHALL IMPLEMENT ALL SOIL EROSION AND SEDIMENT CONTROL MEASURES AS NECESSARY AND TO THE SATISFACTION OF COUNCIL PRIOR TO THE COMMENCEMENT AND DURING CONSTRUCTION. NO DISTURBANCE TO THE SITE SHALL BE PERMITTED OTHER THAN IN THE IMMEDIATE AREA OF THE WORK AND NO MATERIAL SHALL BE REMOVED FROM THE SITE WITHOUT COUNCIL'S APPROVAL. ALL SEDIMENT AND EROSION CONTROL DEVICES TO BE INSTALLED AND MAINTAINED IN ACCORDANCE WITH STANDARDS OUTLINED IN NSW DEPARTMENT OF HOUSING "MANAGING URBAN STORMWATER-SOILS AND CONSTRUCTIONS".
- TOPSOIL SHALL BE STRIPPED AND STOCKPILED OUTSIDE HAZARD AREAS SUCH AS DRAINAGE LINES. THIS TOP SOIL IS TO BE RESPIRED LATER ON AREAS TO BE REVEGETATED AND STABILISED ONLY. (I.E ALL FOOTPATHS, BATTERS, SITE REGARDING AREAS, BASINS AND CATCH DRAINS). TOPSOIL SHALL NOT BE RESPIRED ON ANY OTHER AREAS UNLESS SPECIALLY INSTRUCTED BY THE SUPERIDENT. IF THEY ARE TO REMAIN FOR LONGER THAN ONE MONTH STOCKPILES SHALL BE PROTECTED FROM EROSION BY COVERING THEM WITH A MULCH AND HYDROSEEDING AND, IF NECESSARY, BY LOCATING BANKS OR DRAINS DOWNSTREAM OF A STOCKPILE TO RETARD SILT LADEN RUNOFF.
- THE CONTRACTOR SHALL REGULARLY MAINTAIN ALL SEDIMENT AND EROSION CONTROL DEVICES AND REMOVE ACCUMULATED SILT FROM SUCH DEVICES SUCH THAT MORE THAN 60% OF THEIR CAPACITY LOST. ALL THE SILTS TO BE PLACED OUTSIDE THE LIMIT OF WORKS. THE PERIOD FOR MAINTAINING THESE DEVICES SHALL BE AT LEAST UNTIL ALL DISTURBED AREAS ARE REVEGETATED AND FURTHER AS MAY BE DIRECTED BY THE SUPERINTENDENT OR COUNCIL.
- LAY TURF STRIP (MIN 300 mm WIDE) ON 100 mm TOPSOIL WITH 1.0 m LONG RETURNS EVERY 6.0m BEHIND ALL KERB AT THE TOP OF ALL BATTERS AND AROUND STRUCTURES IMMEDIATELY AFTER BACKFILLING OR FORMATION.
- THE CONTRACTOR SHALL GRASS SEED ALL DISTURBED AREAS WITH AN APPROVED MIX AS SHOWN AS PRACTICABLE AFTER COMPLETION OF EARTHWORKS AND REGRADING.
- VEHICULAR TRAFFIC SHALL BE CONTROLLED DURING CONSTRUCTION CONFINING ACCESS WHERE POSSIBLE TO NOMINATED STABILISED ACCESS POINTS.
- WHEN ANY DEVICES ARE TO BE HANDED OVER TO COUNCIL, THEY SHALL BE IN CLEAN AND STABLE CONDITION.
- THE CONTRACTOR SHALL IMPLEMENT DUST CONTROL BY REGULAR WETTING DOWN (BUT NOT SATURATING) DISTURBED AREA.
- PROVIDE AND MAINTAIN SILT TRAPS AROUND ALL SURFACE INLET PITS UNTIL CATCHMENT IS REVEGETATED OR PAVED.
- REVEGETATE ALL TRENCHES IMMEDIATELY UPON COMPLETION OF BACKFILLING.
- ALL DRAINAGE PIPE INLETS TO BE CAPPED UNTIL:
 - A) DOWNPIPES CONNECTED
 - B) PITS CONSTRUCTED & PROTECTED WITH SILT BARRIER

CDC ISSUE

REV	DATE	DESCRIPTION	BY
4	31-08-2026	CDC ISSUE	

RUBY HOMES

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL, COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:
LOT 9 - 4 Tenth Ave

4 Tenth Avenue Austral

DRAWING TITLE:
SITE ANALYSIS AND SEDIMENT CONTROL



LOT NO:	DATE:	SCALE:	DRAWING No:	REV:
9	22-09-2026	As indicated	CDC.04	4
DRAWN BY:	CHECKED BY:	CLIENT NAME:	ISSUED BY:	
AS	RH	GOVINDA PRASAD GAUDEL & PRATIVA KHAREL GAUDEL		
DRAFTED BY:	RS			

☒ BAL - 12.5

IMPORTANT NOTES:
SUMMARY OF AS 3959 BAL CONSTRUCTION REQUIREMENTS:

THE FOLLOWING IDENTIFIES THE PRIMARY CONSTRUCTION REQUIREMENTS OF BAL-12.5 INCLUDING THE RELEVANT PARTS OF THE NSW VARIATION.

EXTERNAL WALL - EXTERNAL WALLS - PARTS LESS THAN 400M ABOVE GROUND OR DECKS ETC TO BE OF NON-COMBUSTIBLE MATERIAL, 6MM FIBRE CEMENT CLAD OR BUSHFIRE RESISTANT/NATURALLY FIRE RESISTANT TIMBER.

EXTERNAL WINDOWS - PROTECTED BY BUSHFIRE SHUTTER, COMPLETELY SCREENED WITH STEEL, BRONZE OR ALUMINIUM MESH OR 4MM TOUGHENED GLASS OR GLASS BLOCKS WITHIN 400MM OF GROUND, DECK ETC. OPENABLE PORTION METAL SCREENED WITH FRAME OF METAL OR METAL REINFORCED PVC-U OR BUSHFIRE RESISTING TIMBER.

EXTERNAL DOORS PROTECTED BY BUSHFIRE SHUTTER, OR SCREENED WITH STEEL BRONZE OR ALUMINIUM MESH OR GLAZED WITH 5MM TOUGHENED GLASS, NON-COMBUSTIBLE OR NATURALLY FIRE RESISTANT (HIGH DENSITY) TIMBER FOR 400MM ABOVE THRESHOLD, METAL OR BUSHFIRE RESISTING TIMBER FRAMED FOR 400MM ABOVE GROUND, DECKING, ETC TIGHT FITTING WITH WEATHER STRIPS AT BASE.

ROOFS - NON-COMBUSTIBLE COVERING. ROOF/WALL JUNCTION SEALED. OPENINGS FITTED WITH NON-COMBUSTIBLE EMBER GUARDS. ROOF TO BE FULLY SARKED.

VERANDAHS DECKS ETC. - ENCLOSED SUB-FLOOR SPACE - NO SPECIAL REQUIRED FOR MATERIALS EXCEPT WITHIN 400MM OF GROUND. NO SPECIAL REQUIREMENTS FOR SUPPORTS OR FRAMING. DECKING TO BE NON COMBUSTIBLE OR BUSHFIRE RESISTANT WITHIN 300MM HORIZONTALLY AND 400MM VERTICALLY FROM A GLAZED ELEMENT.

Paragon Building Certifiers Pty Ltd

WORK TO BE AS PER PAGE


WATERPROOFING WORK TO BE AS PER PART 10.2 OF THE ABCB HOUSING PROVISIONS STANDARD 2022

Registered Certifier

APPROVED

Reference: 260530/01

Date: 25/09/2026

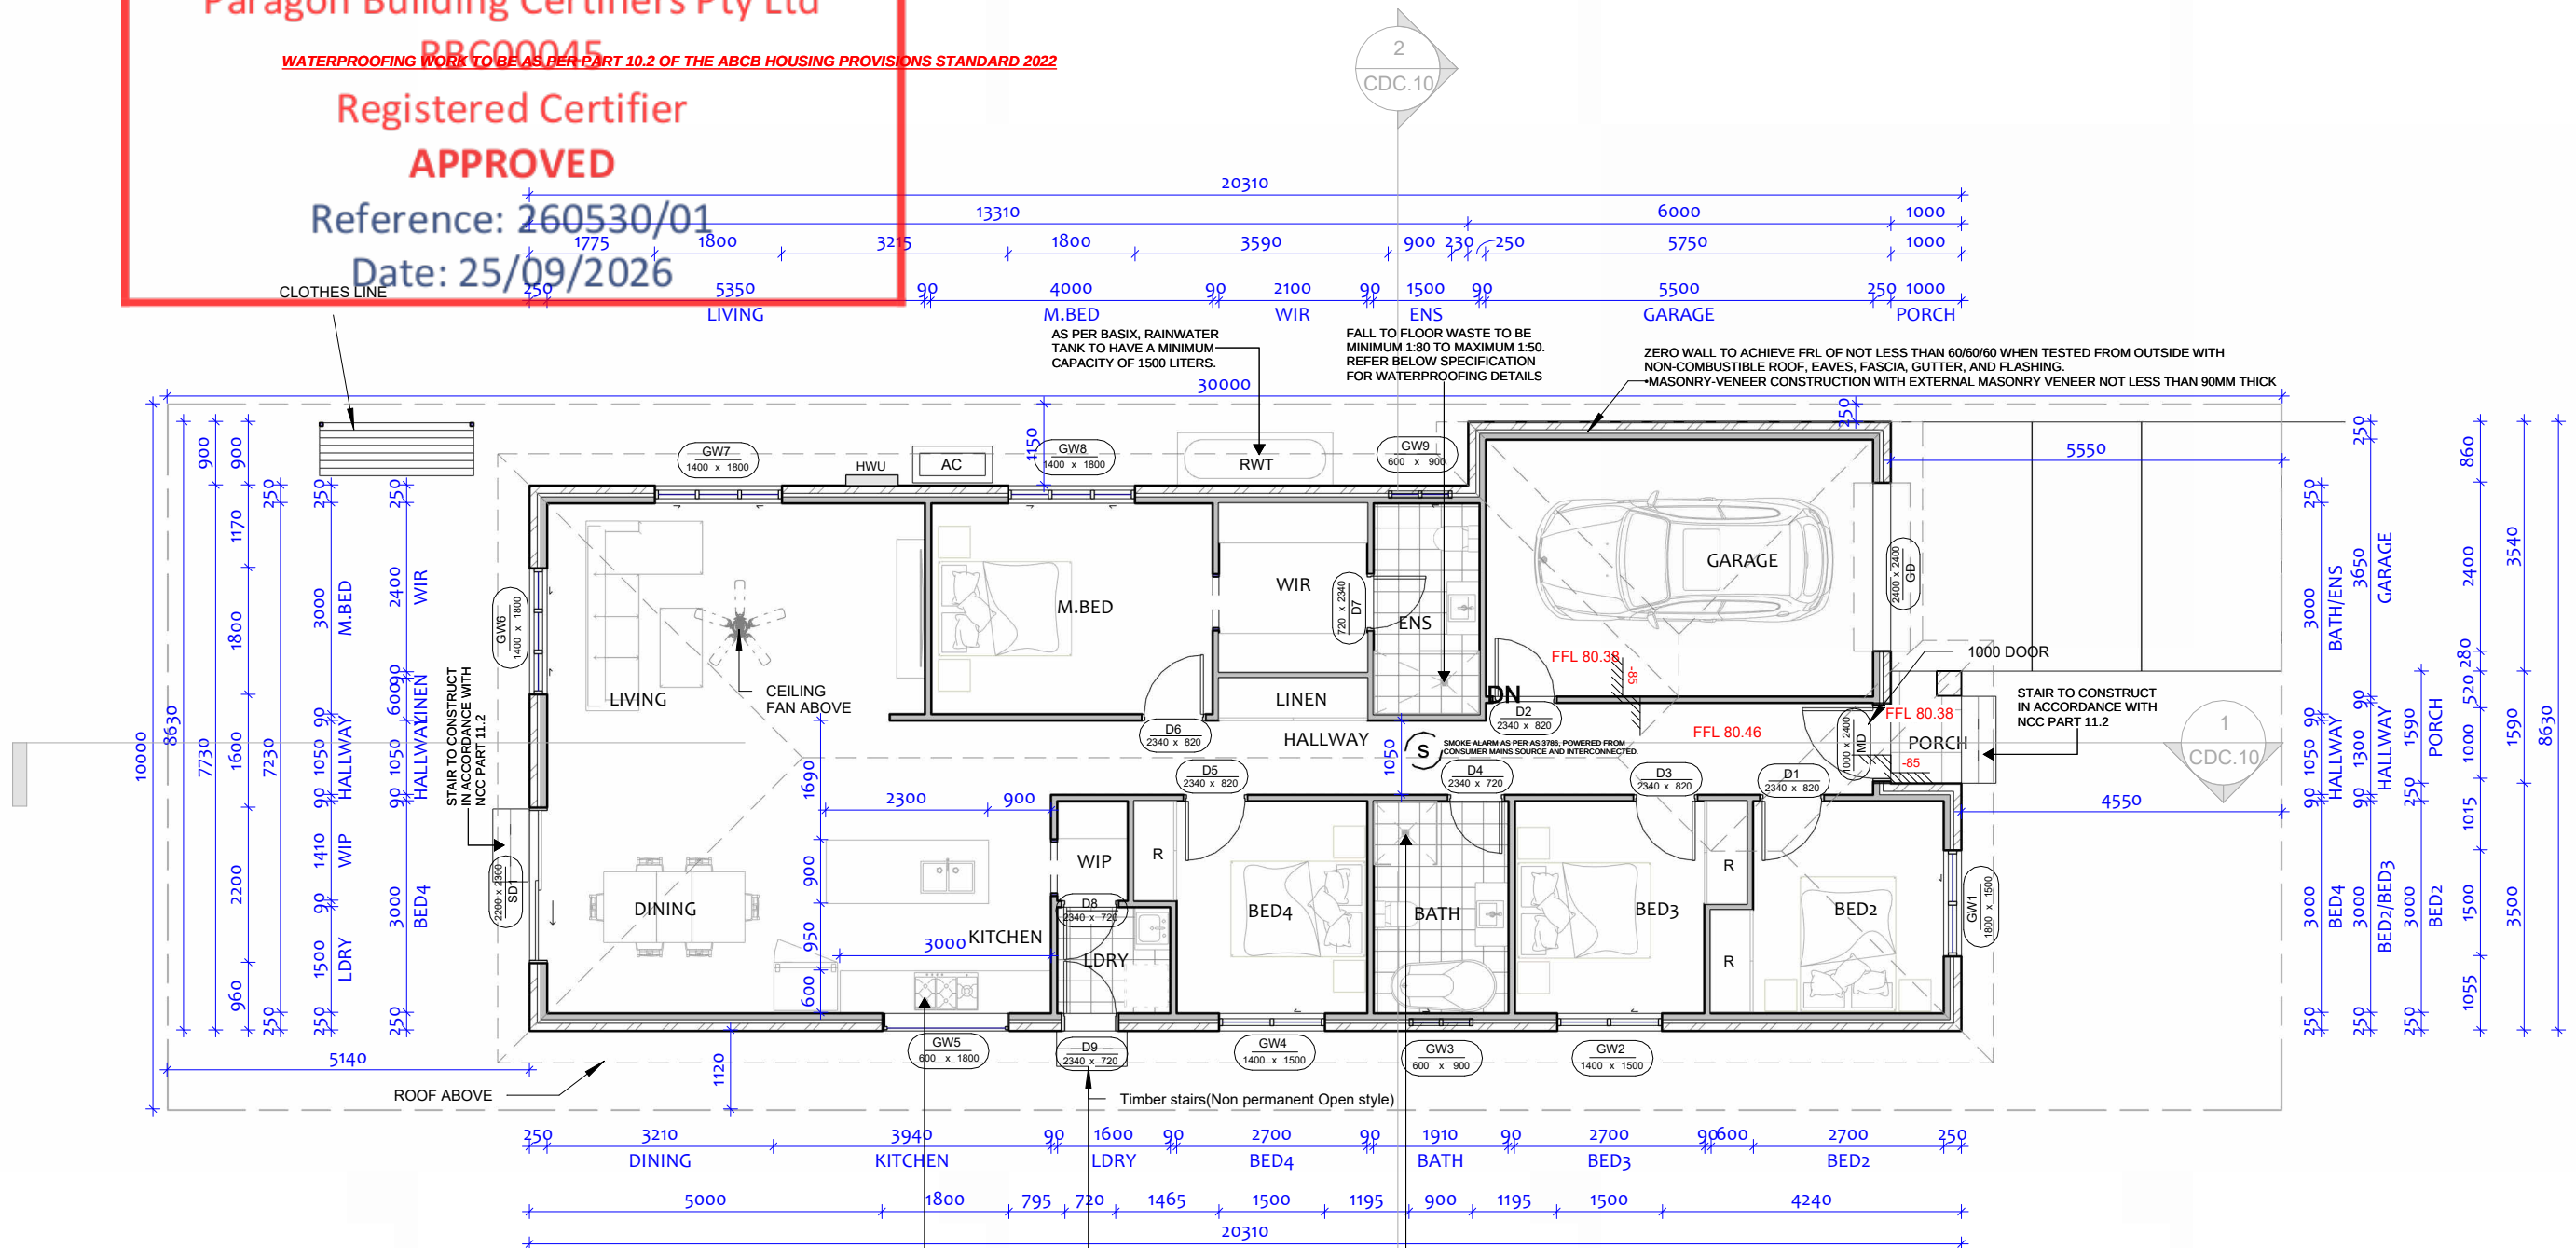

1

Ground Floor

1 : 100

(ANY INSTALLED) KITCHEN RANGEHOOD TO COMPLY WITH REQUIREMENTS OF BCA 2022. REFER BELOW SPECIFICATIONS

STAIR TO CONSTRUCT
IN ACCORDANCE WITH
NCC PART 11.2

FALL TO FLOOR WASTE TO BE
MINIMUM 1:80 TO MAXIMUM 1:50.
REFER BELOW SPECIFICATION
FOR WATERPROOFING DETAILS

Riser and going dimensions (mm)

Stair type	Riser (R)		Going (G)		Slope relationship (2R+G)	
	Max	Min	Max	Min	Max	Min
Stairs	190	115	355	240	700	550

CDC ISSUE

4	31-08-2026	CDC ISSUE	
3	16-06-2026	Area increased to 160 Sq.m Living room, Bedroom and WIR extended and Linen area also incorporated next to WIR. - Ekta	
2	12-06-2026	Area Increased by 5 Sq.m to 153 Sq.m. Living Room Increased to 4.5m, WIR added to M.Bed, All Bedroom Sizes reduced to accomodate the size increase - Ekta/Roshan	
1	10-06-2026	Concept Issue	
REV	DATE	DESCRIPTION	BY




THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL, COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL, & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:
LOT 9 - 4 Tenth Ave
4 Tenth Avenue Austral

DRAWING TITLE:


**GROUND FLOOR
PLAN**

NORTH:



LOT NO: 9	DATE: 22-09-2026	SCALE: 1 : 100	DRAWING No:	REV: 4
DRAWN BY: AS	CHECKED BY: RH		CDC.05	ISSUED BY:
DRAFTED BY: RS	CLIENT NAME: GOVINDA PRASAD GAUDEL & PRATIVA KHAREL GAUDEL			

BAL – 12.5

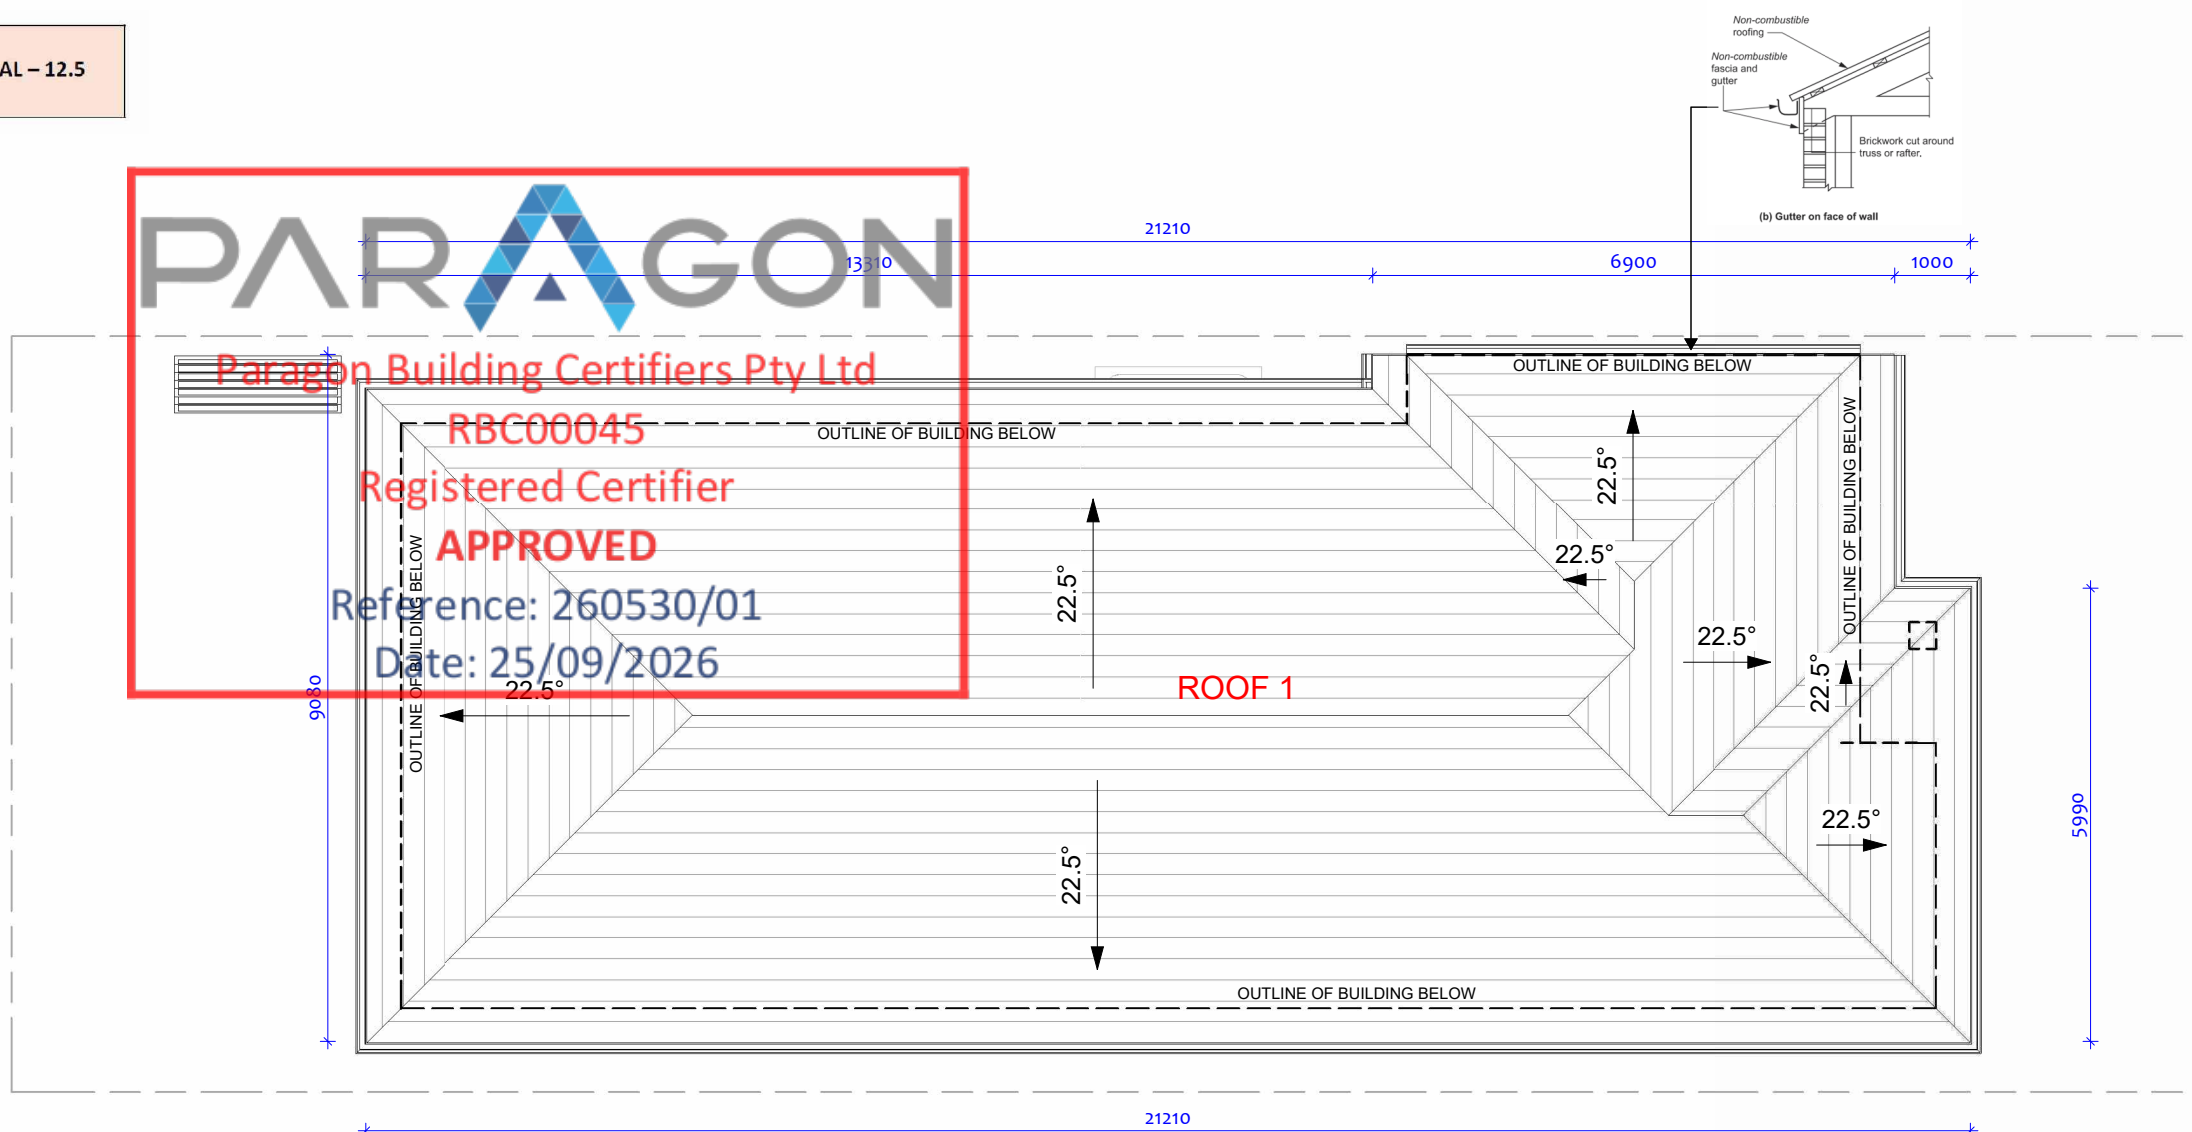

IMPORTANT NOTES:
ALL DIMENSIONS AND NOTES ON ALL PLANS MUST BE CHECKED AND VERIFIED BY BUILDERS AND OWNER PRIOR TO COMMENCEMENT OF ANY BUILDING WORKS. TO CLARIFY AND CONFIRM WITH CONSTRUCTION COMPANY FOR DISCREPANCIES ON ALL DOCUMENTS AND PLANS PROVIDED FOR CONSTRUCTION. ANY WORK INDICATED ON THE PLAN BUT NOT IN THE SPECIFICATION BUT WHICH IS NECESSARY AS PART OF THE CONTRACT, VARIATION TO PLANS, SPECIFICATIONS MAY NOT BE MADE WITHOUT THE WRITTEN CONSENT OF OWNER. IT IS THE RESPONSIBILITY OF THE BUILDER/END USER TO VERIFY PLANS AND SPECIFICATIONS AS TO THEIR ACCURACY AND COMPLY CURRENT BCA AND AUSTRALIAN STANDARDS. WINDOWS TO COMPLY WITH 3.9.3.5 OF THE BCA.

Construction Requirements for BAL 12.5

Construction to comply with Section 3 and Clause 5.2 to 5.8 of AS 3959:2018 & Planning for Bushfire Protection. For full construction requirements, refer to AS 3959:2018 & Planning for Bushfire Protection 2019.

- Floor:**
- Concrete slab on ground
- Walls:**
- Wall that are less than 400mm from the ground or decks to be of masonry veneer or precast/in situ walls of concrete or aerated concrete or cladding fixed to timber framed and is non-combustible material or fibre-cement with minimum 6mm thickness.
- Joints:**
- All joint in the external surface material of wall to be covered, sealed, overlapped, backed or butt jointed.
- Vents and Weepholes:**
- Vents and weepholes in external walls shall be screened with a mesh made of corrosion-resistant steel, bronze or aluminium.
- External glazed elements, assemblies and doors:**
- Window glazing less than 400mm from the ground or decks to be Grade A safety glass of minimum 4mm thickness.
 - Fitted with screens made from steel, bronze or aluminium to openable portion of windows.
 - Window frame less than 400mm from the ground or decks to be made from metal or bushfire resisting timber.
 - External Door to be of non-combustible or solid timber, laminated timber or reconstituted timber, having a minimum thickness of 35 mm for the first 400 mm above the threshold or hollow core, solid timber, laminated timber or reconstituted timber with a non-combustible kickplate on the outside for the first 400 mm above the threshold.
 - Door frame to be of bushfire resisting timber or metals. Where doors incorporate glazing, the glazing shall be Grade A safety glass a minimum of 4 mm in thickness
 - Seals and weather strips Weather strips, draught excluders or draught seals shall be installed.
 - Sliding door frame to be of metal.
 - Garage door within 400mm of ground to be of non-combustible construction and protected with suitable weather strips or brushes.
- Roof:**
- Roof tiles/sheet to be non-combustible.
 - Roof/wall and roof/roof junctions to be sealed.
 - Roof ventilation opening to be fitted with ember guards made of non-combustible material.
 - Tile roof to be fully sharked.
 - Sheet roof
 - Sheet roofs shall:
 - be fully sharked in accordance with Clause 5.6.2, except that foil-backed insulation blankets may be installed over the battens; or
 - have any gaps sealed at the fascia or wall line, hips and ridges by:
 - a mesh or perforated sheet that conforms with Clause 3.6 and that is made of corrosion-resistant steel, bronze or aluminium; or
 - mineral wool; or
 - other non-combustible material; or
 - IV) a combination of any of items (i), (ii) or (iii).
 - Roof penetrations, including roof lights, roof ventilators, roof-mounted evaporative cooling units, aerials, vent pipes and supports for solar collectors or the like, shall be sealed. The material used to seal the penetration shall be non-combustible.
 - Glazed elements in roof lights and skylights may be of polymer provided a Grade A safety glass diffuser, that conforms with AS 1288, is installed under the glazing. Where glazing is an insulating glazing unit (IGU), Grade A toughened safety glass of minimum 4 mm in thickness shall be used in the outer pane of the IGU.
 - Eaves ventilation openings shall be fitted with ember guards in accordance with Clause 3.6 and made of corrosion-resistant steel, bronze or aluminium.
- Decks:**
- Decking, stair treads and the trafficable surfaces of ramps and landings less than 300 mm (measured horizontally at deck level) from glazed elements that are less than 400 mm (measured vertically) from the surface of the deck (see Figure D2, Appendix D) shall be made from non-combustible material or bushfire-resisting timber.
- Water and gas supply pipes:**
- Above-ground, exposed water supply pipes shall be metal. External gas pipes and fittings above ground shall be of steel or copper construction having a minimum wall thickness in accordance with gas regulations or 0.9 mm whichever is the greater. The metal pipe shall extend a minimum of 400 mm within the building and 100 mm below ground.
- At the commencement of building works and in perpetuity, the approved Asset Protection Zone should be managed as per Appendix 4 of Planning for Bush Fire Protection 2019.**
- All fences in bush fire prone areas should be made from either hardwood or non-combustible material. However, in circumstances where the fence connects directly to the dwelling, or in areas of BAL-29 or greater, they should be made of non-combustible material.**

1

ROOF PLAN

1 : 100

Figure 10.8.3 (explanatory): Example of roof space with low level ventilation

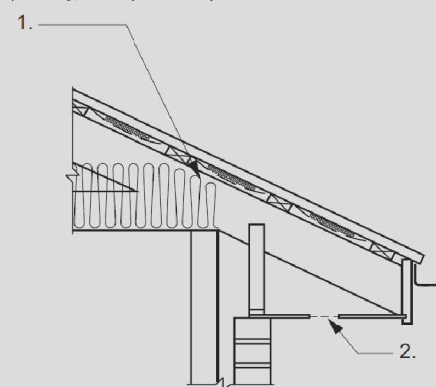


Figure Notes

- (1) Minimum 20 mm gap maintained between insulation and sarking.
(2) Eave ventilation opening in accordance with Table 10.8.3.

VENTILATION OF ROOF SPACES

ROOF SPACE AS PER 10.8.3.1(a) & 1(b)
(i) VENTILATED TO OUTDOOR AIR THROUGH EVENLY DISTRIBUTED OPENINGS IN ACCORDANCE WITH TABLE 10.8.3;
(ii) LOCATED IMMEDIATELY UNDERNEATH THE ROOF TILES OF AN UNSARKED TILED ROOF.

Table 10.8.3: Roof space ventilation requirements

Roof pitch	Ventilation openings
< 10°	25,000 mm ² /m provided at each of two opposing ends
≥ 10° and < 15°	25,000 mm ² /m provided at the eaves and 5,000 mm ² /m at high level
≥ 15° and < 75°	7,000 mm ² /m provided at the eaves and 5,000 mm ² /m at high level, plus an additional 18,000 mm ² /m at the eaves if the roof has a cathedral ceiling

Roof Schedule

Mark	Area	Comments	Description
------	------	----------	-------------

ROOF 1	199 m ²	TILE ROOF	Black or shades of grey or neutral colors only
--------	--------------------	-----------	--

Ground Ceiling: 1


REV	DATE	DESCRIPTION	BY
4	31-08-2026	CDC ISSUE	
2	12-06-2026	Area Increased by 5 Sq.m to 153 Sq.m. Living Room Increased to 4.5m, WIR added to M.Bed, All Bedroom Sizes reduced to accommodate the size increase - Ekta/Roshan	
1	10-06-2026	Concept Issue	

RUBY HOMES

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:
LOT 9 - 4 Tenth Ave
4 Tenth Avenue Austral

DRAWING TITLE:
ROOF PLAN



LOT NO:	DATE:	SCALE:	DRAWING No:	REV:
9	22-09-2026	1 : 100	CDC.07	4
DRAWN BY:	CHECKED BY:	CLIENT NAME:	ISSUED BY:	
AS	RH	GOVINDA PRASAD GAUDEL & PRATIVA KHAREL GAUDEL		
DRAFTED BY:	RS			

CDC ISSUE


BAL – 12.5



North Elevation

2

1 : 100

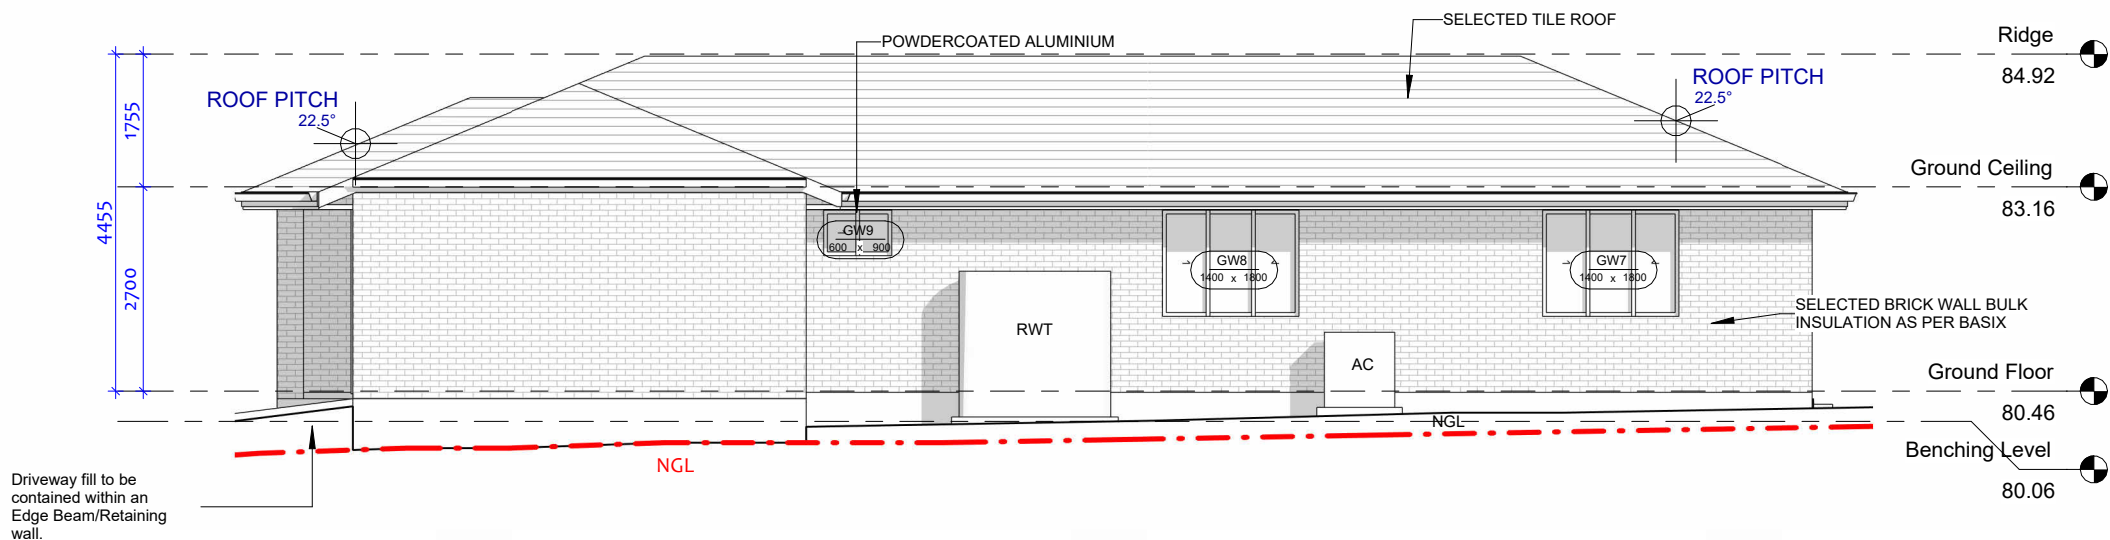

West Elevation

1

1 : 100

Window Schedule 1					
Mark	Height	Width	Sill Height	Head Height	Description

Ground Floor

GW1	1800	1500	600	2400	SLIDING
GW2	1400	1500	1000	2400	SLIDING
GW3	600	900	1800	2400	SLIDING
GW4	1400	1500	1000	2400	SLIDING
GW5	600	1800	1000	1600	FIXED
GW6	1400	1800	1000	2400	SLIDING
GW7	1400	1800	1000	2400	SLIDING
GW8	1400	1800	1000	2400	SLIDING
GW9	600	900	1800	2400	SLIDING

Ground Floor: 9

Construction Requirements for BAL 12.5

Construction to comply with Section 3 and Clause 5.2 to 5.8 of AS 3959:2018 & Planning for Bushfire Protection. For full construction requirements, refer to AS 3959:2018 & Planning for Bushfire Protection 2019.

- Floor:**
- Concrete slab on ground
- Walls:**
- Wall that are less than 400mm from the ground or decks to be of masonry veneer or precast/in situ walls of concrete or aerated concrete or cladding fixed to timber framed and is non-combustible material or fibre-cement with minimum 6mm thickness.
- Joints:**
- All joint in the external surface material of wall to be covered, sealed, overlapped, backed or butt jointed.
- Vents and Weepholes:**
- Vents and weepholes in external walls shall be screened with a mesh made of corrosion-resistant steel, bronze or aluminium.
- External glazed elements, assemblies and doors:**
- Window glazing less than 400mm from the ground or decks to be Grade A safety glass of minimum 4mm thickness.
 - Fitted with screens made from steel, bronze or aluminium to openable portion of windows.
 - Window frame less than 400mm from the ground or decks to be made from metal or bushfire resisting timber.
 - External Door to be of non-combustible or solid timber, laminated timber or reconstituted timber, having a minimum thickness of 35 mm for the first 400 mm above the threshold or hollow core, solid timber, laminated timber or reconstituted timber with a non-combustible kickplate on the outside for the first 400 mm above the threshold.
 - Door frame to be of bushfire resisting timber or metals. Where doors incorporate glazing, the glazing shall be Grade A safety glass a minimum of 4 mm in thickness
 - Seals and weather strips Weather strips, draught excluders or draught seals shall be installed.
 - Sliding door frame to be of metal.
 - Garage door within 400mm of ground to be of non-combustible construction and protected with suitable weather strips or brushes.
- Roof:**
- Roof tiles/sheet to be non-combustible.
 - Roof/wall and roof/roof junctions to be sealed.
 - Roof ventilation opening to be fitted with ember guards made of non-combustible material.
 - Tile roof to be fully sharked.
 - Sheet roof
 - Sheet roofs shall:
 - be fully sarked in accordance with Clause 5.6.2, except that foil-backed insulation blankets may be installed over the battens; or
 - have any gaps sealed at the fascia or wall line, hips and ridges by:
 - a mesh or perforated sheet that conforms with Clause 3.6 and that is made of corrosion-resistant steel, bronze or aluminium; or
 - mineral wool; or
 - other non-combustible material; or
 - a combination of any of items (i), (ii) or (iii).
 - Roof penetrations, including roof lights, roof ventilators, roof-mounted evaporative cooling units, aerials, vent pipes and supports for solar collectors or the like, shall be sealed. The material used to seal the penetration shall be non-combustible.
 - Glazed elements in roof lights and skylights may be of polymer provided a Grade A safety glass diffuser, that conforms with AS 1286, is installed under the glazing. Where glazing is an insulating glazing unit (IGU), Grade A toughened safety glass of minimum 4 mm in thickness shall be used in the outer pane of the IGU.
 - Eaves ventilation openings shall be fitted with ember guards in accordance with Clause 3.6 and made of corrosion-resistant steel, bronze or aluminium.
- Decks:**
- Decking, stair treads and the trafficable surfaces of ramps and landings less than 300 mm (measured horizontally at deck level) from glazed elements that are less than 400 mm (measured vertically) from the surface of the deck (see Figure D2, Appendix D) shall be made from non-combustible material or bushfire-resisting timber.
- Water and gas supply pipes:**
- Above-ground, exposed water supply pipes shall be metal. External gas pipes and fittings above ground shall be of steel or copper construction having a minimum wall thickness in accordance with gas regulations or 0.9 mm whichever is the greater. The metal pipe shall extend a minimum of 400 mm within the building and 100 mm below ground.
- At the commencement of building works and in perpetuity, the approved Asset Protection Zone should be managed as per Appendix 4 of Planning for Bush Fire Protection 2019.**
- All fences in bush fire prone areas should be made from either hardwood or non-combustible material. However, in circumstances where the fence connects directly to the dwelling, or in areas of BAL-29 or greater, they should be made of non-combustible material.**

CDC ISSUE

REV	DATE	DESCRIPTION	BY
4	31-08-2026	CDC ISSUE	
2	12-06-2026	Area Increased by 5 Sq.m to 153 Sq.m. Living Room Increased to 4.5m, WIR added to M.Bed, All Bedroom Sizes reduced to accommodate the size increase - Ekta/Roshan	
1	10-06-2026	Concept Issue	

RUBY HOMES

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:
LOT 9 - 4 Tenth Ave


4 Tenth Avenue Austral

DRAWING TITLE:
ELEVATION 01

NORTH:

LOT NO: 9	DATE: 22-09-2026	SCALE: 1 : 100	DRAWING No: CDC.08	REV: 4
DRAWN BY: AS	CHECKED BY: RH			ISSUED BY:
DRAFTED BY: RS	CLIENT NAME: GOVINDA PRASAD GAUDEL & PRATIVA KHAREL GAUDEL			

BAL – 12.5

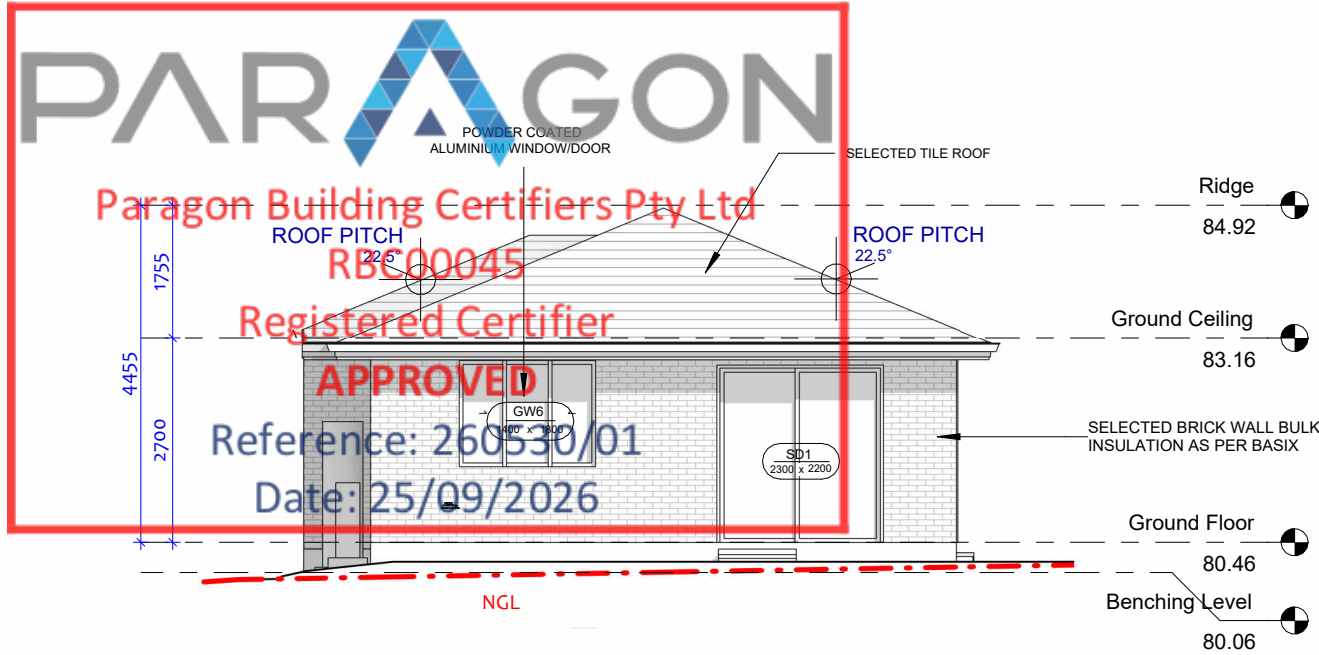


Door Schedule 1				
Mark	Height	Width	Count	Description

Ground Floor				
D1	2340	820	1	FLUSH DOOR
D2	2340	820	1	FLUSH DOOR
D3	2340	820	1	FLUSH DOOR
D4	2340	720	1	FLUSH DOOR
D5	2340	820	1	FLUSH DOOR
D6	2340	820	1	FLUSH DOOR
D7	2340	720	1	FLUSH DOOR
D8	2340	720	1	FLUSH DOOR
D9	2340	720	1	FLUSH DOOR
GD	2400	2400	1	GARAGE DOOR
MD	2400	1000	1	SOLID CORE DOOR
SD1	2300	2200	1	SLIDING DOOR

Ground Floor: 12

2 SOUTH ELEVATION


1 : 100

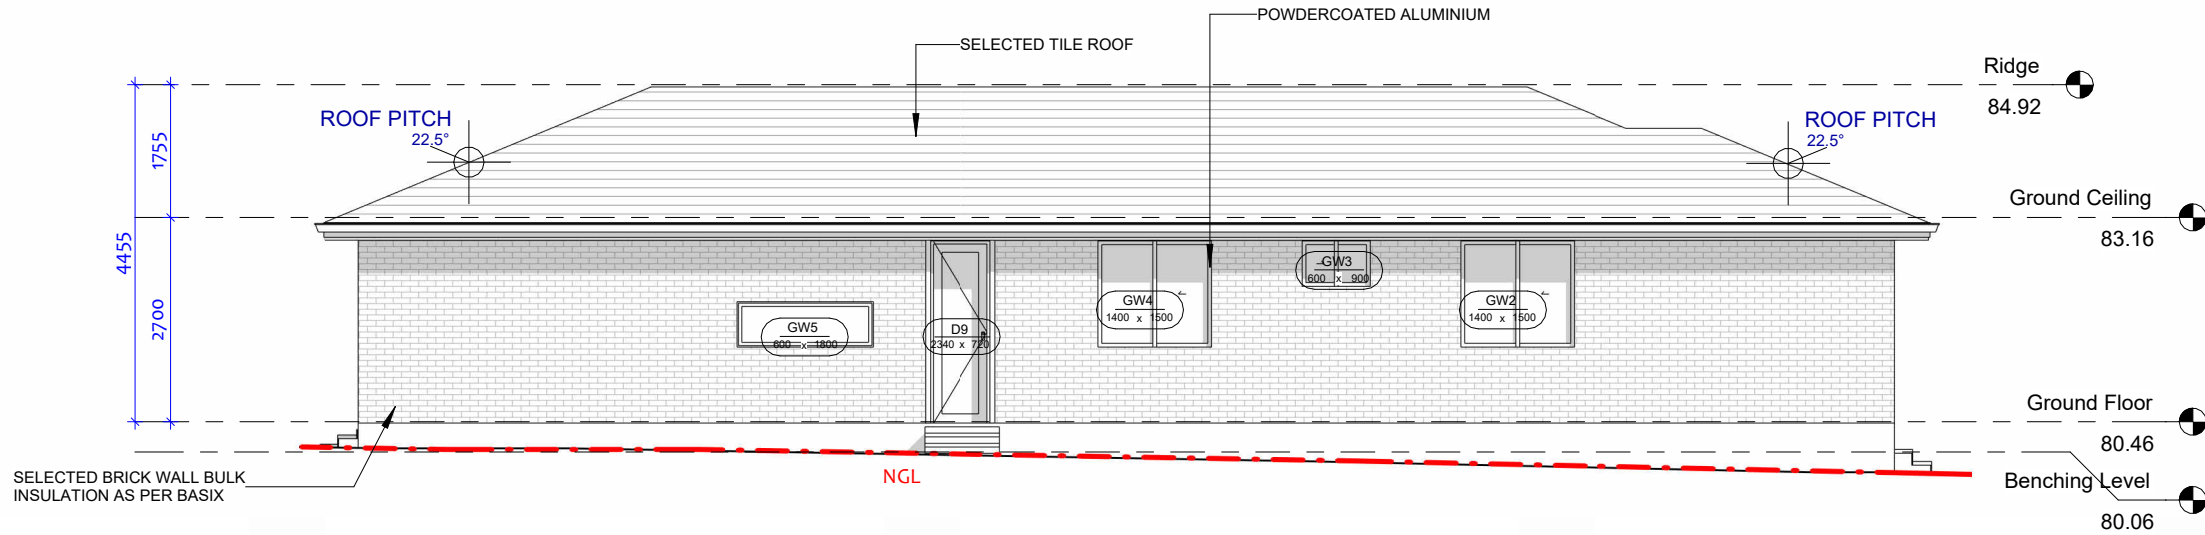

1 East Elevation

1 : 100

REV	DATE	DESCRIPTION	BY
4	31-08-2026	CDC ISSUE	
2	12-06-2026	Area Increased by 5 Sq.m to 153 Sq.m. Living Room Increased to 4.5m, WIR added to M.Bed, All Bedroom Sizes reduced to accomodate the size increase - Ekta/Roshan	
1	10-06-2026	Concept Issue	



RUBY
HOMES

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:
LOT 9 - 4 Tenth Ave

4 Tenth Avenue Austral

DRAWING TITLE:
ELEVATION 02

NORTH:

LOT NO:	DATE:	SCALE:	DRAWING No.	REV:
9	22-09-2026	1 : 100	CDC.09	4
DRAWN BY:	CHECKED BY:	ISSUED BY:		
AS	RH			
DRAFTED BY:	CLIENT NAME:			
RS	GOVINDA PRASAD GAUDEL & PRATIVA KHAREL GAUDEL			

CDC ISSUE

BAL – 12.5

Construction Requirements for BAL 12.5

Construction to comply with Section 3 and Clause 5.2 to 5.8 of AS 3959-2018 & Planning for Bushfire Protection. For full construction requirements refer to AS 3959-2018 & Planning for Bushfire Protection 2019.

Floor:

- Concrete slab on ground

Walls:

- Wall that are less than 400mm from the ground or decks to be of masonry, masonry precast/in situ walls of concrete or aerated concrete or cladding fixed to timber framed and is non-combustible material or fibre-cement with minimum 6mm thickness.

Joints:

- All joint in the external surface material of wall to be covered, sealed, overlapped, backed or butt jointed.

Vents and Weepholes:

- Vents and weepholes in external walls shall be screened with a mesh made of corrosion-resistant steel, bronze or aluminium.

External glazed elements, assemblies and doors:

- Window glazing less than 400mm from the ground or decks to be Grade A safety glass of minimum 4mm thickness.
- Fitted with screens made from steel, bronze or aluminium to openable portion of windows.
- Window frame less than 400mm from the ground or decks to be made from metal or bushfire resisting timber.
- External Door to be of non-combustible or solid timber, laminated timber or reconstituted timber having a minimum thickness of 35 mm for the first 400 mm above the threshold or of solid timber, laminated timber or reconstituted timber with a non-combustible kickplate on the outside for the first 400 mm above the threshold.
- Door frame to be of bushfire resistant timber or metals. Where doors incorporate glazing, the glazing shall be Grade A safety glass a minimum of 4 mm in thickness.
- Seals and weather strips Weather strips, draught excluders or draught seals shall be installed.
- Sliding door frame to be of metal.
- Garage door within 400mm of ground to be of non-combustible construction and protected with suitable weather strips or brushes.

Roof:

- Roof tiles/sheet to be non-combustible.
- Roof/wall and roof/roof junctions to be sealed.
- Roof ventilation opening to be fitted with ember guards made of non-combustible material.
- Tile roof to be fully sharked.

Sheet roof

Sheet roofs shall:

- be fully sharked in accordance with Clause 5.6.2, except that foil-backed insulation blankets may be installed over the battens; or
- have any gaps sealed at the fascia or wall line, hips and ridges by:
 - a mesh or perforated sheet that conforms with Clause 3.6 and that is made of corrosion-resistant steel, bronze or aluminium; or
 - mineral wool; or
 - other non-combustible material; or
 - a combination of any of items (i), (ii) or (iii).

- Roof penetrations, including roof lights, roof ventilators, roof-mounted evaporative cooling units, aerials, vent pipes and supports for solar collectors or the like, shall be sealed. The material used to seal the penetration shall be non-combustible.

- Glazed elements in roof lights and skylights may be of polymer provided a Grade A safety glass diffuser, that conforms with AS 1288, is installed under the glazing. Where glazing is an insulating glazing unit (IGU), Grade A toughened safety glass of minimum 4 mm in thickness shall be used in the outer pane of the IGU.

- Eaves ventilation openings shall be fitted with ember guards in accordance with Clause 3.6 and made of corrosion-resistant steel, bronze or aluminium.

Decks:

- Decking, stair treads and the trafficable surfaces of ramps and landings less than 300 mm (measured horizontally at deck level) from glazed elements that are less than 400 mm (measured vertically) from the surface of the deck (see Figure D2, Appendix D) shall be made from non-combustible material or bushfire-resisting timber.

Water and gas supply pipes:

- Above-ground, exposed water supply pipes shall be metal. External gas pipes and fittings above ground shall be of steel or copper construction having a minimum wall thickness in accordance with gas regulations or 0.9 mm whichever is the greater. The metal pipe shall extend a minimum of 400 mm within the building and 100 mm below ground.

- At the commencement of building works and in perpetuity, the approved Asset Protection Zone should be managed as per Appendix 4 of Planning for Bush Fire Protection 2019.

- All fences in bush fire prone areas should be made from either hardwood or non-combustible material. However, in circumstances where the fence connects directly to the dwelling, or in areas of BAL-29 or greater, they should be made of non-combustible material.

PARAGON

Paragon Building Certifiers Pty Ltd


RBC00045

Registered Certifier

APPROVED


Reference: 260530/01

Date: 25/09/2026

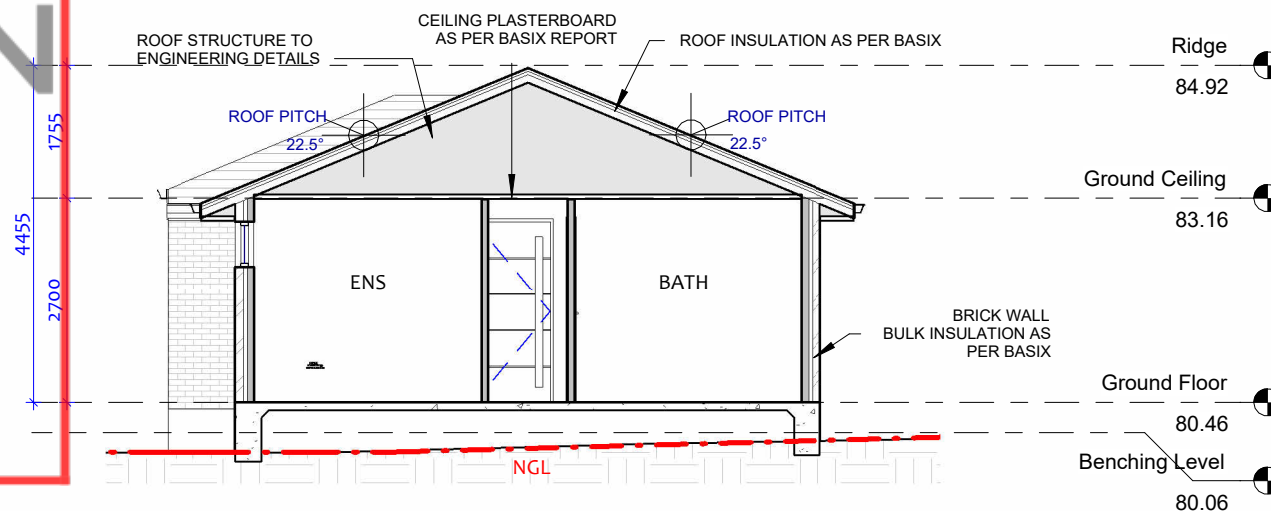

CROSS SECTION

1 : 100

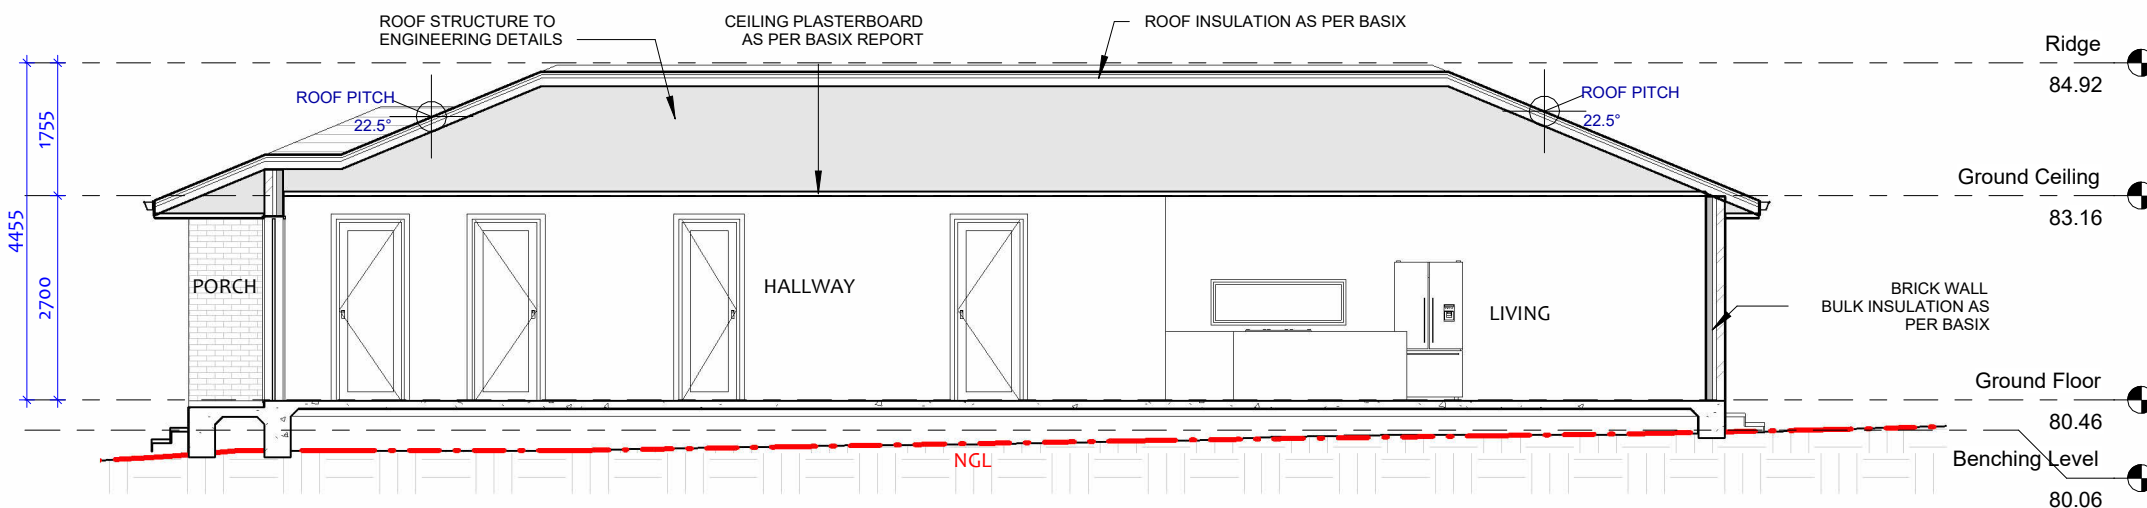

LONGITUDINAL SECTION

1 : 100

REV	DATE	DESCRIPTION	BY
4	31-08-2026	CDC ISSUE	



THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:
LOT 9 - 4 Tenth Ave

4 Tenth Avenue Austral

DRAWING TITLE:
SECTIONS

NORTH:

CDC ISSUE					
LOT NO:	DATE:	SCALE:	DRAWING No:	REV:	
9	22-09-2026	1 : 100	CDC.10		4
DRAWN BY:	CHECKED BY:				ISSUED BY:
AS	RH				
DRAFTED BY:	CLIENT NAME:				
RS	GOVINDA PRASAD GAUDEL & PRATIVA KHAREL GAUDEL				

☑ BAL – 12.5

PARAGON

Paragon Building Certifiers Pty Ltd


RBC00045

Registered Certifier

APPROVED

Reference: 260530/01

Date: 25/09/2026

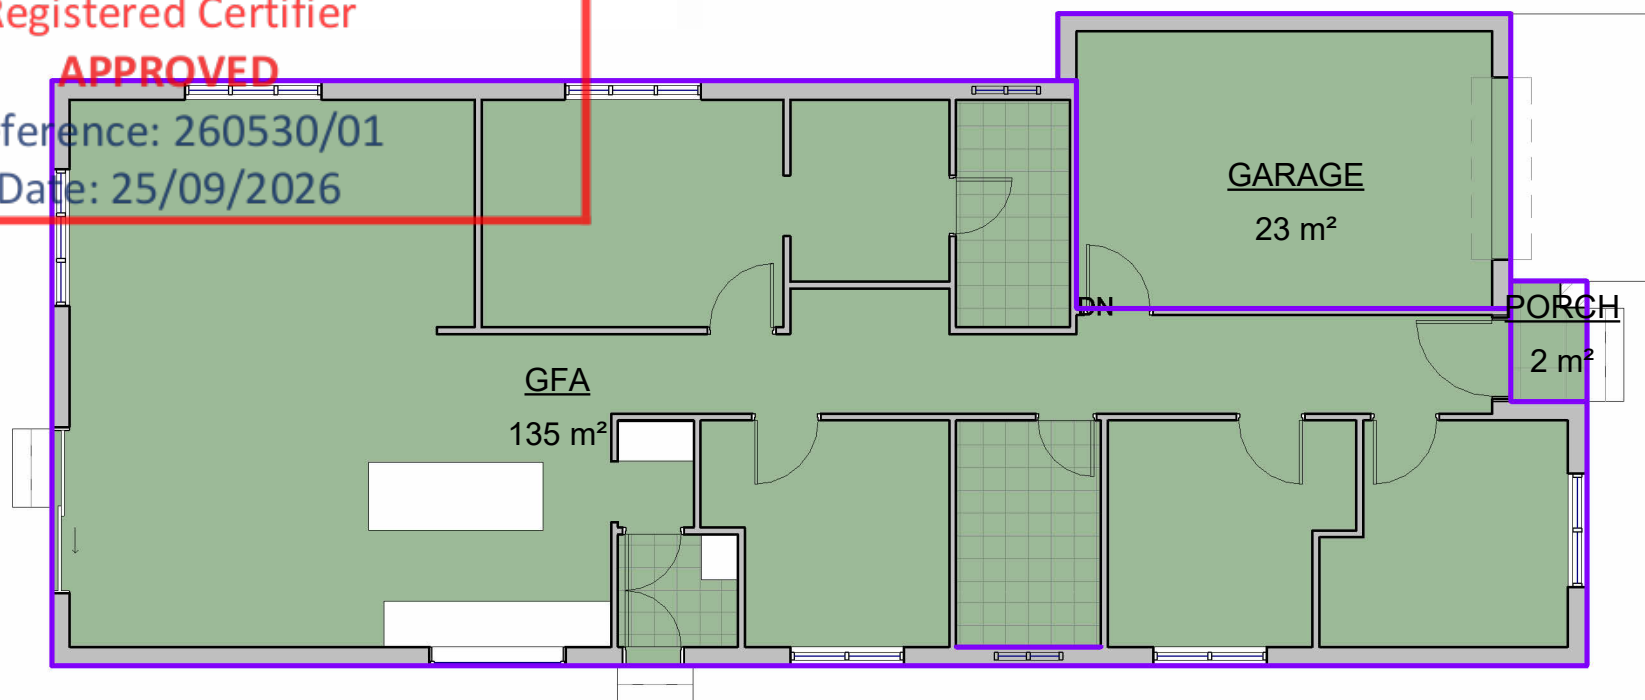

1

Ground Floor

1 : 100

Area Schedule (Gross Building)

Name	Area
------	------

Ground Floor

GFA	135 m²
GARAGE	23 m²
PORCH	2 m²

Ground Floor: 3 159 m²

Grand total: 3 159 m²

REV	DATE	DESCRIPTION	BY
4	31-08-2026	CDC ISSUE	
3	16-06-2026	Area increased to 160 Sq.m Living room, Bedroom and WIR extended and Linen area also incorporated next to WIR. - Ekta	
2	12-06-2026	Area Increased by 5 Sq.m to 153 Sq.m. Living Room Increased to 4.5m, WIR added to M.Bed, All Bedroom Sizes reduced to accommodate the size increase - Ekta/Roshan	
1	10-06-2026	Concept Issue	




THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:
LOT 9 - 4 Tenth Ave

4 Tenth Avenue Austral

DRAWING TITLE:
FLOOR AREA PLAN



LOT NO:	DATE:	SCALE:	DRAWING No:	REV:
9	22-09-2026	1 : 100	CDC.11	4
DRAWN BY:	CHECKED BY:			ISSUED BY:
AS	RH			
DRAFTED BY:	CLIENT NAME:			
RS	GOVINDA PRASAD GAUDEL & PRATIVA KHAREL GAUDEL			

CDC ISSUE

☑ BAL – 12.5

PARAGON

Paragon Building Certifiers Pty Ltd


RBC00045

Registered Certifier

APPROVED

Reference: 260530/01

Date: 25/09/2026

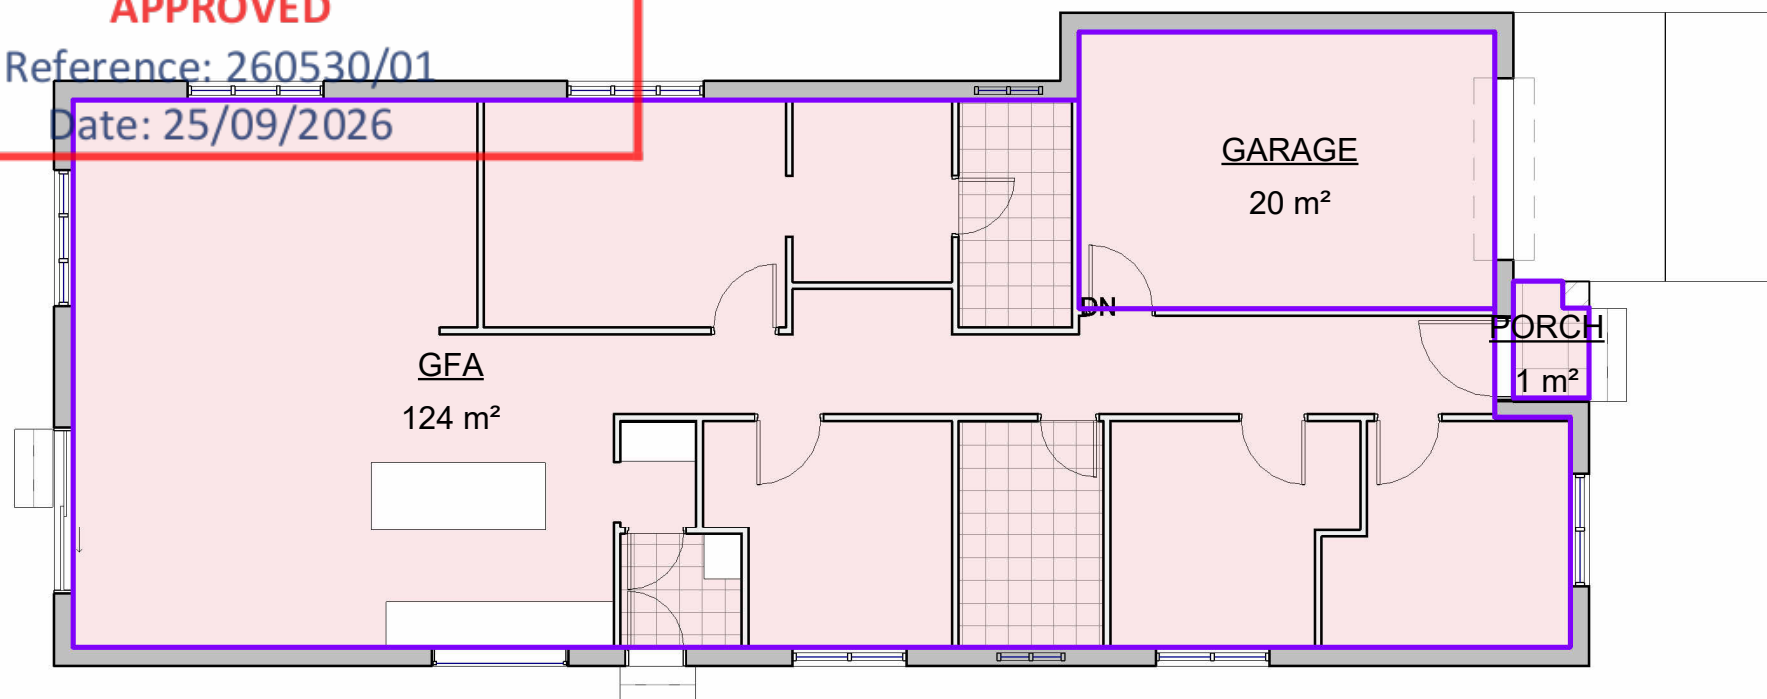

1 Ground Floor
1 : 100

Area Schedule (Rentable)

Name	Area
------	------

Ground Floor

GFA	124 m ²
GARAGE	20 m ²
PORCH	1 m ²

Ground Floor: 3 145 m²

Grand total: 3 145 m²

REV	DATE	DESCRIPTION	BY
4	31-08-2026	CDC ISSUE	



THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:
LOT 9 - 4 Tenth Ave

4 Tenth Avenue Austral

DRAWING TITLE:
RENTABLE AREA PLAN



LOT NO:	9	DATE:	22-09-2026	SCALE:	1 : 100	DRAWING No:	CDC.12	REV:	4
DRAWN BY:	AS	CHECKED BY:	RH	ISSUED BY:					
DRAFTED BY:	RS	CLIENT NAME: GOVINDA PRASAD GAUDEL & PRATIVA KHAREL GAUDEL							

CDC ISSUE

☑ BAL – 12.5

PARAGON

Paragon Building Certifiers Pty Ltd

RBC00045


Registered Certifier

APPROVED

Reference: 260530/01

Date: 25/09/2026



	1. RF	2. BR1	3. AL	4. ED	5. GD	6. FAS	7. GUT
	ROOF	MAIN WALLS	WINDOWS/ BALUSTRADE	MAIN DOOR	GARAGE DOOR	FASCIA	GUTTER
MATERIAL	TILE	BRICK	ALUMINIUM	TIMBER	COLORBOND	COLORBOND	COLORBOND
COLOUR							

NOTE : ALL COLOURS SPECIFIED ARE INDICATIVE ONLY AND ARE SUBJECT TO VARIATION AND TO AVAILABILITY
ANY DISCREPANCY PLEASE FOLLOW AS PER RENDERED IMAGE

REV	DATE	DESCRIPTION	BY
4	31-08-2026	CDC ISSUE	



THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:
LOT 9 - 4 Tenth Ave

4 Tenth Avenue Austral

DRAWING TITLE:
COLOR SCHEDULE

NORTH:

LOT NO:	DATE:	SCALE:	DRAWING No:	REV:
9	22-09-2026	1 : 100	CDC.14	4
DRAWN BY:	CHECKED BY:	CLIENT NAME:	ISSUED BY:	
AS	RH	GOVINDA PRASAD GAUDEL & PRATIVA KHAREL GAUDEL		
DRAFTED BY:				
RS				

CDC ISSUE

BAL – 12.5



CDC - LANDSCAPE PLAN

1 : 200

GENERAL NOTES:

- LANDSCAPE CONTRACTOR TO CHECK DA CONDITIONS AND STAMPED LANDSCAPE PLAN BEFORE COMMENCING WORKS TO ENSURE NO ADDITIONS/AMENDMENTS TO PLAN.
- GARDEN BEDS IN OSD BASIN TO CONSIST OF NON FLOATABLE DECORATIVE GRAVEL.
- REFER TO HYDRAULICS ENGINEERS PLAN FOR OSD DETAILS/FINAL LEVELS.
- MULCHED PLANTING BEDS TO BE A MINIMUM DEPTH OF 75mm AS SELECTED.
- CONTRACTOR'S RESPONSIBILITY TO CHECK AND ADJUST SOIL pH AS REQUIRED.
- PROVIDE TIMBER EDGE AS A MINIMUM BENEATH FENCING/GATES TO DEFINE TURF AND GARDEN BEDS/PATHWAYS, EDGING TO BE PROVIDED TO ALL AREAS WHERE DIFFERING MATERIALS MEET i.e TURF/GARDEN, TURF/GRAVEL PATH ETC.
- WEED MAT BENEATH GRAVEL PATHWAYS REQUIRED TO LIMIT MUD TRACKING.
- PREMIUM ORGANIC GARDEN MIX TO BE USED.
- ALL PLANTS TO BE HEALTHY AND VIGOROUS.
- CONTRACTOR TO MAKE GOOD TURF ON NATURE STRIP POST CONSTRUCTION.
- CONTRACTOR TO MAKE GOOD TURF ON NATURE STRIP POST CONSTRUCTION.
- DO NOT SCALE ARCHITECTURAL SETOUT FROM LANDSCAPE DRAWING.
- EXISTING TREE SPREAD APPROXIMATE ONLY. REFER TO TREE REPORT WHEN APPLICABLE.
- SITE SURVEY PROVIDED BY OTHERS.
- BUFFALO TURF PREFERRED OVER KIKUYU.

LANDSCAPE BASIX NOTE:


THE APPLICANT MUST PLANT INDIGENEOUS OR LOW WATER USE SPECIES OF VEGETATION THROUGHOUT 15 SQM OF THE SITE.

NOTE : BUILDER RESERVES THE RIGHT NOT TO UNDERTAKE NOR SUPPLY CERTIFICATE FOR OCCUPATION CERTIFICATE.

NOTE : TO AID COMPLIANCE WITH BASIX LEGISLATION, PLANTS (WHERE APPLICABLE) HAVE BEEN SELECTED FROM THE LOCAL CITY COUNCIL/SHIRE PLANT LISTS.

NOTE: LOCATION OF SEWER MAINS/LINES, WATER PIPES, UNDERGROUND ELECTRICITY AND OTHER SERVICES MUST BE OBTAINED PRIOR TO COMMENCEMENT OF ANY WORK ON SITE.

CONTRACTORS NOTE : CALCULATED AREAS DETERMINED BY CAD AND HAVE BEEN ROUNDED UP FOR USE AS A GUIDE ONLY. ALLOW STANDARD PERCENTAGE FOR CUTTING AND WASTAGE. CONFIRM DIMENSIONS AND NUMBERS PRIOR TO QUOTING/ORDERING.

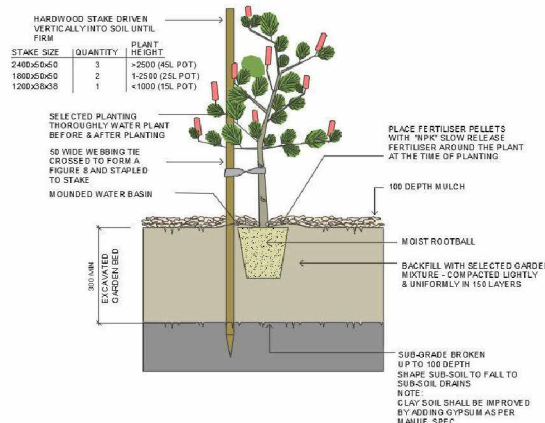

2. TREE & SHRUB PLANTING IN GARDEN BED

NOTE:
DO NOT PLANT IN UNSUITABLE WEATHER CONDITIONS SUCH AS EXTREME HEAT, COLD, WIND OR RAIN.
CLAY SOIL IS TO BE TREATED WITH CLAY BREAKER AND ORGANIC COMPOST.

LANDSCAPE AREA

FRONT AREA	28 m ²
BACKYARD AREA	51.4 m ²
TOTAL AREA	79.4 m ²

Construction Requirements for BAL 12.5

Construction to comply with Section 3 and Clause 5.2 to 5.8 of AS 3959:2018 & Planning for Bushfire Protection. For full construction requirements, refer to AS 3959:2018 & Planning for Bushfire Protection 2019.

Floor:

- Concrete slab on ground

Walls:

- Wall that are less than 400mm from the ground or decks to be of masonry veneer or precast/in situ walls of concrete or aerated concrete or cladding fixed to timber framed and is non-combustible material or fibre-cement with minimum 6mm thickness.

Joints:

- All joint in the external surface material of wall to be covered, sealed, overlapped, backed or butt jointed.

Vents and Weepholes:

- Vents and weepholes in external walls shall be screened with a mesh made of corrosion-resistant steel, bronze or aluminium.

External glazed elements, assemblies and doors:

- Window glazing less than 400mm from the ground or decks to be Grade A safety glass of minimum 4mm thickness.
- Fitted with screens made from steel, bronze or aluminium to openable portion of windows.
- Window frame less than 400mm from the ground or decks to be made from metal or bushfire resisting timber.
- External door to be of non-combustible or solid timber, laminated timber or reconstituted timber, having a minimum thickness of 35 mm for the first 400 mm above the threshold or hollow core, solid timber, laminated timber or reconstituted timber with a non-combustible kickplate on the outside for the first 400 mm above the threshold.
- Door frame to be of bushfire resisting timber or metals. Where doors incorporate glazing, the glazing shall be Grade A safety glass a minimum of 4 mm in thickness
- Seals and weather strips Weather strips, draught excluders or draught seals shall be installed.
- Sliding door frame to be of metal.
- Garage door within 400mm of ground to be of non-combustible construction and protected with suitable weather strips or brushes.

Roof:

- Roof tiles/sheet to be non-combustible.
- Roof/wall and roof/roof junctions to be sealed.
- Roof ventilation opening to be fitted with ember guards made of non-combustible material.
- Tile roof to be fully sharked.
- Sheet roof
- Sheet roofs shall:
 - be fully sarked in accordance with Clause 5.6.2, except that foil-backed insulation blankets may be installed over the battens; or
 - have any gaps sealed at the fascia or wall line, hips and ridges by:
 - a mesh or perforated sheet that conforms with Clause 3.6 and that is made of corrosion-resistant steel, bronze or aluminium; or
 - mineral wool; or
 - other non-combustible material; or
 - a combination of any of items (i), (ii) or (iii).
- Roof penetrations, including roof lights, roof ventilators, roof-mounted evaporative cooling units, serials, vent pipes and supports for solar collectors or the like, shall be sealed. The material used to seal the penetration shall be non-combustible.
- Glazed elements in roof lights and skylights may be of polymer provided a Grade A safety glass diffuser, that conforms with AS 1288, is installed under the glazing. Where glazing is an insulating glazing unit (IGU), Grade A toughened safety glass of minimum 4 mm in thickness shall be used in the outer pane of the IGU.
- Eaves ventilation openings shall be fitted with ember guards in accordance with Clause 3.6 and made of corrosion-resistant steel, bronze or aluminium.

Decks:


- Decking, stair treads and the trafficable surfaces of ramps and landings less than 300 mm (measured horizontally at deck level) from glazed elements that are less than 400 mm (measured vertically) from the surface of the deck (see Figure D2, Appendix D) shall be made from non-combustible material or bushfire-resisting timber.

Water and gas supply pipes:

- Above-ground, exposed water supply pipes shall be metal. External gas pipes and fittings above ground shall be of steel or copper construction having a minimum wall thickness in accordance with gas regulations or 0.9 mm whichever is the greater. The metal pipe shall extend a minimum of 400 mm within the building and 100 mm below ground.

- At the commencement of building works and in perpetuity, the approved Asset Protection Zone should be managed as per Appendix 4 of Planning for Bush Fire Protection 2019.

- All fences in bush fire prone areas should be made from either hardwood or non-combustible material. However, in circumstances where the fence connects directly to the dwelling, or in areas of BAL-29 or greater, they should be made of non-combustible material.

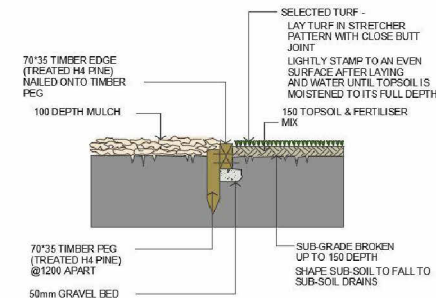

1. TURF & GARDEN EDGE DETAIL

NOTE:
ALIGNMENT OF BRICK EDGE SHALL BE EVEN & FREE FROM DIPS AND HUMPS.

CDC ISSUE

REV	DATE	DESCRIPTION	BY
4	31-08-2026	CDC ISSUE	



THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:


LOT 9 - 4 Tenth Ave

4 Tenth Avenue Austral

DRAWING TITLE:

LANDSCAPE PLAN

NORTH:



LOT NO:

9

DRAWN BY:

AS

DRAFTED BY:

RS

DATE:

22-09-2026

CHECKED BY:

RH

CLIENT NAME:

GOVINDA PRASAD GAUDEL & PRATIVA KHAREL GAUDEL

SCALE:

1 : 200

DRAWING No:

CDC.15

REV:

4

ISSUED BY:

ABCB HOUSING PROVISIONS : PART 10.2 WET AREA WATERPROOFING

10.2.1 Wet Areas

1. Building elements in wet areas within a building must be protected with a waterproofing system.
2. The waterproofing system in (1) must be either waterproof or water resistant in accordance with 10.2.2 to 10.2.6.

10.2.2 Shower Area (enclosed and unenclosed)

1. For a shower area with a hob, step-down or level threshold, the following applies:
- a. The floor of the shower area must be waterproof, including any hob or step-down (see Figure 10.2.2) and
- b. The walls of the shower area must be waterproof not less than 1800 mm above the floor substrate (see Figure 10.2.2).
- c. Wall junctions and joints within the shower area must be waterproof not less than 40 mm either side of the junction (see Figure 10.2.2).
- d. Wall/floor junctions within the shower area must be waterproof (see Figure 10.2.2).
- e. Penetrations within the shower area must be waterproof.
2. A shower with a preformed shower base must also comply with the requirements of (1), except for (a) which is not applicable.

Figure 10.2.2: Extent of treatment for shower areas - concrete compressed fibre-cement and fibre-cement sheet floors.

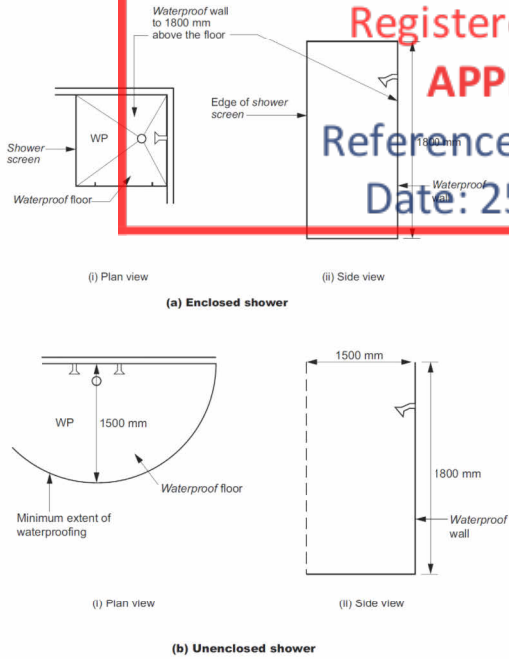


Figure Notes
Wall/floor junction heights are to be as per 10.2.2 to 10.2.6 (as applicable).

Notes
Where a shower is above a bath or spa, use requirements for shower.

10.2.3 Area outside shower area

1. For concrete, compressed fibre-cement and fibre-cement sheet flooring, the floor of the room must be water resistant.
2. For timber floors including particleboard, plywood and other timber based flooring materials, the floor of the room must be waterproof.
3. Wall/floor junctions must be -
- a. waterproof, and
- b. where a flashing is used, the horizontal leg must be not less than 40 mm.

10.2.4 Areas adjacent to baths and spas without showers

1. For areas adjacent to all baths and spas, the following applies:
- a. For concrete, compressed fibre-cement and fibre-cement sheet flooring, the floor of the room must be water resistant.
- b. For timber floors including particleboard, plywood and other timber based flooring materials, the floor of the room must be waterproof.
- c. Tap and spout penetrations must be waterproof where they occur in horizontal surfaces.
2. For areas adjacent to non-freestanding baths and spas, the following applies:
- a. Walls must be water resistant (see Figure 10.2.4a and Figure 10.2.4b)-
- to a height of not less than 150mm above the vessel, for the extent of the vessel, where the vessel is within 75mm of a wall; and
 - for all exposed surfaces below vessel lip.
- b. Wall junctions and joints must be water resistant within 150mm above a vessel for the extent of the vessel.
- c. Wall/floor junctions must be waterproof for the extent of the vessel (see Figure 10.2.4a and Figure 10.2.4b).
3. For inserted baths and spas, the following applies:
- a. For floors and horizontal surfaces:
- Any shelf area adjoining the bath or spa must be waterproof and include a waterstop under the vessel lip.
 - There are no requirements for the floor under a bath or spa.
- b. For walls:
- Waterproof to not less than 150mm above the lip of a bath or spa.
 - There are no requirements for the floor under a bath or spa.
- c. For wall junctions and joints, the following applies:
- Waterproof junctions within 150mm of a bath or spa.
 - There are no requirements for junctions and joints in walls beneath the lip of a bath or spa.
- d. Tap and spout penetrations must be waterproof where they occur in horizontal surfaces.

Figure 10.2.4a: Areas adjacent to baths and spas without showers for concrete, compressed fibre-cement and fibre-cement sheet flooring


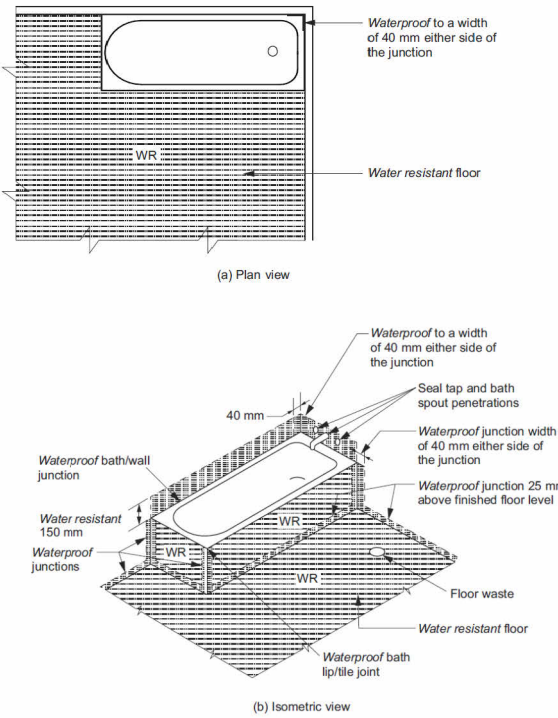



Figure 10.2.4b: Areas adjacent to baths and spas without showers for timber floors including particle-board, plywood and other floor materials

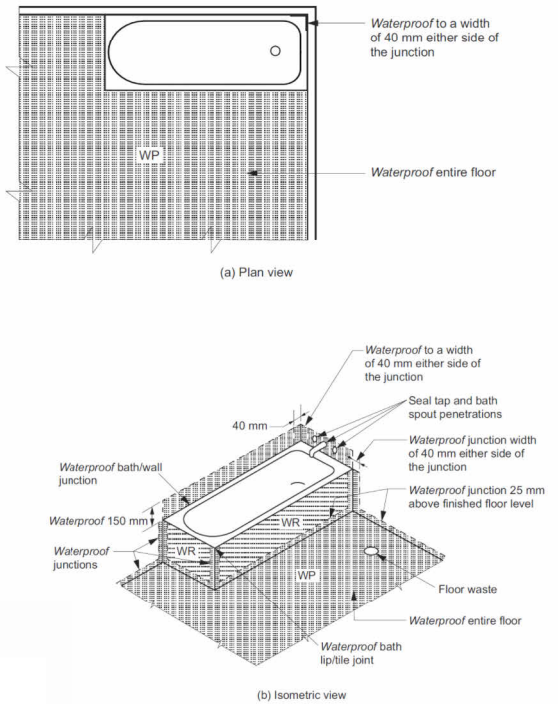

10.2.5 Other areas

1. For walls adjoining other types of vessels (e.g. sink, basin or laundry tub), the following applies:
- a. Walls must be water resistant to a height of not less than 150mm above the vessel, for the extent of the vessel, where the vessel is within 75 mm of a wall (see Figure 10.2.5.)
- b. Waterproof wall junctions where a vessel is fixed to a wall.
- c. Waterproof tap and spout penetrations where they occur in surfaces required to be waterproof or water resistant.
2. For laundries and WCs, the following applies:
- a. The floor of the room must be water resistant.
- b. Wall/floor junctions must be water resistant, and where a flashing is used, the horizontal leg must not be less than 40 mm.
3. For WCs with handheld bidet spray installations, the following applies:
- a. The floor of the room must be waterproof.
- b. Walls must be -
- waterproof in WC area within a 900 mm radius from the wall connection of the handheld bidet spray device to a height of not less than 150mm above the floor substrate; and
 - water resistant in WC area within a 900 mm radius from the wall connection of the handheld bidet device to not less than 1200 mm above the finished floor level of the WC.
- c. Wall junctions within the WC area within 900 mm radius from the wall connection of the handheld bidet spray device must be waterproof.
- d. Wall/floor junctions within the WC area within 1000 mm radius from the wall connection of the handheld bidet spray device must be waterproof.
- e. Penetrations in the WC area must be waterproof.

Figure 10.2.5: Bath and vessel abutting wall - areas to be protected

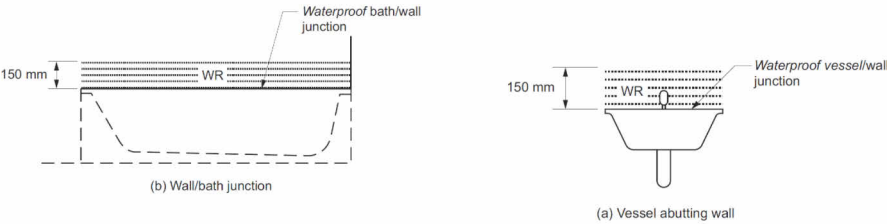

10.2.6 Waterproofing systems

1. For the purposes of this Part, a waterproofing system is deemed -
- a. waterproof, if it complies with (2); or
- b. water resistant, if it complies with (3).
2. For a waterproofing system required to be waterproof in accordance with 10.2.2 to 10.2.5, the materials nominated in 10.2.8 must be used.
3. For a waterproofing system required to be water resistant in accordance with 10.2.2 to 10.2.5, the materials nominated in 10.2.9 must be used in conjunction with the materials in 10.2.10.

10.2.12 Construction of wet area floors - falls

Where a floor waste is installed -

a. the minimum continuous fall of a floor plane to the waste must be 1:80; and

b. the maximum continuous fall of a floor plane to the waste must be 1:50.

4	31-08-2026	CDC ISSUE	
REV	DATE	DESCRIPTION	BY



THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:


LOT 9 - 4 Tenth Ave

4 Tenth Avenue Austral

DRAWING TITLE:

WATERPROOFING DETAILS

NORTH:



LOT NO:	DATE:	SCALE:	DRAWING No:	REV:
9	22-09-2026	1 : 50	CDC.18	4
DRAWN BY:	CHECKED BY:			ISSUED BY:
AS	RH			
DRAFTED BY:	CLIENT NAME:			
RS	GOVINDA PRASAD GAUDEL & PRATIVA KHAREL GAUDEL			

CDC ISSUE

☑ BAL – 12.5

PARAGON

Paragon Building Certifiers Pty Ltd


RBC00045

Registered Certifier

APPROVED

Reference: 260530/01

Date: 25/09/2026

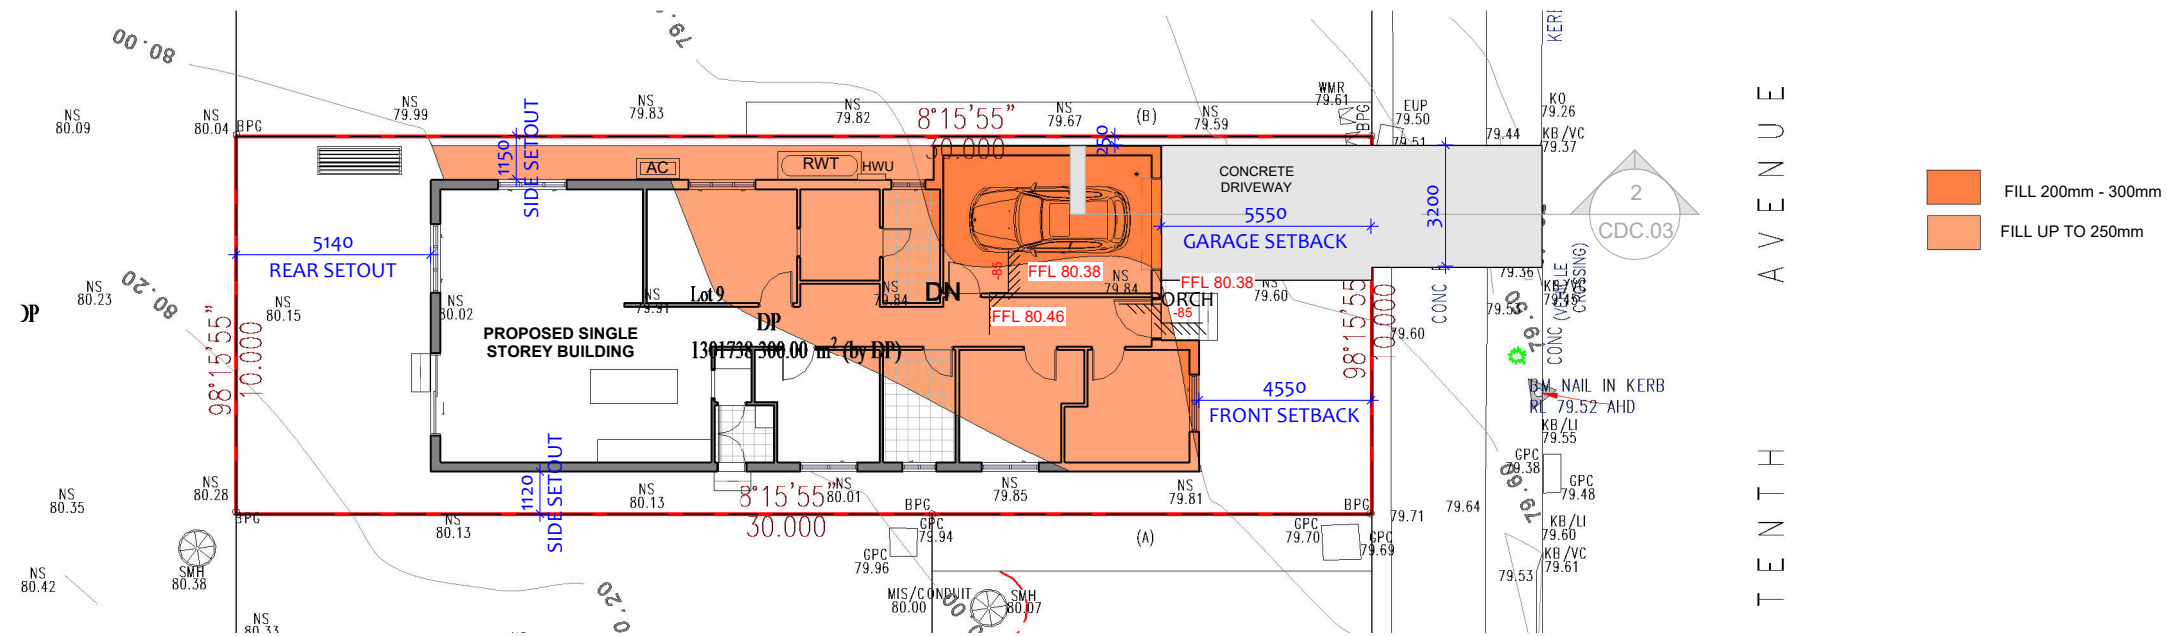

1

CDC -CUT/FILL PLAN


1 : 200

REV	DATE	DESCRIPTION	BY
4	31-08-2026	CDC ISSUE	



RUBY
HOMES

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT: LOT 9 - 4 Tenth Ave 4 Tenth Avenue Austral	DRAWING TITLE: CUT/FILL PLAN	NORTH: 	LOT NO: 9 DRAWN BY: AS DRAFTED BY: RS	DATE: 22-09-2026 CHECKED BY: RH CLIENT NAME: GOVINDA PRASAD GAUDEL & PRATIVA KHAREL GAUDEL	SCALE: 1 : 200	DRAWING No: CDC.20	REV: 4 ISSUED BY:
--	--	--	---	--	--------------------------------------	--	--