

FOR CONSTRUCITON

LOT 2007 21 LOUISIANA STREET ROUSE HILL. IN DP 1279737.

PROPOSED CONSTRUCTION OF A TWO STOREY DWELLING



BASIX COMMITMENTS		Certificate number: 1860480S Date of issue: Tuesday, 11 August 2026
WATER		
LANDSCAPE	60m2	
TOILETS	4 STARS	
KITCHEN TAPS	4 STARS	
SHOWER HEADS	4 STAR (>4.5 but <=6 Umin)	
BASIN TAPS	4 STARS	
ALTERNATIVE WATER	1500L RAINWATER TANK	
ROOF WATER TO TANK	221m2	
ALT.WATER USES- TANK	LAUNDRY	
ALT. WATER USES - RETIC	ALL TOILETS + ONE OUTDOOR TAP	
OUTDOOR SPA	NA	
ENERGY		
HOT WATER	GAS INSTANTANEOUS - 5 STAR	
AIR-CON (HEATING)	3 PHASE DUCTED - EER 3.0-3.5	
AIR-CON (COOLING)	3 PHASE DUCTED - EER 3.0-3.5	
VENTILATION - BATHROOM	NONE/ NATURAL VENTILATION	
VENTILATION - KITCHEN	DUCTED - MANUAL SWITCH	
VENTILATION - LAUNDRY	NONE/ NATURAL VENTILATION	
PV SYSTEM	NA	
COOKTOP	GAS	
OVEN	ELECTRIC	
CLOTHES DRYING	OUTDOOR CLOTHESLINE	
LIGHTING	DEDICATED LED	

GENERAL LEGEND	
AC	AIR CONDITIONING UNIT
AL	POWDERCOATED ALUMINIUM DOOR/ WINDOW
BAL	BALUSTRADE TYPE
BG	BOX GUTTER
BR1, BR2, etc.	BRICK FACE TYPE
CAP	METAL CAPPING
CD1, CD2, etc.	WALL CLADDING
CONC.	CONCRETE FLOOR
CPT	CARPET
CRT	CONCRETE ROOF TILES
CR1, CR2, etc.	CEMENT RENDER TYPE/ COLOUR
DP/S	DOWN PIPE
DW	DISH WASHER
ED	ENTRY DOOR
F	FRIDGE
FAS	FASCIA
FET	FEATURE TILE
FT, FT1, FT2, etc.	FLOOR TILES
FW	FLOOR WASTE
GD	GARAGE DOOR
GUT	GUTTER
HWU	HOT WATER UNIT
HYB	HYBRID FLOOR
L	LINEN
MR	METAL ROOF
MW	MICROWAVE OVEN
NGL	NATURAL GROUND LEVEL
OBS	OBSCURED GLASS
P	PANTRY
R	ROBE
RL	REDUCED LEVEL
RWH	RAIN WATER HEAD
RWT	RAIN WATER TANK
S	STORAGE
TOW	TOP OF WALL
TL	TIMBER LAMINATE
WC	WATER CLOSET
WM	WASHING MACHINE
SD	SMOKE DETECTOR

Sheet List				
Sheet No.	Sheet Name	Drawn By	Current Revision Date	Current Revision
CDC.01	COVER SHEET	AS	19-08-2026	CDC ISSUE
CDC.02A	GENERAL NOTES	AS	03-07-2026	CDC ISSUE
CDC.02B	GENERAL NOTES 02	AS	03-07-2026	CDC ISSUE
CDC.03	LOCATION PLAN AND SITE PLAN	AS	19-08-2026	CDC ISSUE
CDC.04	SITE ANALYSIS AND SEDIMENT CONTROL	AS	19-08-2026	CDC ISSUE
CDC.05	GROUND FLOOR PLAN	AS	19-08-2026	CDC ISSUE
CDC.06	FIRST FLOOR LEVEL	AS	19-08-2026	CDC ISSUE
CDC.07	ROOF PLAN	AS	03-07-2026	CDC ISSUE

Sheet List				
Sheet No.	Sheet Name	Drawn By	Current Revision Date	Current Revision
CDC.08	ELEVATION 01	AS	03-07-2026	CDC ISSUE
CDC.09	ELEVATION 02	AS	03-07-2026	CDC ISSUE
CDC.10	SECTIONS	AS	03-07-2026	CDC ISSUE
CDC.11	FLOOR AREA PLAN	AS	03-07-2026	CDC ISSUE
CDC.12	RENTABLE AREA PLAN	AS	03-07-2026	CDC ISSUE
CDC.14	COLOR SCHEDULE	AS	03-07-2026	CDC ISSUE
CDC.15	LANDSCAPE PLAN	AS	19-08-2026	CDC ISSUE
CDC.19	WATERPROOFING PLAN	AS	03-07-2026	CDC ISSUE

				CDC ISSUE								
13	19-08-2026	Spa removed, RWT 2000L, TU added, Ldry position changed, G.BED layout changed, Ground Floor Dining extended, Area increased by 11sqm, hot/cold water provision, Cavity door to WIP, WIR2 and WIR4 removed and made built-in robes, Cladding wall on FF, FW3 and FW11 removed, Rear roof reduced to 18 degrees		 THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.	PROJECT: LOT 2007 21 LOUISIANA STREET 21 LOUISIANA STREET ROUSE HILL	DRAWING TITLE: COVER SHEET	NORTH:	LOT NO: 2007	DATE: 26-08-2026	SCALE: As indicated	DRAWING No: CDC.01	REV: 13
								DRAWN BY: AS	CHECKED BY: RH			ISSUED BY:
								DRAFTED BY: ID	CLIENT NAME: Sanjeewa Jayawickrama Monarawila & Gayani Perera Weheragodage			
REV	DATE	DESCRIPTION	BY									



THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

BUILDING SPECIFICATIONS

**National Construction Code – Volume 2,
Amendment 1 – Building Code of Australia 2022
& Housing Provisions Standard 2022**

SITE PREPARATION

- PART 3.1 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.

EARTHWORKS

- TO BE CARRIED OUT IN ACCORDANCE WITH THE REQUIREMENTS OF THE ENVIRONMENTAL PLANNING & ASSESSMENT ACT 1979 AND DEVELOPMENT CONSENT CONDITIONS
- PART 3.2 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 4678:2002 - EARTH-RETAINING STRUCTURES

DRAINAGE

- PART 3.3 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS/NZS 3500.1:2021 - PLUMBING & DRAINAGE - WATER SERVICES
- AS/NZS 3500.2:2021 - PLUMBING & DRAINAGE - SANITARY PLUMBING & DRAINAGE
- AS/NZS 3500.3:2021 - PLUMBING & DRAINAGE - STORMWATER DRAINAGE
- AS/NZS 3500.4:2021 - PLUMBING & DRAINAGE - HEATED WATER SERVICES

STRUCTURAL WORK

- Part 2.2 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 4100:2020 - STEEL STRUCTURES CODES
- AS/NZS 1170.0:2002 - GENERAL PRINCIPLES
- AS/NZS 1170.1:2002 - PARTS 1 PERMANENT, IMPOSED AND OTHER ACTIONS
- AS/NZS 1170.2:2021 - PART 2 WIND ACTIONS
- AS 3700:2018 - SAA MASONRY CODE
- AS 1684.3:2021 - RESIDENTIAL TIMBER FRAMED CONSTRUCTION

FOOTINGS & SLABS

- PART 4 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 2159:2009 - PILING - DESIGN & INSTALLATION
- AS 2870:2011 - RESIDENTIAL SLABS & FOOTINGS
- AS 3600:2018 - CONCRETE STRUCTURES

MASONRY

- PART 5 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 3700:2018 - MASONRY STRUCTURES

FRAMING

- PART 6 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 1684.2:2021 - RESIDENTIAL TIMBER-FRAMED CONSTRUCTION - NON- CYCLONIC AREAS
- AS 1720.1:2010 - TIMBER STRUCTURES - DESIGN METHODS
- AS 4100:2020 - STEEL STRUCTURES
- AS 3660.1:2014 - TERMITE MANAGEMENT SYSTEM

ROOF & WALL CLADDING

- PART 7 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 1273:1991 - UNPLASTICIZED PVC (UPVC) DOWNPIPES & FITTINGS FOR RAINWATER
- AS 1562.1:2018 - DESIGN & INSTALLATION OF SHEET ROOF & WALL CLADDING - METAL
- AS/NZS 1562.3:2006 - DESIGN & INSTALLATION OF SHEET ROOF & WALL CLADDING - PLASTIC
- AS 2049:2002 - ROOF TILES
- AS 2050:2018 - INSTALLATION OF ROOF TILES
- AS 4285:2019 - ROOFLIGHTS

GLAZING

- PART 8 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 1288:2021 - GLASS IN BUILDINGS - SELECTION & INSTALLATION
- AS 2047:2014 - WINDOWS & EXTERNAL GLAZED DOORS IN BUILDINGS
- AS/NZS 2208:1996 - SAFETY GLAZING MATERIALS IN BUILDINGS

FIRE SAFETY

- PART 9 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 3786:2014 - SMOKE ALARMS USING SCATTERED LIGHT, TRANSMITTED LIGHT OR IONIZATION

HEALTH & AMENITY

- PART 10 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS/NZS ISO 717.1:2004 - ACOUSTICS - RATING OF SOUND INSULATION IN BUILDINGS & OF BUILDING ELEMENTS - AIRBORNE SOUND INSULATION
- AS ISO 717.2:2004 - ACOUSTICS - RATING OF SOUND INSULATION IN BUILDINGS & OF BUILDING ELEMENTS - IMPACT SOUND INSULATION
- AS 1668.2:2012 - THE USE OF VENTILATION & AIR CONDITIONING IN BUILDINGS - MECHANICAL VENTILATION IN BUILDINGS
- AS 1668.4:2012 - THE USE OF VENTILATION & AIR CONDITIONING IN BUILDINGS - NATURAL VENTILATION OF BUILDINGS
- AS/NZS 1680.0:2009 - INTERIOR LIGHTING - SAFE MOVEMENT
- AS 3740:2021 - WATERPROOFING OF DOMESTIC WET AREAS
- AS 3000:2018 - ELECTRICAL INSTALLATION
- BCA Part 10.8.1, AS4200.1 & AS4200.2 - PLIABLE BUILDING MEMBRANE INSTALLED.

WATERPROOFING

- PART 10.2 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022
- AS 3740:2021 - WATERPROOFING TO WET AREA
- AS 4654:2012 - EXTERNAL WET AREAS

SAFE MOVEMENT & ACCESS

- PART 11 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 1428.1:2009 - DESIGN FOR ACCESS & MOBILITY - GENERAL REQUIREMENTS FOR ACCESS - NEW BUILDING WORK
- AS 1657:2018 - FIXED PLATFORMS, WALKWAYS, STAIRWAYS & LADDERS - DESIGN, CONSTRUCTION & INSTALLATION

HANDRAILS & BALUSTRADE

- PART 11.3.3 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- PART 11.3.4 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- PART 11.3.5 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 1170.1:2002 - BALUSTRADE INSTALLATION

PROTECTION OF OPENABLE WINDOW

- PART 11.3.7 AND 11.3.8 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.

ENERGY EFFICIENCY

- PART 13 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022 & BASIX CERTIFICATE.

HEATING APPLIANCES, FIREPLACES, CHIMNEYS AND FLUES

- PART 12.4 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.

MECHANICAL VENTILATION

- EXHAUST FROM A BATHROOM, SANITARY COMPARTMENT TO DISCHARGE DIRECTLY TO OUTDOOR AIR WITH MINIMUM FLOW RATE OF 25L/S & MAKE-UP AIR VIA OPENINGS TO AN ADJACENT ROOM WITH A FREE AREA OF 14,000 MM². THIS EXHAUST SYSTEM MUST BE INTERLOCKED WITH LIGHT SWITCH AND INCLUDE RUN-ON TIMER SO THAT THE EXHAUST SYSTEM CONTINUES TO OPERATE FOR 10 MINUTES AFTER THE LIGHT SWITCH IS OFF.
- ANY INSTALLED - KITCHEN RANGEHOOD EXHAUST TO DISCHARGE DIRECTLY OR VIA DUCT TO OUTDOOR AIR WITH MINIMUM FLOW RATE OF 40L/S & MAKE-UP AIR VIA OPENINGS TO AN ADJACENT ROOM WITH A FREE AREA OF 14,000 MM².
- LAUNDRY EXHAUST TO DISCHARGE DIRECTLY OR VIA DUCT TO OUTDOOR AIR WITH MINIMUM FLOW RATE OF 40L/S & MAKE-UP AIR VIA OPENINGS TO AN ADJACENT ROOM WITH A FREE AREA OF 14,000 MM².



1	03-07-2026	CDC ISSUE	
REV	DATE	DESCRIPTION	BY



THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:
LOT 2007 21 LOUISIANA STREET
21 LOUISIANA STREET ROUSE HILL

DRAWING TITLE:
GENERAL NOTES

NORTH:	LOT NO: 2007	DATE: 26-08-2026	SCALE: 1 : 2	DRAWING No: CDC.02A	REV: 1
	DRAWN BY: AS	CHECKED BY: RH			ISSUED BY:
	DRAFTED BY: ID	CLIENT NAME: Sanjeeva Jayawickrama Monarawila & Gayani Perera Weheragodage			

TERMITE SHEET


- TERMITE SHEET EXTENDS THROUGH THE ENTIRE MASONRY LEAF AND IS VISIBLE AT THE FINISHED FACE OF THE WALL.



(a) Masonry veneer with separate strip footings

DIMENSIONS IN MILLIMETRES

FIGURE 5.5 (in part) TYPICAL SHEET INSTALLATION TO EXTERNAL WALL WITH CONCRETE FLOOR SLAB

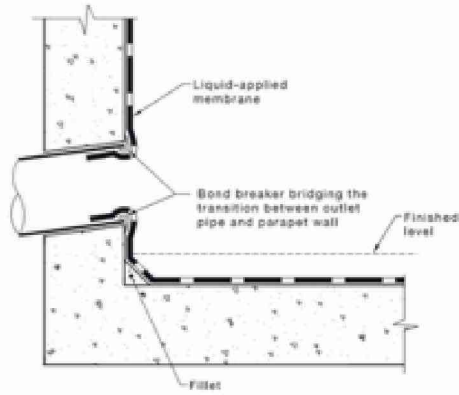

(a) Overflow through parapet

WATERPROOFING

FALL TO FLOOR WASTE TO BE MINIMUM 1:80 TO MAXIMUM 1:50

Figure 10.2.29: Typical membrane termination at drainage outlet



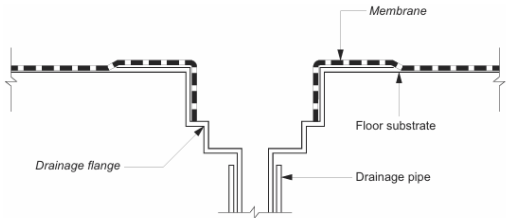


Figure 10.2.24: Typical bathroom door details for whole bathroom waterproofing

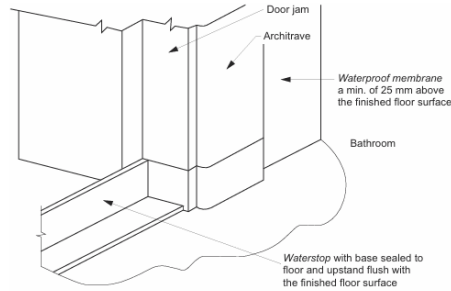


(a) After installation of architrave

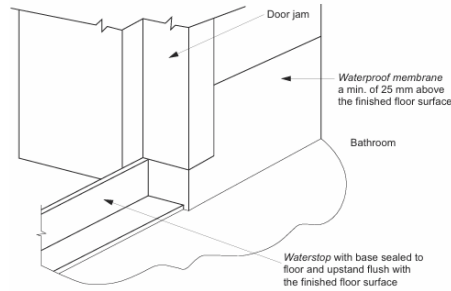

(b) Prior to installation of architrave


DPC FOR BRICKS


DAMP-PROOF COURSE (DPC) TO EXTENDS THROUGH THE ENTIRE MASONRY LEAF AND NEED TO BE VISIBLE AT THE FINISHED FACE OF THE WALL FROM OUTSIDE

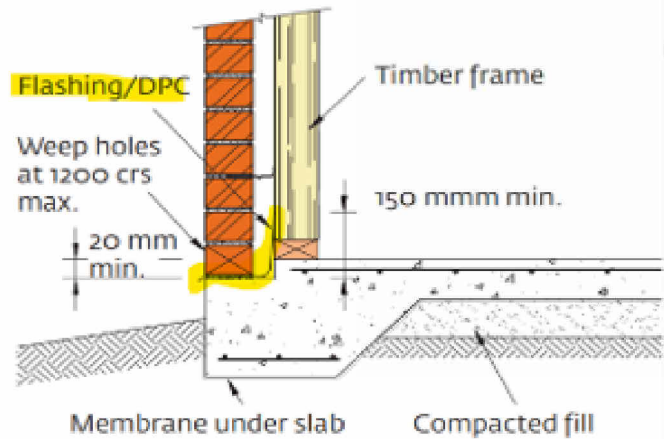


OVERFLOW TO BALCONY:


- SURFACE DRAIN & OVERFLOW TO BALCONY

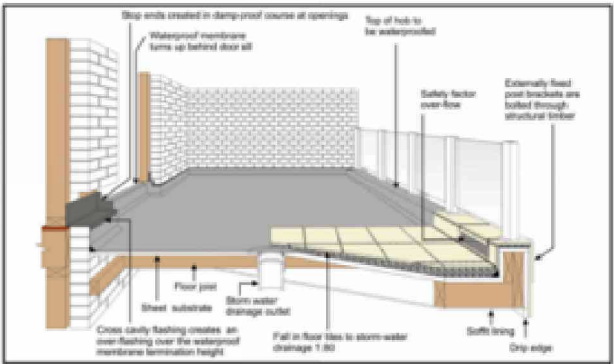

				CDC ISSUE								
					PROJECT: LOT 2007 21 LOUISIANA STREET 21 LOUISIANA STREET ROUSE HILL	DRAWING TITLE: GENERAL NOTES 02		LOT NO:	DATE:	SCALE:	DRAWING No:	REV:
								2007	26-08-2026	1 : 2	CDC.02B	2
								DRAWN BY:	CHECKED BY:			
								AS	RH			
2	03-07-2026	CDC ISSUE		THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.				CLIENT NAME:	Sanjeeva Jayawickrama Monarawila & Gayani Perera Weheragodage			
1	26-06-2026	WIP Door Adjusted and Spa Added										
REV	DATE	DESCRIPTION	BY									

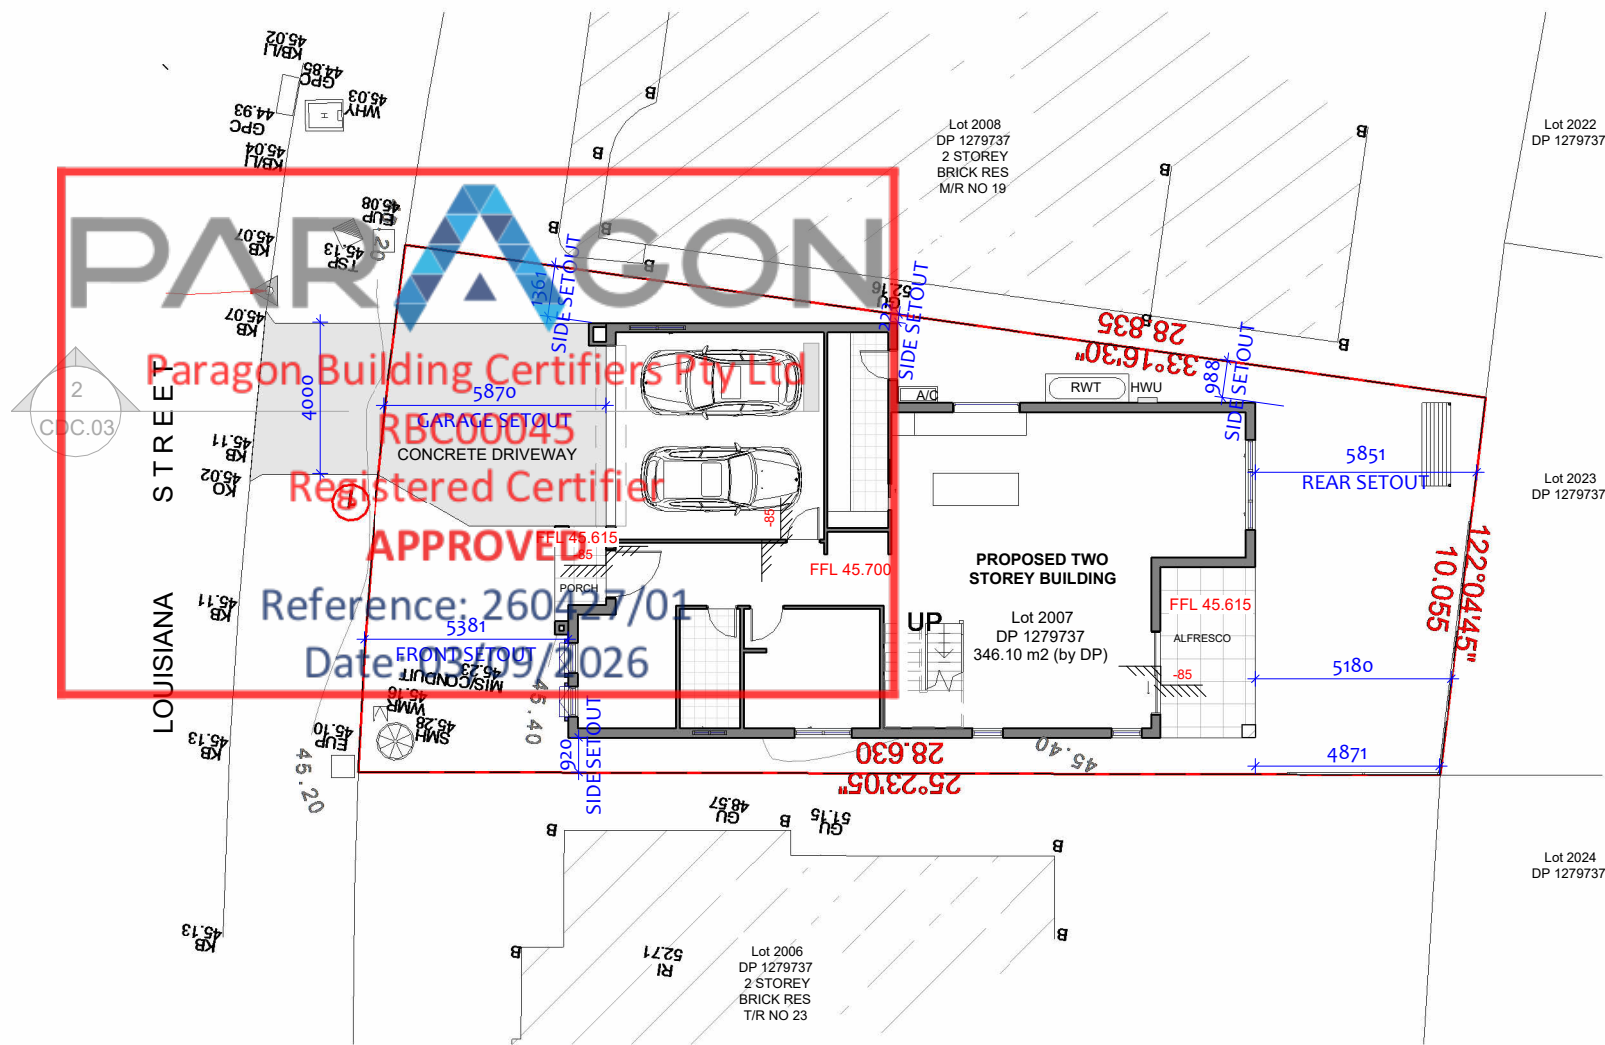

1 CDC - SITE PLAN
1 : 200

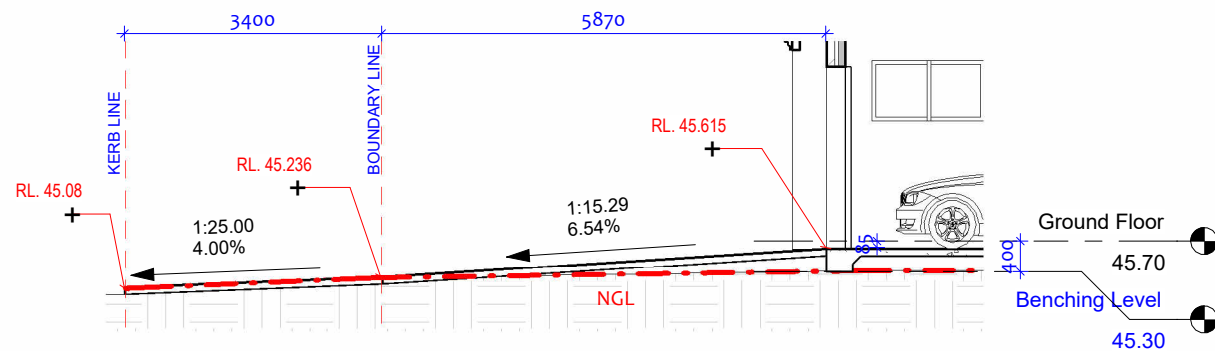

2 DRIVEWAY SECTION
1 : 100

Area Schedule (Rentable)


Name	Area
Ground Floor	
GFA	116 m ²
GARAGE	30 m ²
PORCH	3 m ²
ALFRESCO	11 m ²
Ground Floor: 4	161 m ²
Level 1	
FFA	102 m ²
STAIR VOID	20 m ²
PORCH	3 m ²
Level 1: 3	125 m ²
Grand total: 7	285 m ²

GREENFIELD HOUSING CODE COMPLIANCE TABLE

DESCRIPTION		COMPLIANCE		COMMENT
ELEMENT	CODE CONTROL	REQUIREMNT	PROPOSED	
LOAND ZONE	1 GENERAL RESIDENTIAL			
LOT NO	LOT 2007			
LOT AREA	346.1 m2			
LOT WIDTH	Standard Lot Min. 6m at Building Line facing primary road	6.0m	13.6 m	YES
HEIGHT	MAX. Height	8.5m	8.0m (MAX.)	YES
FRONT SETBACK	FRONT SET BACK (Min. Setback from Primary Road) For 300-350 sqm. Lot	4.5 m	5.3m	YES
REAR SET BACK (MIN.)	GROUND FLOOR	3m	5.85m	YES
	FIRST FLOOR	6m	7.3 m	
SIDE SET BACK (MIN.)	GROUND FLOOR	0/0.9m	0.28/0.9m	YES
	FIRST FLOOR	1.2/0.9m	1.4/0.9m	
FLOOR SPACE RATIO (FSR)	235 sqm.	235.00m2	230 m2	YES
GROSS FLOOR AREA PLAN	GROUND FLOOR		116 m2	
	FIRST FLOOR		102 m2	
TOTAL FLOOR AREA			216m2	
ROOF AREA			207 m2	
GARAGE			30m2	
PRIVATE OPEN SPACE	>10m Lot width	24m2	24 m2	YES
LANDSCAPE AREA	15 % of TOTAL LAND AREA	51.91 m2	105 m2	YES

CDC ISSUE

REV	DATE	DESCRIPTION	BY	PROJECT:	DRAWING TITLE:	NORTH:	LOT NO:	DATE:	SCALE:	DRAWING No:	REV:
3	19-08-2026	Spa removed, RWT 2000L, TU added, Ldry position changed, G.BED layout changed, Ground Floor Dining extended, Area increased by 11sqm, hot/cold water provision, Cavity door to WIP, WIR2 and WIR4 removed and made built-in robes, Cladding wall on FF, FW3 and FW11 removed, Rear roof reduced to 18 degrees		LOT 2007 21 LOUISIANA STREET	LOCATION PLAN AND SITE PLAN		2007	26-08-2026	As indicated	CDC.03	3
2	08-07-2026	Above Ground Spa- Client		21 LOUISIANA STREET ROUSE HILL			AS	RH			
							ID				

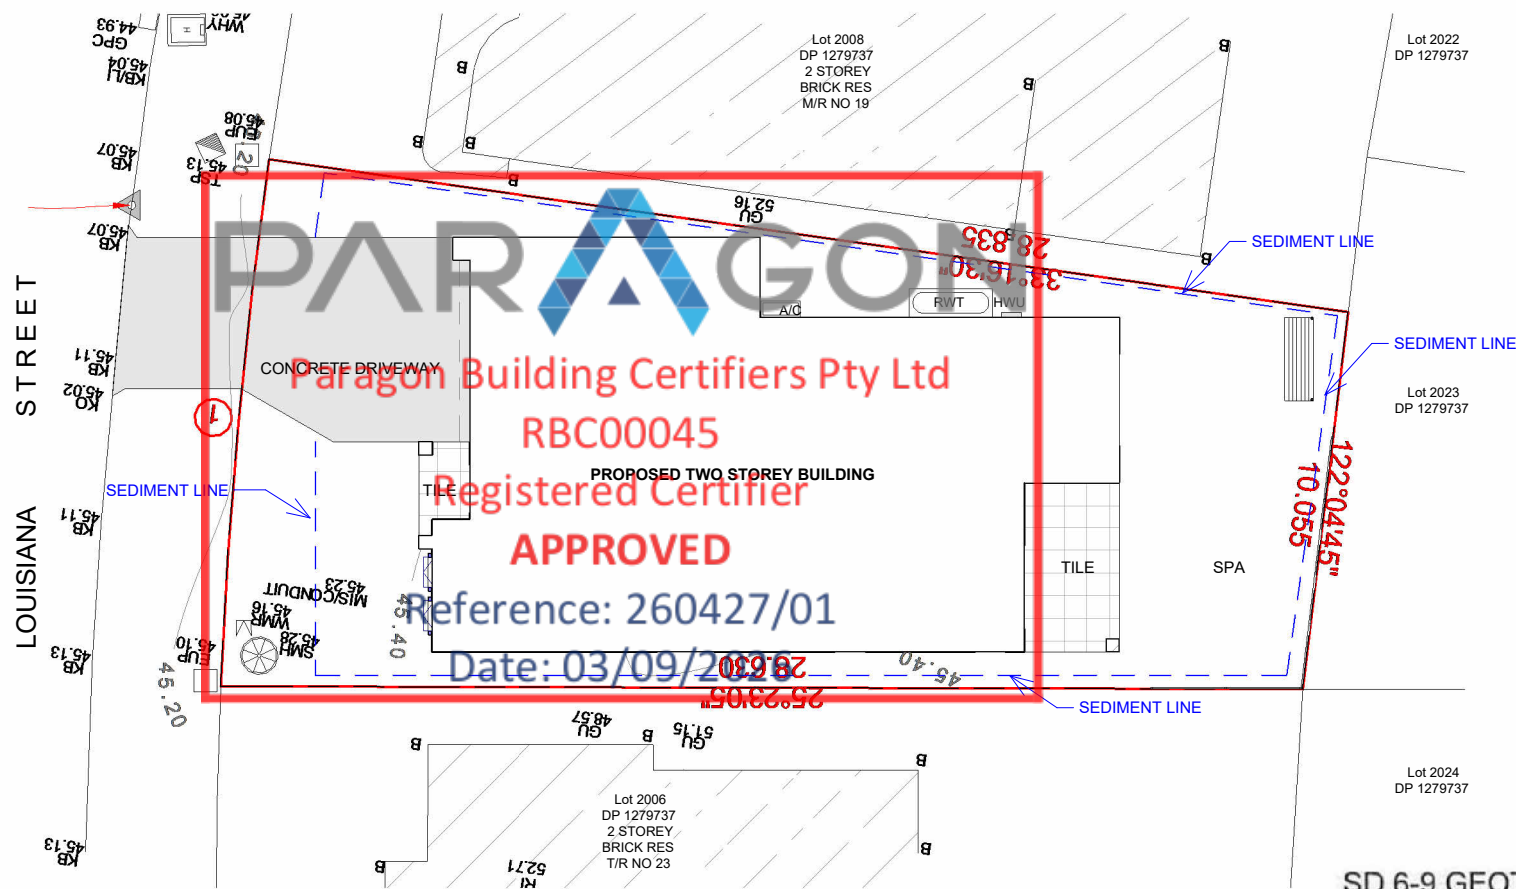

TEMPORARY 1.8M HIGH WIRE ML FENCE WITH DUSTPROOF MESH APPLIED TO FULL HEIGHT TO BOUNDARIES AS REQUIRED

LOCATION OF WASTE BINS

SEDIMENT FENCE AS REQUIRED

GRAVEL ACCESS

SITE ACCESS AREA TO BE USED FOR WASHDOWN AREA

FOOTPATH CLEAN AND CLEAR AT ALL TIMES

LOCATION OF STOCKPILE MATERIAL

MATERIAL STORAGE AREA

TEMPORARY TOILETS

INSTALL TEMPORARY SEDIMENT BARRIERS TO ALL INLET PITS LIKELY TO COLLECT SILT LADEN WATER, TO COUNCIL'S REQUIREMENTS.

SD 6-9 GEOTEXTILE INLET FILTER

- 1) FABRICATE A SEDIMENT BARRIER MADE FROM GEOTEXTILE. REFER SD6-7 FOR DETAILS.
- 2) SUPPORT GEOTEXTILE WITH MESH TIED TO POSTS AT 1 m Ctrs.
- 3) DO NOT COVER INLET WITH GEOTEXTILE.

SITE WORKS NOTES





1. ORIGIN OF LEVELS PROVIDED BY SURVEYOR
2. THE BUILDER SHALL VERIFY ALL DIMENSIONS AND EXISTING LEVELS ON SITE PRIOR TO THE COMMENCEMENT OF WORK AND ANY DISCREPANCIES SHALL BE REPORTED TO THE SURVEYOR / ENGINEER.
3. TOPSOIL SHALL BE STRIPPED FROM THE CONSTRUCTION AREA AND STOCKPILED ON SITE, TO BE LATER SPREAD OR DISPOSED OFF SITE AS DIRECTED BY SUPERVISOR / ENGINEER.
4. ALL TRENCH BACKFILL MATERIAL SHALL BE COMPACTED TO THE SAME DENSITY AS THE ADJACENT MATERIAL.
5. ALL SERVICE TRENCHES UNDER VEHICULAR PAVEMENTS SHALL BE BACKFILLED WITH SAND OR APPROVED GRANULAR MATERIALS, TO THE UNDERSIDE OF THE PAVEMENT, AND COMPACTED TO 98% STANDARD MAXIMUM DRY DENSITY, IN ACCORDANCE WITH AS 1289E1.1.

1 CDC - SITE ANALYSIS AND SEDIMENT CONTROL

1 : 200

SD 5-7 STABILISED SITE ACCESS

- 1) STRIP TOPSOIL AND LEVEL SITE.
- 2) COMPACT SUBGRADE.
- 3) COVER AREA WITH GEOTEXTILE.
- 4) CONSTRUCT 200 mm THICK PAD OVER GEOTEXTILE USING ROADBASE OR 30 mm AGGREGATE. Min 15 m LONG OR TO BUILDING ALIGNMENT. Min 3 m WIDE.
- 5) CONSTRUCT HUMP IMMEDIATELY WITHIN BOUNDARY TO DIVERT WATER TO A SEDIMENT FENCE OR OTHER SEDIMENT TRAP.

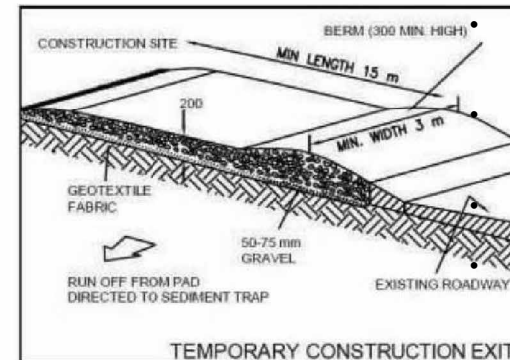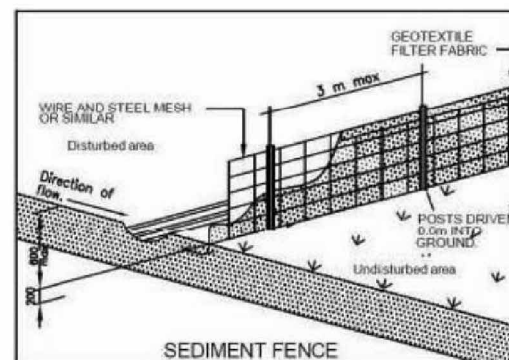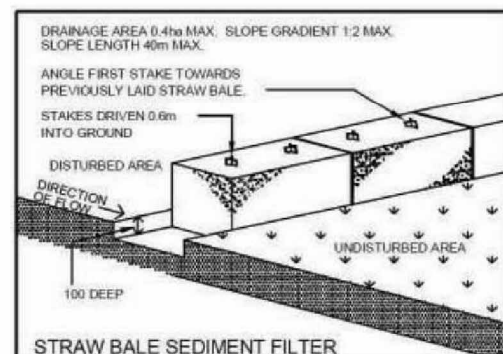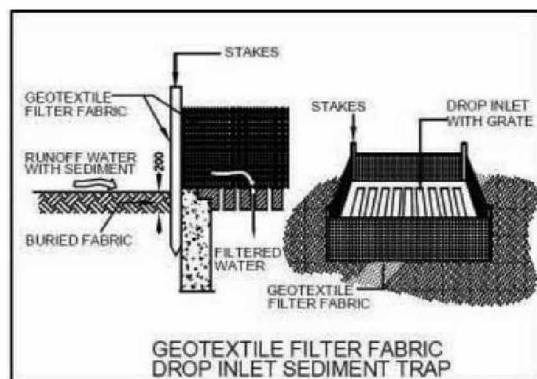

SEDIMENT AND EROSION NOTES:

- THIS PLAN TO BE READ IN CONJUNCTION WITH SEDIMENT AND EROSION CONTROL DETAILS AS ATTACHED.
- THE CONTRACTOR SHALL IMPLEMENT ALL SOIL EROSION AND SEDIMENT CONTROL MEASURES AS NECESSARY AND TO THE SATISFACTION OF COUNCIL PRIOR TO THE COMMENCEMENT AND DURING CONSTRUCTION. NO DISTURBANCE TO THE SITE SHALL BE PERMITTED OTHER THAN IN THE IMMEDIATE AREA OF THE WORK AND NO MATERIAL SHALL BE REMOVED FROM THE SITE WITHOUT COUNCIL'S APPROVAL. ALL SEDIMENT AND EROSION CONTROL DEVICES TO BE INSTALLED AND MAINTAINED IN ACCORDANCE WITH STANDARDS OUTLINED IN NSW DEPARTMENT OF HOUSING "MANAGING URBAN STORMWATER-SOILS AND CONSTRUCTIONS".
- TOPSOIL SHALL BE STRIPPED AND STOCKPILED OUTSIDE HAZARD AREAS SUCH AS DRAINAGE LINES. THIS TOP SOIL IS TO BE RESPIRED LATER ON AREAS TO BE REVEGETATED AND STABILISED ONLY. (I.E ALL FOOTPATHS, BATTERS, SITE REGARDING AREAS, BASINS AND CATCH DRAINS). TOPSOIL SHALL NOT BE RESPIRED ON ANY OTHER AREAS UNLESS SPECIALLY INSTRUCTED BY THE SUPERINTENDENT. IF THEY ARE TO REMAIN FOR LONGER THAN ONE MONTH STOCKPILES SHALL BE PROTECTED FROM EROSION BY COVERING THEM WITH A MULCH AND HYDROSEEDING AND, IF NECESSARY, BY LOCATING BANKS OR DRAINS DOWNSTREAM OF A STOCKPILE TO RETARD SILT LADEN RUNOFF.
- THE CONTRACTOR SHALL REGULARLY MAINTAIN ALL SEDIMENT AND EROSION CONTROL DEVICES AND REMOVE ACCUMULATED SILT FROM SUCH DEVICES SUCH THAT MORE THAN 60% OF THEIR CAPACITY NOT LOST. ALL THE SILTS TO BE PLACED OUTSIDE THE LIMIT OF WORKS. THE PERIOD FOR MAINTAINING THESE DEVICES SHALL BE AT LEAST UNTIL ALL DISTURBED AREAS ARE REVEGETATED AND FURTHER AS MAY BE DIRECTED BY THE SUPERINTENDENT OR COUNCIL.
- LAY TURF STRIP (MIN 300 mm WIDE) ON 100 mm TOPSOIL WITH 1.0 m LONG RETURNS EVERY 6.0m BEHIND ALL KERB AT THE TOP OF ALL BATTERS AND AROUND STRUCTURES IMMEDIATELY AFTER BACKFILLING OR FORMATION.
- THE CONTRACTOR SHALL GRASS SEED ALL DISTURBED AREAS WITH AN APPROVED MIX AS SHOWN AS PRACTICABLE AFTER COMPLETION OF EARTHWORKS AND REGRADING.
- VEHICULAR TRAFFIC SHALL BE CONTROLLED DURING CONSTRUCTION CONFINING ACCESS WHERE POSSIBLE TO NOMINATED STABILISED ACCESS POINTS.
- WHEN ANY DEVICES ARE TO BE HANDED OVER TO COUNCIL, THEY SHALL BE IN CLEAN AND STABLE CONDITION.
- THE CONTRACTOR SHALL IMPLEMENT DUST CONTROL BY REGULAR WETTING DOWN (BUT NOT SATURATING) DISTURBED AREA.
- PROVIDE AND MAINTAIN SILT TRAPS AROUND ALL SURFACE INLET PITS UNTIL CATCHMENT IS REVEGETATED OR PAVED.
- REVEGETATE ALL TRENCHES IMMEDIATELY UPON COMPLETION OF BACKFILLING.
- ALL DRAINAGE PIPE INLETS TO BE CAPPED UNTIL:
 - A) DOWNPIPES CONNECTED
 - B) PITS CONSTRUCTED & PROTECTED WITH SILT BARRIER

CDC ISSUE

REV	DATE	DESCRIPTION	BY	PROJECT:	DRAWING TITLE:	NORTH:	LOT NO:	DATE:	SCALE:	DRAWING No:	REV:
2	19-08-2026	Spa removed, RWT 2000L, TU added, Ldry position changed, G.BED layout changed, Ground Floor Dining extended, Area increased by 11sqm, hot/cold water provision, Cavity door to WIP, WIR2 and WIR4 removed and made built-in robes, Cladding wall on FF, FW3 and FW11 removed, Rear roof reduced to 18 degrees		LOT 2007 21 LOUISIANA STREET	SITE ANALYSIS AND SEDIMENT CONTROL		2007	26-08-2026	As indicated	CDC.04	2
1	03-07-2026	CDC ISSUE		21 LOUISIANA STREET ROUSE HILL			AS	RH			
							DRAFTED BY:	CLIENT NAME:			
							ID	Sanjeeva Jayawickrama Monarawila & Gayani Perera Weheragodage			



THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

☒ BAL – 19

WATERPROOFING WORK TO BE AS PER PART 10.2 OF THE ABCB HOUSING PROVISIONS STANDARD 2022

IMPORTANT NOTES:
ALL DIMENSIONS AND NOTES ON ALL PLANS MUST BE CHECKED AND VERIFIED BY BUILDERS AND OWNER PRIOR TO COMMENCEMENT OF ANY BUILDING WORKS. TO CLARIFY AND CONFIRM WITH CONSTRUCTION COMPANY FOR DISCREPANCIES ON ALL DOCUMENTS AND PLANS PROVIDED FOR CONSTRUCTION. ANY WORK INDICATED ON THE PLAN BUT NOT IN THE SPECIFICATION BUT WHICH IS NECESSARY AS PART OF THE CONTRACT, VARIATION TO PLANS, SPECIFICATIONS MAY NOT BE MADE WITHOUT THE WRITTEN CONSENT OF OWNER. IT IS THE RESPONSIBILITY OF THE BUILDER/END USER TO VERIFY PLANS AND SPECIFICATIONS AS TO THEIR ACCURACY AND COMPLY CURRENT BCA AND AUSTRALIAN STANDARDS. WINDOWS TO COMPLY WITH 3.9.3.5 OF THE BCA.

BAL-19 CONSTRUCTION NOTES:


External Walls - Parts less than 400mm above ground or decks etc to be of non-combustible material, 6mm fibre cement clad or bushfire resistant/naturally fire resistant timber.

External Windows - Protected by bushfire shutter, completely screened with steel, bronze or aluminium mesh or 5mm toughened glass or glass blocks with 400mm of ground deck, etc. Openable portion metal screened with frame of metal or metal reinforced PVC-U or bushfire resisting timber.

External Doors - Protected by bushfire shutter, or screened with steel bronze or aluminium mesh or glazed with 5mm toughened glass, non-combustible or 35 mm solid timber for 400mm above threshold, metal or bushfire resisting timber framed for 400mm above ground, decking, etc tight fitting with weather strips at base.

Roofs - Non-combustible covering. Roof/wall junction sealed. Openings fitted with non-combustible ember guards. Roof to be fully sarked.

Verandahs, Decks etc - Enclosed sub-floor-space - no special required for materials except within 400mm of ground. No special requirements for supports or framing. Decking to be non combustible or bushfire resistant within 300mm horizontally and 400mm vertically from a glazed element.

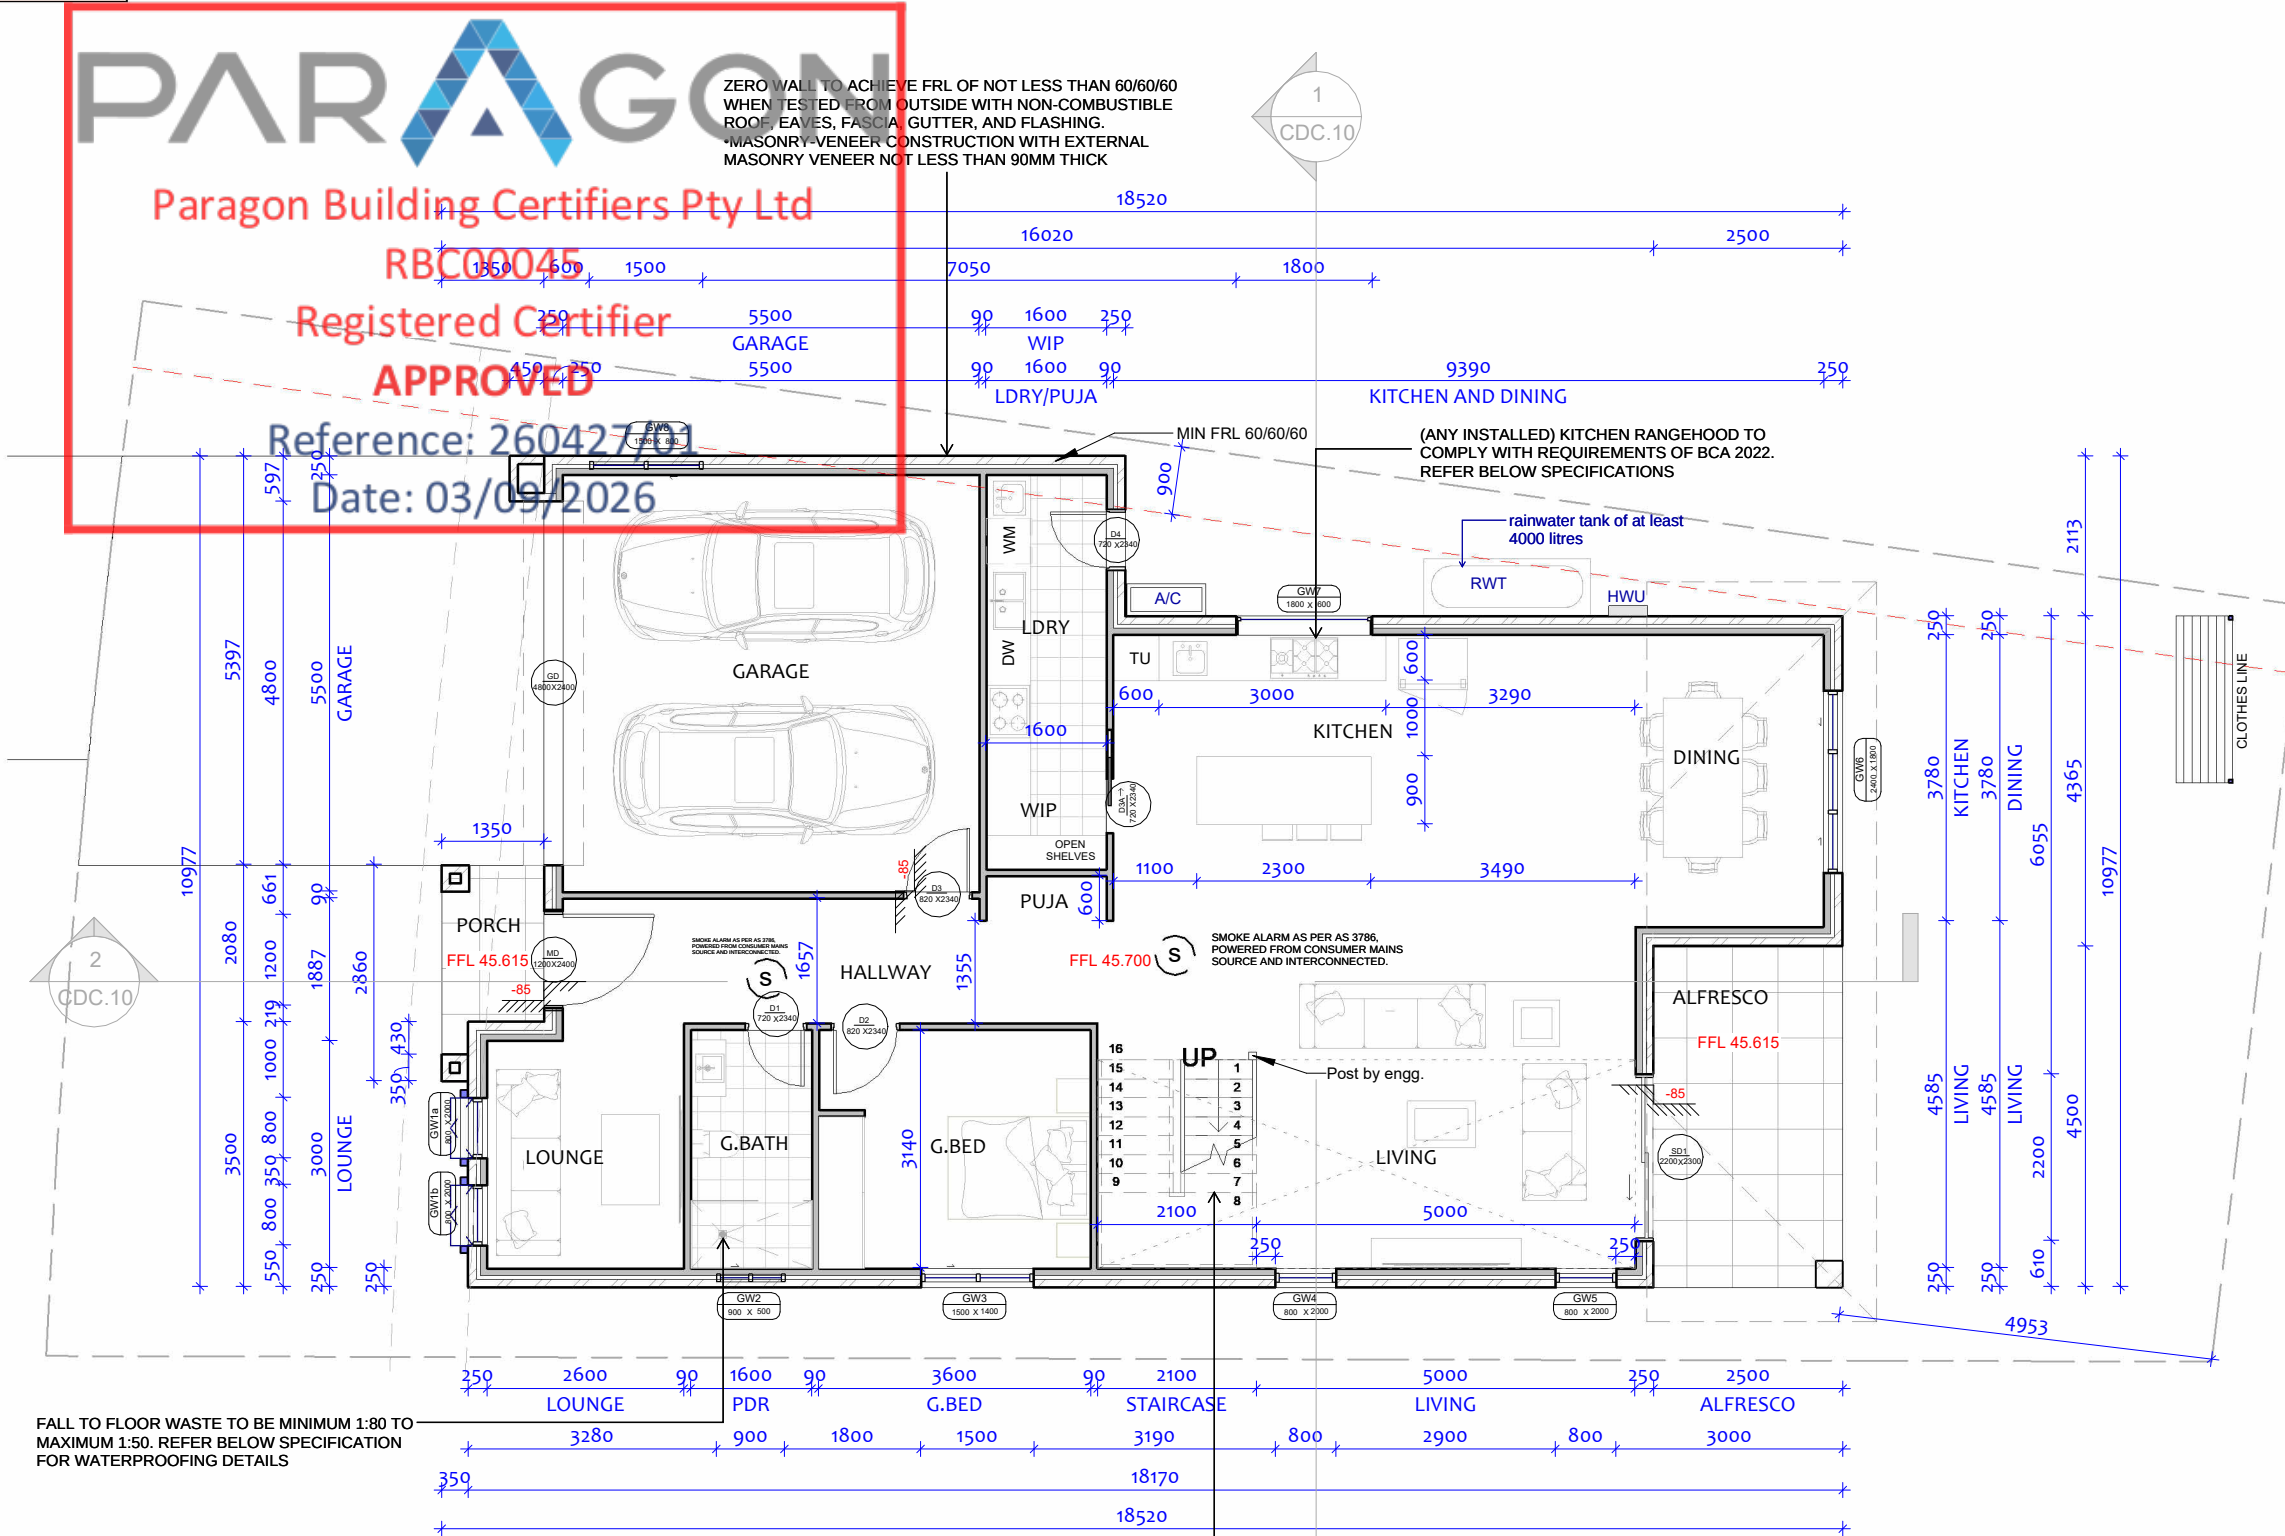

FALL TO FLOOR WASTE TO BE MINIMUM 1:80 TO MAXIMUM 1:50. REFER BELOW SPECIFICATION FOR WATERPROOFING DETAILS

Ground Floor

1

1 : 100

STAIR, SLIP RESISTANCE, BALUSTRADE, HANDRAIL TO CONSTRUCT IN ACCORDANCE WITH NCC PART 11.2, 11.3, AS1170.1:2002 & AS1657:2018.

CDC ISSUE

13	19-08-2026	Spa removed, RWT 2000L, TU added, Ldry position changed, G.BED layout changed, Ground Floor Dining extended, Area increased by 11sqm, hot/cold water provision, Cavity door to WIP, WIR2 and WIR4 removed and made built-in robes, Cladding wall on FF, FW3 and FW11 removed, Rear roof reduced to 18 degrees	BY
12	08-07-2026	Above Ground Spa- Client	BY
REV	DATE	DESCRIPTION	BY

RUBY HOMES

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:
LOT 2007 21 LOUISIANA STREET
21 LOUISIANA STREET ROUSE HILL

DRAWING TITLE:
GROUND FLOOR PLAN

NORTH:

LOT NO:	DATE:	SCALE:	DRAWING No:	REV:
2007	26-08-2026	1 : 100	CDC.05	13
DRAWN BY:	CHECKED BY:			ISSUED BY:
AS	RH			
DRAFTED BY:	CLIENT NAME:			
ID	Sanjeeva Jayawickrama Monarawila & Gayani Perera Weheragodage			

☒ BAL – 19

WATERPROOFING WORK TO BE AS PER PART 10.2 OF THE ABCB HOUSING PROVISIONS STANDARD 2022

IMPORTANT NOTES:
ALL DIMENSIONS AND NOTES ON ALL PLANS MUST BE CHECKED AND VERIFIED BY BUILDERS AND OWNER PRIOR TO COMMENCEMENT OF ANY BUILDING WORKS. TO CLARIFY AND CONFIRM WITH CONSTRUCTION COMPANY FOR DISCREPANCIES ON ALL DOCUMENTS AND PLANS PROVIDED FOR CONSTRUCTION. ANY WORK INDICATED ON THE PLAN BUT NOT IN THE SPECIFICATION BUT WHICH IS NECESSARY AS PART OF THE CONTRACT, VARIATION TO PLANS, SPECIFICATIONS MAY NOT BE MADE WITHOUT THE WRITTEN CONSENT OF OWNER. IT IS THE RESPONSIBILITY OF THE BUILDER/END USER TO VERIFY PLANS AND SPECIFICATIONS AS TO THEIR ACCURACY AND COMPLY CURRENT BCA AND AUSTRALIAN STANDARDS. WINDOWS TO COMPLY WITH 3.9.3.5 OF THE BCA.

BAL-19 CONSTRUCTION NOTES:

External Walls - Parts less than 400mm above ground or decks etc to be of non-combustible material, 6mm fibre cement clad or bushfire resistant/naturally fire resistant timber.

External Windows - Protected by bushfire shutter, completely screened with steel, bronze or aluminium mesh or 5mm toughened glass or glass blocks with 400mm of ground deck, etc. Openable portion metal screened with frame of metal or metal reinforced PVC-U or bushfire resisting timber.

External Doors - Protected by bushfire shutter, or screened with steel bronze or aluminium mesh or glazed with 5mm toughened glass, non-combustible or 35 mm solid timber for 400mm above threshold, metal or bushfire resisting timber framed for 400mm above ground, decking, etc tight fitting with weather strips at base.

Roofs - Non-combustible covering. Roof/wall junction sealed. Openings fitted with non-combustible ember guards. Roof to be fully sarked.

Verandahs, Decks etc - Enclosed sub-floor-space - no special required for materials except within 400mm of ground. No special requirements for supports or framing. Decking to be non combustible or bushfire resistant within 300mm horizontally and 400mm vertically from a glazed element.

PARAGON

Paragon Building Certifiers Pty Ltd

RBC00045

Registered Certifier

APPROVED

Reference: 260427/01

Date: 03/09/2026

ROOF ABOVE

FALL TO FLOOR WASTE TO BE MINIMUM 1:80 TO MAXIMUM 1:50. REFER BELOW SPECIFICATION FOR WATERPROOFING DETAILS

1
CDC.10

FALL TO THE FLOOR WASTE TO BE MIN. 1:80 AND MAX. 1:50

WINDOW TO BE PROTECTED WITH OPENINGS NOT MORE THAN 125MM

WINDOW TO BE PROTECTED WITH OPENINGS NOT MORE THAN 125MM

OVERFLOW PIPE

BALUSTRADE TO CONSTRUCT IN ACCORDANCE WITH NCC PART 11.3.3 AND 11.3.4

FALL TO FLOOR WASTE TO BE MINIMUM 1:80 TO MAXIMUM 1:50. REFER BELOW SPECIFICATION FOR WATERPROOFING DETAILS

Level 1

1 : 100

1

9	19-08-2026	Spa removed, RWT 2000L, TU added, Ldry position changed, G.BED layout changed, Ground Floor Dining extended, Area increased by 11sqm, hot/cold water provision, Cavity door to WIP, WIR2 and WIR4 removed and made built-in robes, Cladding wall on FF, FW3 and FW11 removed, Rear roof reduced to 18 degrees	BY
8	03-07-2026	CDC ISSUE	
REV	DATE	DESCRIPTION	BY

RUBY HOMES

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:
LOT 2007 21 LOUISIANA STREET
21 LOUISIANA STREET ROUSE HILL


DRAWING TITLE:
FIRST FLOOR LEVEL

NORTH:

LOT NO:	2007	DATE:	26-08-2026	SCALE:	1 : 100	DRAWING No:	CDC.06	REV:	9
DRAWN BY:	AS	CHECKED BY:	RH					ISSUED BY:	
DRAFTED BY:	ID	CLIENT NAME:	Sanjeeva Jayawickrama Monarawila & Gayani Perera Weheragodage						

CDC ISSUE

☒ BAL – 19

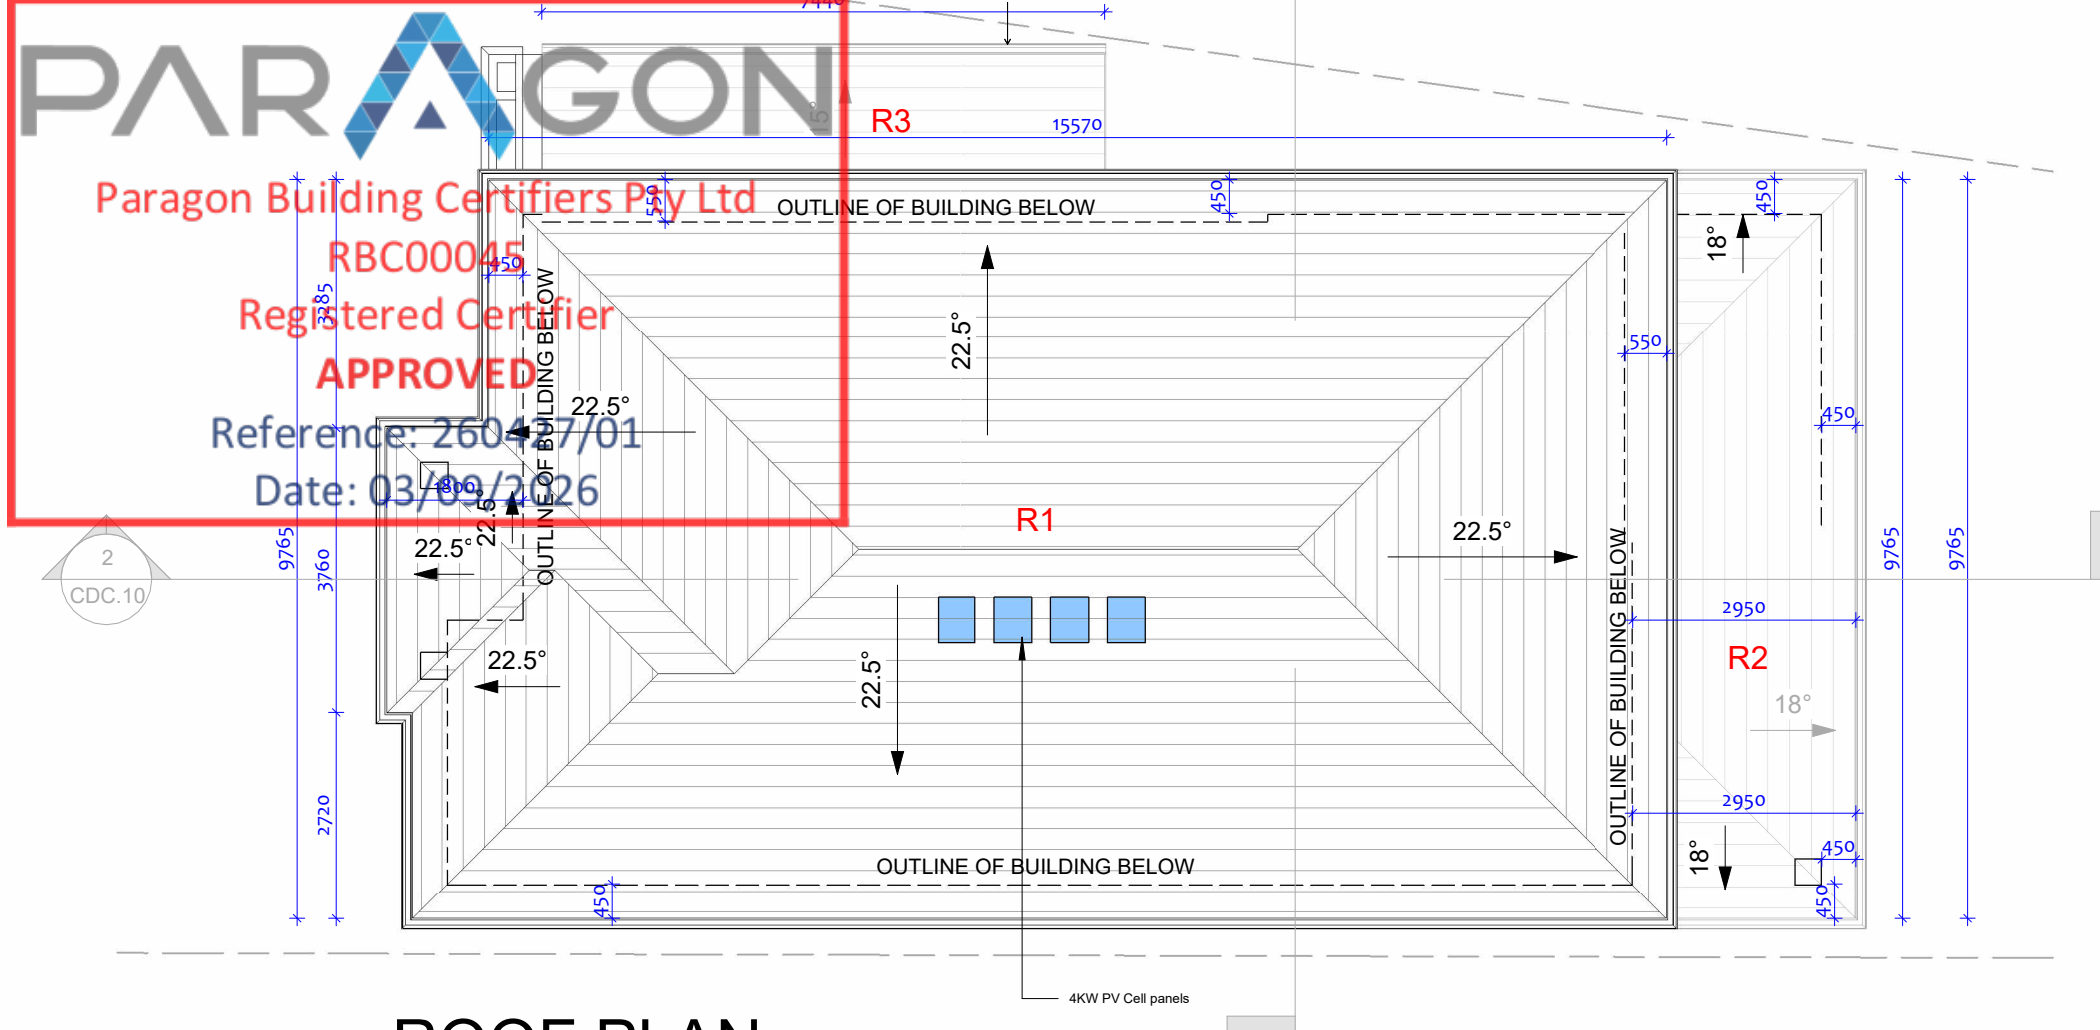

ROOF PLAN

1 : 100

Figure 10.8.3 (explanatory): Example of roof space with low level ventilation

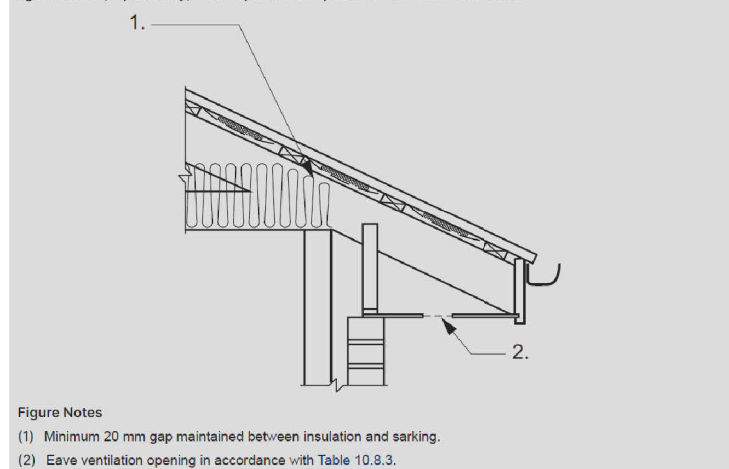


Table 10.8.3: Roof space ventilation requirements

Roof pitch	Ventilation openings
< 10°	25,000 mm ² /m provided at each of two opposing ends
≥ 10° and < 15°	25,000 mm ² /m provided at the eaves and 5,000 mm ² /m at high level
≥ 15° and < 75°	7,000 mm ² /m provided at the eaves and 5,000 mm ² /m at high level, plus an additional 18,000 mm ² /m at the eaves if the roof has a cathedral ceiling

Roof Schedule

Mark	Base Level	Area	Comments
R1	CEILING LEVEL	173 m ²	TILE
R2	Level 1	31 m ²	TILE
R3	Level 1	17 m ²	TILE

Grand total: 3

221 m²

CDC ISSUE


5	03-07-2026	CDC ISSUE	
4	16-06-2026	Front windows 2000mm height, French style balustrade at balcony, Main bathroom 3m, Shower downstairs, Dining window 2400x1800 - Samuel	
REV	DATE	DESCRIPTION	BY


RUBY
H O M E S

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:
LOT 2007 21 LOUISIANA STREET
21 LOUISIANA STREET ROUSE HILL

DRAWING TITLE:
ROOF PLAN



LOT NO: 2007	DATE: 26-08-2026	SCALE: 1 : 100	DRAWING No: CDC.07	REV: 5
DRAWN BY: AS	CHECKED BY: RH	CLIENT NAME: Sanjeeva Jayawickrama Monarawila & Gayani Perera Weheragodage	ISSUED BY:	
DRAFTED BY: ID				

IMPORTANT NOTES:
ALL DIMENSIONS AND NOTES ON ALL PLANS MUST BE CHECKED AND VERIFIED BY BUILDERS AND OWNER PRIOR TO COMMENCEMENT OF ANY BUILDING WORKS. TO CLARIFY AND CONFIRM WITH CONSTRUCTION COMPANY FOR DISCREPANCIES ON ALL DOCUMENTS AND PLANS PROVIDED FOR CONSTRUCTION. ANY WORK INDICATED ON THE PLAN BUT NOT IN THE SPECIFICATION BUT WHICH IS NECESSARY AS PART OF THE CONTRACT, VARIATION TO PLANS, SPECIFICATIONS MAY NOT BE MADE WITHOUT THE WRITTEN CONSENT OF OWNER. IT IS THE RESPONSIBILITY OF THE BUILDER/END USER TO VERIFY PLANS AND SPECIFICATIONS AS TO THEIR ACCURACY AND COMPLY CURRENT BCA AND AUSTRALIAN STANDARDS. WINDOWS TO COMPLY WITH 3.9.3.5 OF THE BCA.

BAL-19 CONSTRUCTION NOTES:

External Walls - Parts less than 400mm above ground or decks etc to be of non-combustible material, 6mm fibre cement clad or bushfire resistant/naturally fire resistant timber.

External Windows - Protected by bushfire shutter, completely screened with steel, bronze or aluminium mesh or 5mm toughened glass or glass blocks with 400mm of ground deck, etc. Openable portion metal screened with frame of metal or metal reinforced PVC-U or bushfire resisting timber.

External Doors - Protected by bushfire shutter, or screened with steel bronze or aluminium mesh or glazed with 5mm toughened glass, non-combustible or 35 mm solid timber for 400mm above threshold, metal or bushfire resisting timber framed for 400mm above ground, decking, etc tight fitting with weather strips at base.


Roofs - Non-combustible covering. Roof/wall junction sealed. Openings fitted with non-combustible ember guards. Roof to be fully sarked.

Verandahs, Decks etc - Enclosed sub-floor-space - no special required for materials except within 400mm of ground. No special requirements for supports or framing. Decking to be non combustible or bushfire resistant within 300mm horizontally and 400mm vertically from a glazed element.


ABCB HOUSING PROVISIONS STANDARD 2022

10.8.3 VENTILATION OF ROOF SPACES

1. IN CLIMATE ZONES 6, 7 AND 8, A ROOF MUST HAVE A ROOF SPACE THAT
- (A) IS LOCATED
- (I) IMMEDIATELY ABOVE THE *PRIMARY INSULATION LAYER*, OR
 - (II) IMMEDIATELY ABOVE SARKING WITH A *VAPOUR PERMEANCE* OF NOT LESS THAN 1.14 µG/N.S, WHICH IS IMMEDIATELY ABOVE THE *PRIMARY INSULATION LAYER* OR
 - (III) IMMEDIATELY ABOVE CEILING INSULATION THAT MEETS THE REQUIREMENTS OF 13.2.3(3) AND 13.2.3(4); AND
- (B) HAS A HEIGHT OF NOT LESS THAN 20MM; AND
- (C) IS EITHER -
- (I) VENTILATED TO OUTDOOR AIR THROUGH EVENLY DISTRIBUTED OPENINGS IN ACCORDANCE WITH TABLE 10.8.3; OR
 - (II) LOCATED IMMEDIATELY UNDERNEATH THE ROOF TILES OF A UNSARKED TILED ROOF.

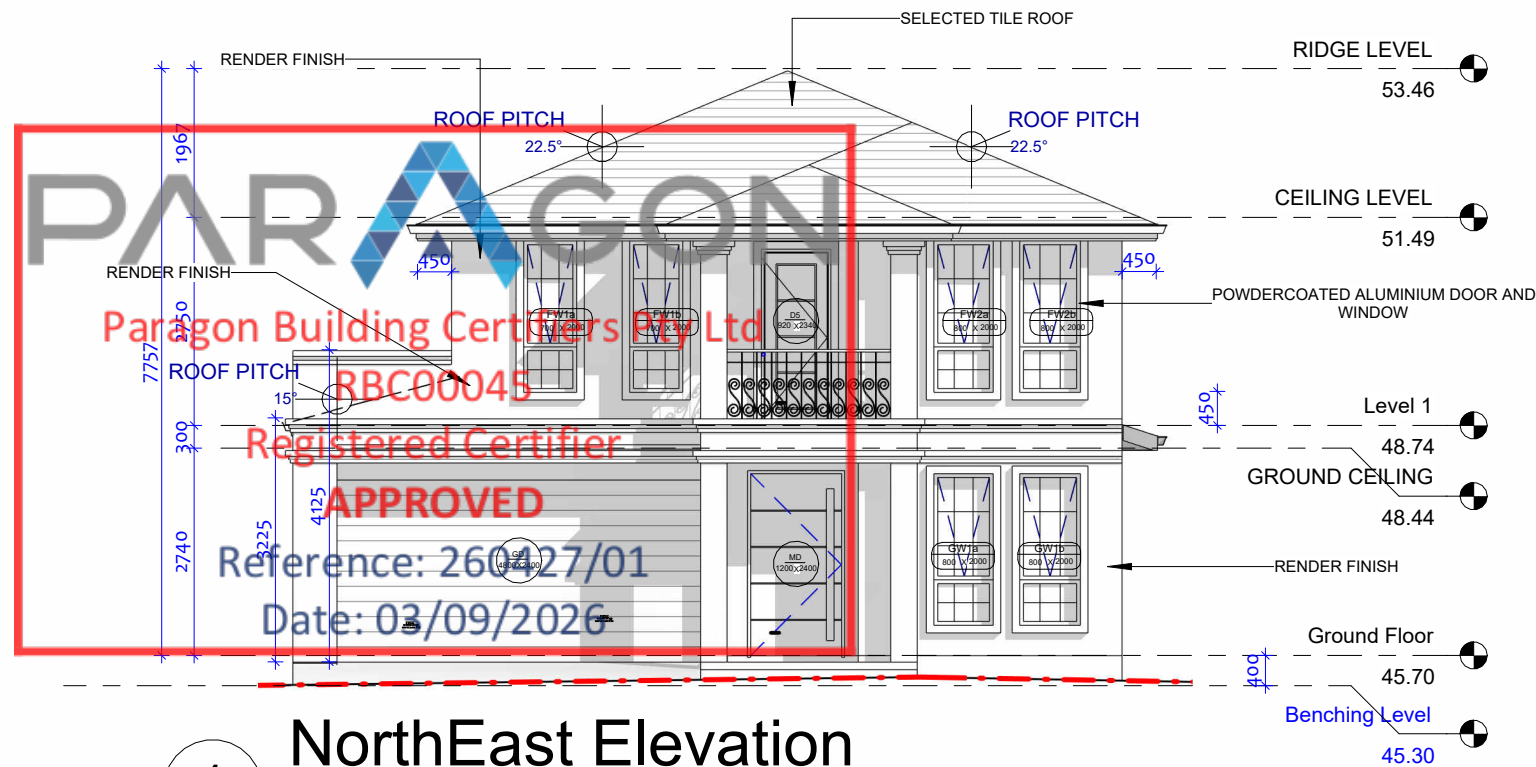

1 NorthEast Elevation
1 : 100

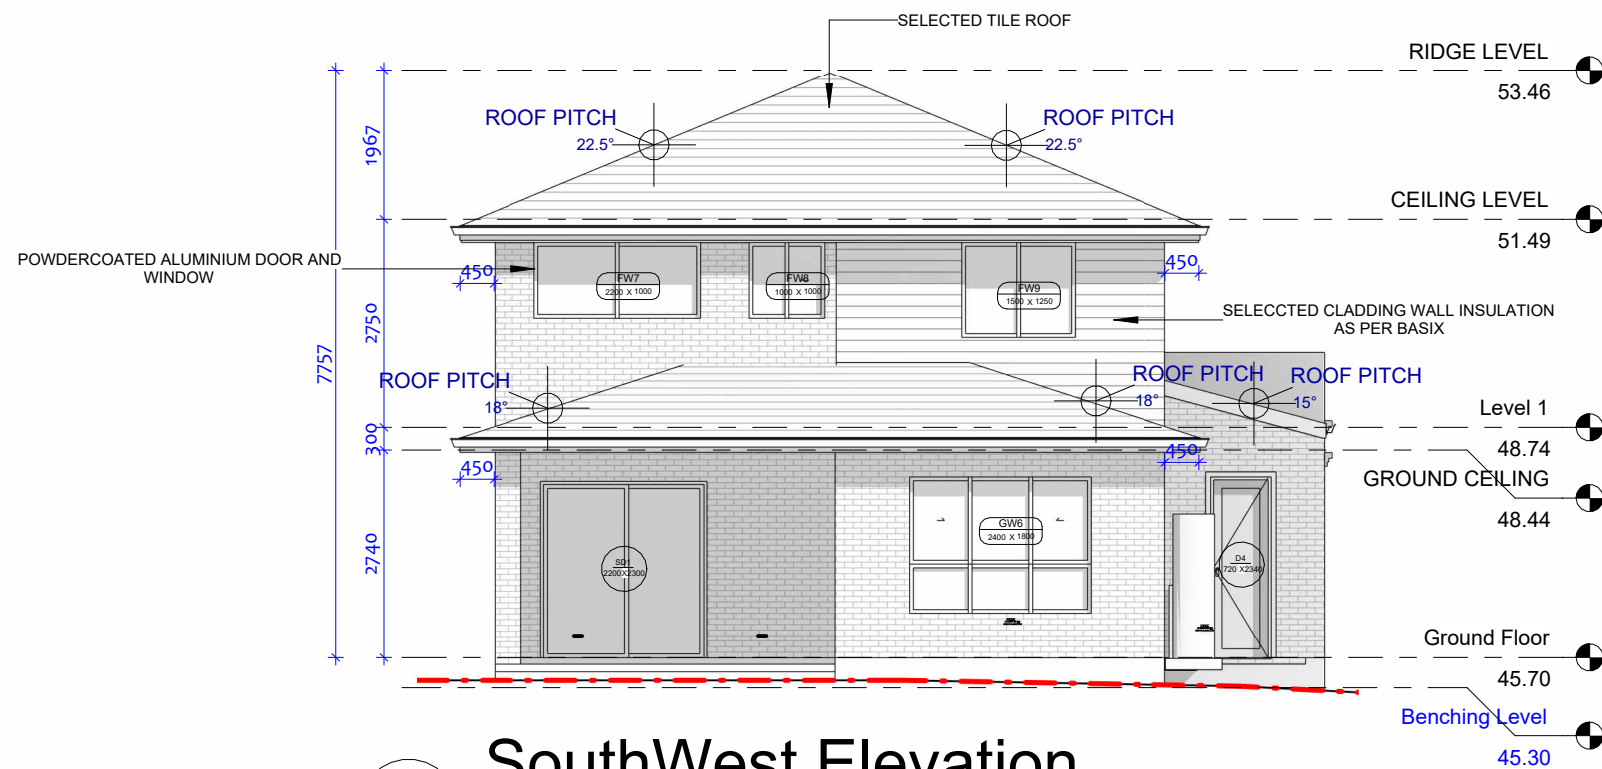

2 SouthWest Elevation
1 : 100

Window Schedule 1					
Mark	Height	Width	Sill Height	Head Height	Description

Ground Floor

GW1a	2000	800	400	2400	Awning French
GW1b	2000	800	400	2400	Awning French
GW2	500	900	1800	2300	SLIDING
GW3	1400	1500	1000	2400	SLIDING
GW4	2000	800	400	2400	FIXED
GW5	2000	800	400	2400	FIXED
GW6	1800	2400	600	2400	SLIDING
GW7	600	1800	1050	1650	FIXED
GW8	800	1500	1600	2400	SLIDING

Ground Floor: g

Level 1

FW1a	2000	700	450	2450	Awning French
FW1b	2000	700	450	2450	Awning French
FW2a	2000	800	450	2450	Awning French
FW2b	2000	800	450	2450	Awning French
FW3	600	1500	1850	2450	SLIDING
FW4	2000	1000	450	2450	FIXED
FW5	2000	800	450	2450	FIXED
FW6	2000	800	450	2450	FIXED
FW7	1000	2200	1450	2450	SLIDING
FW8	1000	1000	1450	2450	SLIDING
FW9	1250	1500	1200	2450	SLIDING
FW10	800	1500	1650	2450	SLIDING
FW11	800	800	1650	2450	SLIDING
FW12	600	1000	1850	2450	FIXED
FW13	600	1000	1850	2450	FIXED

Level 1: 15

CDC ISSUE

 THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION. PROJECT: LOT 2007 21 LOUISIANA STREET 21 LOUISIANA STREET ROUSE HILL DRAWING TITLE: ELEVATION 01 NORTH:				LOT NO: 2007 DRAWN BY: AS DRAFTED BY: ID	DATE: 26-08-2026 CHECKED BY: RH CLIENT NAME: Sanjeewa Jayawickrama Monarawila & Gayani Perera Weheragodage	SCALE: 1 : 100 DRAWING No: CDC.08	REV: 7 ISSUED BY:
7 REV	03-07-2026 DATE	CDC ISSUE DESCRIPTION	BY				



Paragon Building Certifiers Pty Ltd

RBC00045

Registered Certifier

APPROVED

Reference: 260427/01

Date: 03/09/2026

Door Schedule 1

Mark	Width	Height	Count	Description
------	-------	--------	-------	-------------

Ground Floor


D1	720	2340	1	FLUSH DOOR
D2	820	2340	1	FLUSH DOOR
D3	820	2340	1	FLUSH DOOR
D3A	720	2340	1	CAVITY DOOR
D4	720	2340	1	FLUSH DOOR
GD	4800	2400	1	GARAGE DOOR
MD	1200	2400	1	SOLID CORE DOOR
SD1	2200	2300	1	SLIDING DOOR

Ground Floor: 8


Level 1

D5	920	2340	1	GLAZED DOOR
D6	720	2340	1	FLUSH DOOR
D7	820	2340	1	FLUSH DOOR
D8	820	2340	1	FLUSH DOOR
D9	820	2340	1	FLUSH DOOR
D10	820	2340	1	FLUSH DOOR
D11	720	2340	1	FLUSH DOOR

Level 1: 7

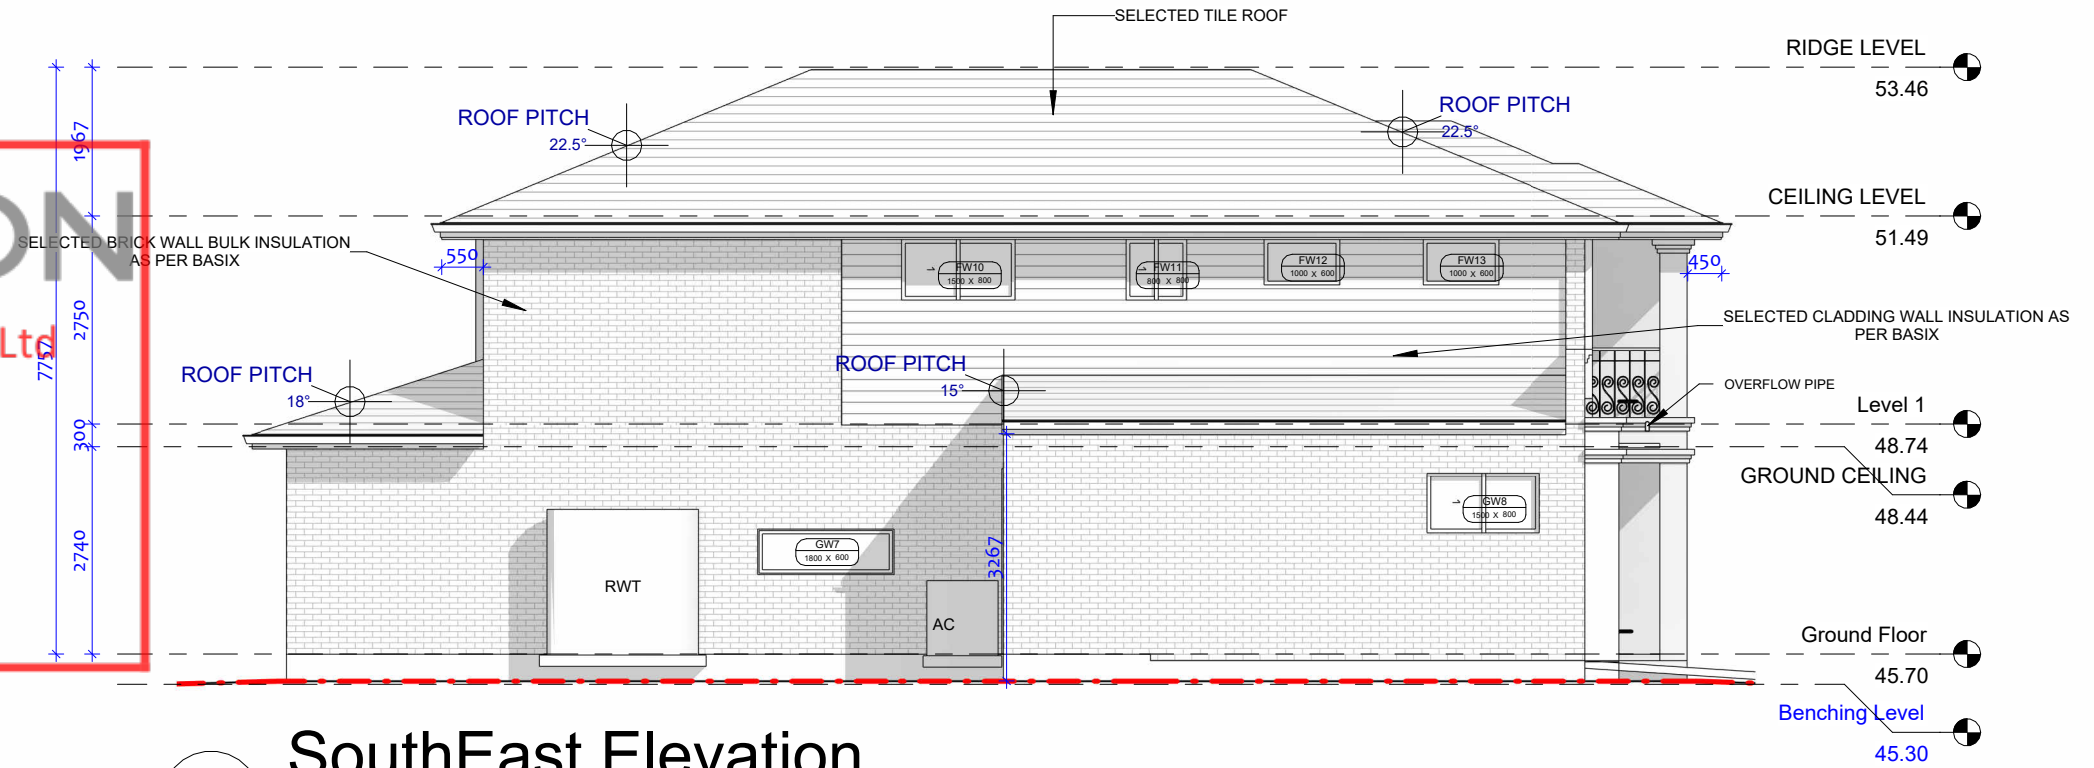

1 SouthEast Elevation
1 : 100

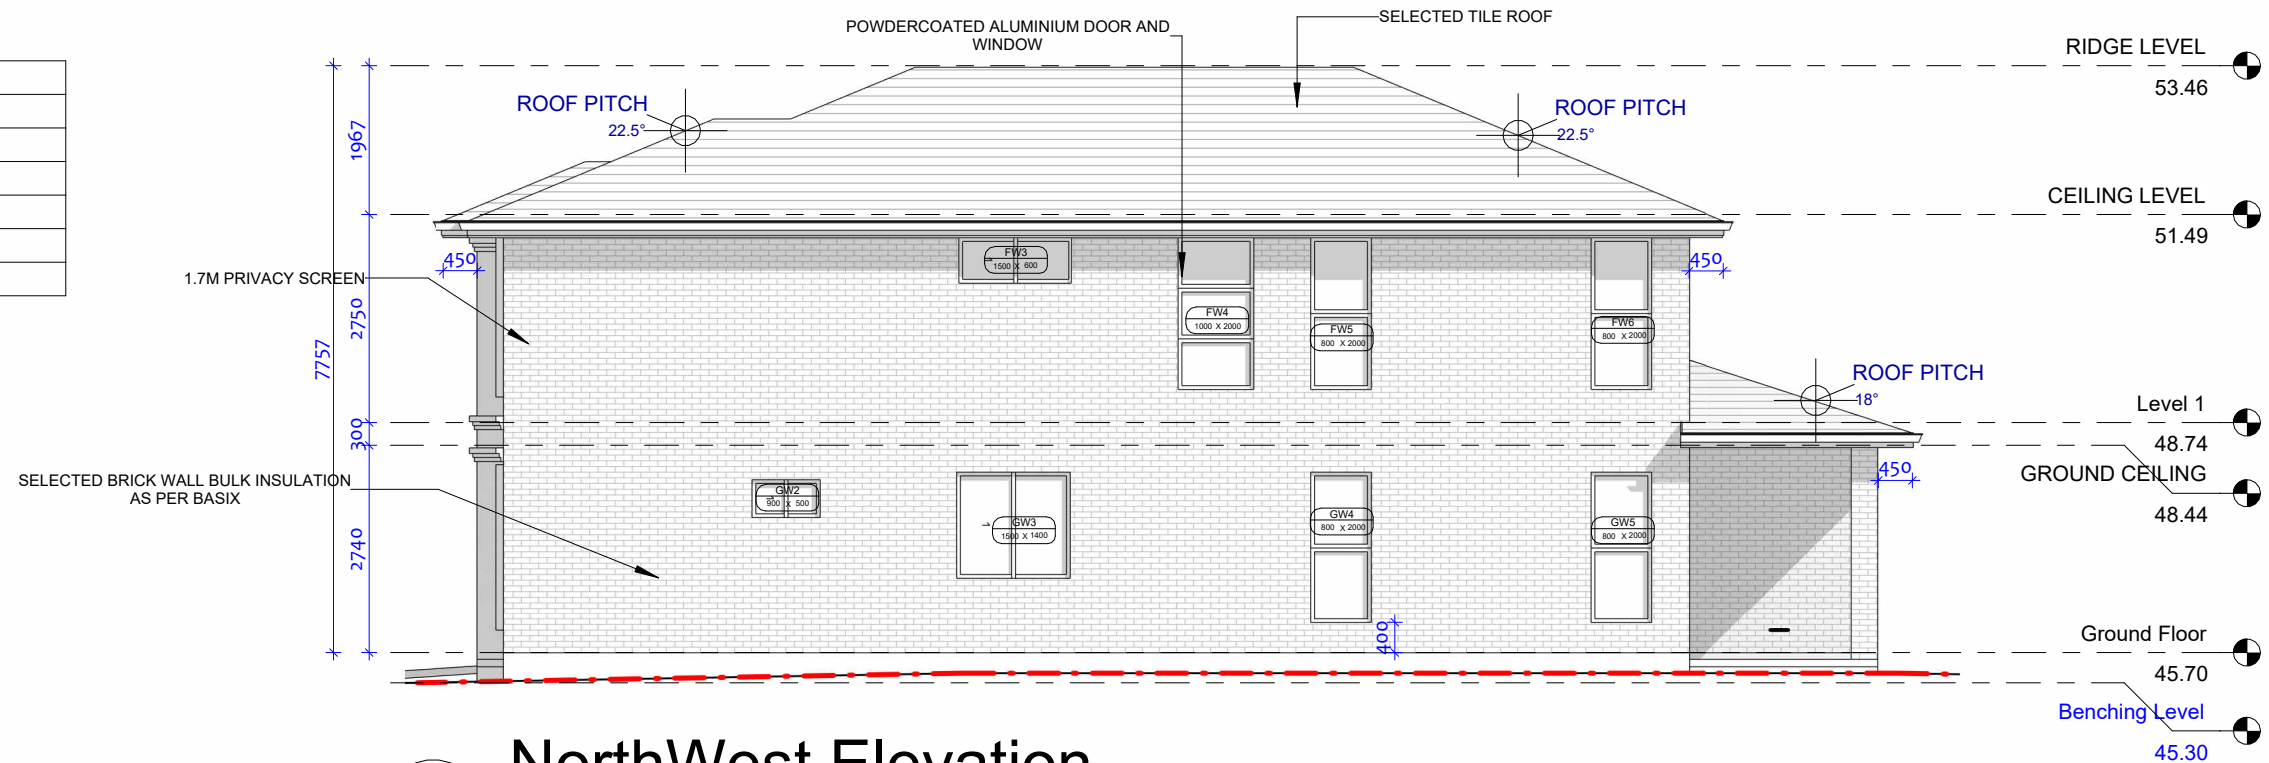


2 NorthWest Elevation
1 : 100

CDC ISSUE


7	03-07-2026	CDC ISSUE		
REV	DATE	DESCRIPTION	BY	
PROJECT: LOT 2007 21 LOUISIANA STREET 21 LOUISIANA STREET ROUSE HILL				
DRAWING TITLE: ELEVATION 02				
NORTH:				
LOT NO:	2007	DATE:	26-08-2026	SCALE:
DRAWN BY:	AS	CHECKED BY:	RH	1 : 100
DRAFTED BY:	ID	CLIENT NAME:	Sanjeewa Jayawickrama Monarawila & Gayani Perera Weheragodage	
DRAWING No:		REV:	7	ISSUED BY:
CDC.09				

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

RUBY HOMES

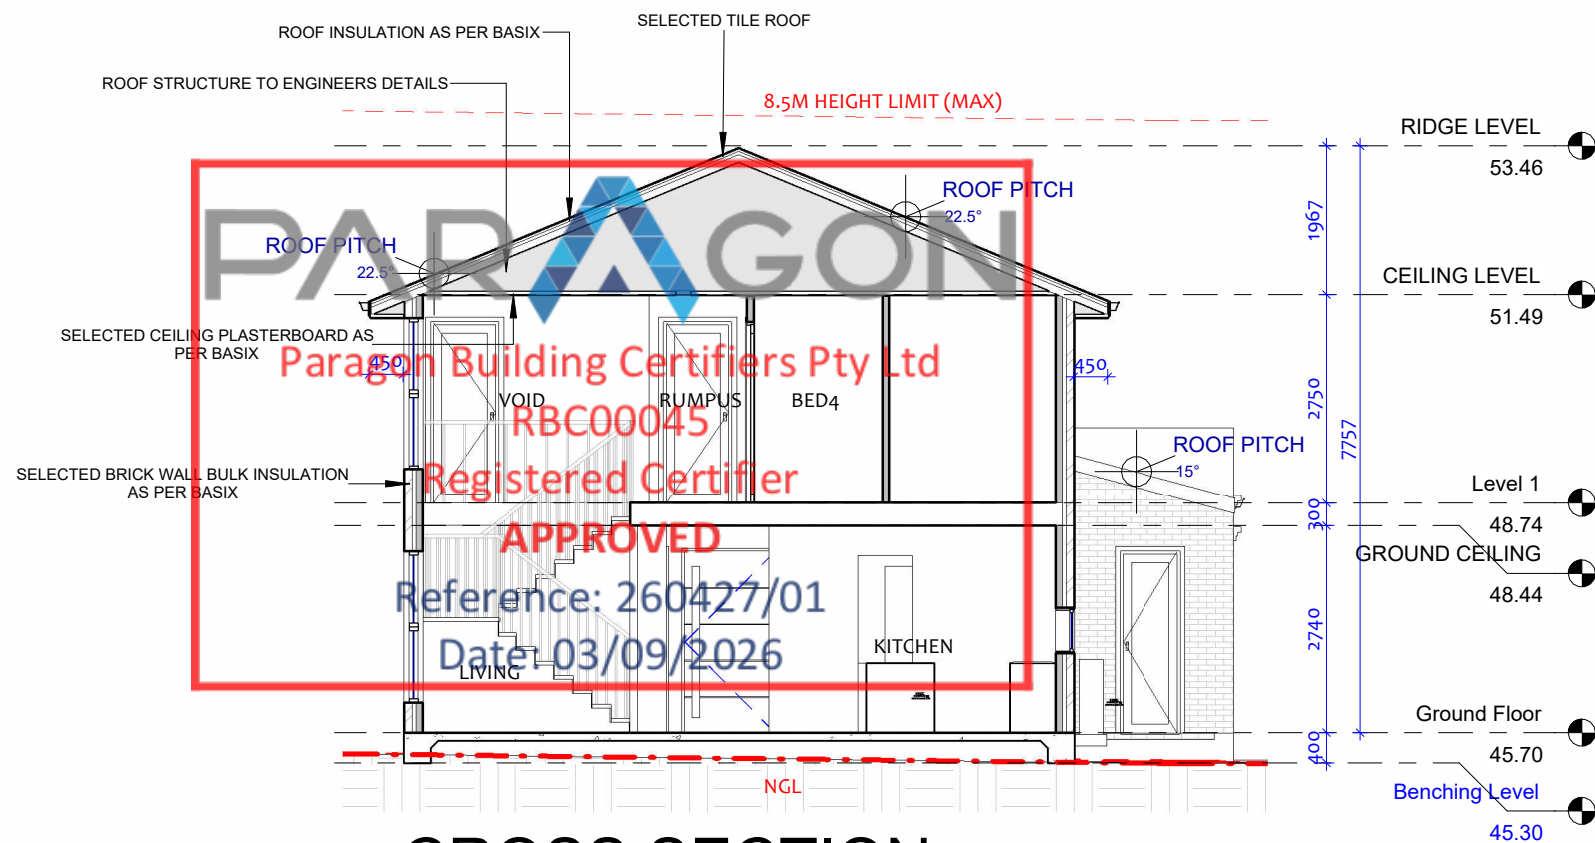

1 CROSS SECTION
1 : 100

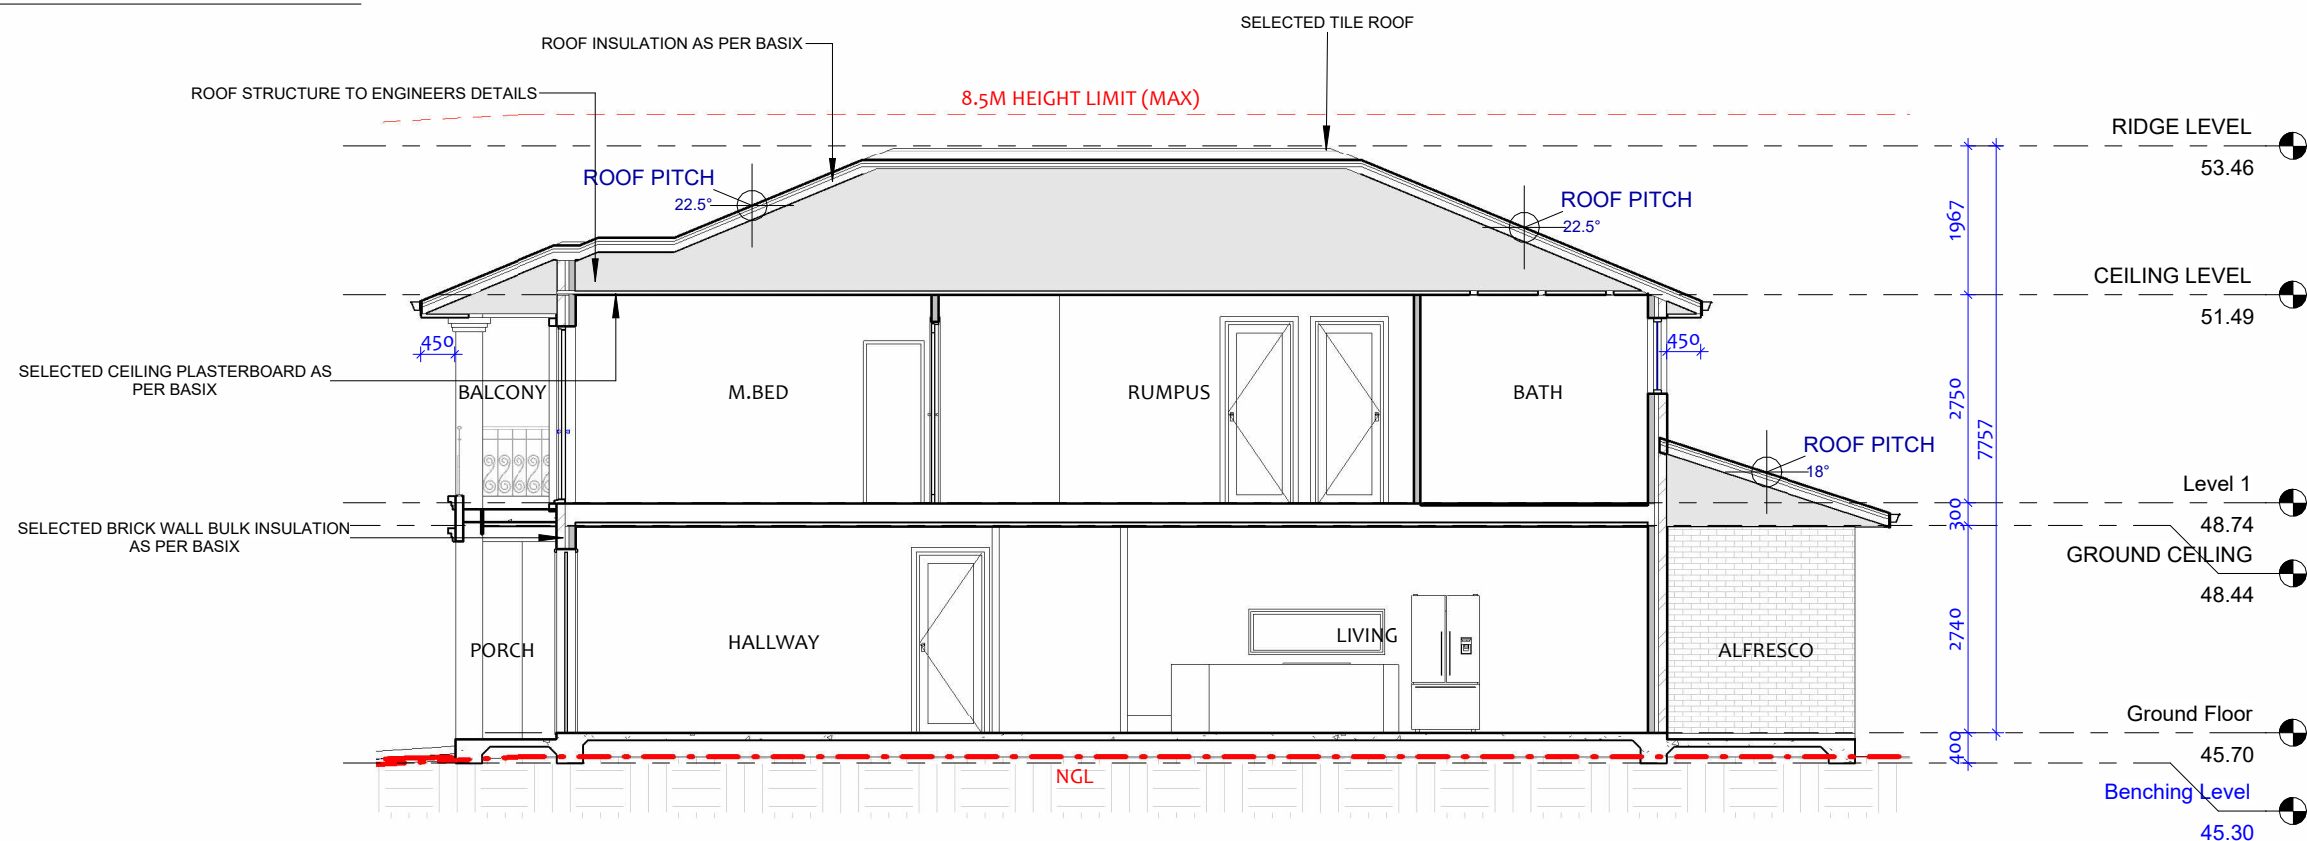

2 LONGITUDINAL SECTION
1 : 100


REV	DATE	DESCRIPTION	BY
1	03-07-2026	CDC ISSUE	



 THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.


PROJECT:
 LOT 2007 21 LOUISIANA STREET
 21 LOUISIANA STREET ROUSE HILL

DRAWING TITLE:
 SECTIONS



LOT NO:	DATE:	SCALE:	DRAWING No:	REV:
2007	26-08-2026	1 : 100	CDC.10	1
DRAWN BY:	CHECKED BY:	CLIENT NAME:	ISSUED BY:	
AS	RH	Sanjeewa Jayawickrama Monarawila & Gayani Perera Weheragodage		
DRAFTED BY:				
ID				

CDC ISSUE

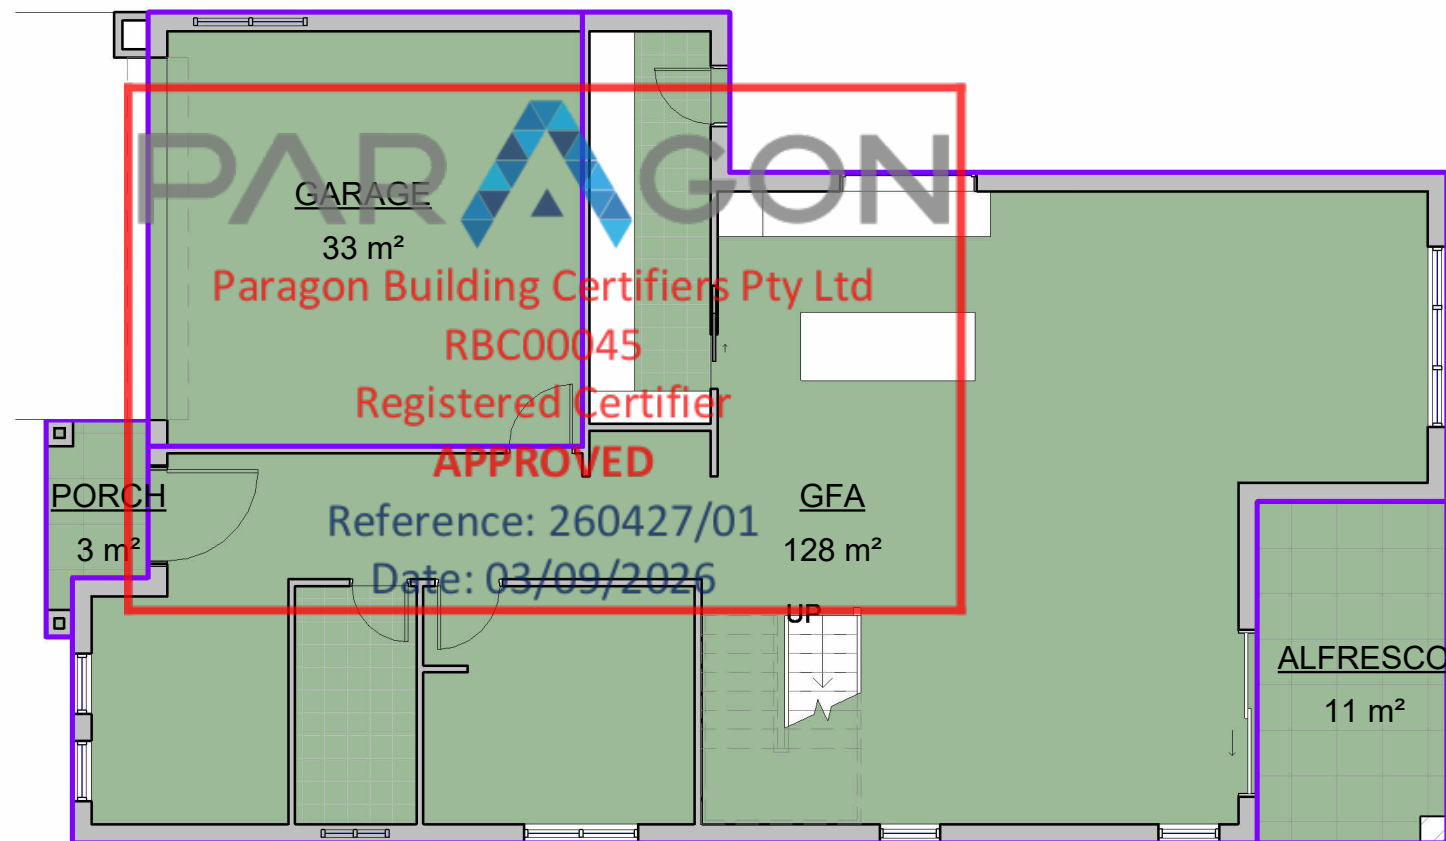

1 Ground Floor
1 : 100

Area Schedule (Gross Building)	
Name	Area

Ground Floor

GFA	128 m ²
GARAGE	33 m ²
PORCH	3 m ²
ALFRESCO	11 m ²


Ground Floor: 4 175 m²

Level 1


FFA	114 m ²
BALCONY	3 m ²
STAIR VOID	20 m ²


Level 1: 3 137 m²

Grand total: 7 312 m²

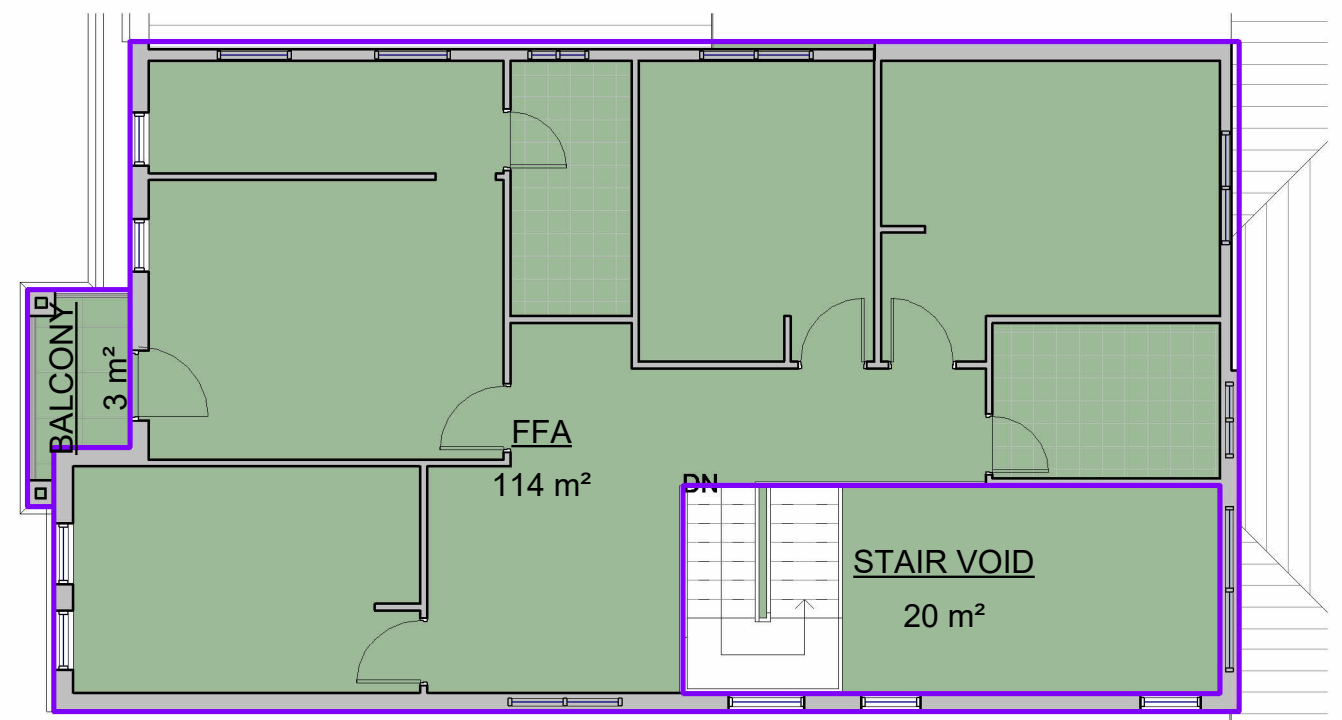

2 Level 1
1 : 100

				CDC ISSUE																			
 THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION. PROJECT: LOT 2007 21 LOUISIANA STREET 21 LOUISIANA STREET ROUSE HILL DRAWING TITLE: FLOOR AREA PLAN NORTH:  <table><tr><td>LOT NO: 2007</td><td>DATE: 26-08-2026</td><td>SCALE: 1 : 100</td><td>DRAWING No: CDC.11</td><td>REV: 7</td></tr><tr><td>DRAWN BY: AS</td><td>CHECKED BY: RH</td><td colspan="3">ISSUED BY:</td></tr><tr><td colspan="2">DRAFTED BY: ID</td><td colspan="3">CLIENT NAME: Sanjeewa Jayawickrama Monarawila & Gayani Perera Weheragodage</td></tr></table>				LOT NO: 2007	DATE: 26-08-2026	SCALE: 1 : 100	DRAWING No: CDC.11	REV: 7	DRAWN BY: AS	CHECKED BY: RH	ISSUED BY:			DRAFTED BY: ID		CLIENT NAME: Sanjeewa Jayawickrama Monarawila & Gayani Perera Weheragodage							
LOT NO: 2007	DATE: 26-08-2026	SCALE: 1 : 100	DRAWING No: CDC.11	REV: 7																			
DRAWN BY: AS	CHECKED BY: RH	ISSUED BY:																					
DRAFTED BY: ID		CLIENT NAME: Sanjeewa Jayawickrama Monarawila & Gayani Perera Weheragodage																					
7	03-07-2026	CDC ISSUE																					
REV	DATE		DESCRIPTION	BY																			

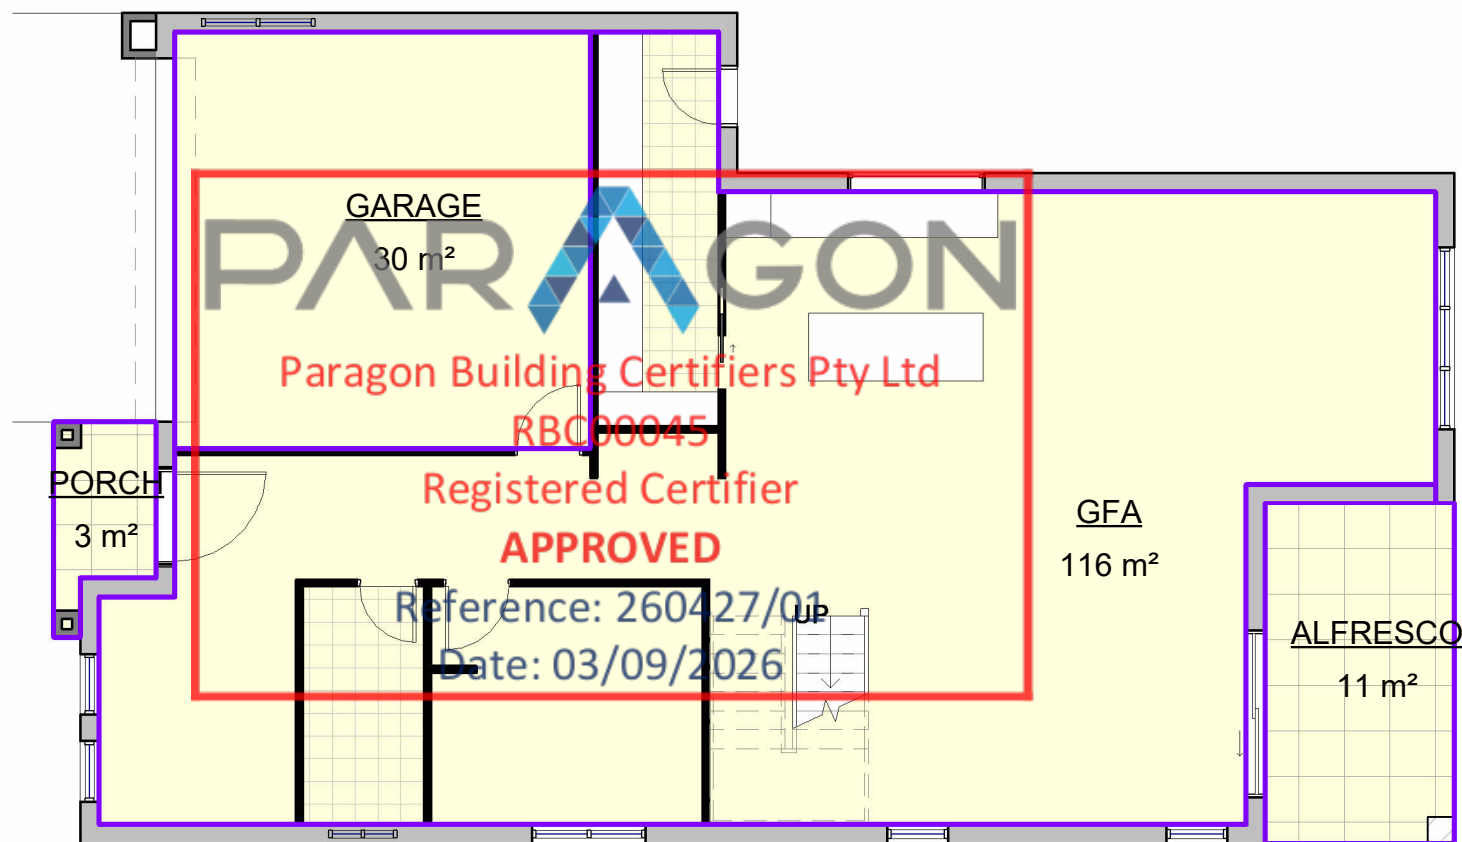


1

Ground Floor

1 : 100

Area Schedule (Rentable)	
Name	Area
Ground Floor	
GFA	116 m²
GARAGE	30 m²
PORCH	3 m²
ALFRESCO	11 m²
Ground Floor: 4	161 m²
Level 1	
FFA	102 m²
STAIR VOID	20 m²
PORCH	3 m²
Level 1: 3	125 m²
Grand total: 7	285 m²

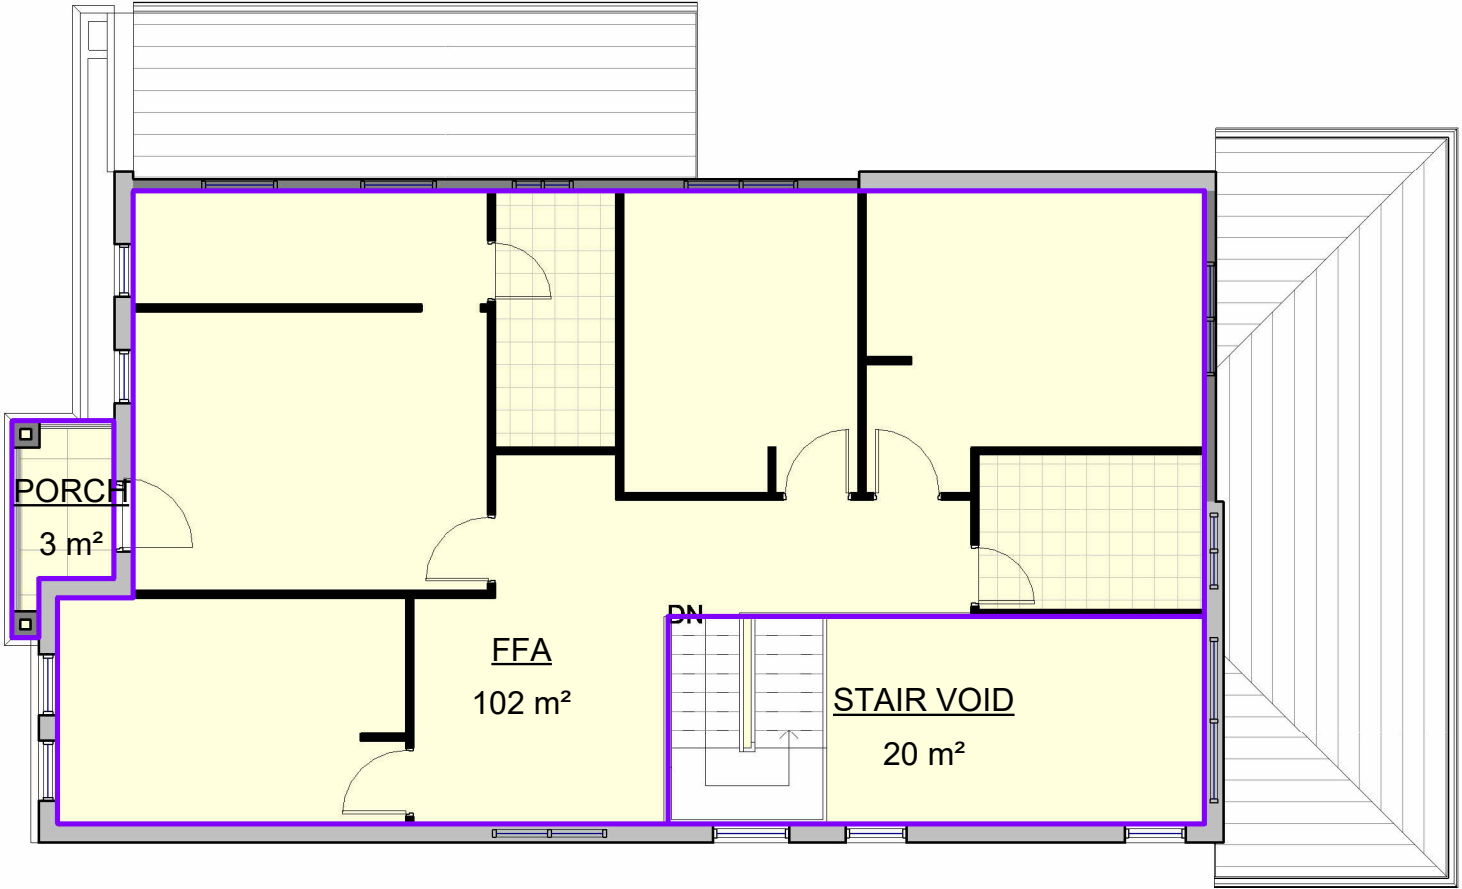

2

Level 1

1 : 100


REV	DATE	DESCRIPTION	BY
1	03-07-2026	CDC ISSUE	



THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:
LOT 2007 21 LOUISIANA STREET
21 LOUISIANA STREET ROUSE HILL

DRAWING TITLE:
RENTABLE AREA PLAN



LOT NO: 2007	DATE: 26-08-2026	SCALE: 1 : 100	DRAWING No:	REV: 1
DRAWN BY: AS	CHECKED BY: RH		CDC.12	ISSUED BY:
DRAFTED BY: ID	CLIENT NAME: Sanjeewa Jayawickrama Monarawila & Gayani Perera Weheragodage			

CDC ISSUE

PARAGON

Paragon Building Certifiers Pty Ltd

RBC00045

Registered Certifier

APPROVED

Reference: 260427/01

Date: 03/09/2026



	1. RF	2. BR1	3. CD1	4. CR1	5. AL	6. ED	7. GD	8. FAS	9. GUT
	ROOF	MAIN WALLS	CLADDING	ACCENT 1/RENDER	WINDOWS/ BALUSTRADE	MAIN DOOR	GARAGE DOOR	FASCIA	GUTTER
MATERIAL	TILE	BRICK	BLUEBOARD	BRICK	ALUMINIUM	TIMBER	COLORBOND	COLORBOND	COLORBOND
COLOUR									
	BASALT	BLACKBUTT	LEXICON HALF	LEXICON HALF	MONUMENT	NORSEWOOD	WOODLAND GREY	BASALT	BASALT

NOTE : ALL COLOURS SPECIFIED ARE INDICATIVE ONLY AND ARE SUBJECT TO VARIATION AND TO AVAILABILITY
ANY DISCREPANCY PLEASE FOLLOW AS PER RENDERED IMAGE

1	03-07-2026	CDC ISSUE	
REV	DATE	DESCRIPTION	BY

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:

LOT 2007 21 LOUISIANA STREET
21 LOUISIANA STREET ROUSE HILL

DRAWING TITLE:

COLOR SCHEDULE

NORTH:

LOT NO:	DATE:	SCALE:	DRAWING No:	REV:
2007	26-08-2026	1 : 100	CDC.14	1
DRAWN BY:	CHECKED BY:			ISSUED BY:
AS	RH			
DRAFTED BY:	CLIENT NAME:			
ID	Sanjeewa Jayawickrama Monarawila & Gayani Perera Weheragodage			

CDC ISSUE

LEGENDS

Paragon Building Certifiers Pty Ltd

RBC00045

Registered Certifier

APPROVED

Reference: 260427/01

Date: 03/09/2026

PROPOSED SCREENING PLANTING

PROPOSED SHRUB PLANTING


PROPOSED ACCENT PLANTING

PROPOSED TREE

PROPOSED TURF AREA TO BE SIR WALTER SOFT LEAF BUFFALO

PROPOSED CONCRETE PATH

PRINCIPAL PRIVATE OPEN SPACE

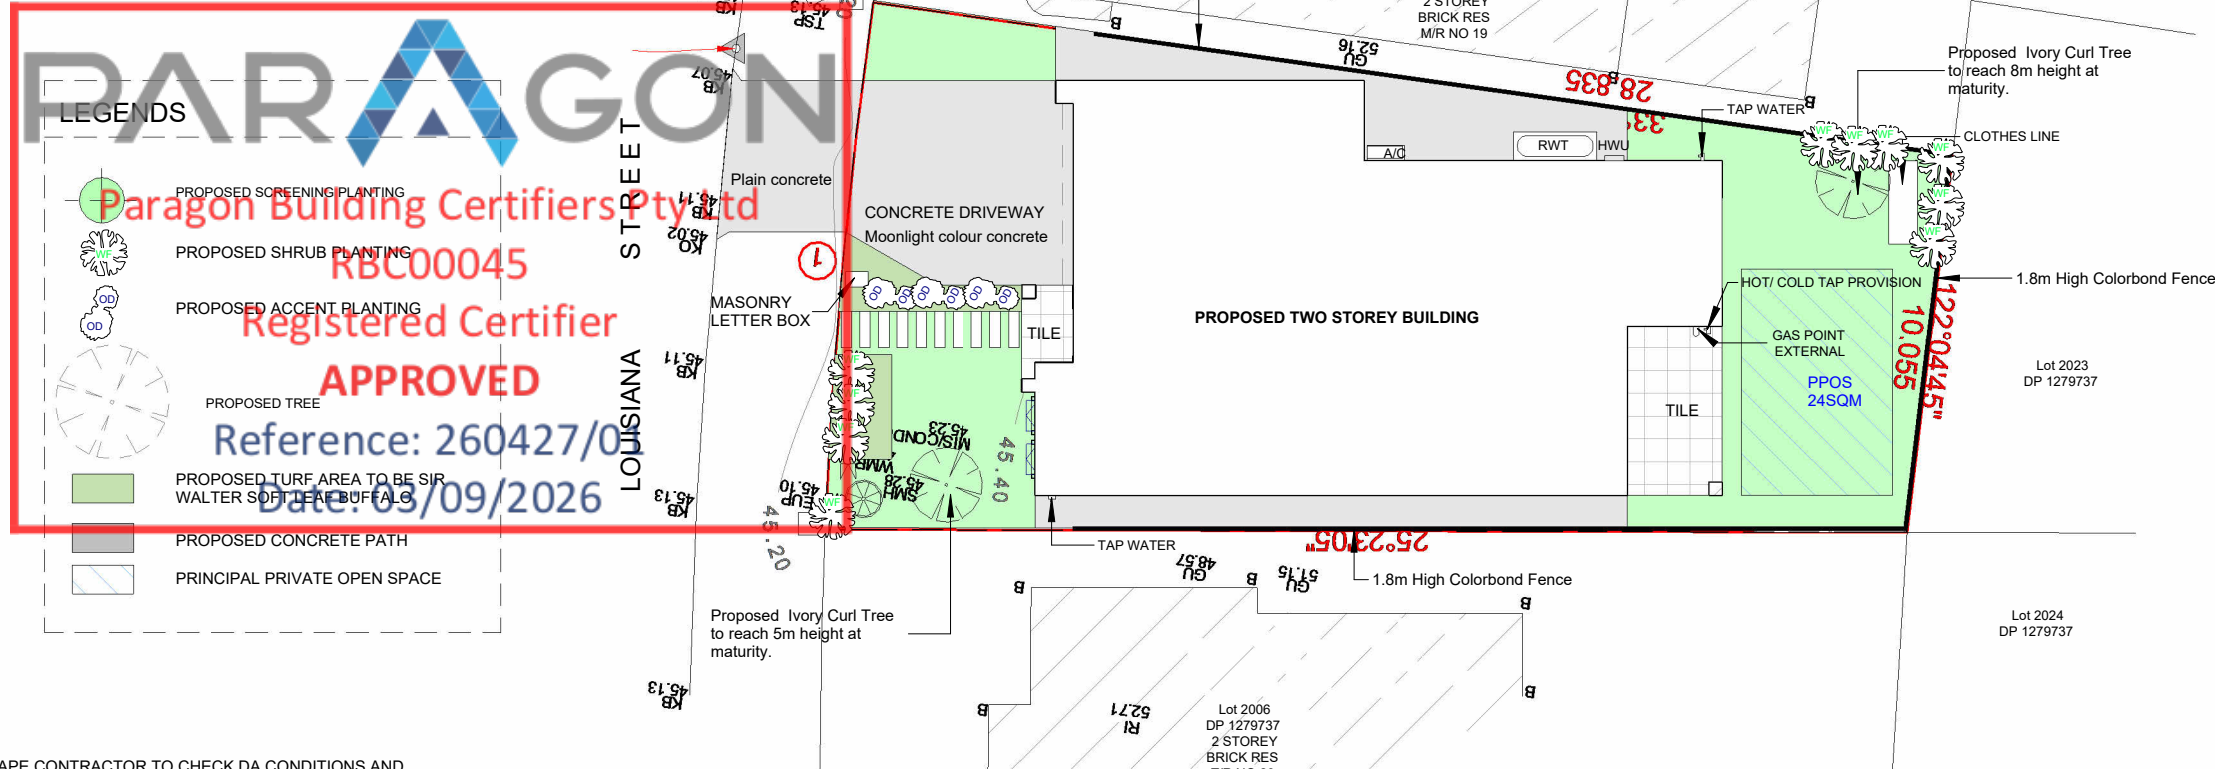

- GENERAL NOTES:**
- LANDSCAPE CONTRACTOR TO CHECK DA CONDITIONS AND STAMPED LANDSCAPE PLAN
 - BEFORE COMMENCING WORKS TO ENSURE NO ADDITIONS/AMENDMENTS TO PLAN.
 - GARDEN BEDS IN OSD BASIN TO CONSIST OF NON FLOATABLE DECORATIVE GRAVEL.
 - REFER TO HYDRAULICS ENGINEERS PLAN FOR OSD DETAILS/FINAL LEVELS.
 - MULCHED PLANTING BEDS TO BE A MINIMUM DEPTH OF 75mm AS SELECTED.
 - CONTRACTOR'S RESPONSIBILITY TO CHECK AND ADJUST SOIL pH AS REQUIRED.
 - PROVIDE TIMBER EDGE AS A MINIMUM BENEATH FENCING/GATES TO DEFINE TURF AND GARDEN BEDS/PATHWAYS.EDGING TO BE PROVIDED TO ALL AREAS WHERE DIFFERING MATERIALS MEET i.e TURF/GARDEN,TURF/GRAVEL PATH ETC.
 - WEED MAT BENEATH GRAVEL GRAVEL PATHWAYS REQUIRED TO LIMIT MUD TRACKING.
 - PREMIUM ORGANIC GARDEN MIX TO BE USED.
 - ALL PLANTS TO BE HEALTHY AND VIGOROUS.
 - CONTRACTOR TO MAKE GOOD TURF ON NATURE STRIP POST CONSTRUCTION
 - CONTRACTOR TO MAKE GOOD TURF ON NATURE STRIP POST CONSTRUCTION.
 - DO NOT SCALE ARCHITECTURAL SETOUT FROM LANDSCAPE DRAWING.
 - EXISTING TREE SPREAD APPROXIMATE ONLY.REFER TO TREE REPORT WHEN APPLICABLE.
 - SITE SURVEY PROVIDED BY OTHERS.
 - BUFFALO TURF PREFERRED OVER KIKUYU.

LANDSCAPE BASIX NOTE:
THE APPLICANT MUST PLANT INDIGENEOUS OR LOW WATER USE SPECIES OF VEGETATION THROUGHOUT 15 SQM OF THE SITE.

NOTE :BUILDER RESERVES THE RIGHT NOT TO UNDERTAKE NOR SUPPLY CERTIFICATE FOR OCCUPATION CERTIFICATE.
NOTE : TO AID COMPLIANCE WITH BASIX LEGISLATION,PLANTS (WHERE APPLICABLE) HAVE BEEN SELECTED FROM THE LOCAL CITY COUNCIL/SHIRE PLANT LISTS.
NOTE: LOCATION OF SEWER MAINS/LINES,WATER PIPES,UNDERGROUND ELECTRICITY AND OTHER SERVICES MUST BE OBTAINED PRIOR TO COMMENCEMENT OF ANY WORK ON SITE.

CONTRACTORS NOTE : CALCULATED AREAS DETERMINED BY CAD AND HAVE BEEN ROUNDED UP FOR USE AS A GUIDE ONLY ALLOW STANDARD PERCENTAGE FOR CUTTING AND WASTAGE .CONFIRM DIMENSIONS AND NUMBERS PRIOR TO QUOTING/ORDERING.

CDC - LANDSCAPE PLAN


1 : 200

LANDSCAPE AREA

FRONT AREA	43 m ²
BACKYARD AREA	62 m ²
TOTAL AREA	105 m ²


PLANT SCHEDULE

Genus	Common Name	Qty	Pot size	Height	width
Trees					
Buckinghamia callicissima	Ivory Curl Tree	2	45L	6-10m	Dense feature tree with, green glossy foliage. Greenish yellow flowers in small terminal clusters.
Shrubs					
Bursaria Spinosa Var Sppinosa	Blackthorn ,Boxthorn	8	140mm	1.5m	Thorny, wiry branches. Leaf size and shape varies with age. Small, white fragrant flowers.
Dodonea Visco ssp. Cuneata	Wedge-Leaft Hop Bush	6	140mm	1m	Compact growth. Sticky leaves taper to sharp point. Green fruit turns red and purple
Indigofera Australis	Native Indigo	5	140mm	1m	Slender, erect. Pink to lilac pea flowers, numerous along stems.
Hedgeing & screening Plants					
Acmena smithii 'Cherry Surprise'	Lilly Pilly Cherry Surprise PBR	10	140mm	3m	It has attractive small dense green foliage that provides a continuous flush of cherry-red new growth nearly all year round. Small white starry flowers bloom in summer.

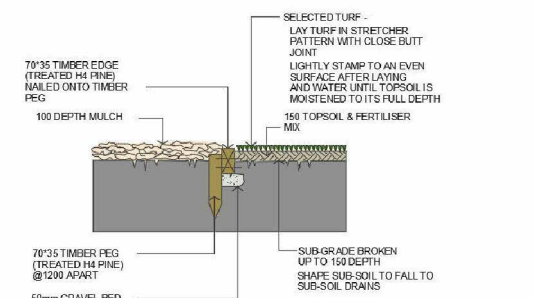

1. TURF & GARDEN EDGE DETAIL

NOTE:
ALIGNMENT OF BRICK EDGE SHALL BE EVEN & FREE FROM DIPS AND HUMPS.

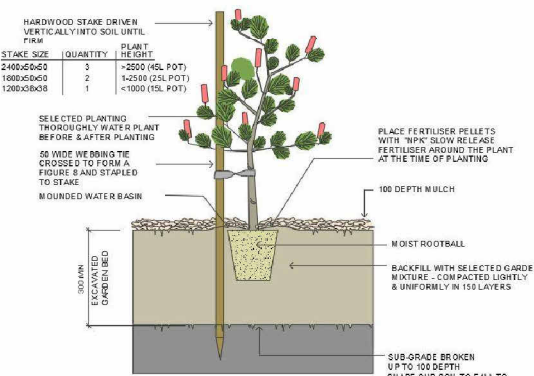

2. TREE & SHRUB PLANTING IN GARDEN BED


NOTE:
DO NOT PLANT IN UNSUITABLE WEATHER CONDITIONS SUCH AS EXTREME HEAT, COLD, WIND OR RAIN.
CLAY SOIL IS TO BE TREATED WITH CLAY BREAKER AND ORGANIC COMPOST



Bursaria spinosa var spinosa
Blackthorn, Boxthorn
Type: Shrub. Description: Thorny, wiry branches. Leaf size and shape varies with age. Small, white fragrant flowers. *Height:* Medium. *Flowers:* Jan-April. *Propagation:* sow seed. *Prune:* after flowering, only to maintain shape.



Dodonea viscosa ssp. Cuneata
Wedge-leaf Hop Bush
Type: Shrub. Description: Compact growth. Sticky leaves taper to sharp point. Green fruit turns red and purple. *Height:* 1m. *Flowers:* Spring. *Propagation:* from seed or take cutting in Spring and Summer. *Prune:* minimally.



Indigofera australis
Native Indigo
Type: Shrub. Description: Slender, erect. Pink to lilac pea flowers, numerous along stems. *Height:* 1m. *Flowers:* Spring. *Propagation:* from cutting, early to mid Summer. *Prune:* trim lightly after flowering.



Backhousia myrtifolia
Grey Myrtle
Type: Tree. Description: Dense feature tree with, green glossy foliage. Greenish yellow flowers in small terminal clusters. *Height:* 6-10m. *Flowers:* Nov-Dec. *Propagation:* sow seed in Spring. *Prune:* minimally.

CDC ISSUE

REV	DATE	DESCRIPTION	BY	PROJECT:	DRAWING TITLE:	NORTH:	LOT NO:	DATE:	SCALE:	DRAWING No:	REV:
2	19-08-2026	Spa removed, RWT 2000L, TU added, Ldry position changed, G.BED layout changed, Ground Floor Dining extended, Area increased by 11sqm, hot/cold water provision, Cavity door to WIP, WIR2 and WIR4 removed and made built-in robes, Cladding wall on FF, FW3 and FW11 removed, Rear roof reduced to 18 degrees		LOT 2007 21 LOUISIANA STREET	LANDSCAPE PLAN		2007	26-08-2026	1 : 200	CDC.15	2
1	03-07-2026	CDC ISSUE		21 LOUISIANA STREET ROUSE HILL			AS	RH			
							DRAFTED BY:	CLIENT NAME:			
							ID	Sanjeeva Jayawickrama Monarawila & Gayani Perera Weheragodage			

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

ABCB HOUSING PROVISIONS : PART 10.2 WET AREA WATERPROOFING

10.2.1 Wet Areas

1.

Building elements in wet areas within a building must be protected with a waterproofing system.
2.

The waterproofing system in (1) must be either waterproof or water resistant in accordance with 10.2.2 to 10.2.6.

10.2.2 Shower Area (enclosed and unenclosed)

1.

For a shower area with a hob, step-down or level threshold, the following applies:

a.

The floor of the **shower area** must be **waterproof**, including any hob or step-down (see Figure 10.2.2); and

b.

The walls of the **shower area** must be **waterproof** not less than 1800 mm above the floor substrate (see Figure 10.2.2).

c.

Wall junctions and joints within the **shower area** must be **waterproof** not less than 40 mm either side of the junction (see Figure 10.2.2).

d.

Wall/floor junctions within the shower area must be **waterproof** (see Figure 10.2.2).

e.

Penetrations within the **shower area** must be **waterproof**.

2.

A shower with a **preformed shower base** must also comply with the requirements of (1), except for (a) which is not applicable.
- Figure 10.2.2: Extent of treatment for shower areas - concrete compressed fibre-cement and fibre-cement sheet floors.
-
- Figure Notes
Wall/floor junction heights are to be as per 10.2.2 to 10.2.6 (as applicable).
- Notes
Where a shower is above a bath or spa, use requirements for shower.
- 10.2.3 Area outside shower area
1.

For concrete, compressed fibre-cement and fibre-cement sheet flooring, the floor of the room must be water resistant.

2.

For timber floors including particleboard, plywood and other timber based flooring materials, the floor of the room must be waterproof.

3.

Wall/floor junctions must be -

a.

waterproof, and

b.

where a flashing is used, the horizontal leg must be not less than 40 mm.
- 10.2.4 Areas adjacent to baths and spas without showers
1.

For areas adjacent to all baths and spas, the following applies:

a.

For concrete, compressed fibre-cement and fibre-cement sheet flooring, the floor of the room must be water resistant.

b.

For timber floors including particleboard, plywood and other timber based flooring materials, the floor of the room must be waterproof.

c.

Tap and spout penetrations must be waterproof where they occur in horizontal surfaces.

2.

For areas adjacent to non-freestanding baths and spas, the following applies:

a.

Walls must be water resistant (see Figure 10.2.4a and Figure 10.2.4b)-

•

to a height of not less than 150mm above the vessel, for the extent of the vessel, where the vessel is within 75mm of a wall; and

•

for all exposed surfaces below vessel lip.

b.

Wall junctions and joints must be water resistant within 150mm above a vessel for the extent of the vessel.

c.

Wall/floor junctions must be waterproof for the extent of the vessel (see Figure 10.2.4a and Figure 10.2.4b).

3.

For inserted baths and spas, the following applies:

a.

For floors and horizontal surfaces:

•

Any shelf area adjoining the bath or spa must be waterproof and include a waterstop under the vessel lip.

•

There are no requirements for the floor under a bath or spa.

b.

For walls:

•

Waterproof to not less than 150mm above the lip of a bath or spa.

•

There are no requirements for the floor under a bath or spa.

c.

For wall junctions and joints, the following applies:

•

Waterproof junctions within 150mm of a bath or spa.

•

There are no requirements for junctions and joints in walls beneath the lip of a bath or spa.

d.

Tap and spout penetrations must be waterproof where they occur in horizontal surfaces.

Figure 10.2.4a: Areas adjacent to baths and spas without showers for concrete, compressed fibre-cement and fibre-cement sheet flooring

Figure 10.2.4b: Areas adjacent to baths and spas without showers for timber floors including particle-board, plywood and other floor materials

10.2.5 Other areas

1.

For walls adjoining other types of vessels (e.g. sink, basin or laundry tub), the following applies:

a.

Walls must be water resistant to a height of not less than 150mm above the vessel, for the extent of the vessel, where the vessel is within 75 mm of a wall (see Figure 10.2.5.)

b.

Waterproof wall junctions where a vessel is fixed to a wall.

c.

Waterproof tap and spout penetrations where they occur in surfaces required to be waterproof or water resistant.

2.

For laundries and WCs, the following applies:

a.

The floor of the room must be water resistant.

b.

Wall/floor junctions must be water resistant, and where a flashing is used, the horizontal leg must not be less than 40 mm.

3.

For WCs with handheld bidet spray installations, the following applies:

a.

The floor of the room must be waterproof.

b.

Walls must be -

•

waterproof in WC area within a 900 mm radius from the wall connection of the handheld bidet spray device to a height of not less than 150mm above the floor substrate; and

•

water resistant in WC area within a 900 mm radius from the wall connection of the handheld bidet device to not less than 1200 mm above the finished floor level of the WC.

c.

Wall junctions within the WC area within 900 mm radius from the wall connection of the handheld bidet spray device must be waterproof.

d.

Wall/floor junctions within the WC area within 1000 mm radius from the wall connection of the handheld bidet spray device must be waterproof.

e.

Penetrations in the WC area must be waterproof.

Figure 10.2.5: Bath and vessel abutting wall - areas to be protected

10.2.6 Waterproofing systems

1.

For the purposes of this Part, a waterproofing system is deemed -

a.

waterproof, if it complies with (2); or

b.

water resistant, if it complies with (3).

2.

For a waterproofing system required to be waterproof in accordance with 10.2.2 to 10.2.5, the materials nominated in 10.2.8 must be used.

3.

For a waterproofing system required to be water resistant in accordance with 10.2.2 to 10.2.5, the materials nominated in 10.2.9 must be used in conjunction with the materials in 10.2.10.

10.2.12 Construction of wet area floors - falls

Where a floor waste is installed -

a.

the minimum continuous fall of a floor plane to the waste must be 1:80; and

b.

the maximum continuous fall of a floor plane to the waste must be 1:50.

2	03-07-2026	CDC ISSUE	
1	26-06-2026	WIP Door Adjusted and Spa Added	
REV	DATE	DESCRIPTION	BY

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE DEVELOPER & THE REPRODUCTION OF ANY PART WITHOUT THE PRIOR WRITTEN CONSENT OF THE DEVELOPER IS A VIOLATION OF APPLICABLE LAWS. IN NO EVENT SHALL THE DEVELOPER BE HELD LIABLE FOR SPECIAL COLLATERAL, INCIDENTAL OR CONSEQUENTIAL LIABILITY IN CONNECTION WITH THE USE OF THIS DIGITAL DATA ONCE RELEASED FROM THE DEVELOPER'S OFFICE. THIS DRAWING IS TO BE READ & UNDERSTOOD IN CONJUNCTION WITH THE STRUCTURAL, MECHANICAL, ELECTRICAL & / OR ANY OTHER CONSULTANT'S DOCUMENTATION AS MAY BE APPLICABLE TO THE PROJECT PRIOR TO THE START OF ANY WORKS AND FOR ITS DURATION.

PROJECT:
LOT 2007 21 LOUISIANA STREET
21 LOUISIANA STREET ROUSE HILL

DRAWING TITLE:
WATERPROOFING PLAN

LOT NO:	DATE:	SCALE:	DRAWING No:	REV:
2007	26-08-2026	1 : 50	CDC.19	2
DRAWN BY:	CHECKED BY:			ISSUED BY:
AS	RH			
DRAFTED BY:	CLIENT NAME:			
ID	Sanjeewa Jayawickrama Monarawila & Gayani Perera Weheragodage			

CDC ISSUE

A3