



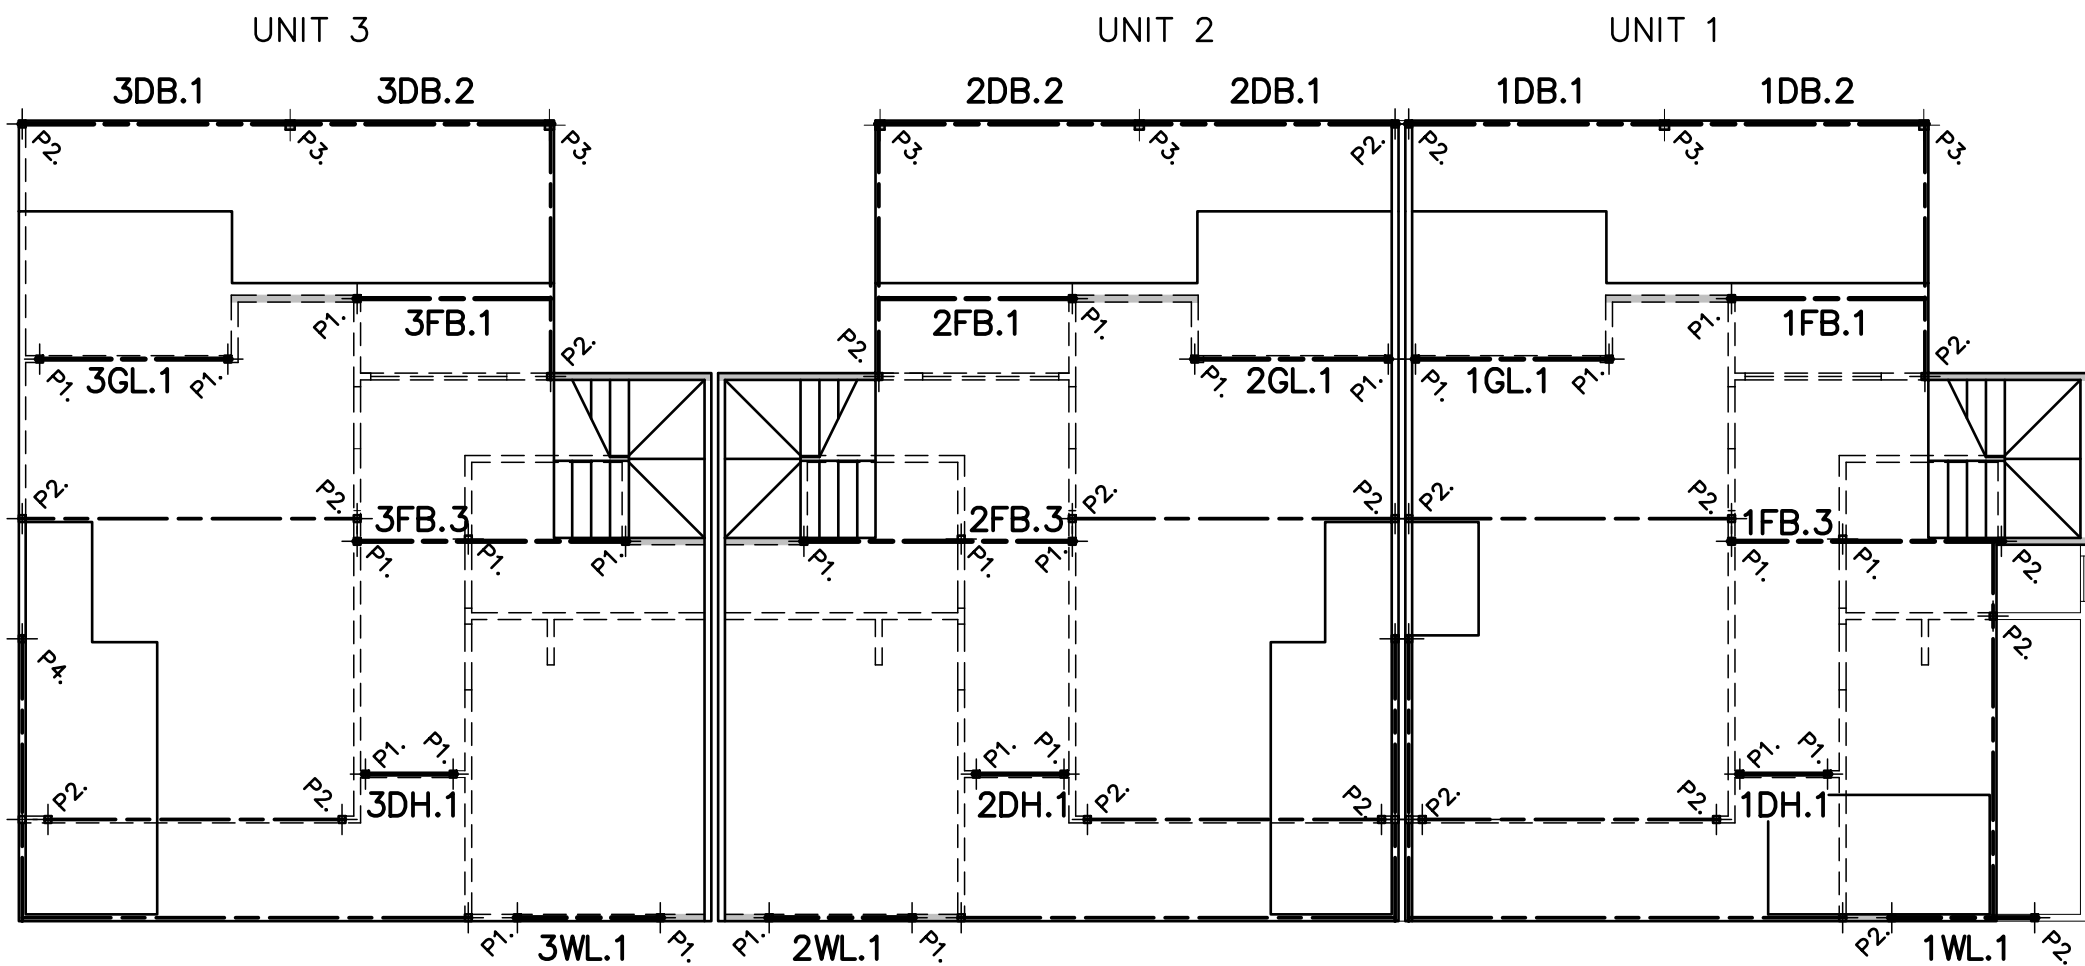


FIRST FLOOR BEAM LAYOUT FOR UNITS 1 – 3 (1:100)

TIMBER MEMBERS

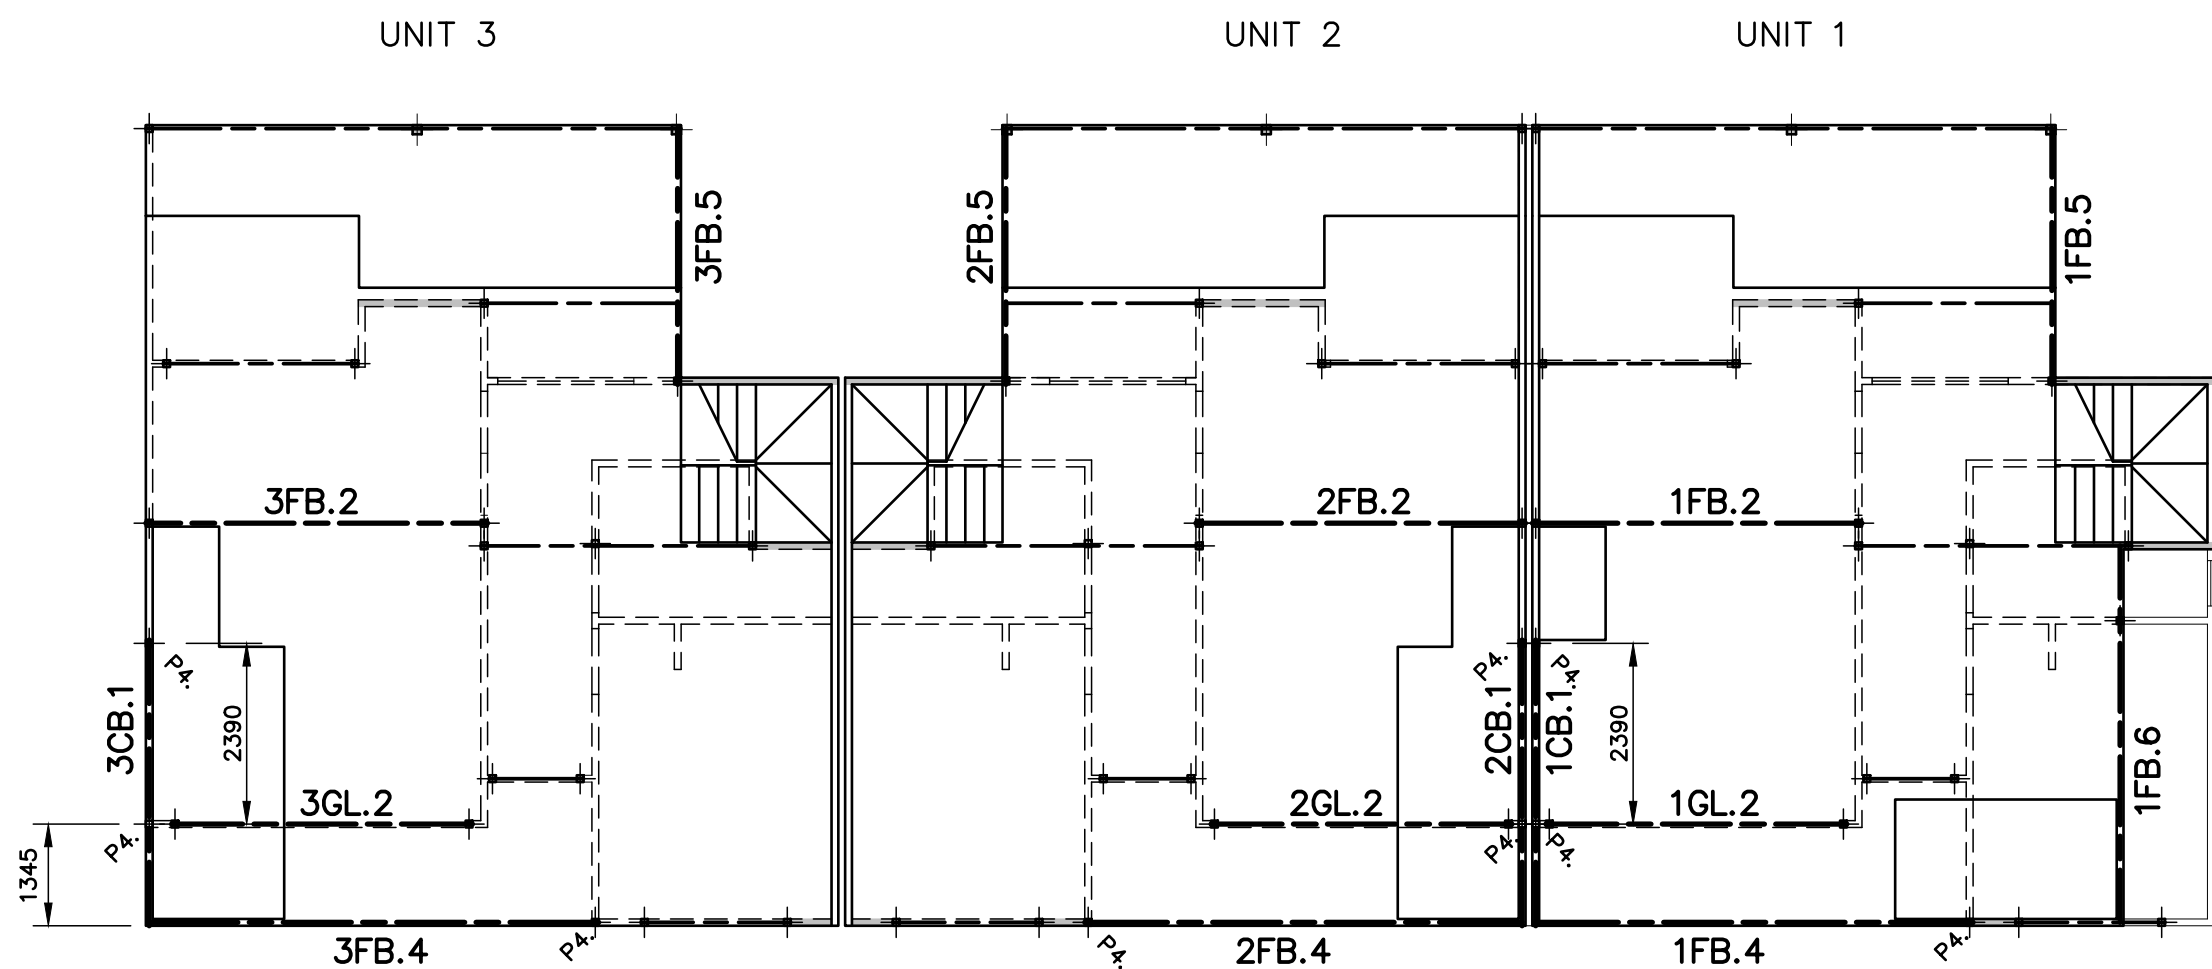

FIRST FLOOR BEAM LAYOUT FOR UNITS 1 – 3 (1:100)

STEEL MEMBERS

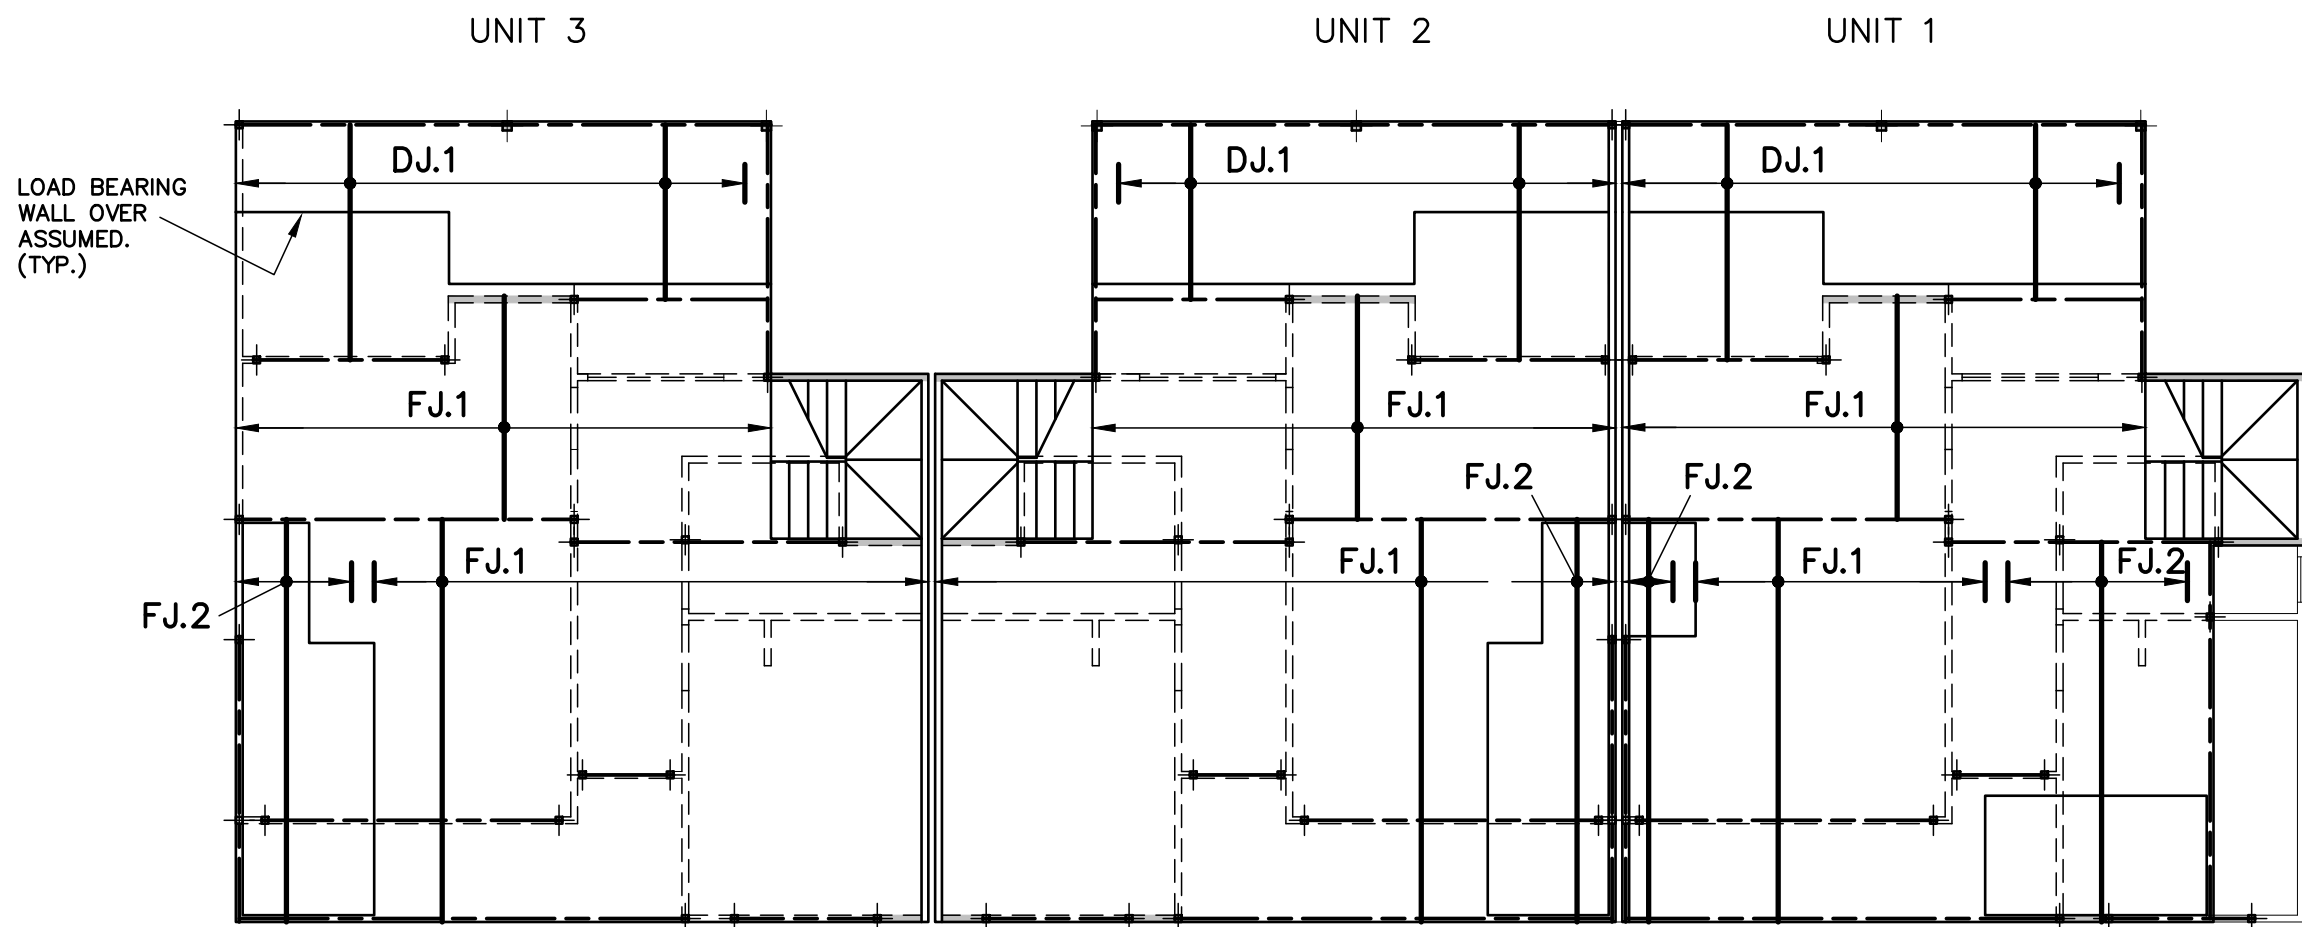

FIRST FLOOR JOIST LAYOUT FOR UNITS 1 – 3 (1:100)

MEMBER SCHEDULE

POSTS

- P.1 — 2/90 x 45 MGP12 studs nailed or screwed together
P.2 — 2/90 x 45 LVL studs nailed or screwed together
P.3 — 140 x 140 F7. treated pine post on HD galvanised post shoe.
P.4 — 89 x 6 SHS. post

UNIT No.1

FLOOR BEAMS

- 1FB.1 — 300 x 45 LVL. (3.7m max. span)
1FB.2 — 250 UB 25.7 (4.4m max. span)
1FB.3 — Timber to AS1684 (2.0m max. span)
1FB.4 — 250 PFC. (6.0m max. span)
1FB.5 — 200 PFC. (3.3m max. span) or timber (size to suit set-down requirements for waterproofing)
1FB.6 — 250 UB 25.7 or 2/300 x 45 LVL. (4.0m max. span)

DECK BEAMS

- 1DB.1 — 280 x 65 GL10/H3 treated designpine (3.5m max. span)
1DB.2 — 280 x 65 GL10/H3 treated designpine (3.5m max. span)

GARAGE LINTEL

- 1GL.1 — 2/240 x 45 LVL. (2.4m max. span)
1GL.2 — 250 UB 25.7 (3.8m max. span)

DOOR HEAD

- 1DH.1 — 300 x 45 LVL. if in floor depth or 130 x 45 LVL. as door head (1.3m max. span)

WINDOW LINTELS

- 1LW.1 — 2/170 x 45 LVL. (1.8m max. span)

CANTILEVERED BEAM

- 1CB.1 — 250 PFC. (2.5m max. span) (1.4m max. cantilever)

UNIT No.2

FLOOR BEAMS

- 2FB.1 — 300 x 45 LVL. (3.7m max. span)
2FB.2 — 250 UB 25.7 (4.4m max. span)
2FB.3 — Timber to AS1684 (2.0m max. span)
2FB.4 — 250 PFC. (6.0m max. span)
2FB.5 — 200 PFC. (3.3m max. span) or timber (size to suit set-down requirements for waterproofing)

DECK BEAMS

- 2DB.1 — 280 x 65 GL10/H3 treated designpine (3.5m max. span)
2DB.2 — 280 x 65 GL10/H3 treated designpine (3.5m max. span)

GARAGE LINTEL

- 2GL.1 — 2/240 x 45 LVL. (2.4m max. span)
2GL.2 — 250 UB 25.7 (3.8m max. span)

DOOR HEAD

- 2DH.1 — 300 x 45 LVL. if in floor depth or 130 x 45 LVL. as door head (1.3m max. span)

WINDOW LINTELS

- 2LW.1 — 2/170 x 45 LVL. (1.8m max. span)

CANTILEVERED BEAM

- 2CB.1 — 250 PFC. (2.5m max. span) (1.4m max. cantilever)

NOTE 1

Deeper joists than those specified may be required to suit drainage pipe fixtures located within the floor space.

NOTE 2

LVL. beams shall be equivalent to Hyspan LVL.14 or LVL.13
Lintels for openings of less than 3.6m width shall be determined from AS 1684.

Timber framing shall be in accordance with AS 1684 'Residential Timber Framed Construction'.

FIRST FLOOR LEVEL FRAMING

Wall framing and Lintels for openings widths less than 3.6m on the first floor level together with roof trusses shall be designed by the frame supplier.

Internal walls on first floor level have been assumed to be non-loadbearing (trussed roof)

UNIT No.3

FLOOR BEAMS

- 3FB.1 — 300 x 45 LVL. (3.7m max. span)
3FB.2 — 250 UB 25.7 (4.4m max. span)
3FB.3 — Timber to AS1684 (2.0m max. span)
3FB.4 — 250 PFC. (6.0m max. span)
3FB.5 — 200 PFC. (3.3m max. span) or timber (size to suit set-down requirements for waterproofing)

DECK BEAMS

- 3DB.1 — 280 x 65 GL10/H3 treated designpine (3.5m max. span)
3DB.2 — 280 x 65 GL10/H3 treated designpine (3.5m max. span)

GARAGE LINTEL

- 3GL.1 — 2/240 x 45 LVL. (2.4m max. span)
3GL.2 — 250 UB 25.7 (3.8m max. span)

DOOR HEAD

- 3DH.1 — 300 x 45 LVL. if in floor depth or 130 x 45 LVL. as door head (1.3m max. span)

WINDOW LINTELS

- 3LW.1 — 2/170 x 45 LVL. (1.8m max. span)

CANTILEVERED BEAM

- 3CB.1 — 250 PFC. (2.5m max. span) (1.4m max. cantilever)

FLOOR JOISTS

- FJ.1 — MJ300–90 meyJOIST at 450 spacing or equivalent (5.4m max. span)
FJ.2 — MJ255–63 or 240 x 45 LVL. at 450 spacing (4.0m max. span)
DJ.1 — 200 x 45 LVL. at 450 spacing or use 240 x 45 joists ripped down to 200 deep to create fall. Install packing to suit habitable room space. (3.2m max. span)



ISSUE:	DATE:	DETAILS OF AMENDMENT:

HALCROW & ASSOCIATES

CONSULTING STRUCTURAL ENGINEERS

A.C.N. 003 805 374

108 Avoca Drive,
Kincumber, N.S.W. 2251.
P.O. Box 6349 Kincumber, 2251

Phone: (02) 4369-0977

Email: design@halcrows.com.au

DESIGN:	H.M.H.	DRAWN:	B.N.
DATE:	30.10.25	CHECKED:	HMH
SCALE:	1:100	APPROVED:	Hugh M. Halcrow
			BE MIEAUST CPENG

CLIENT:	Khouri Projects
PROJECT:	Proposed Multi Dwelling Housing – 6 Units
SITE:	Lots 258 & 259 (No. 59–61) Memorial Ave., BLACKWALL
TITLE:	FIRST FLOOR FRAMING PLANS – SHEET 1

DRAWING NUMBER:

24.06.010

No. IN SET:

S5 of 9

AMENDMENT: