

PROPOSED DOUBLE STOREY DWELLING
#28,Guruwin Street,Austral




Paragon Building Certifiers Pty Ltd
RBC00045
Registered Certifier
APPROVED

Reference: 260489/01
Date: 08/09/2026



Page No	Title
1	Coverpage
2	Safety in Design Notes
3	Building Specification
4	Building Specification
5	Basix Notes
6	Cut and Fill Plan
7	Site Plan
8	Slab Plan
9	Ground Floor Plan
10	First Floor Plan
11	Roof Plan
12	Elevation
13	Side Elevation
14	Section
15	Door Schedule & SOF
16	Window Schedule
17	Landscape Plan
18	Sediment Control Plan
19	GFA Calculation
20	Floor Finish

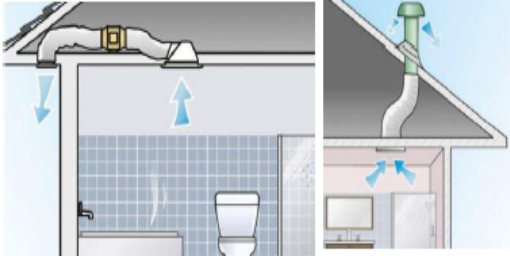SAFETY IN DESIGN NOTES: THESE NOTES MUST BE READ AND UNDERSTOOD BY ALL INVOLVED IN THE PROJECT. THIS INCLUDES (BUT IS NOT EXCLUDED TO): OWNER, BUILDER, SUB-CONTRACTORS, CONSULTANTS, RENOVATORS, OPERATORS, MAINTAINORS, DEMOLISHERS.				
BUILDING SPECIFICATIONS:				
National Construction Code - Volume 2 Amendment 2- Building Code of Australia 2022 & Housing Provisions Standard 2022				
1. FALLS, SLIPS, TRIPS a) WORKING AT HEIGHTS DURING CONSTRUCTION Wherever possible, components for this building should be prefabricated off-site or at ground level to minimise the risk of workers falling more than 2 m. However, construction of this building will require workers to be working at heights where a fall in excess of 2m is possible and injury is likely to result from such a fall. The builder should provide a suitable barrier wherever a person is required to work in a situation where falling more than 2m is a possibility. DURING MAINTENANCE For houses or other low-rise buildings where scaffolding is appropriate: Cleaning and maintenance of windows, walls, roof or other components of this building will require persons to be situated where a fall from a height in excess of 2m is possible. Where this type of activity is required, scaffolding, ladders or trestles should be used in accordance with relevant codes of practice, regulations or legislation. FLOOR FINISHES BY OWNER b) SLIPPERY OR UNEVEN SURFACES Designer has not been involved in the selection of surface finishes, the owner is responsible for the selection of surface finishes in the pedestrian trafficable areas of this building. Surfaces should be selected in accordance with AS HB 197:1999 and AS/NZ 4586:2004. c) STEPS, LOOSE OBJECTS AND UNEVEN SURFACES Due to design restrictions for this building, steps and/or ramps are included in the building which may be a hazard to the workers carrying objects or otherwise occupied. Steps should be clearly marked with both visual and tactile warning during construction, maintenance, demolition and at all times when the building operates as a workplace. Building owners and occupiers should monitor the pedestrian access ways and in particular access to areas where maintenance is routinely carried out to ensure that surfaces have not moved or cracked so that they become uneven and present a trip hazard. Spills, loose material, stray objects or any other matter that may cause a slip or trip hazard. Spills, loose material, stray objects or any other matter that may cause a slip or trip hazard should be cleaned or removed from access ways. Contractors should be required to maintain a tidy work site during construction, maintenance or demolition to reduce the risk of trips and falls in the workplace. Materials for construction or maintenance should be stored in designated areas away from access ways and work areas.	4. SERVICES Rupture of services during excavation or other activity creates a variety of risks including release of hazardous materials. Existing services are located on and around this site. Where known, these are identified on the plans but the exact location and extent of services may vary from that indicated. Services should be located using an appropriate excavation practice should be used and, where necessary, specialist contractors should be used. LOCATIONS WITH UNDERGROUND POWER: Underground power lines MAY be located in or around this site. All underground power lines must be disconnected or carefully located and adequate warning signs used prior to any construction, maintenance or demolition commencing. LOCATIONS WITH OVERHEAD POWER LINES: Overhead power lines MAY be near or on this site. These pose a risk of electrocution if struck or approached by lifting devices or the plant and persons working above ground level. Where there is a danger of this occurring, power lines should be, where practical, disconnected or relocated. Where this is not practical adequate warning in the form of bright colored tape or signage should be used or a protective barrier provided. 5. MANUAL TASKS Components within the design with a mass excess of 45kg should be lifted by two or more workers or by mechanical lifting device. Where this is not practical, suppliers and fabricators should be required to limit the component mass. All material packaging, building and maintenance components should clearly show the total mass of packages and where practical all items should be stored on site in a way which minimises bending before lifting. Advice should be provided on safe lifting methods in all areas where lifting may occur. Construction, maintenance and demolition of this building will require the use of portable tools and equipment. These should be fully maintained in accordance with manufacturer's specifications and not used where faulty or (in the case of electrical equipment) not carrying a current electrical safety tag. All safety guards or devices should be regularly checked and Personal Protective Equipment should be used in accordance with manufacturer's specifications. 6. CONFINED SPACES EXCAVATION Construction of this building and some maintenance on this building will require excavation and installation of items within excavations. Where practical, installation should be carried out using methods which do not require workers to enter the excavation. Where this is not practical adequate support for the excavated area should be provided to prevent collapse. Warning signs and barriers to prevent accidental or unauthorised access to all excavations should be provided. ENCLOSED SPACES For buildings with enclosed spaces where maintenance or other access may be required. Enclosed spaces within this building may present a risk to persons entering for construction, maintenance or any other purpose. The design documentation calls for warning signs and barriers to unauthorised access. These should be maintained throughout the life of the building. Where workers are required to enter enclosed spaces, air testing equipment and Personal Protective Equipment should be provided. SMALL SPACES For buildings with small spaces where maintenance or other access may be required: Some small spaces within this building will require access by construction or maintenance workers. The design documentation calls for warning signs and barriers to unauthorised access. These should be maintained throughout the life of the building. Where workers are required to enter small spaces they should be scheduled so that access is for short periods. Manual lifting and other manual activity should be restricted in small spaces. 7. HAZARDOUS SUBSTANCES ASBESTOS For alterations to a building constructed prior to 1990- It may contain asbestos 1986- It is likely to contain asbestos either in cladding material or in fire retardant insulation material. In either case, the builder should check and, if necessary, take appropriate action before demolishing, cutting, sanding, drilling or otherwise disturbing the existing structure. POWDERED MATERIALS Many materials used in the construction of this building can cause harm if inhaled in powdered form. Persons working on or in the building during construction, operational maintenance or demolition should ensure good ventilation and wear Personal Protective Equipment including protection against inhalation while using powdered material or when sanding, drilling, cutting or otherwise disturbing or creating powdered material. TREATED TIMBER The design of this building may include provision for the inclusion of treated timber within the structure. Dust or fumes from this material can be harmful. Persons working on or in the building during construction, operational maintenance or demolition should ensure good ventilation and wear Personal Protective Equipment including protection against inhalation of harmful materials when sanding, drilling, cutting or using treated timber in any way that may cause harmful material to be released. Do not burn treated timber. VOLATILE ORGANIC COMPOUNDS Many types of glue, solvents, spray packs, paints, varnishes and some cleaning materials and disinfectants have dangerous emissions. Areas where these are used should be kept well ventilated while the material is being used and for a period after installation. Personal Protective Equipment may also be required. The manufacturer's recommendations for use must be carefully considered at all times.	SYNTHETIC MINERAL FIBRE Fibreglass, rockwool, ceramic and other material used for thermal or sound insulation may contain synthetic mineral fibre which may be harmful if inhaled or if it comes in contact with skin, eyes or other sensitive parts of the body. PPE including protection against inhalation of harmful materials should be used when installing, removing or working near bulk insulation material. TIMBER FLOORS This building may contain timber floors which have an applied finish. Areas where finishes are applied should be kept well ventilated during sanding and application and for a period after installation. PPE may also be required. The manufacturer's recommendations for use must be carefully considered at all times. 8. PUBLIC ACCESS Public access to construction and demolition sites and to areas under maintenance causes risk to workers and public. Warning signs and secure barriers to unauthorised access should be provided. Where electrical installations, excavations, plant or loose materials are present they should be secured when not fully supervised. 9. OTHER HIGH RISK ACTIVITY All electrical work should be carried out in accordance with the code of Practice: Managing Electrical risks at the Workplace, AS/NZ 30112 and all licensing requirements. All work using plant should be carried out in accordance with Code of Practice: Managing risks of Plant at the workplace. All work should be carried out in accordance with Code of Practice: Managing Noise and Preventing Hearing Loss at Work. Due to the history of serious incidents it is recommended that particular care be exercised when undertaking work involving steel construction and concrete placement. All the above applies. SITE PREPARATION - PART 3.1 OF THE NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022. EARTHWORKS - TO BE CARRIED OUT IN ACCORDANCE WITH THE REQUIREMENTS OF THE ENVIRONMENTAL PLANNING & ASSESSMENT ACT 1979 AND DEVELOPMENT CONSENT CONDITIONS - PART 3.2 OF THE NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022. - AS 4678:2002 - EARTH-RETAINING STRUCTURES DRAINAGE - PART 3.3 OF THE NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING ROVISIONS STANDARD 2022. - AS/NZS 3500.1:2021 - PLUMBING & DRAINAGE - WATER SERVICES - AS/NZS 3500.2:2021 - PLUMBING & DRAINAGE - SANITARY PLUMBING & DRAINAGE - AS/NZS 3500.3:2021 - PLUMBING & DRAINAGE STORMWATER DRAINAGE - AS/NZS 3500.4:2021 - PLUMBING & DRAINAGE - HEATED WATER SERVICES STRUCTURAL WORK - Part 2.2 OF THE NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022. - AS 4100-2020- STEEL STRUCTURES CODES - AS/NZS 1170.0-2002 – GENERAL PRINCIPLES - AS/NZS 1170.1-2002 – PARTS 1 PERMANENT, IMPOSED AND OTHER ACTIONS - AS/NZS 1170.2-2021 – PART 2 WIND ACTIONS - AS 3700-2018- SAA MASONRY CODE - AS 1684.3-2021- RESIDENTIAL TIMBER FRAMED CONSTRUCTION FOOTINGS & SLABS - PART 4 OF THE NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022. - AS 2159:2009 - PILING - DESIGN & INSTALLATION - AS 2870:2011 - RESIDENTIAL SLABS & FOOTINGS - AS 3600:2018 - CONCRETE STRUCTURES MASONRY - PART 5 OF THE NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022. - AS 3700:2018 - MASONRY STRUCTURES FRAMING - PART 6 OF THE NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022. - AS 1684.2:2021 - RESIDENTIAL TIMBER- FRAMED CONSTRUCTION - NON- CYCLONIC AREAS - AS 1720.1:2010 - TIMBER STRUCTURES - DESIGN METHODS - AS 4100:2020 - STEEL STRUCTURES - AS 3660.1-2014 – TERMITE MANAGEMENT SYSTEM ROOF & WALL CLADDING - PART 7 OF THE NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022. - AS 1273:1991 - UNPLASTICIZED PVC (UPVC) DOWNPIPES & FITTINGS FOR RAINWATER - AS 1562.1:2018 - DESIGN & INSTALLATION OF SHEET ROOF & WALL CLADDING - METAL - AS/NZS 1562.3:2006 - DESIGN & INSTALLATION OF SHEET ROOF & WALL CLADDING - PLASTIC - AS 2049:2002 - ROOF TILES - AS 2050:2018 - INSTALLATION OF ROOF TILES - AS 4285:2019 – ROOFLIGHTS GLAZING - PART 8 OF THE NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022. - AS 1288:2021 - GLASS IN BUILDINGS - SELECTION & INSTALLATION - AS 2047:2014 - WINDOWS & EXTERNAL GLAZED DOORS IN BUILDINGS - AS/NZS 2208:1996 - SAFETY GLAZING MATERIALS IN BUILDINGS	FIRE SAFETY - PART 9 OF THE NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022. - AS 3786:2014 - SMOKE ALARMS USING SCATTERED LIGHT, TRANSMITTED LIGHT OR IONIZATION HEALTH & AMENITY - PART 10 OF THE NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022. - AS/NZS ISO 717.1:2004 - ACOUSTICS - RATING OF SOUND INSULATION IN BUILDINGS & OF BUILDING ELEMENTS - AIRBORNE SOUND INSULATION - AS ISO 717.2:2004 - ACOUSTICS - RATING OF SOUND INSULATION IN BUILDINGS & OF BUILDING ELEMENTS - IMPACT SOUND INSULATION - AS 1668.2:2012 - THE USE OF VENTILATION & AIR CONDITIONING IN BUILDINGS - MECHANICAL VENTILATION IN BUILDINGS - AS 1668.4:2012 - THE USE OF VENTILATION & AIR CONDITIONING IN BUILDINGS - NATURAL VENTILATION OF BUILDINGS - AS/NZS 1680.0:2009 - INTERIOR LIGHTING - SAFE MOVEMENT - AS 3740:2021 - WATERPROOFING OF DOMESTIC WET AREAS - AS 3000-2018 – ELECTRICAL INSTALLATION - BCA Part 10.8.1, AS4200.1 & AS4200.2 – PLIABLE BUILDING MEMBRANE INSTALLED. WATERPROOFING - NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022 - AS 3740-2021– WATERPROOFING TO WET AREA - AS 4654-2012 – EXTERNAL WET AREAS SAFE MOVEMENT & ACCESS - PART 11 OF THE NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022. - AS 1428.1:2009 - DESIGN FOR ACCESS & MOBILITY - GENERAL REQUIREMENTS FOR ACCESS - NEW BUILDING WORK - AS 1657:2018 - FIXED PLATFORMS, WALKWAYS, STAIRWAYS & LADDERS - DESIGN, CONSTRUCTION & INSTALLATION HANDRAILS & BALUSTRADE - PART 11.3.3 OF THE NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022. - PART 11.3.4 OF THE NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022. - PART 11.3.5 OF THE NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022. - AS 1170.1-2002 – BALUSTRADE INSTALLATION PROTECTION OF OPENABLE WINDOW PART 11.3.7 AND 11.3.8 OF THE NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022. ENERGY EFFICIENCY - PART 13 OF THE NCC VOLUME 2 BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022 & BASIX CERTIFICATE. MECHANICAL VENTILATION - EXHAUST FROM A BATHROOM, SANITARY COMPARTMENT TO DISCHARGE DIRECTLY TO OUTDOOR AIR WITH MINIMUM FLOW RATE OF 25L/S & MAKE-UP AIR VIA OPENINGS TO AN ADJACENT ROOM WITH A FREE AREA OF 14,000 MM2. THIS EXHAUST SYSTEM MUST BE INTERLOCKED WITH LIGHT SWITCH AND INCLUDE RUN-ON TIMER SO THAT THE EXHAUST SYSTEM CONTINUES TO OPERATE FOR 10 MINUTES AFTER THE LIGHT SWITCH IS OFF. - ANY INSTALLED - KITCHEN RANGEHOOD EXHAUST TO DISCHARGE DIRECTLY OR VIA DUCT TO OUTDOOR AIR WITH MINIMUM FLOW RATE OF 40L/S & MAKE-UP AIR VIA OPENINGS TO AN ADJACENT ROOM WITH A FREE AREA OF 14,000 MM2. - LAUNDRY EXHAUST TO DISCHARGE DIRECTLY OR VIA DUCT TO OUTDOOR AIR WITH MINIMUM FLOW RATE OF 40L/S & MAKE-UP AIR VIA OPENINGS TO AN ADJACENT ROOM WITH A FREE AREA OF 14,000 MM2.	

NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.

All boundaries and contours are subject to survey drawing. All levels to Australian Height Data. It is the contractors responsibility to confirm all measurements on site and locations of any services prior to work on site.



37604191460 **ABN**
(02) 8710 3852
SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW, 2212
design@iedesigns.com.au
www.iedesigns.com.au



A	07-09-2026	Issue for CDC

DRAWING : Safety in Design Notes
CLIENT : Sandstone Constructions
PROJECT : PROPOSED DOUBLE STOREY DWELLING
#28, Guruwin Street, Austral Lot- 224 D.P 1302263

DRAWN BY: NB	DATE : 07-09-2026	PROJECT NO. 2607 933
SCALE:	APPLICATION : CDC	ISSUE A
PAGE SIZE A3	PAGE NO: 2	

All documents here within are subject to Australian Copyright Laws.

TERMITE SHEET

-TERMITE SHEET EXTENDS THROUGH THE ENTIRE MASONRY LEAF AND IS
VISIBLE AT THE FINISHED FACE OF THE WALL.

Figure 10.2.29 Typical membrane termination at drainage outlet




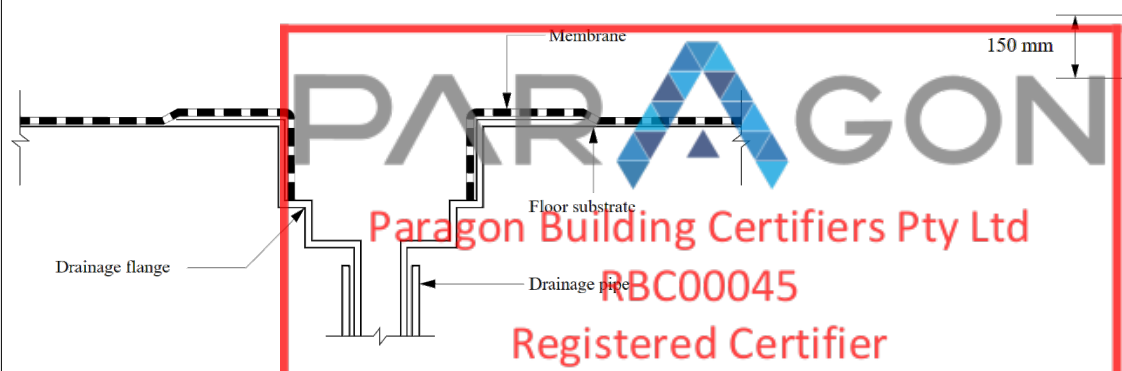


Figure 10.2.24 Typical bathroom door details for whole bathroom waterproofing

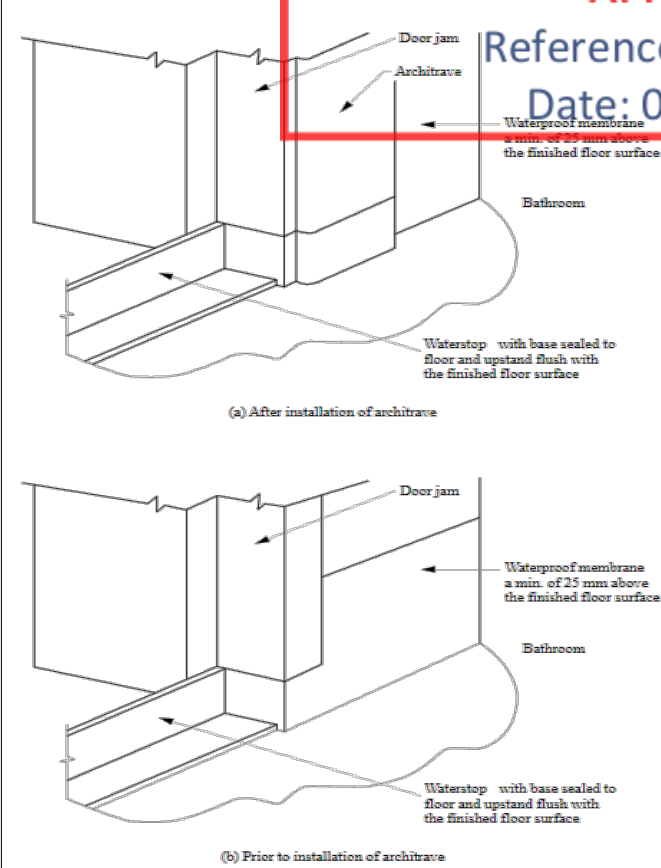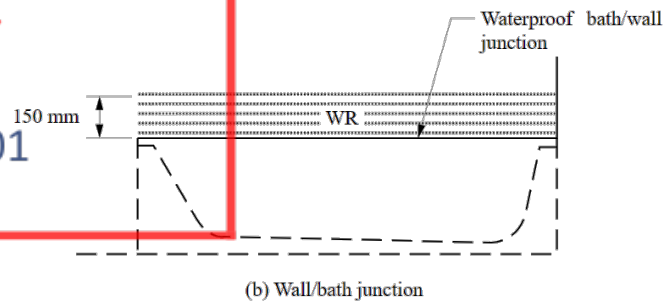

BASIN & BATHTUB:

Figure 10.2.5 Bath and vessel abutting wall — areas to be protected

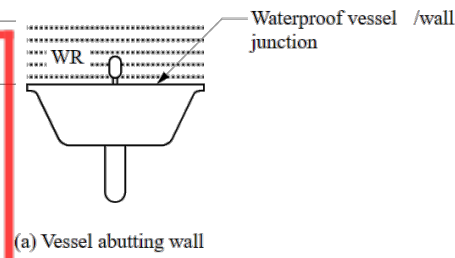

ENCLOSED SHOWER AREA

Figure 10.2.17 Typical hobless construction



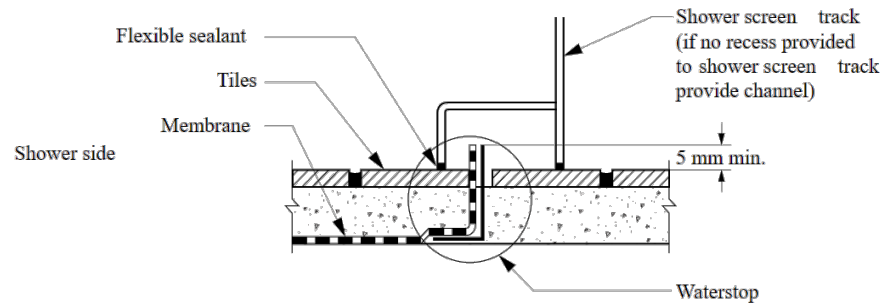


Figure 10.2.16: Typical hob construction — internal membrane

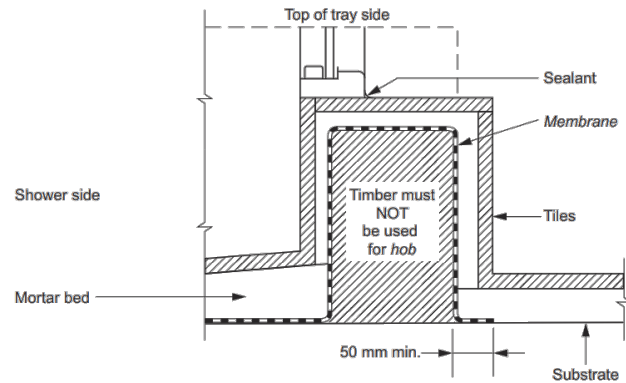

Typical detail of HOB Construction as per BCA ABCB Housing Provisions Part 10.2.16

Figure 10.2.2 Extent of treatment for shower areas — concrete compressed fibre-cement and fibre-cement sheet floors

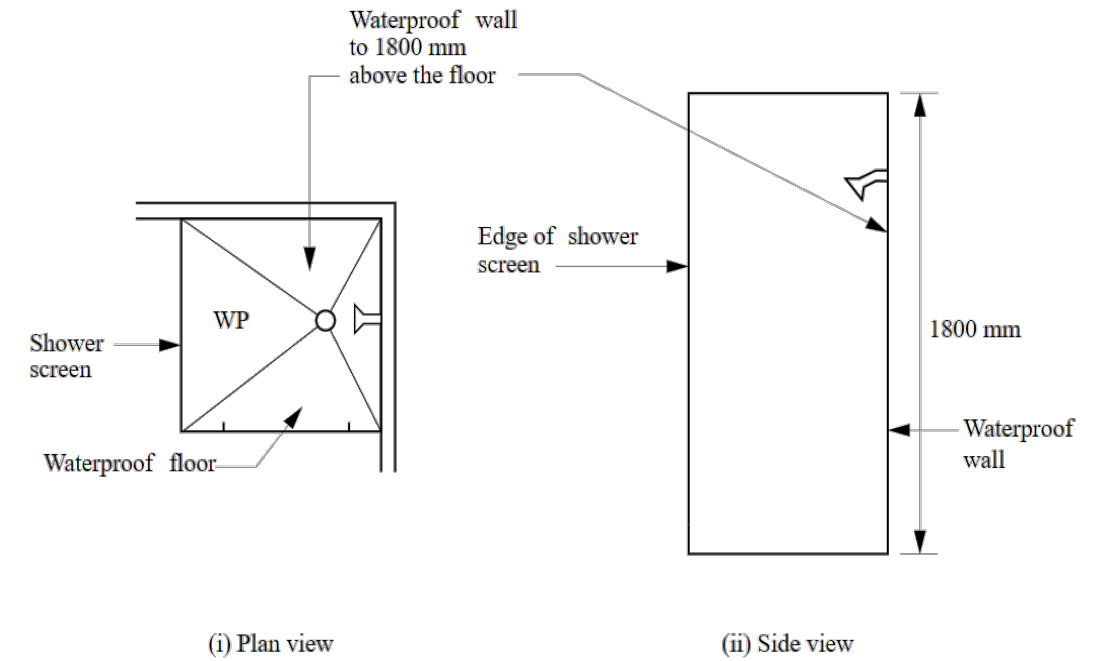

(a) Enclosed shower

Typical detail of enclosed shower as per BCA ABCB Housing Provisions Part 10.2.2
10.2.12 Construction of wet area floors — falls


Where a floor waste is installed—

- (a) the minimum continuous fall of a floor plane to the waste must be 1:80; and
- (b) the maximum continuous fall of a floor plane to the waste must be 1:50.

Floor Waste

app.buildingtools.co

tools

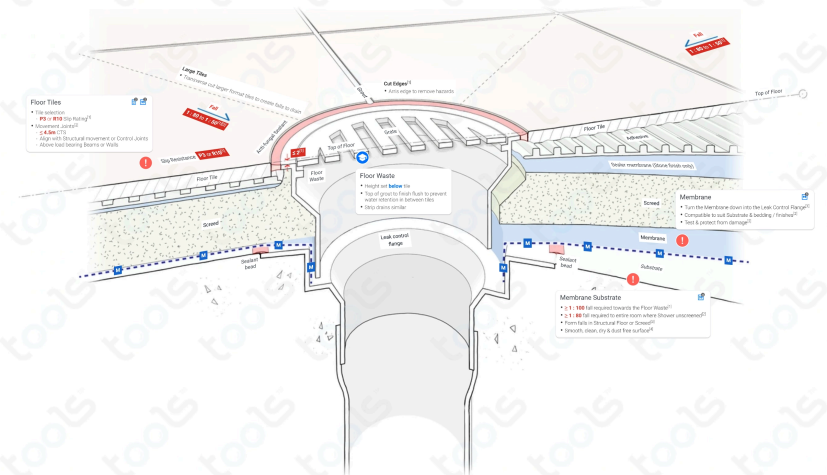

NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.
All boundaries and contours are subject to survey drawing. All levels to Australian Height Data. It is the contractors responsibility to confirm all measurements on site and locations of any services prior to work on site.
All documents here within are subject to Australian Copyright Laws.



37604191460 ABN
(02) 8710 3852
SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW, 2212
design@iedesigns.com.au
www.iedesigns.com.au



A	07-09-2026	Issue for CDC

DRAWING : **Building Specification**
CLIENT : **Sandstone Constructions**
PROJECT : **PROPOSED DOUBLE STOREY DWELLING**
#28, Guruwin Street, Austral
Lot- 224 D.P 1302263

DRAWN BY:	DATE :	PROJECT NO.
NB	07-09-2026	2607 933
SCALE:	APPLICATION :	ISSUE
PAGE SIZE	PAGE NO:	A
A3	3	

TERMITE SHEET


- TERMITE SHEET EXTENDS THROUGH THE ENTIRE MASONRY LEAF AND IS VISIBLE AT THE FINISHED FACE OF THE WALL.



FIGURE 5.5 (in part) TYPICAL SHEET INSTALLATION TO EXTERNAL WALL WITH CONCRETE FLOOR SLAB

DPC FOR BRICKS

DAMP-PROOF COURSE (DPC) TO EXTENDS THROUGH THE ENTIRE MASONRY LEAF AND NEED TO BE VISIBLE AT THE FINISHED FACE OF THE WALL FROM OUTSIDE

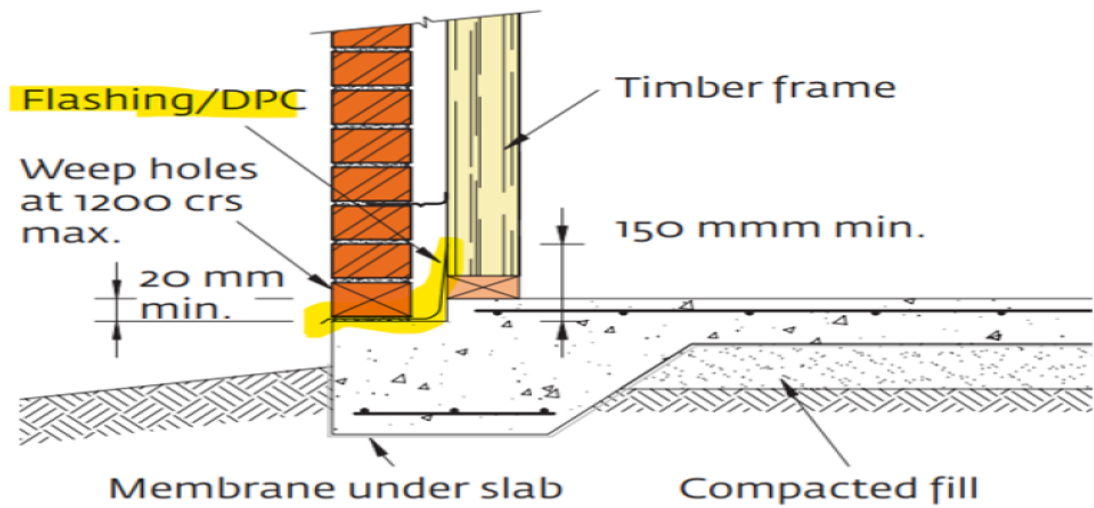

NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.
All boundaries and contours are subject to survey drawing. All levels to Australian Height Data. It is the contractors responsibility to confirm all measurements on site and locations of any services prior to work on site.
All documents here within are subject to Australian Copyright Laws.



37604191460 ABN
(02) 8710 3852
SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW, 2212
design@iedesigns.com.au
www.iedesigns.com.au



A	07-09-2026	Issue for CDC

Figure 10.8.3 (explanatory) Example of roof space with low level ventilation


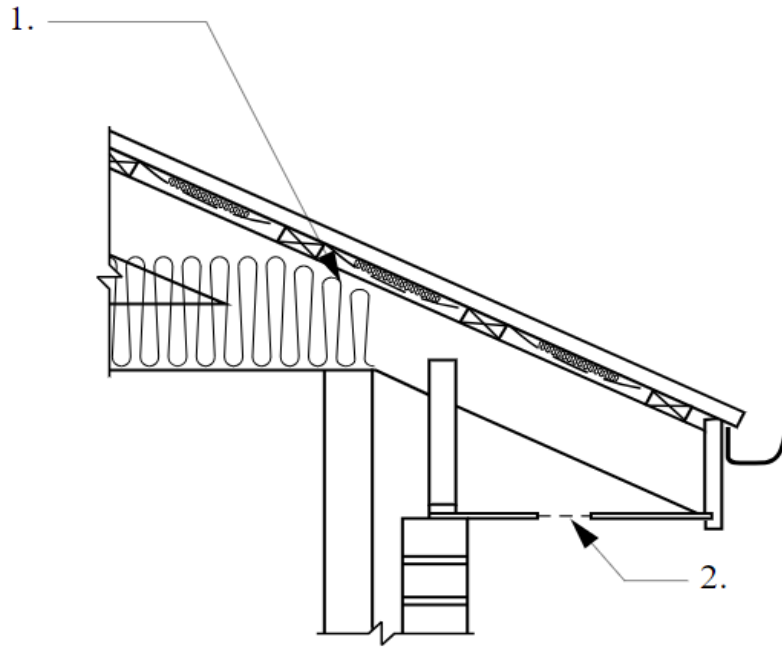


Figure Notes

- (1) Minimum 20 mm gap maintained between insulation and sarking.
(2) Eave ventilation opening in accordance with Table 10.8.3.

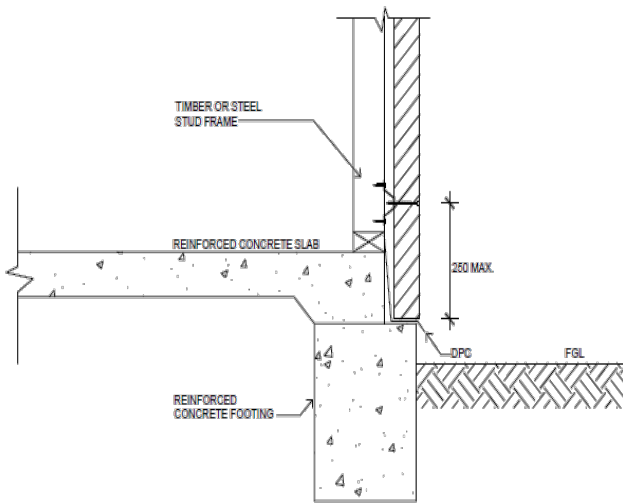

10.8.3


Ventilation of roof spaces

[2019: 3.8.7.4]

- (1) In *climate zones* 6, 7 and 8, a roof must have a roof space that—
- (a) is located—
- (i) immediately above the *primary insulation layer*; or
- (ii) immediately above sarking with a *vapour permeance* of not less than 1.14 µg/N.s, which is immediately above the *primary insulation layer*; or
- (iii) immediately above ceiling insulation that meets the requirements of 13.2.3(3) and 13.2.3(4); and
- (b) has a height of not less than 20 mm; and
- (c) is either—
- (i) ventilated to *outdoor air* through evenly distributed openings in accordance with Table 10.8.3; or
- (ii) located immediately underneath the roof tiles of an unsarked tiled roof.
- (2) The requirements of (1) do not apply to a—
- (a) concrete roof; or
- (b) roof that is made of structural insulated panels; or
- (c) roof that is subject to Bushfire Attack Level FZ requirements in accordance with AS 3959.

Table 10.8.3: Roof space ventilation requirements

Roof pitch	Ventilation openings
< 10°	25,000 mm²/m provided at each of two opposing ends
≥ 10° and < 15°	25,000 mm²/m provided at the eaves and 5,000 mm²/m at high level
≥ 15° and < 75°	7,000 mm²/m provided at the eaves and 5,000 mm²/m at high level, plus an additional 18,000 mm²/m at the eaves if the roof has a cathedral ceiling

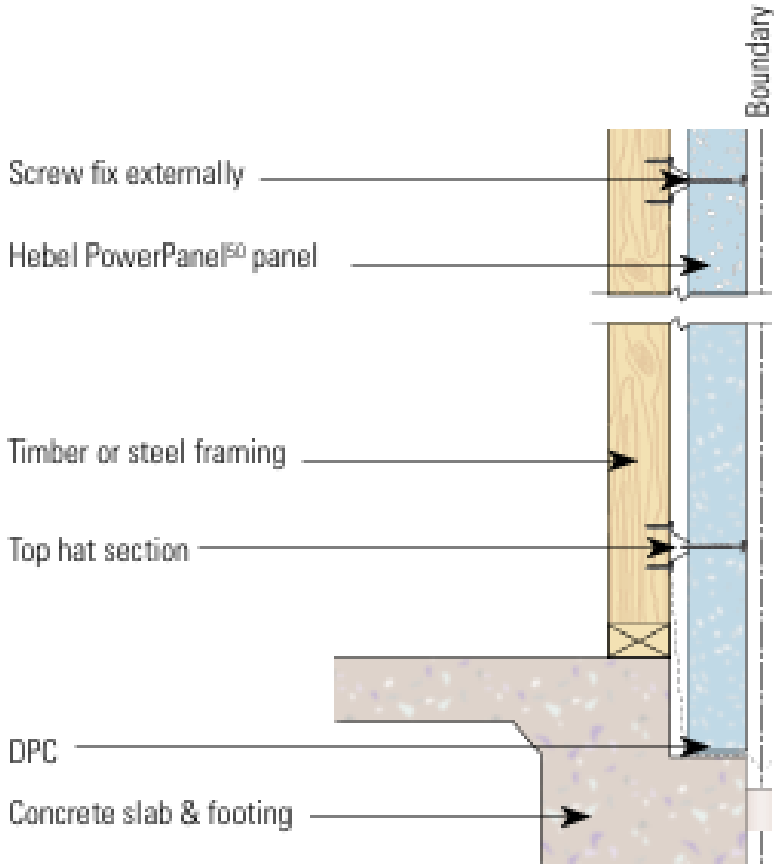

BASIX™ Certificate

Building Sustainability Index
www.planningportal.nsw.gov.au/development-and-assessment/basix

Single Dwelling

Certificate number: 1862419S

This certificate confirms that the proposed development will meet the NSW government's requirements for sustainability, if it is built in accordance with the commitments set out below. Terms used in this certificate, or in the commitments, have the meaning given by the document entitled "BASIX Definitions" dated 10/09/2020 published by the Department. This document is available at www.planningportal.nsw.gov.au/definitions

Secretary
Date of issue: Monday, 24 August 2026
To be valid, this certificate must be submitted with a development application or lodged with a complying development certificate application within 3 months of the date of issue.



PARAGON

Paragon Building Certifiers Pty Ltd
RBC00045
Registered Certifier
APPROVED
Reference: 260489/01
Date: 08/09/2026

Basix-Commitments

/for details: See the Basix certificate/

Alternative water

- The applicant must install a rainwater tank of at least 2000 litres.
The rainwater tank to collect rain runoff from at least 120 m2 of the roof
The applicant must connect the rainwater tank to:
- all toilets in the development
 - the cold water tap that supplies each clothes washer
 - at least one outdoor tap in the development

Fixtures

- Shower heads 4 star (>6.0 but <= 7.5 L/min)
- Toilets.....3 star
- Kitchen tap.....3 star
- Basin Taps.....3 star

Hot Water System: gas instantaneous with a performance of 6.0 stars /or a system with a higher energy rating/

Heating/Cooling: In at least 1 living area and 1 bedroom: 1-phase Air-conditioning; Energy rating: 3.0 Star (Average Zoned)

Ventilation

- At least 1 Bathroom: individual fan, ducted to façade ; Operation control: manual switch on/off
- Kitchen: individual fan, ducted to façade ; Operation control: manual switch on/off
- Laundry: natural ventilation , or no laundry; Operation control: n/a

Natural lighting

- The applicant must install a window and/or skylight in the kitchen of the dwelling for natural lighting.
- The applicant must install a window and/or skylight in 1 bathroom(s)/toilet(s) in the development for natural lighting.

Artificial lighting

- The applicant must ensure that a minimum of 80% of light fixtures are fitted with fluorescent, compact fluorescent, or light-emitting-diode(LED lamps.)

OTHER

- The applicant must install a gas cooktop & electric oven in the kitchen of the dwelling.
- The applicant must install a fixed outdoor clothes drying line as part of the development.

BEFORE
YOU DIG
www.byda.com.au

Zero Damage - Zero Harm

NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.

All boundaries and contours are subject to survey drawing. All levels to Australian Height Data. It is the contractors responsibility to confirm all measurements on site and locations of any services prior to work on site.

All documents here within are subject to Australian Copyright Laws.

INNOVATIVE
ECO DESIGNS
Your Home Your Style

37604191460 ABN
(02) 8710 3852
SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW, 2212
design@iedesigns.com.au
www.iedesigns.com.au

ACCREDITED
BUILDING DESIGNER

A	07-09-2026	Issue for CDC

DRAWING : Basix Notes
CLIENT : Sandstone Constructions
PROJECT : PROPOSED DOUBLE STOREY DWELLING #28,Guruwin Street,Austral Lot- 224 D.P 1302263

DRAWN BY: NB	DATE : 07-09-2026
SCALE:	APPLICATION : CDC
PAGE SIZE A3	PAGE NO: 5

PROJECT NO. 2607 933
ISSUE A

Cut and Fill is only under Slab.
Cut and Fill on the site is minimal, Hence does not
required Retaining wall.

PARAGON

Paragon Building Certifiers Pty Ltd

RBC00045

Registered Certifier


APPROVED

Reference: 260489/01

Date: 08/09/2026

(A) EASEMENT FOR ACCESS, MAINTENANCE & OVERHANG 0.5 WIDE (D.P.1302283)

(B) EASEMENT TO DRAIN WATER 1.5 WIDE (D.P.1302283)

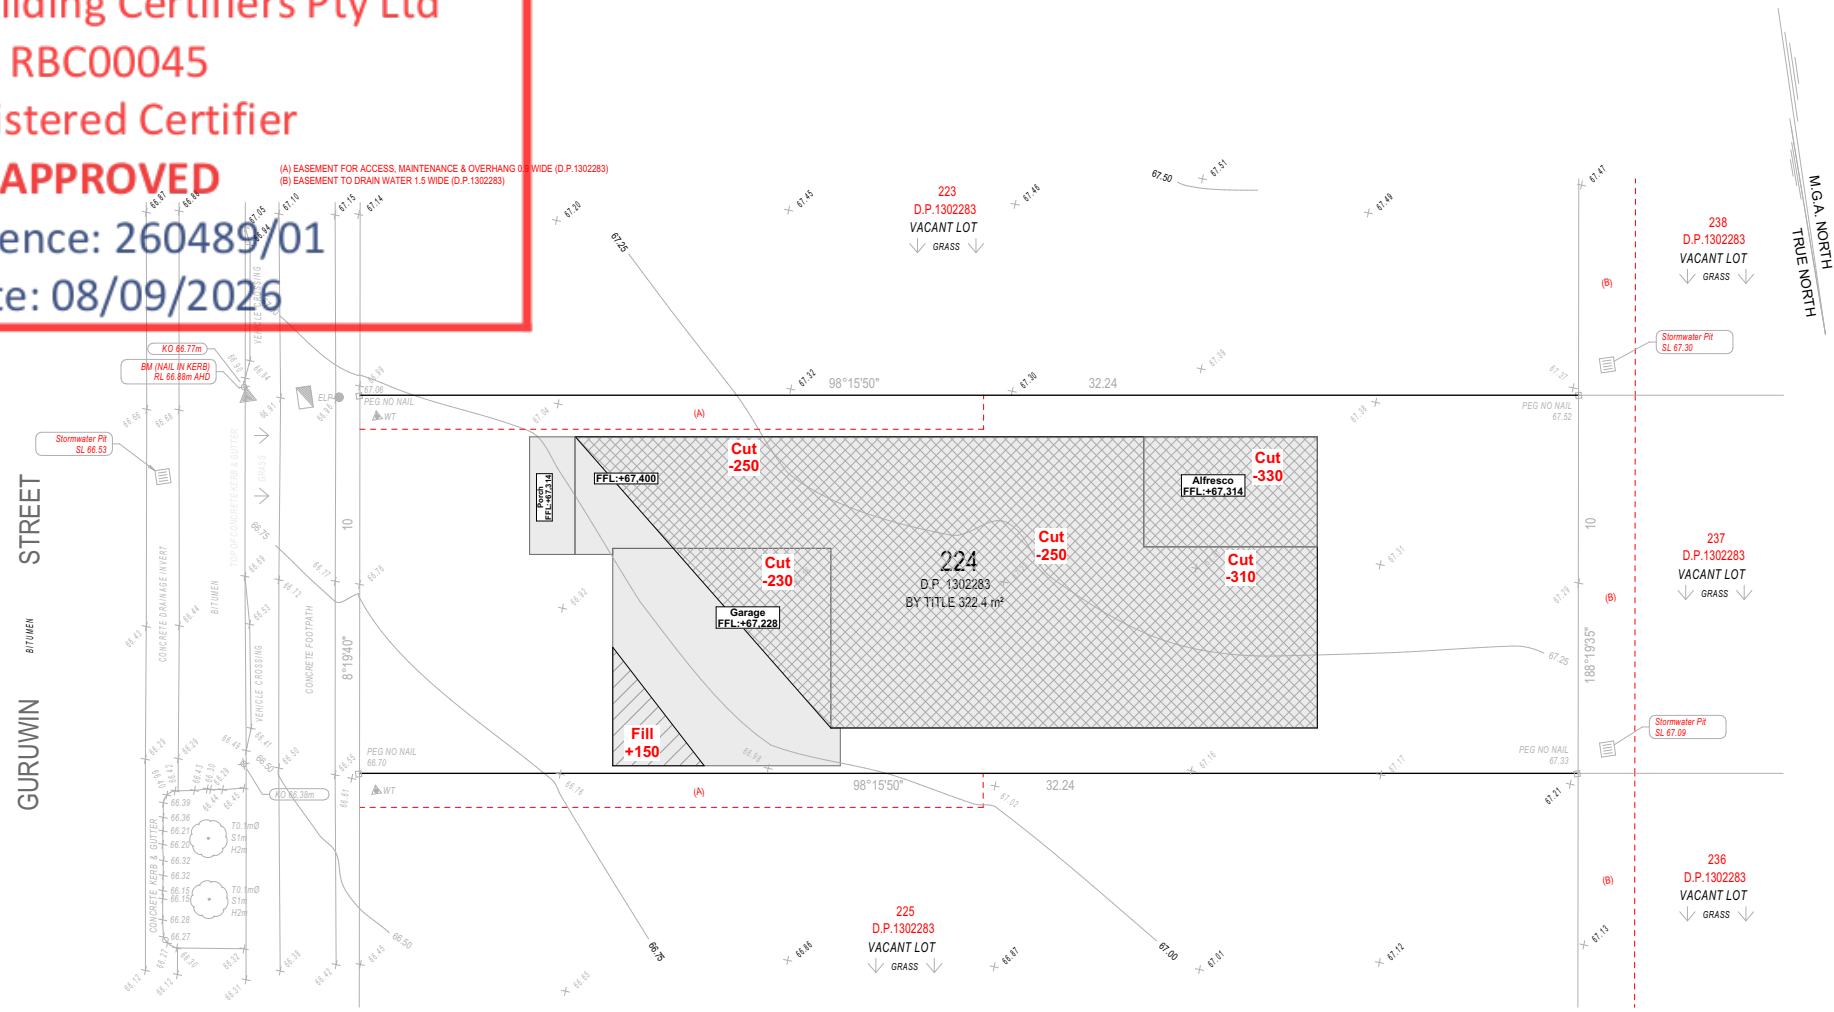

Cut and Fill Plan
1:200



NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.

All boundaries and contours are subject to survey drawing. All levels to Australian Height Data. It is the contractors responsibility to confirm all measurements on site and locations of any services prior to work on site.

All documents here within are subject to Australian Copyright Laws.



37604191460 ABN
(02) 8710 3852
SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW, 2212
design@iedesigns.com.au
www.iedesigns.com.au



A	07-09-2026	Issue for CDC

DRAWING : **Cut and Fill Plan**


CLIENT : **Sandstone Constructions**

PROJECT : **PROPOSED DOUBLE STOREY DWELLING**
#28, Guruwin Street, Austral
Lot- 224 D.P 1302263

DRAWN BY: NB	DATE : 07-09-2026	PROJECT NO. 2607 933
SCALE: 1:200	APPLICATION : CDC	ISSUE A
PAGE SIZE A3	PAGE NO: 6	

Site Calculations			
No.	Name	Area SQM	% of Total Site Area
01	Total Site Area	322.40	100
02	Total Landscape area	89.36	27
03	Area forward of the building line	56.94	18
04	Landscape area forward of the building line	20.30	6
05	Landscape area Behind of the building line	69.06	21
06	Articulation	0.03	

Gross Floor Area		
No	Name	Area SQM
01	Ground Floor	108.77
02	First Floor	92.88
		201.65 m ²

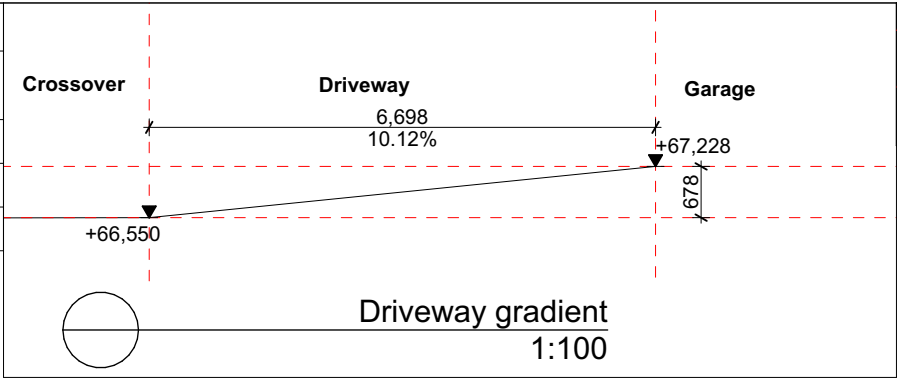

As per 88b, condition no.6 point 4 no building shall be erected or permitted to remain erected on any lot burdened having roof other than Clay tiles, Cement tiles, Slate or non reflective surface corrugated iron. All roofing materials shall be black or shades of grey or natural colours only.

Paragon Building Certifiers Pty Ltd


RBC00045

Registered Certifier

APPROVED

Reference: 260489/01

Date: 08/09/2026

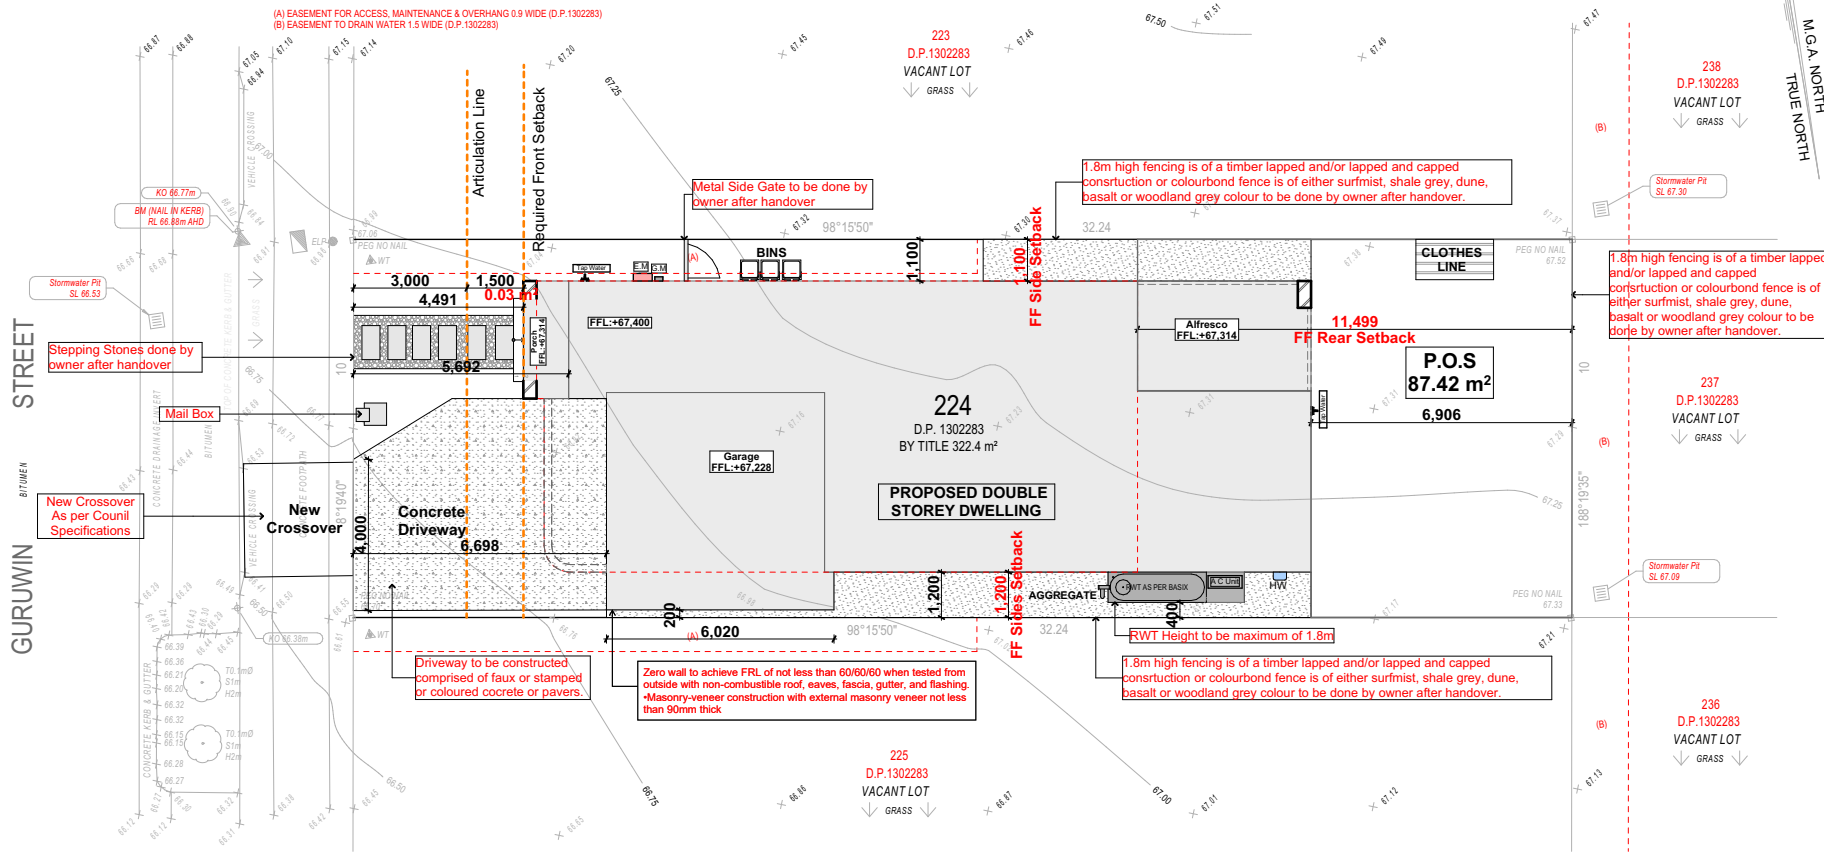

Site Plan
1:200

SURVEY LEGEND	
LEGEND:	ABBREVIATIONS:
SUBJECT BOUNDARY	BM - BENCHMARK
ADJOINING BOUNDARY	ELP - ELECTRICAL LIGHT POLE
EASEMENT	IL - INVERT LEVEL
CONTOUR MAJOR	KO - KERB OUTLET
CONTOUR MINOR	RL - REDUCED LEVEL
TOP KERB	SL - SURFACE LEVEL
	WT - WATER TAP
SYMBOLS:	
BENCHMARK	▲
KERB OUTLET/IL	+
WATER TAP	•
ELECTRICAL LIGHT POLE	•
S/W GRATE	■
TELSTRA PIT	■
TREE & TRUNK	○

LEGEND		
Ref.Img	Mark	Name
	S.A	Smoke Alarm (AS3786 Hard Wired to Mains)
	R.W.T	Rain Water Tank
	E.M	Electric Meter
	A/C	Air Conditioner
	HW	Wall Mounted Hot water System
	P.O.S	Private Open Space
	FW	Floor Waste
	MV	Mechanical Ventilation (All vent to exhaust outside).
	ME	Mechanical Ventilation (All vent to exhaust outside).



NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.

All boundaries and contours are subject to survey drawing. All levels to Australian Height Data. It is the contractors responsibility to confirm all measurements on site and locations of any services prior to work on site.


All documents here within are subject to Australian Copyright Laws.



37604191460 ABN
(02) 8710 3852
SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW, 2212
design@iedesigns.com.au
www.iedesigns.com.au




A	07-09-2026	Issue for CDC
---	------------	---------------



DRAWING : Site Plan
CLIENT : Sandstone Constructions
PROJECT : PROPOSED DOUBLE STOREY DWELLING
#28, Guruwin Street, Austral
Lot- 224 D.P 1302263

DRAWN BY: NB	DATE : 07-09-2026	PROJECT NO. 2607 933
SCALE: 1:200	APPLICATION : CDC	ISSUE A
PAGE SIZE A3	PAGE NO: 7	

- NOTE
- CONCRETE SLAB AS PER ENGINEERS DETAILS
 - CONCRETE FOOTINGS AS PER ENGINEER'S DETAILS
 - EDGE BEAM DETAILS AS PER ENGINEER'S DETAILS
 - ALL BRICK REBATES AS PER ENGINEER'S DETAILS

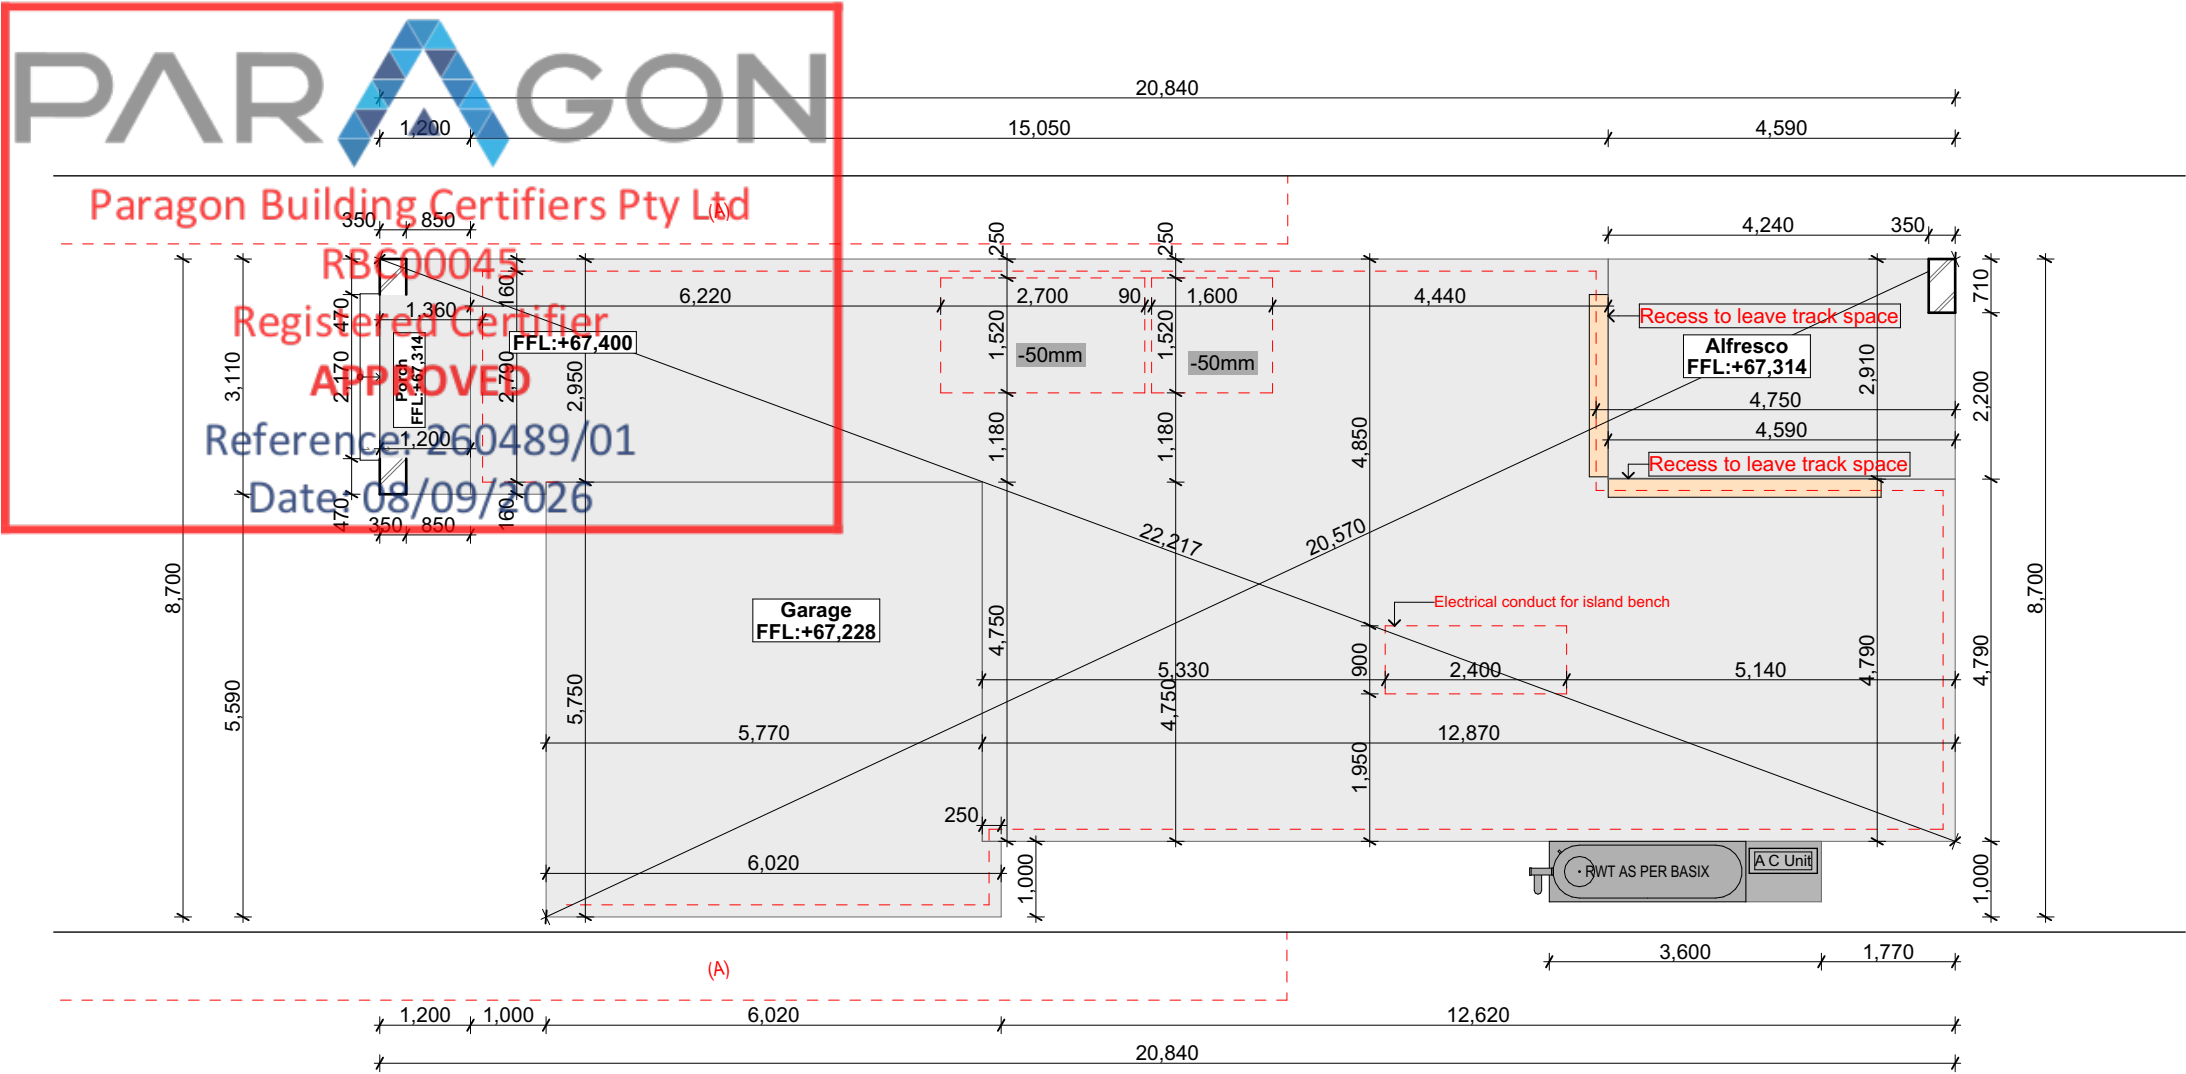

Slab Plan
1:100



NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.

All boundaries and contours are subject to survey drawing. All levels to Australian Height Data. It is the contractors responsibility to confirm all measurements on site and locations of any services prior to work on site.


All documents here within are subject to Australian Copyright Laws.



37604191460 ABN
(02) 8710 3852
SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW, 2212
design@iedesigns.com.au
www.iedesigns.com.au



A	07-09-2026	Issue for CDC



DRAWING : **Slab Plan**
CLIENT : **Sandstone Constructions**
PROJECT : **PROPOSED DOUBLE STOREY DWELLING**
#28, Guruwin Street, Austral
Lot- 224 D.P 1302263

DRAWN BY: **NB**
SCALE: **1:100**
PAGE SIZE **A3**
DATE : **07-09-2026**
APPLICATION : **CDC**
PAGE NO: **8**

PROJECT NO. **2607 933**
ISSUE **A**

Total Built up			
No.	Name	Area SQM	Area SQ
01	Ground floor	105.92	11.40
02	Garage	33.38	3.59
03	Porch	3.73	0.40
04	Alressco	13.36	1.44
05	First Floor	113.31	12.20
06	Balcony	7.57	0.82
		277.27 m ²	29.85

External Walls with vapour permeable membrane as per manufacturer detail.
As per 88b, condition no.6 point 4 no building shall be erected or permitted to remain erected on any lot burdened having roof other than Clay tiles, Cement tiles, Slate or non reflective surface corrugated iron. All roofing materials shall be black or shades of grey or natural colours only.

PARAGON

Paragon Building Certifiers Pty Ltd



RBC00045

Registered Certifier

APPROVED

Reference: 260489/01

Date: 08/09/2026

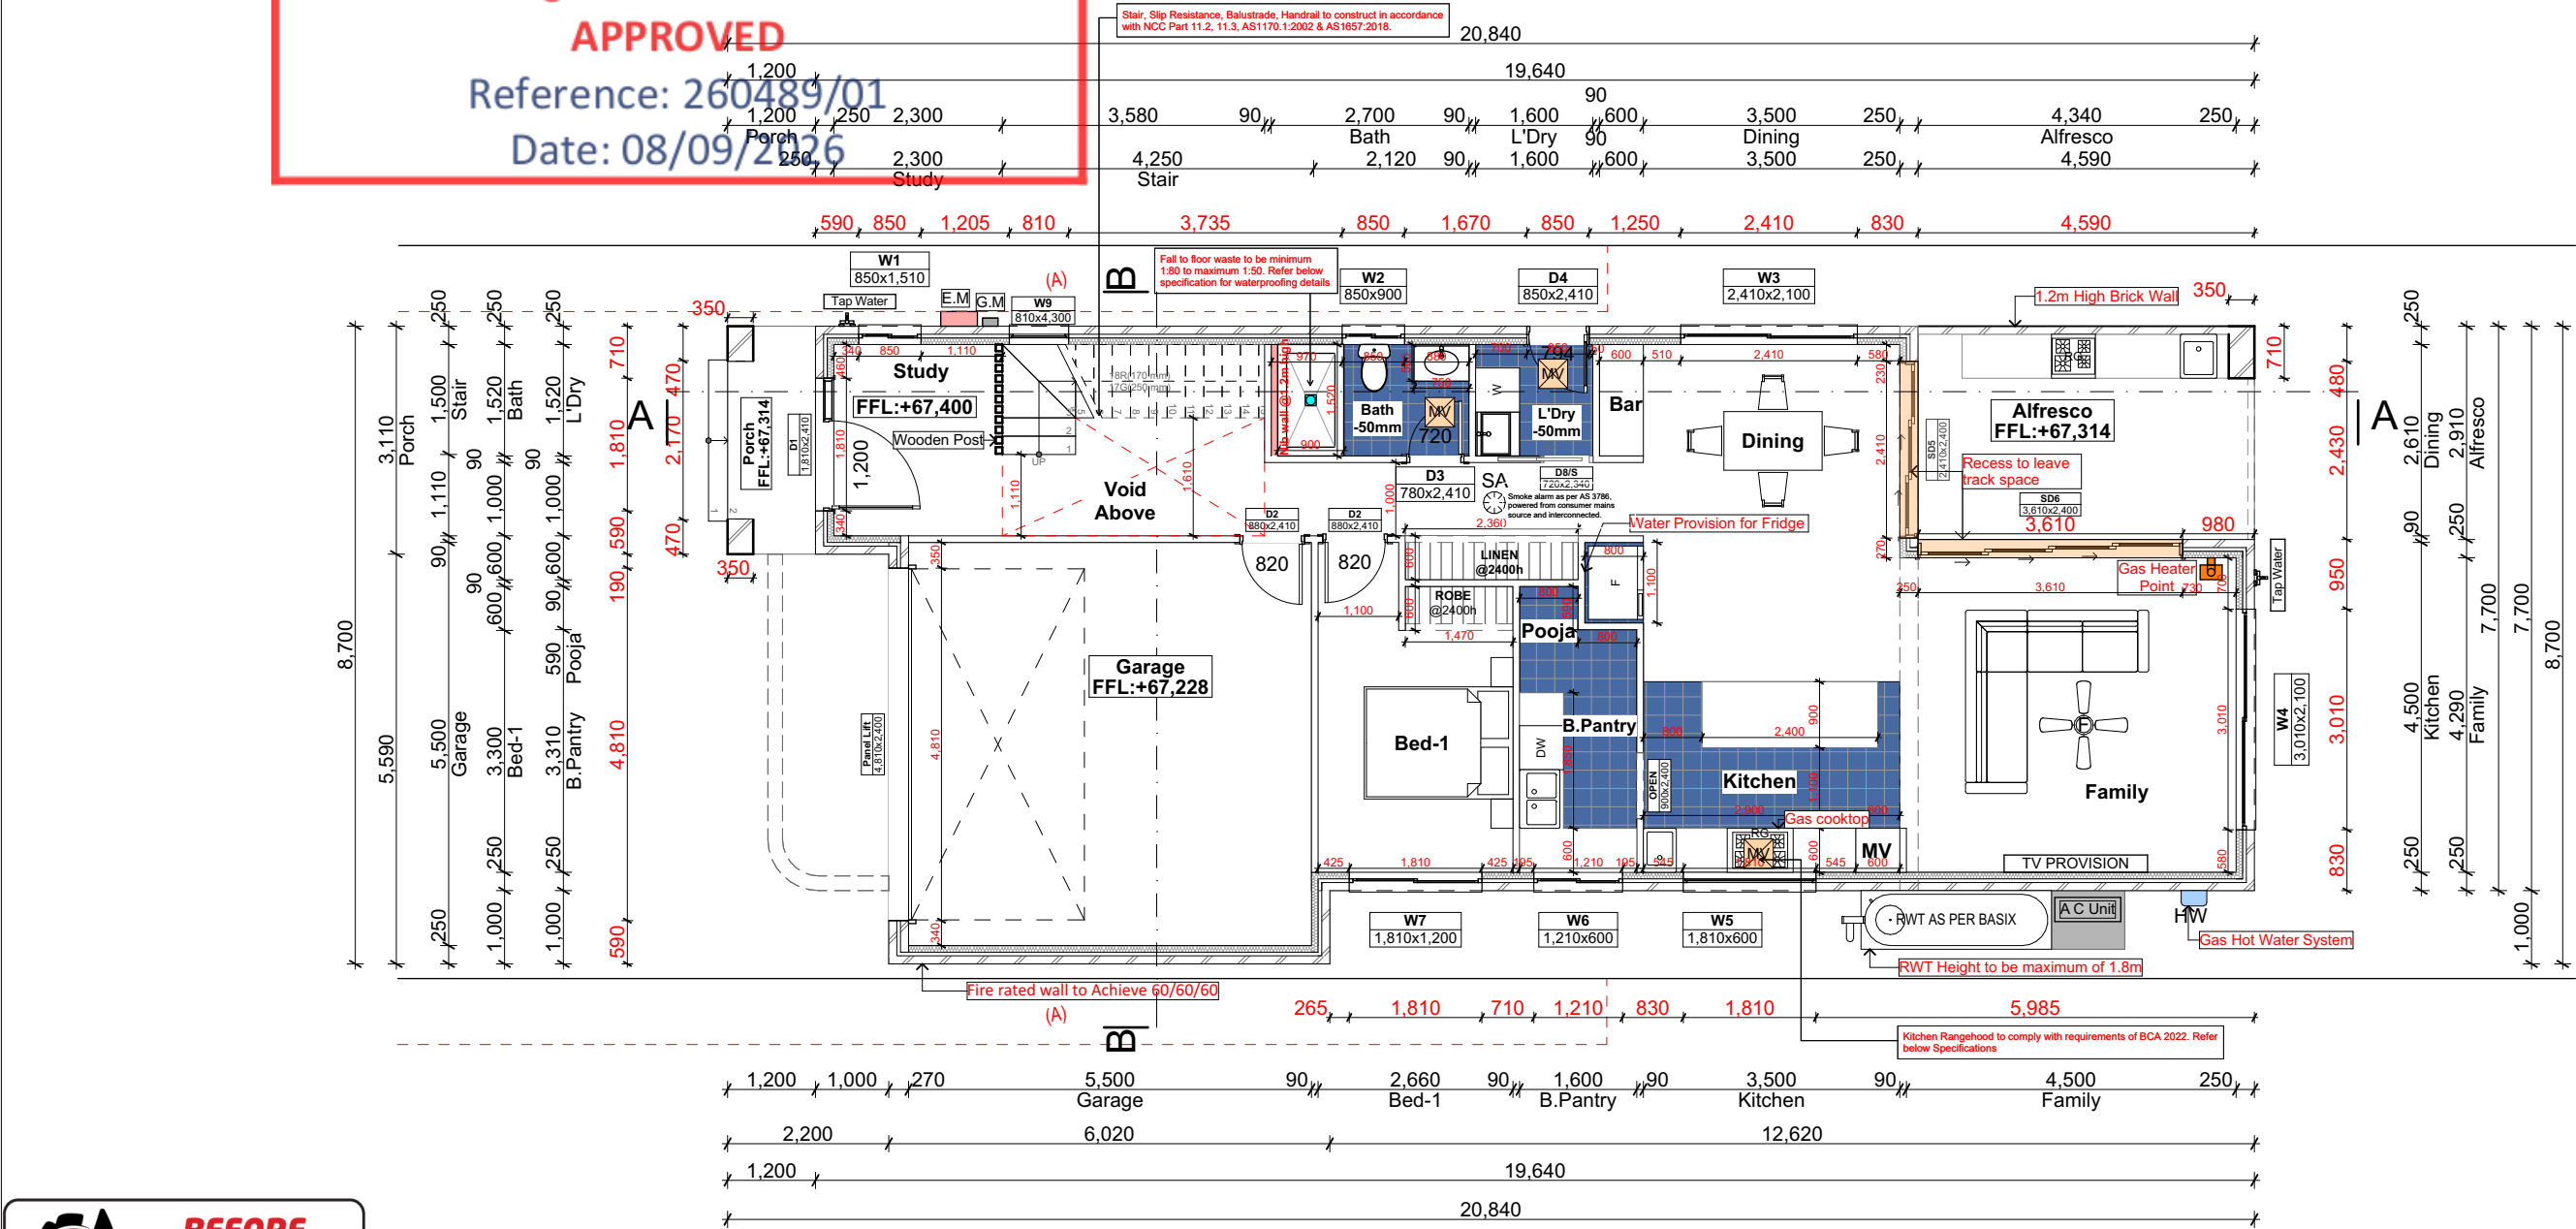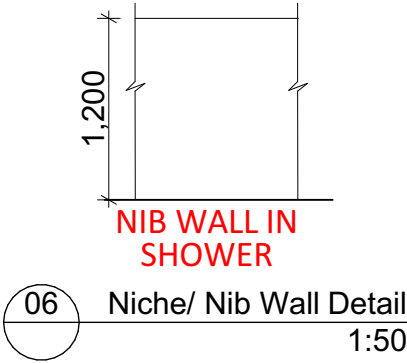

LEGEND		
Ref.Img	Mark	Name
	S.A	Smoke Alarm (AS3786 Hard Wired to Mains)
	R.W.T	Rain Water Tank
	E.M	Electric Meter
	A/C	Air Conditioner
	HW	Wall Mounted Hot water System
	P.O.S	Private Open Space
	FW	Floor Waste
	MV	Mechanical Ventilation (All vent to exhaust outside).
	ME	Mechanical Ventilation (All vent to exhaust outside).

BEFORE
YOU DIG
www.byda.com.au

Zero Damage - Zero Harm


NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.
All boundaries and contours are subject to survey drawing. All levels to Australian Height Data. It is the contractors responsibility to confirm all measurements on site and locations of any services prior to work on site.
All documents here within are subject to Australian Copyright Laws.

INNOVATIVE
ECO DESIGNS
Your Home Your Style

37604191460 ABN
(02) 8710 3852
SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW, 2212
design@iedesigns.com.au
www.iedesigns.com.au

bdca
ACCREDITED
BUILDING DESIGNER


A	07-09-2026	Issue for CDC
---	------------	---------------



DRAWING : **Ground Floor Plan**
CLIENT : **Sandstone Constructions**
PROJECT : **PROPOSED DOUBLE STOREY DWELLING**
#28, Guruwin Street, Austral
Lot- 224 D.P 1302263


DRAWN BY:	DATE :	PROJECT NO.
NB	07-09-2026	2607 933
SCALE:	APPLICATION :	ISSUE
1:100	CDC	A
PAGE SIZE	PAGE NO:	
A3	9	

As per 88b, condition no.6 point 4 no building shall be erected or permitted to remain erected on any lot burdened having roof other than Clay tiles, Cement tiles, Slate or non reflective surface corrugated iron. All roofing materials shall be black or shades of grey or natural colours only.

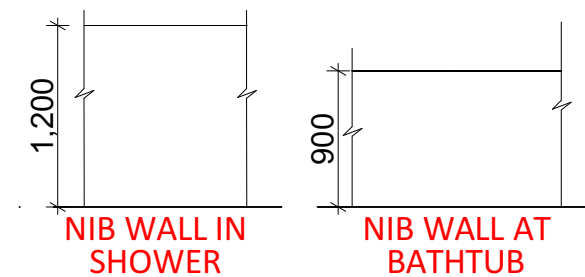

06

Niche/ Nib Wall Detail
1:50

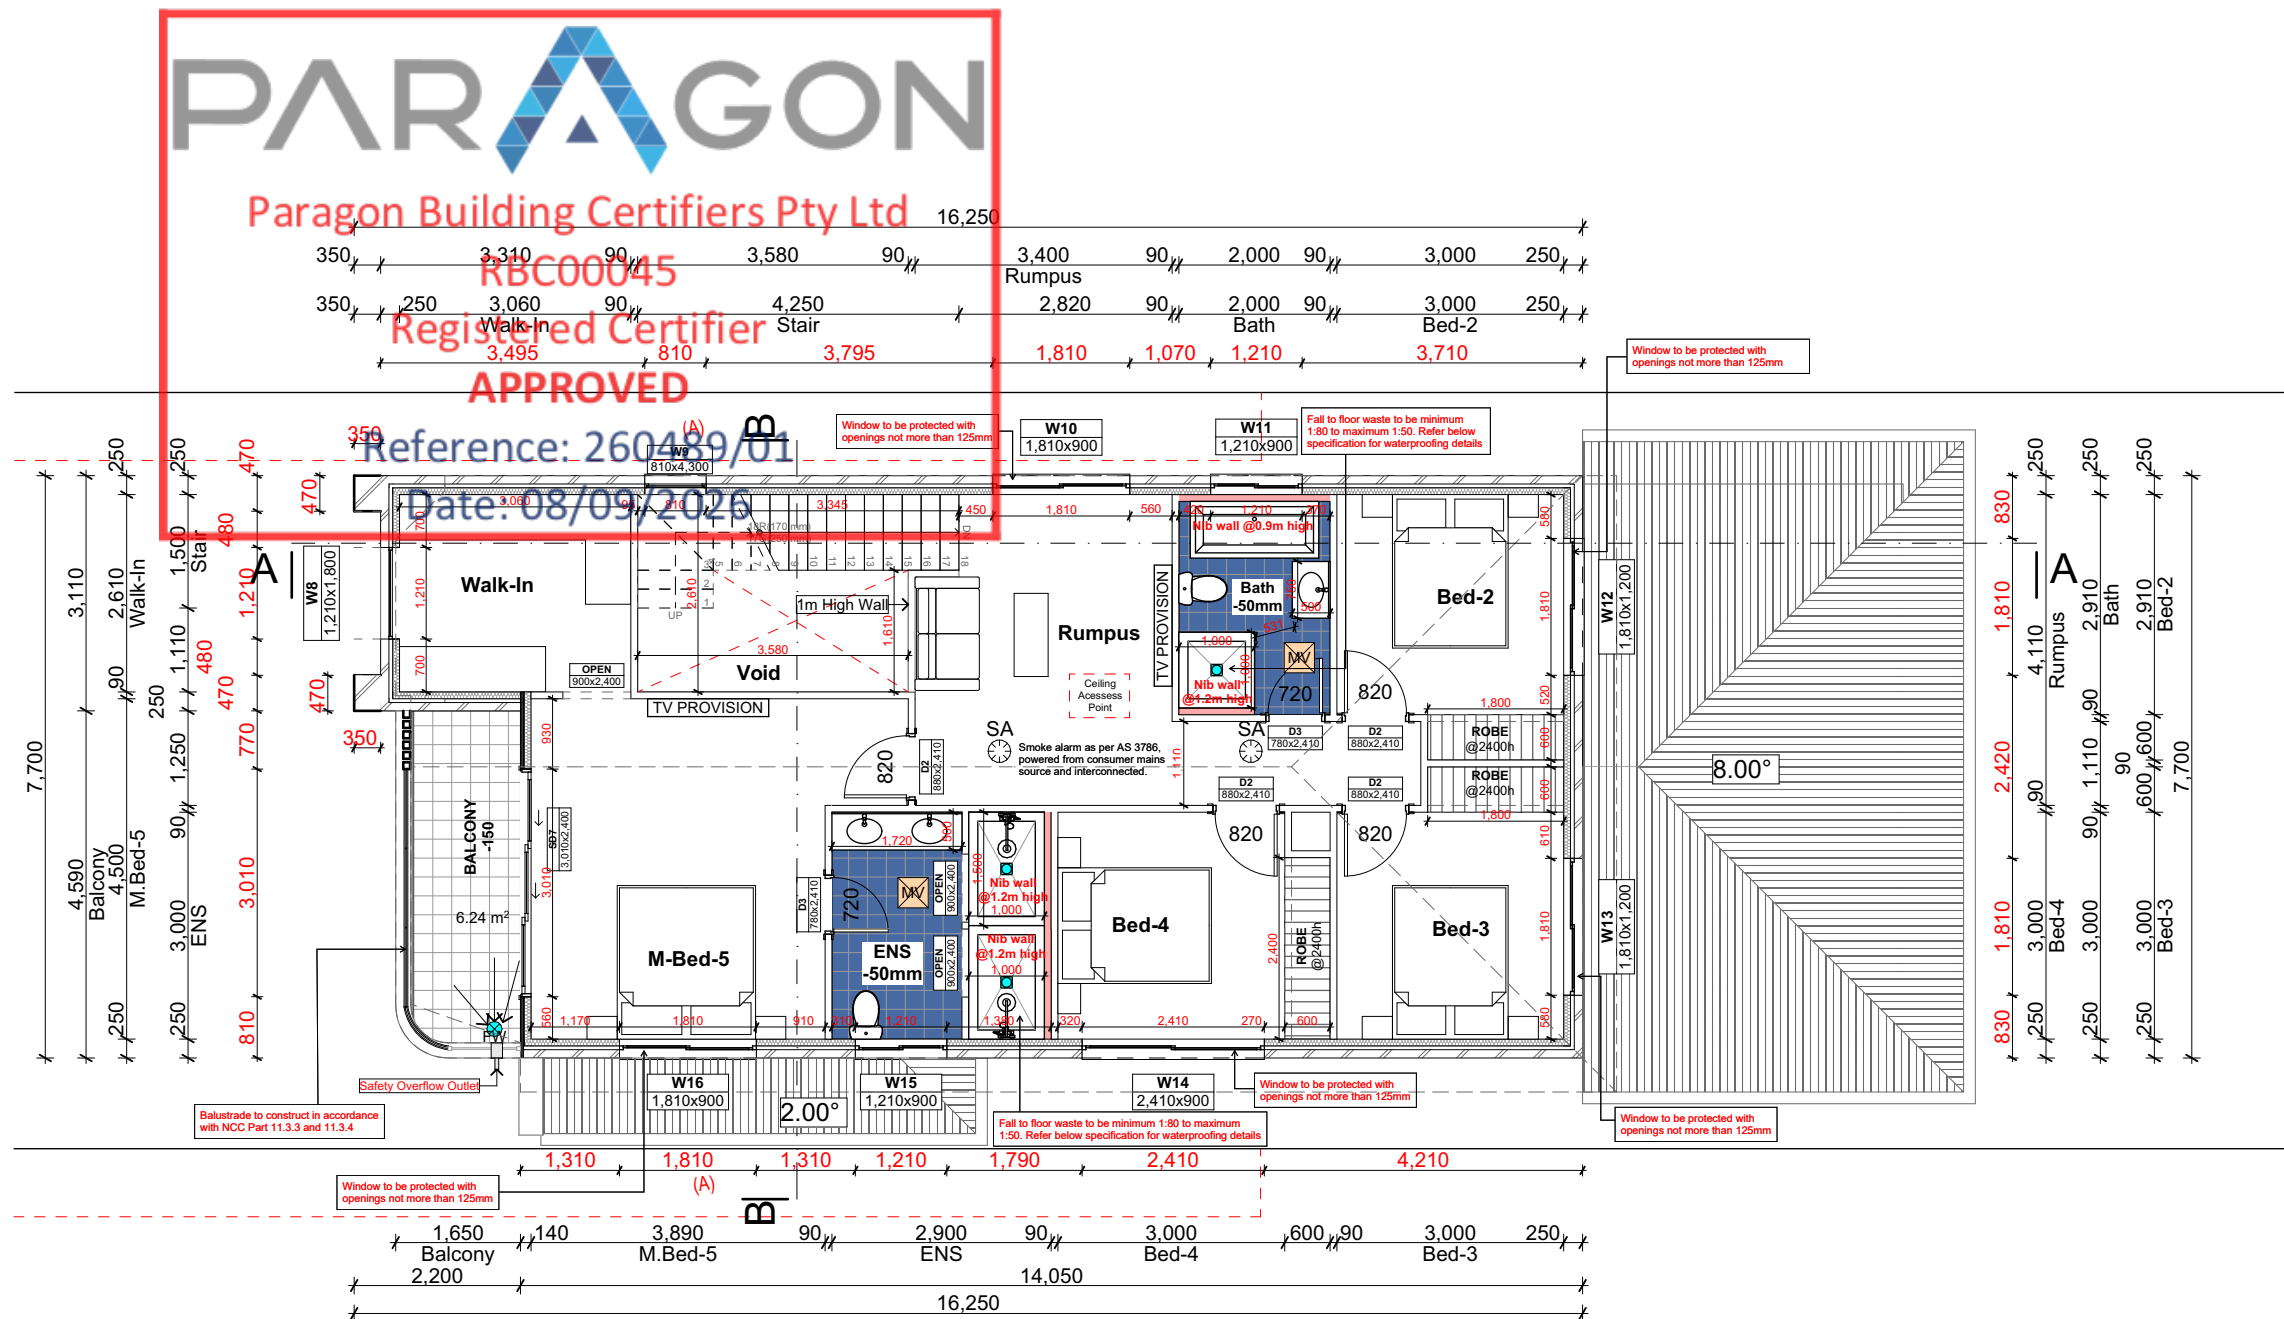

2.

First Floor
1:100



NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.

All documents here within are subject to Australian Copyright Laws.



37604191460 **ABN**
(02) 8710 3852
SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW,2212
design@iedesigns.com.au
www.iedesigns.com.au



A	07-09-2026	Issue for CDC



DRAWING : First Floor Plan

CLIENT : Sandstone Constructions


PROJECT : PROPOSED DOUBLE STOREY DWELLING
#28, Guruwin Street, Austral
Lot- 224 D.P 1302263

DRAWN BY: NB	DATE: 07-09-2026	PROJECT NO. 2607 933
SCALE: 1:100	APPLICATION: CDC	ISSUE A
PAGE SIZE A3	PAGE NO: 10	

DRAWN BY: NB	DATE: 07-09-2026	PROJECT NO. 2607 933
SCALE: 1:100	APPLICATION: CDC	ISSUE A
PAGE SIZE A3	PAGE NO: 11	

First floor windows to touch the eaves.

As per 88b, condition no.6 point 4 no building shall be erected or permitted to remain erected on any lot burdened having roof other than Clay tiles, Cement tiles, Slate or non reflective surface corrugated iron. All roofing materials shall be black or shades of grey or natural colours only.

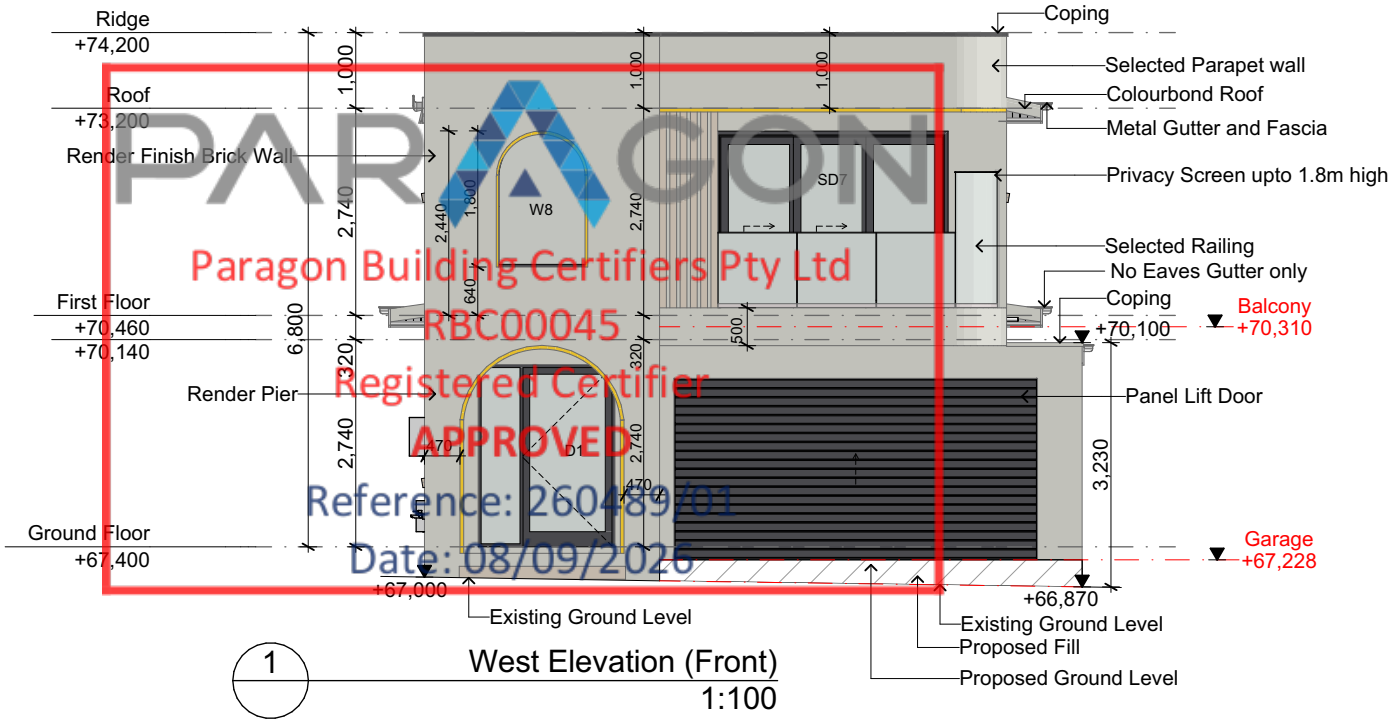

Zero Damage - Zero Harm

NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.

All boundaries and contours are subject to survey drawing. All levels to Australian Height Data. It is the contractors responsibility to confirm all measurements on site and locations of any services prior to work on site.

All documents here within are subject to Australian Copyright Laws.



37604191460 ABN
(02) 8710 3852
SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW, 2212
design@iedesigns.com.au
www.iedesigns.com.au




A 07-09-2026 Issue for CDC

DRAWING : **Elevation**
CLIENT : **Sandstone Constructions**
PROJECT : **PROPOSED DOUBLE STOREY DWELLING**
#28, Guruwin Street, Austral
Lot- 224 D.P 1302263


DRAWN BY: **NB**
SCALE: **1:100**
PAGE SIZE **A3**
DATE : **07-09-2026**
APPLICATION : **CDC**
PAGE NO: **12**

PROJECT NO. **2607 933**
ISSUE **A**

First floor windows to touch the eaves. As per 88b, condition no.6 point 4 no building shall be erected or permitted to remain erected on any lot burdened having roof other than Clay tiles, Cement tiles, Slate or non reflective surface corrugated iron. All roofing materials shall be black or shades of grey or natural colours only.

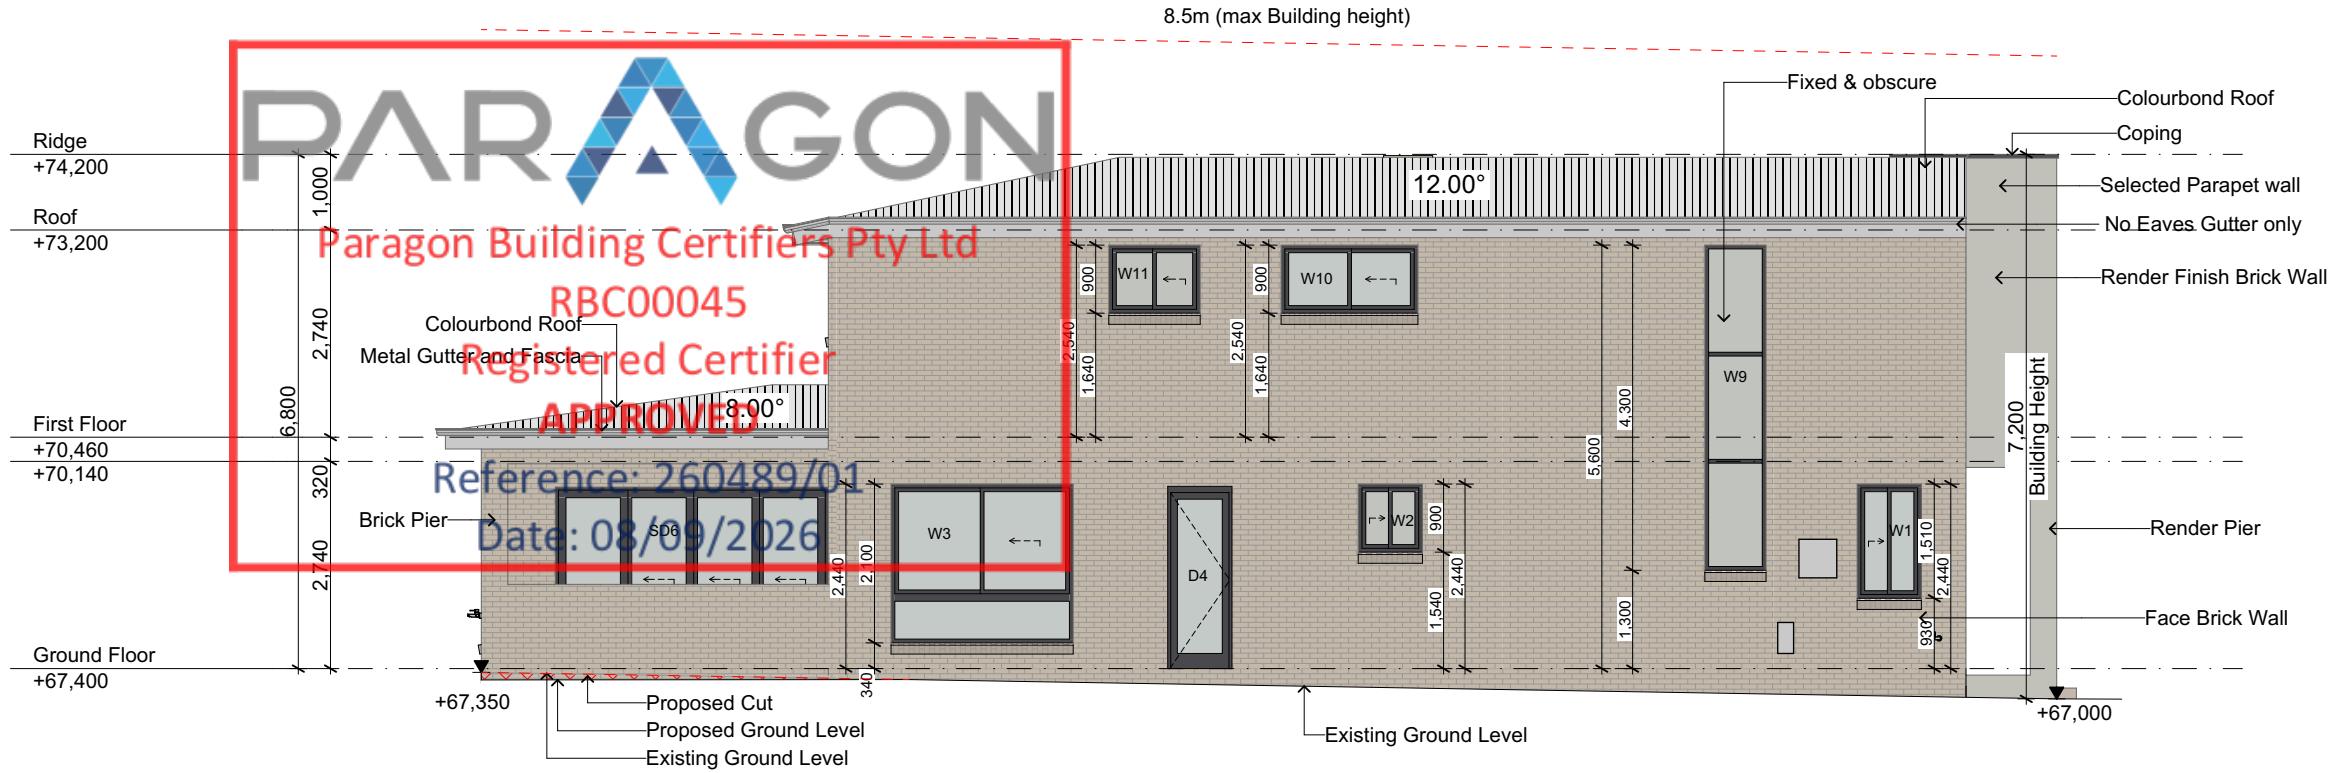

3 North Elevation (Left Side)
1:100

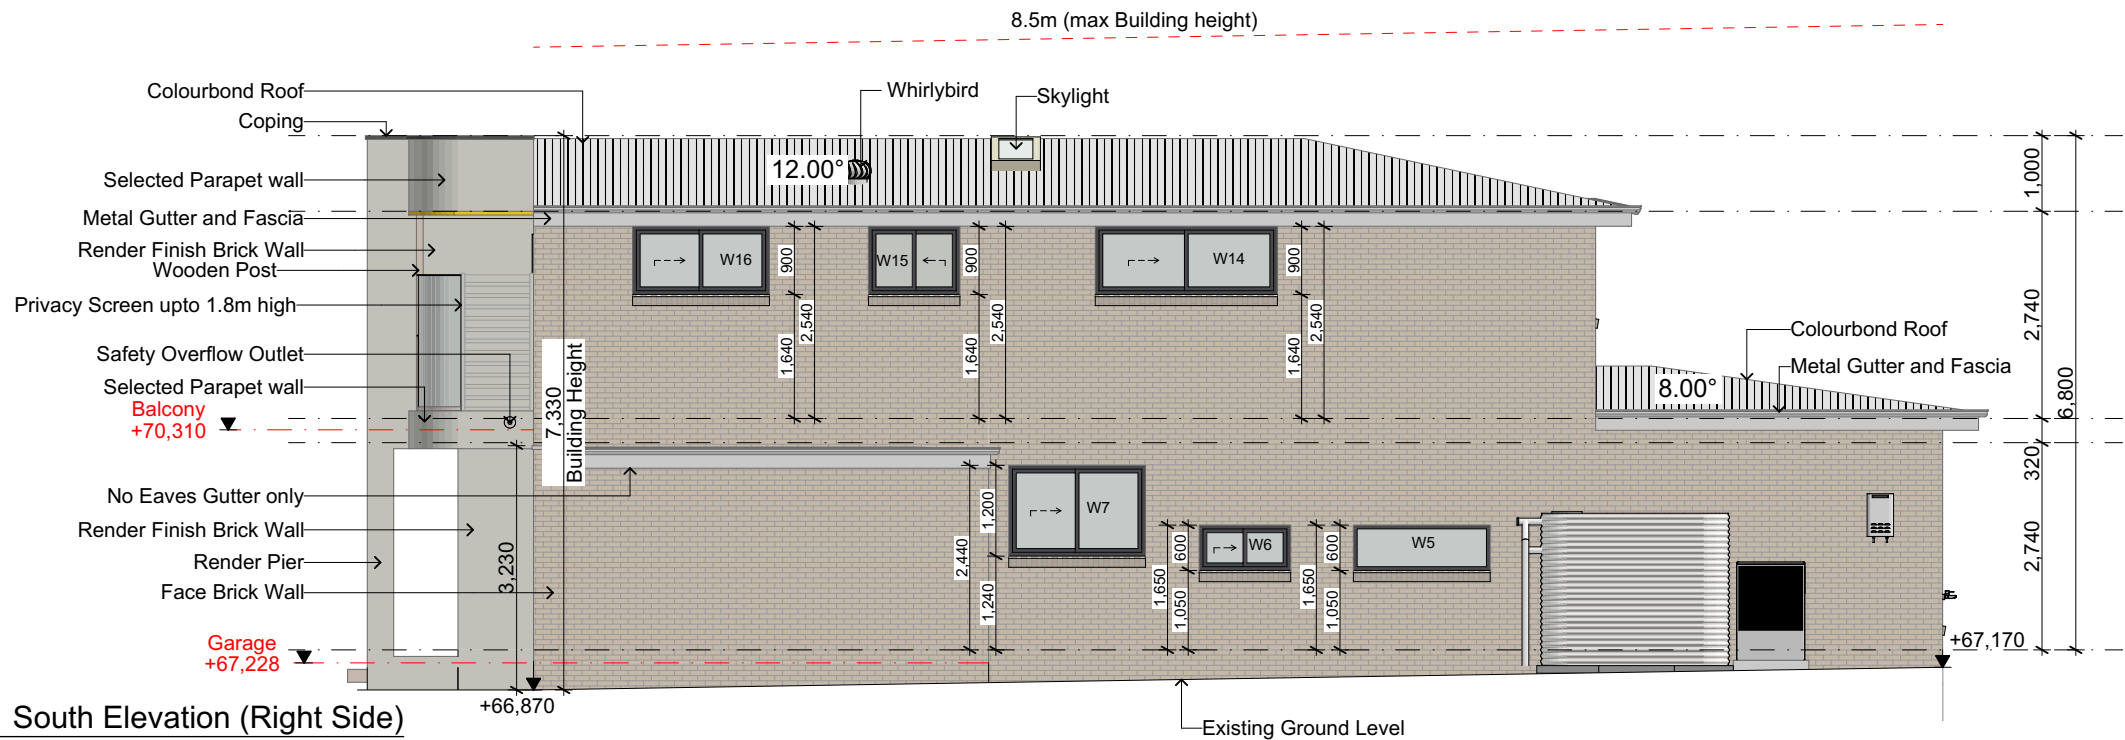

4 South Elevation (Right Side)
1:100



NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.
All boundaries and contours are subject to survey drawing. All levels to Australian Height Data. It is the contractors responsibility to confirm all measurements on site and locations of any services prior to work on site.
All documents here within are subject to Australian Copyright Laws.



37604191460 ABN
(02) 8710 3852
SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW, 2212
design@iedesigns.com.au
www.iedesigns.com.au



A	07-09-2026	Issue for CDC	

DRAWING : **Side Elevation**
CLIENT : **Sandstone Constructions**
PROJECT : **PROPOSED DOUBLE STOREY DWELLING**
#28, Guruwin Street, Austral
Lot- 224 D.P 1302263

DRAWN BY: NB	DATE : 07-09-2026	PROJECT NO. 2607 933
SCALE: 1:100	APPLICATION : CDC	ISSUE A
PAGE SIZE A3	PAGE NO: 13	

As per 88b, condition no.6 point 4 no building shall be erected or permitted to remain erected on any lot burdened having roof other than Clay tiles, Cement tiles, Slate or non reflective surface corrugated iron. All roofing materials shall be black or shades of grey or natural colours only.

PARAGON

Paragon Building Certifiers Pty Ltd



RBC00045

Registered Certifier

APPROVED

Reference: 260489/01

Date: 08/09/2026

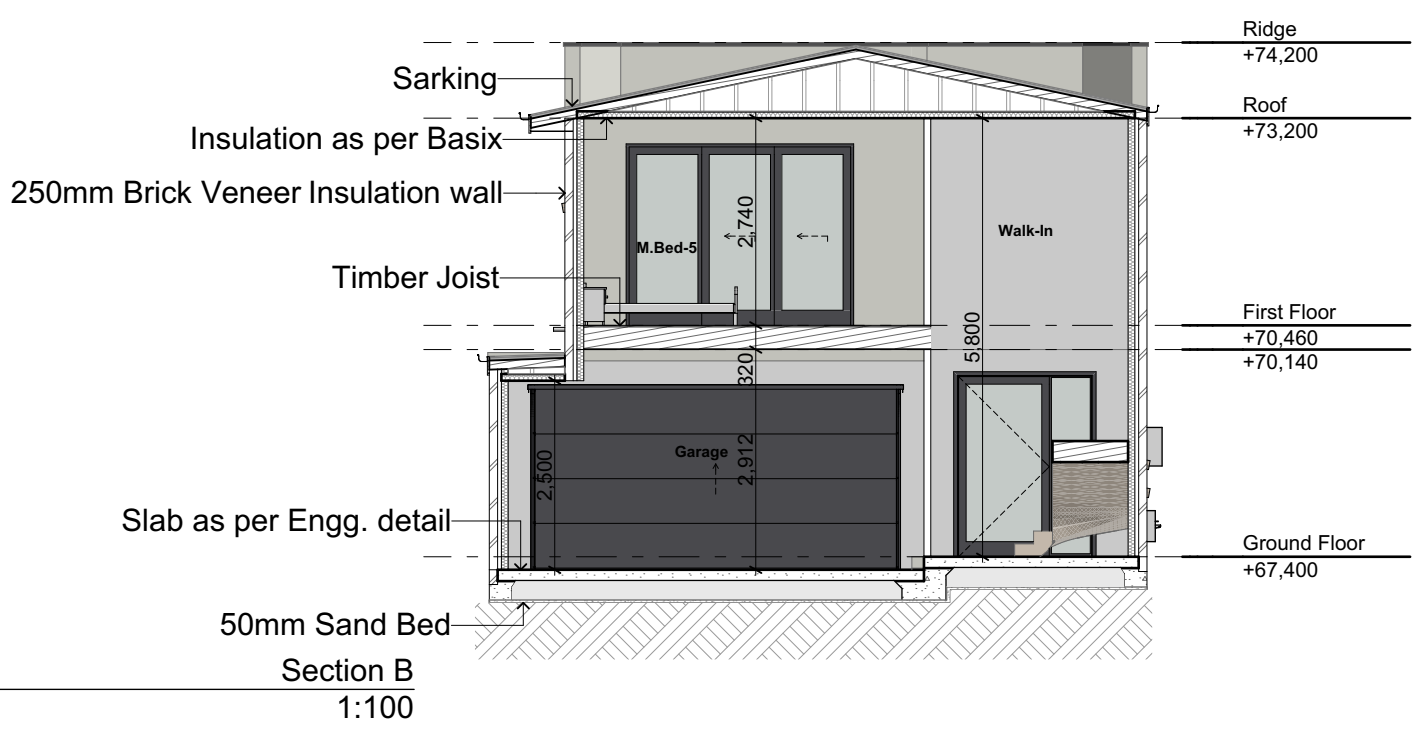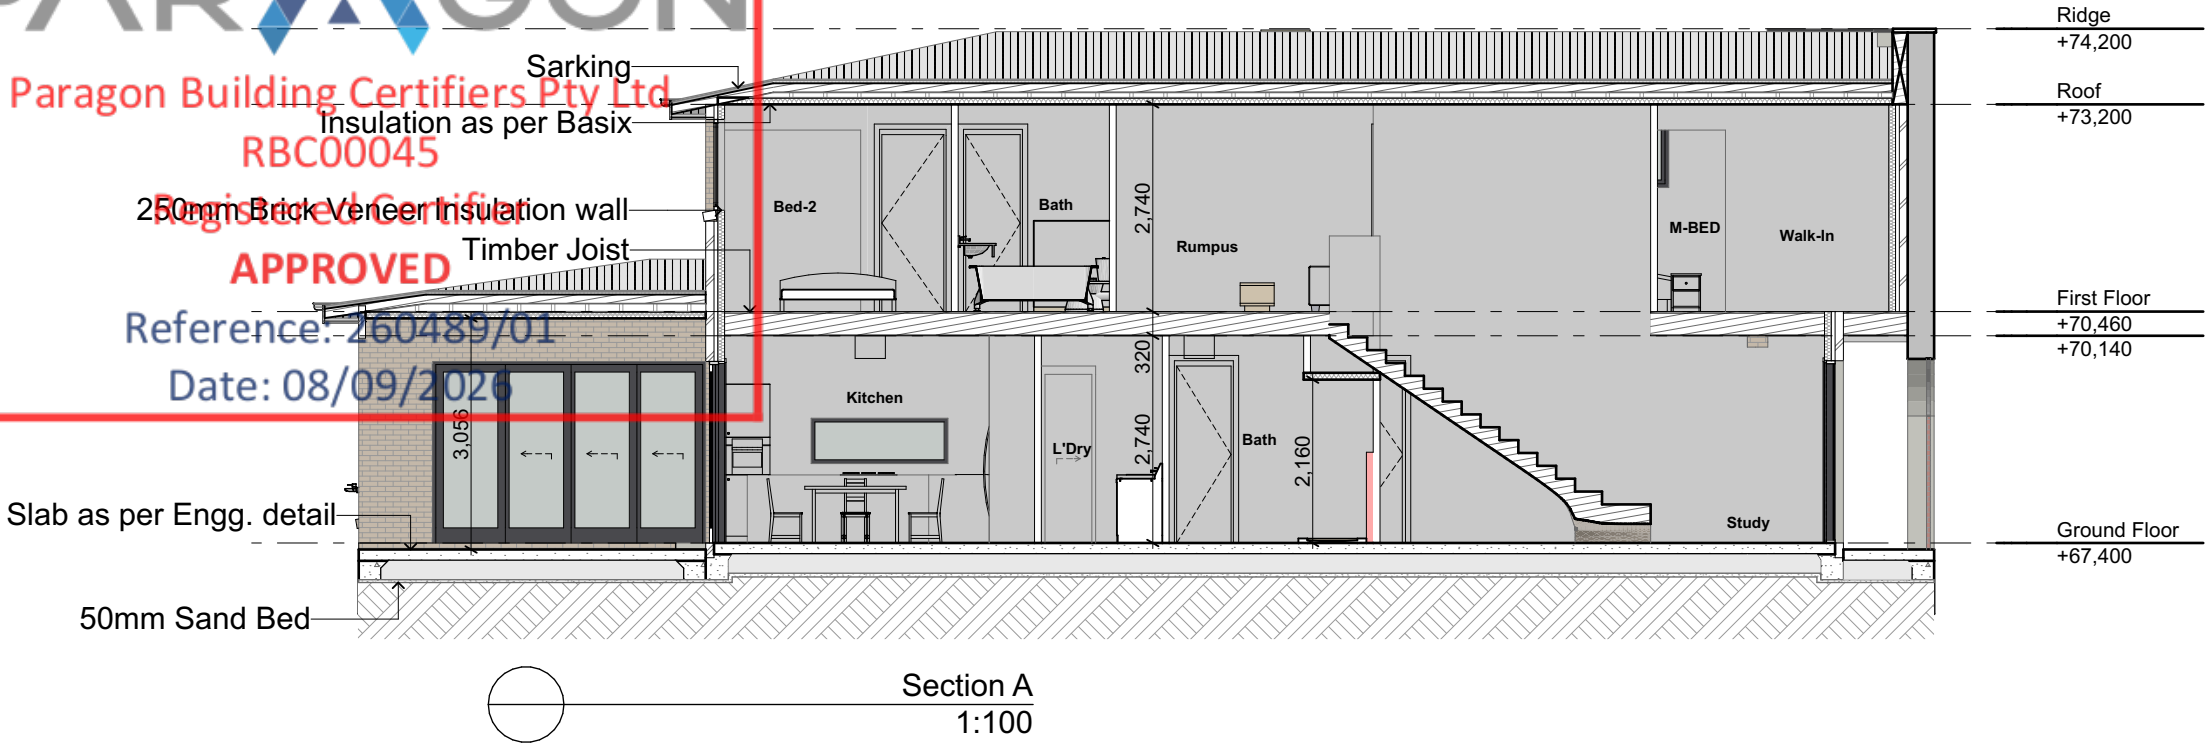

BEFORE
YOU DIG
www.byda.com.au

Zero Damage - Zero Harm

NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.

All boundaries and contours are subject to survey drawing. All levels to Australian Height Data. It is the contractors responsibility to confirm all measurements on site and locations of any services prior to work on site.

All documents here within are subject to Australian Copyright Laws.

INNOVATIVE
ECO DESIGNS
Your Home Your Style

37604191460 ABN
(02) 8710 3852

SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW, 2212
design@iedesigns.com.au
www.iedesigns.com.au

ACCREDITED
BUILDING DESIGNER

A	07-09-2026	Issue for CDC
---	------------	---------------

DRAWING : **Section**

CLIENT : **Sandstone Constructions**

PROJECT : **PROPOSED DOUBLE STOREY DWELLING**
#28, Guruwin Street, Austral
Lot- 224 D.P 1302263

DRAWN BY: NB	DATE : 07-09-2026	PROJECT NO. 2607 933
SCALE: 1:100	APPLICATION : CDC	ISSUE A
PAGE SIZE A3	PAGE NO: 14	

Door Schedule					
ID	D2	D3	D8/S	OPEN	
Wallhole Dimensions(W x H)	880×2,410	780×2,410	720×2,340	900×2,400	
Leaf Dimensions	820×2,340	720×2,340	620×2,230	---	
Elevation					
Total Glazed Area SQM	0.00	0.00	0.00	---	0.00
Position	Interior	Interior	Interior	Interior	
Quantity	6	3	1	4	14

Aluminium Door Schedule			
ID	D1	D4	Panel Lift
Frame Dimensions (W X H)	1,810×2,410	850×2,410	4,810×2,400
Elevation			
Total Glazed Area SQM	3.28	1.21	1.41
Glazed Area SQM	---	---	---
Position	Exterior	Exterior	Exterior
Quantity	1	1	1

Aluminium Door Schedule				
ID	SD5	SD6	SD7	
Frame Dimensions (W X H)	2,410×2,400	3,610×2,400	3,010×2,400	
Elevation				
Total Glazed Area SQM	3.56	5.62	4.80	19.88
Glazed Area SQM	---	---	---	0.00
Position	Exterior	Exterior	Exterior	
Quantity	1	1	1	6



NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.

All boundaries and contours are subject to survey drawing. All levels to Australian Height Data. It is the contractors responsibility to confirm all measurements on site and locations of any services prior to work on site.

All documents here within are subject to Australian Copyright Laws.



37604191460 ABN
(02) 8710 3852
SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW, 2212
design@iedesigns.com.au
www.iedesigns.com.au



A	07-09-2026	Issue for CDC

DRAWING : **Door Schedule & SOF**

CLIENT : **Sandstone Constructions**

PROJECT : **PROPOSED DOUBLE STOREY DWELLING**
#28,Guruwin Street,Austral
Lot- 224 D.P 1302263

DRAWN BY:
NB

SCALE:

PAGE SIZE
A3

DATE :
07-09-2026

APPLICATION :
CDC

PAGE NO:
15

PROJECT NO.
2607 933

ISSUE
A

SCHEDULE OF FINISHES		
Element	SPECIFICATION	COLOUR
Walls	Simply Hampton- Fresh white	
Render Finish Facade	Sufmist	
Roof	Colorbond Sufmist	
Gutter	Black	
Fascia	Black	
Window	Black	
Garage Door	Black	
Coping	Black	

As per 88b, condition no.6 point 4 no building shall be erected or permitted to remain erected on any lot burdened having roof other than Clay tiles, Cement tiles, Slate or non reflective surface corrugated iron. All roofing materials shall be black or shades of grey or natural colours only.

Window Schedule									
ID	W1	W2	W3	W4	W5	W6	W7	W8	W9
Frame Dimensions	850×1,510	850×900	2,410×2,100	3,010×2,100	1,810×600	1,210×600	1,810×1,200	1,210×1,800	810×4,300
Elevation									
Glass	Glass - Clear	Glass - Obscure	Glass - Clear	Glass - Clear	Glass - Clear	Glass - Clear	Glass - Clear	Glass - Obscure	Glass - Obscure
Glazed Area SQM	0.79	0.42	3.96	5.04	0.86	0.38	1.56	0.00	2.91
Glazed Area SQM	---	---	---	---	---	---	---	1.83	---
Quantity	1	1	1	1	1	1	1	1	1

Window Schedule								
ID	W10	W11	W12	W13	W14	W15	W16	
Frame Dimensions	1,810×900	1,210×900	1,810×1,200	1,810×1,200	2,410×900	1,210×900	1,810×900	
Elevation								
Glass	Glass - Clear	Glass - Obscure	Glass - Clear	Glass - Clear	Glass - Clear	Glass - Obscure	Glass - Clear	
Glazed Area SQM	1.09	0.67	1.56	1.56	1.51	0.67	1.09	24.07
Glazed Area SQM	---	---	---	---	---	---	---	1.83
Quantity	1	1	1	1	1	1	1	16

NOTE:
- TO BE CHECKED AND CONFIRMED BY BUILDER ON SITE BEFORE PLACING ORDER.
-FALL PREVENTION FROM WINDOWS
-WINDOWS TO BE MANUFACTURED IN ACCORDANCE WITH REQUIREMENTS OF NCC 2022 vol. 2 part 11.3.7
1- If Opening withing 1700mm above the floor; and climable elements between 150 and 750 mM above the floor, opening must be permanently restricted to 125mm; or fitted withn a non-removable robust screen.
2-If opening between 865 and 1700mm above the floor; and no climable elements between 150 and 760mm bove the floor, opening must be restricted to 125mm; or fitted with a removable robust screen.
3- If opening between 865 of the floor; and climable elements between 150 and 760mm above the floor;or fitted with a non-removable robust screen.
4-If no opening within 1700mm of the floor. No restrictions apply.

Part 11.3.7 Protection of openable windows - bedrooms
(1) A window opening in a bedroom must be provided with protection, where the floor below the window is 2 m or more above the surface beneath.
(2) Where the lowest level of the window opening covered by (1) is less than 1.7 m above the floor, the window opening must comply with the following:
(a) The openable portion of the window must be protected with-
(i) a device capable of restricting the window opening; or
(ii) a screen with secure fittings.
(b) A device or screen required by (a) must-
(i) not permit a 125 mm sphere to pass through the window opening or screen; and
(ii) resist an outward horizontal action of 250 N against the-
(A) window restrained by a device; or
(B) screen protecting the opening; and
(iii) have a child resistant release mechanism if the screen or device is able to be removed, unlocked or overridden.
(3) Where a device or screen provided in accordance with (2)(a) is able to be removed, unlocked or overridden, a barrier with a height not less than 865 mm above the floor is required to the openable window in addition to window protection.
(4) A barrier covered by (3) must not-
(a) permit a 125 mm sphere to pass through it; and
(b) have any horizontal or near horizontal elements between 150 mm and 760 mm above the floor that facilitate climbing.

11.3.8 Protection of openable windows - rooms other than bedrooms
(1) A window opening in a room other than a bedroom must be provided with protection where the floor below the window is 4 m or more above the surface beneath.
(2) The openable part of the window covered by (a) must be protected with a barrier with a height of not less than 865mm above the floor.
(3) A barrier required by (b) must not-
(a) permit a 125 mm sphere to pass through it; and
(b) have any horizontal or near horizontal elements between 150 mm and 760 mm above the floor that facilitate climbing.

As per 88b, condition no.6 point 4 no building shall be erected or permitted to remain erected on any lot burdened having roof other than Clay tiles, Cement tiles, Slate or non reflective surface corrugated iron. All roofing materials shall be black or shades of grey or natural colours only.



NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.

All boundaries and contours are subject to survey drawing. All levels to Australian Height Data. It is the contractors responsibility to confirm all measurements on site and locations of any services prior to work on site.

All documents here within are subject to Australian Copyright Laws.



37604191460 ABN
(02) 8710 3852
SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW,2212
design@iedesigns.com.au
www.iedesigns.com.au



A	07-09-2026	Issue for CDC

DRAWING : **Window Schedule**

CLIENT : **Sandstone Constructions**

PROJECT : **PROPOSED DOUBLE STOREY DWELLING**
#28,Guruwin Street,Austral
Lot- 224 D.P 1302263

DRAWN BY: NB
SCALE:
PAGE SIZE A3

DATE : **07-09-2026**
APPLICATION : CDC
PAGE NO: 16

PROJECT NO. **2607 933**
ISSUE **A**

All Landscape to be done by owner.



05 Mail Box
1:20



Paragon Building Certifiers Pty Ltd

RBC00045

Registered Certifier

APPROVED

Reference: 260489/01

Date: 08/09/2026

LANDSCAPE SCHEDULE

Refrence Image	ABB	NAME	TYPE	HEIGHT	POT. SIZE	QUA.
	(ML)	MELALEUCA LINARIIFOLIA	Tree	8-15m	75LT.	1
	(PC)	PYRUS CALLERYANA (CHANTICLEER)	Tree	5m	45LT.	1
	(BS)	BANKSIA SPINULOSA	Shrub	1-3m	300mm	7
		BUFFALO GRASS	Grass			
		AGGREGATE				


LEGEND

Ref.img	Name
	Tree
	Shrub
	Grass (Landscape Area)
	Aggregate

GE:- GARDEN EDGING AS SELECTED
TREATED PINE SPLITS 90 MM 2.4 MT LENGTH,
FASTENED TO HARWOOD STAKES, MINIMUM DEPTH
IN GROUND OF 300 MM WITH GALVANISED TREATED
PINE SCREWS(SIZE 75 MM X 8G)

LAWN:- BUFFALO WITH SHIRLEYS NO.17 FERTILISER
ALL PLANTS TO HAVE 35 MM OF BARK CHIP MULCH
SPREAD OVER TOP SOIL TURF TO BE WATERED
MORNING AND EVENING FOR A PERIOD OF TWO
WEEKS OR AD NECESSARY.

As per 88b, condition no.6 point 4 no building shall be erected or permitted to remain erected on any lot burdened having roof other than Clay tiles, Cement tiles, Slate or non reflective surface corrugated iron. All roofing materials shall be black or shades of grey or natural colours only.

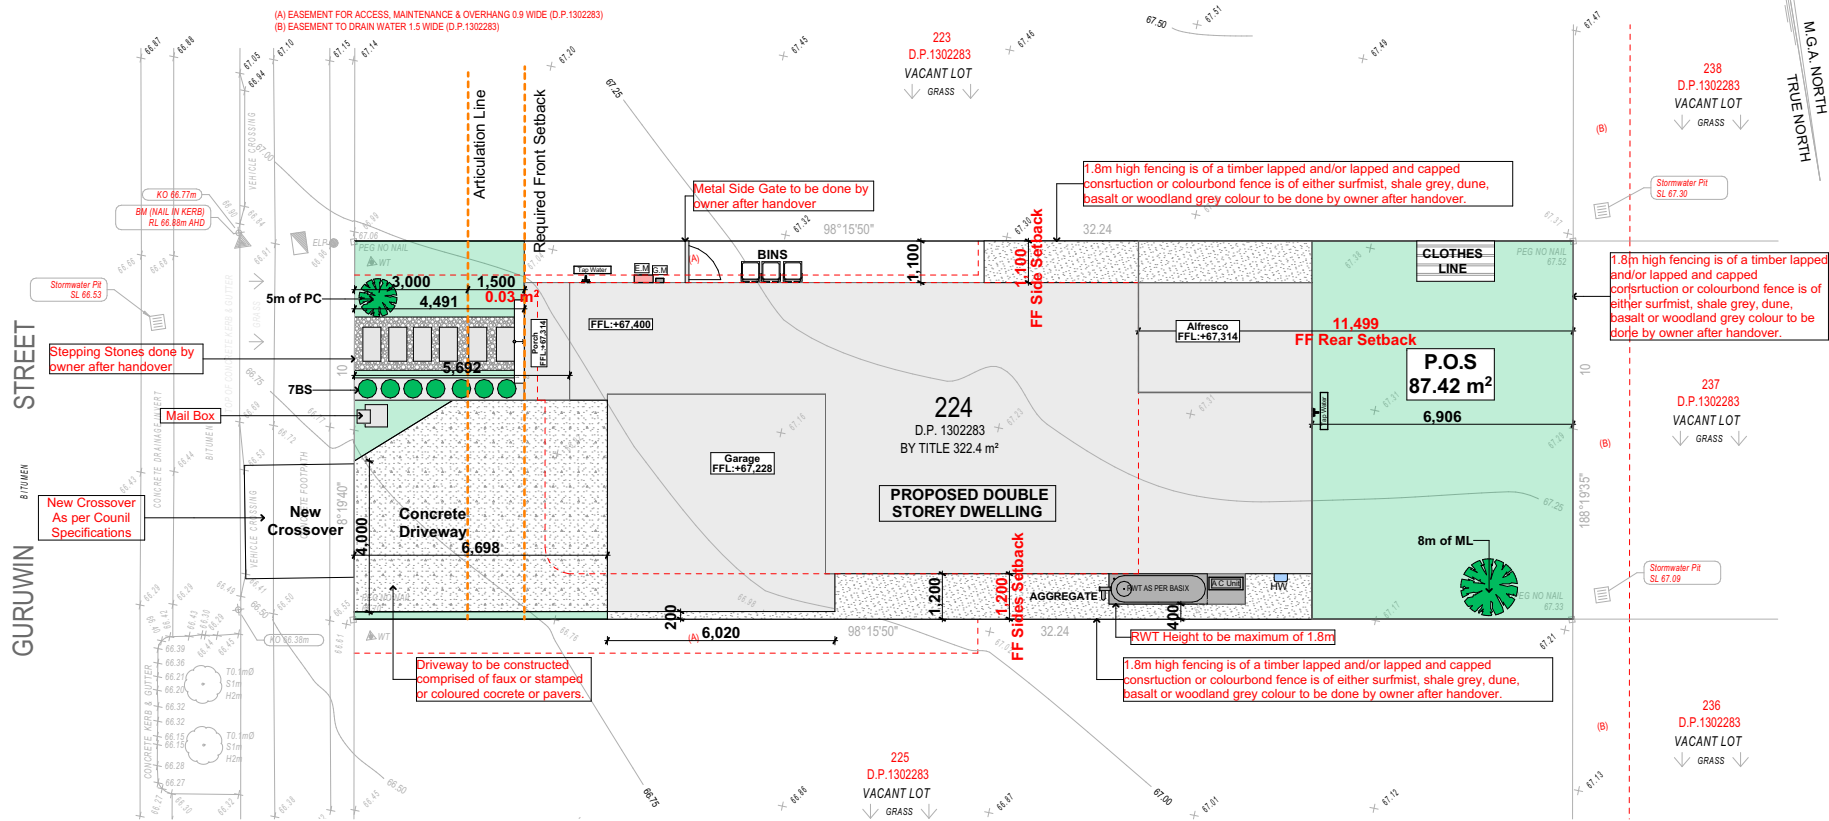

Landscape Plan
1:200



Zero Damage - Zero Harm

NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.

All boundaries and contours are subject to survey drawing. All levels to Australian Height Data. It is the contractors responsibility to confirm all measurements on site and locations of any services prior to work on site.


All documents here within are subject to Australian Copyright Laws.



37604191460 ABN
(02) 8710 3852
SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW, 2212
design@iedesigns.com.au
www.iedesigns.com.au




A	07-09-2026	Issue for CDC
---	------------	---------------



DRAWING : **Landscape Plan**
CLIENT : **Sandstone Constructions**
PROJECT : **PROPOSED DOUBLE STOREY DWELLING**
#28, Guruwin Street, Austral
Lot- 224 D.P 1302263

DRAWN BY: NB
SCALE: 1:200
PAGE SIZE A3
DATE : **07-09-2026**
APPLICATION : CDC
PAGE NO: 17
PROJECT NO. **2607 933**
ISSUE **A**

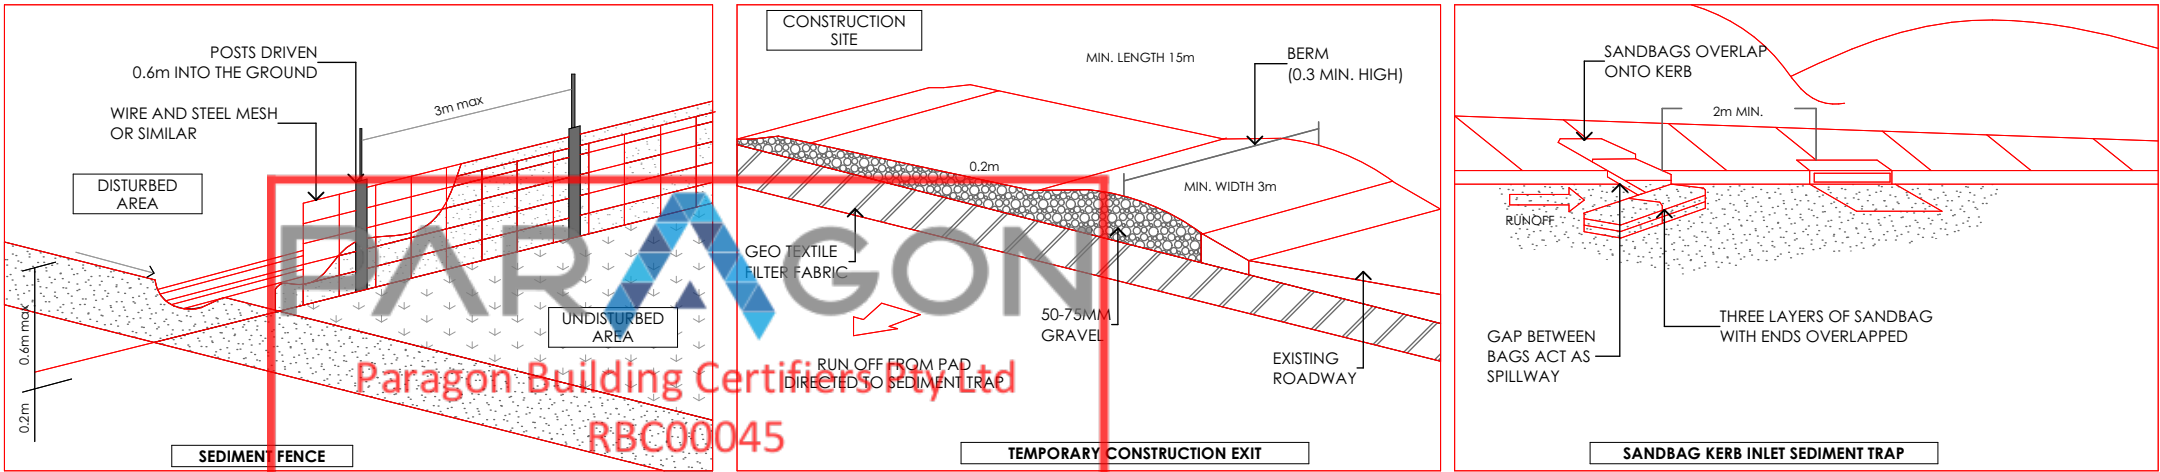


- ### SEDIMENT CONTROL NOTES
1. ALL EROSION AND SEDIMENTATION CONTROL MEASURES, INCLUDING REVEGETATION AND STORAGE OF SOIL AND TOPSOIL, SHALL BE IMPLEMENTED TO THE STANDARDS OF THE SOIL CONSERVATION OF NSW.
 2. ALL DRAINAGE WORKS SHALL BE CONSTRUCTED AND STABILIZED AS EARLY AS POSSIBLE DURING DEVELOPMENT.
 3. SEDIMENT TRAPS SHALL BE CONSTRUCTED AROUND ALL INLET PITS, CONSISTING OF 300mm WIDE x 300mm DEEP TRENCH.
 4. ALL SEDIMENT BASINS AND TRAPS SHALL BE CLEANED WHEN THE STRUCTURES AREA MAXIMUM OF 60% FULL OF SOIL MATERIALS, INCLUDING THE MAINTENANCE PERIOD.
 5. ALL DISTURBED AREAS SHALL BE REVEGITATED AS SOON AS THE RELEVANT WORKS ARE COMPLETED.
 6. SOIL AND TOPSOIL STOCKPILES SHALL BE LOCATED AWAY FROM DRAINAGE LINES AND AREA WHERE WATER MAY CONCENTRATE.
 7. FILTER SHALL BE CONSTRUCTED BY STRETCHING A FILTER FABRIC(PROPEX OR APPROVED EQUIVALENT BETWEEN POST AT 3.0m CENTRES. FABRIC SHALL BE BURIED 150mm ALONG ITS LOWER.

TOPSOIL SHALL BE STRIPPED AND STOCKPILED OUTSIDE HAZARD AREAS SUCH AS DRAINAGE LINES. THIS TOPSOIL IS TO BE RE-SPREAD LATER ON AREAS TO BE REVEGETATED AND STABILISED ONLY. (i.e ALL FOOT-PATHS, BATTERS, SITE, REGRADING AREAS, DRAINAGE RESERVES AND CHANNELS). TOP SOIL SHALL NOT BE SPREAD ON ANY OTHER AREAS SPECIFICALLY INSTRUCTED BY THE SUPERINTENDENT. IF THEY ARE TO REMAIN FOR LONGER THAN ONE MONTH STOCKPILES SHALL BE PROTECTED FROM EROSION BY COVERING THEM WITH A MULCH AND HYDROSEEDING AND, IF NECESSARY, BY LOCATING BANKS OR DRAINS UPSLOPE TO DIVERT THE RUNOFF AROUND THEM. IN SOME CIRCUMSTANCES IT MAY BE NECESSARY TO PLACE BANKS OR DRAINS DOWN STREAM OF A STOCKPILE TO RETARD SEDIMENT LADEN RUNOFF. THE CONTRACTOR SHALL REGULARLY MAINTAIN ALL SEDIMENT AND EROSION CONTROL DEVICES AND REMOVE ACCUMULATED SILT FROM SUCH DEVICES BEFORE NO MORE THAN 60% OF THEIR CAPACITY IS LOST. ALL THE SILT REMOVED SHALL BE DISPOSED OF AS DIRECTED BY THE SUPERINTENDENT. (NO SILT SHALL BE PLACED OUTSIDE THE LIMITS OF WORKS). THE PERIOD FOR MAINTAINING THESE DEVICES SHALL BE AT LEAST UNTIL ALL DISTURBED AREAS ARE REVEGETATED AND FURTHER AS MAY BE DIRECTED BY THE SUPERINTENDENT OR COUNCIL

- ### SEDIMENT NOTES
1. CONSTRUCT SEDIMENT FENCE AS CLOSE AS POSSIBLE AND PARALLEL TO THE CONTOURS OF THE SITE.
 2. DRIVE 1.5 m LONG STAR PICKETS INTO GROUND Max 3 m Ctrs.
 3. DIG A 150 mm DEEP TRENCH ALONG THE UPSLOPE LINE OF THE FENCE FOR THE BOTTOM OF THE FABRIC TO BE ENTRENCHED.
 4. BACKFILL TRENCH OVER BASE OF FABRIC.
 5. FIX SELF SUPPORTING GEOTEXILE TO UPSLOPE SIDE OF POSTS WITH WIRE TIES OR AS RECOMMENDED BY GEOTEXILE MANUFACTURER.
 6. JOIN SECTIONS OF FABRIC AT A SUPPORT POST WITH A Min LAP OF 150 mm.

*THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE FOLLOWING:

- 1-ARCHITECTURAL PLANS
- 2-CONTOUR AND DETAIL SURVEY

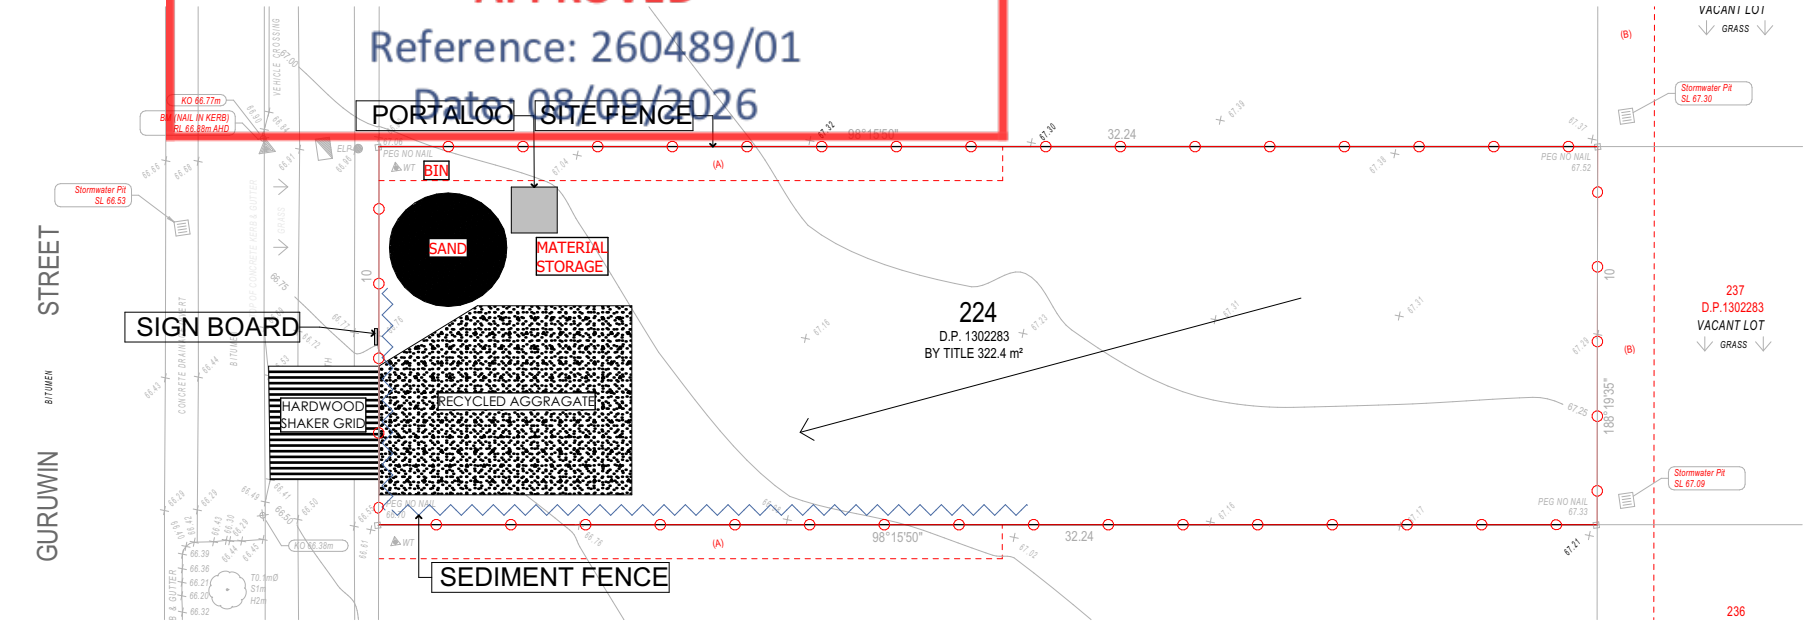

Sediment Control Plan
1:200



NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.

All boundaries and contours are subject to survey drawing. All levels to Australian Height Data. It is the contractors responsibility to confirm all measurements on site and locations of any services prior to work on site.


All documents here within are subject to Australian Copyright Laws.



37604191460 ABN
(02) 8710 3852
SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW, 2212
design@iedesigns.com.au
www.iedesigns.com.au





A	07-09-2026	Issue for CDC



DRAWING : **Sediment Control Plan**
CLIENT : **Sandstone Constructions**
PROJECT : **PROPOSED DOUBLE STOREY DWELLING**
#28, Guruwin Street, Austral
Lot- 224 D.P 1302263

DRAWN BY: NB
SCALE: 1:200
PAGE SIZE A3
DATE : **07-09-2026**
APPLICATION : CDC
PAGE NO: 18

PROJECT NO. **2607 933**
ISSUE **A**

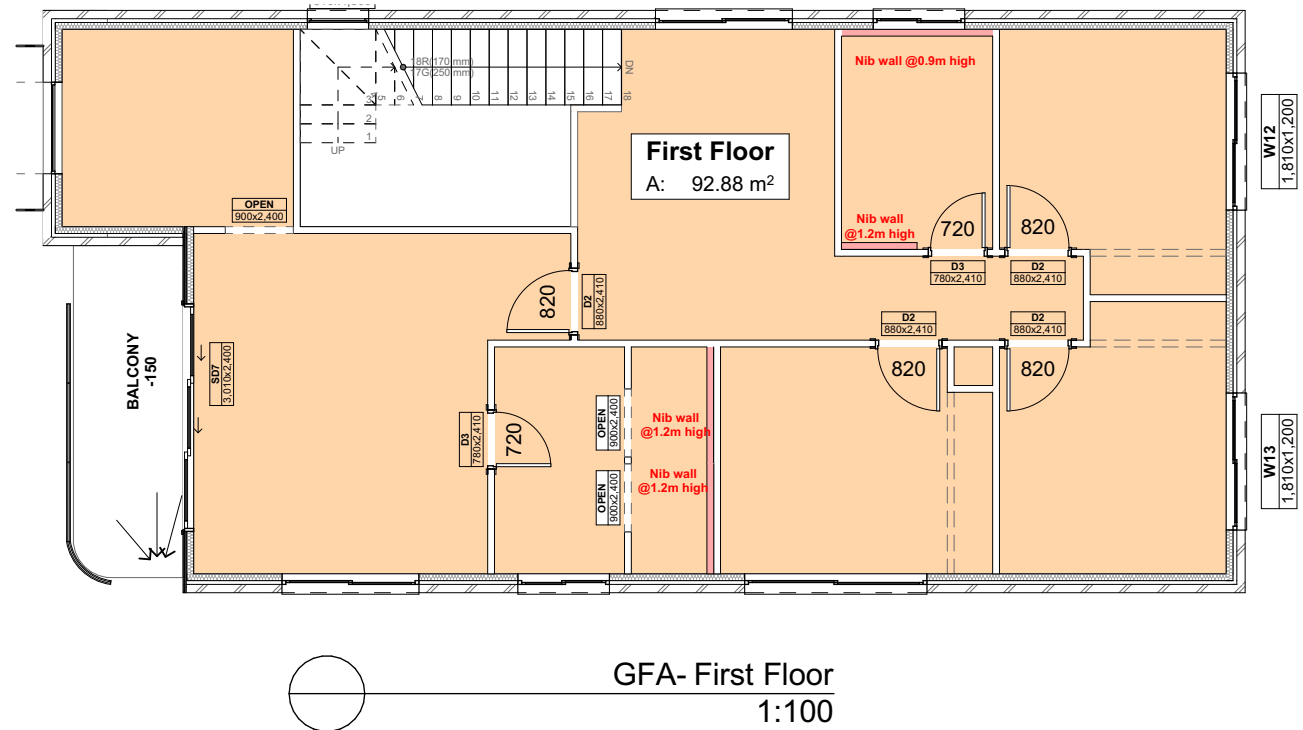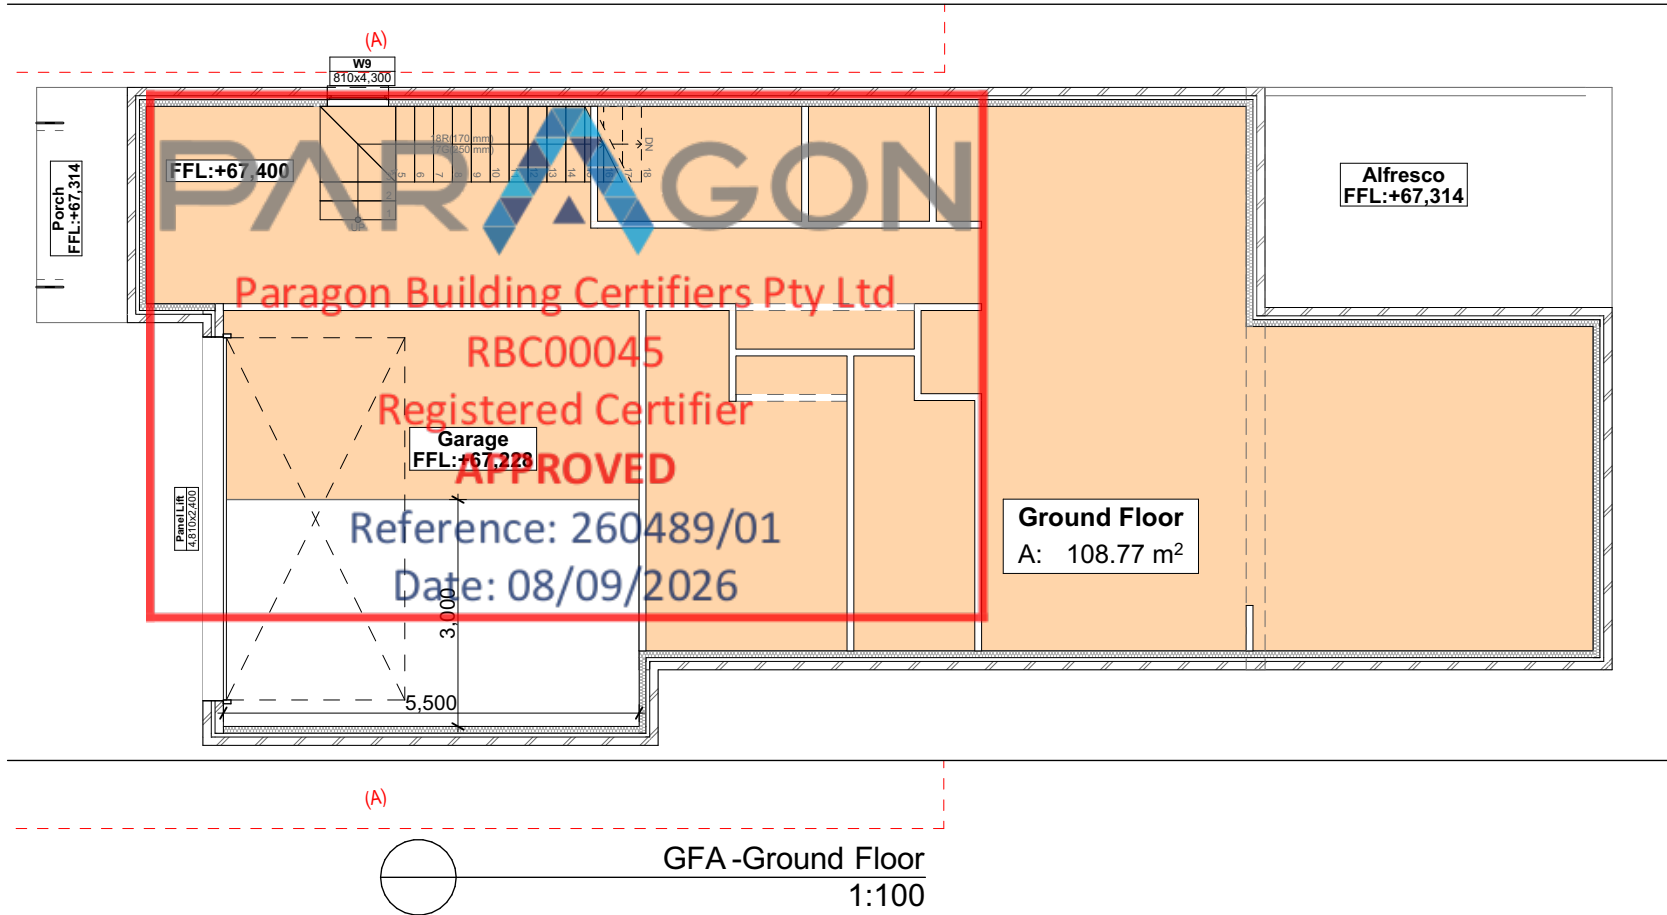

NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.

All boundaries and contours are subject to survey drawing. All levels to Australian Height Data. It is the contractors responsibility to confirm all measurements on site and locations of any services prior to work on site.

All documents here within are subject to Australian Copyright Laws.



37604191460 ABN
(02) 8710 3852

SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW, 2212

design@iedesigns.com.au

www.iedesigns.com.au



A	07-09-2026	Issue for CDC	

DRAWING : **GFA Calculation**

CLIENT : **Sandstone Constructions**

PROJECT : **PROPOSED DOUBLE STOREY DWELLING**
#28, Guruwin Street, Austral
Lot- 224 D.P 1302263

DRAWN BY:
NB

SCALE:
1:100

PAGE SIZE
A3


DATE :
07-09-2026

APPLICATION :
CDC


PAGE NO:
19

PROJECT NO.
2607 933

ISSUE
A

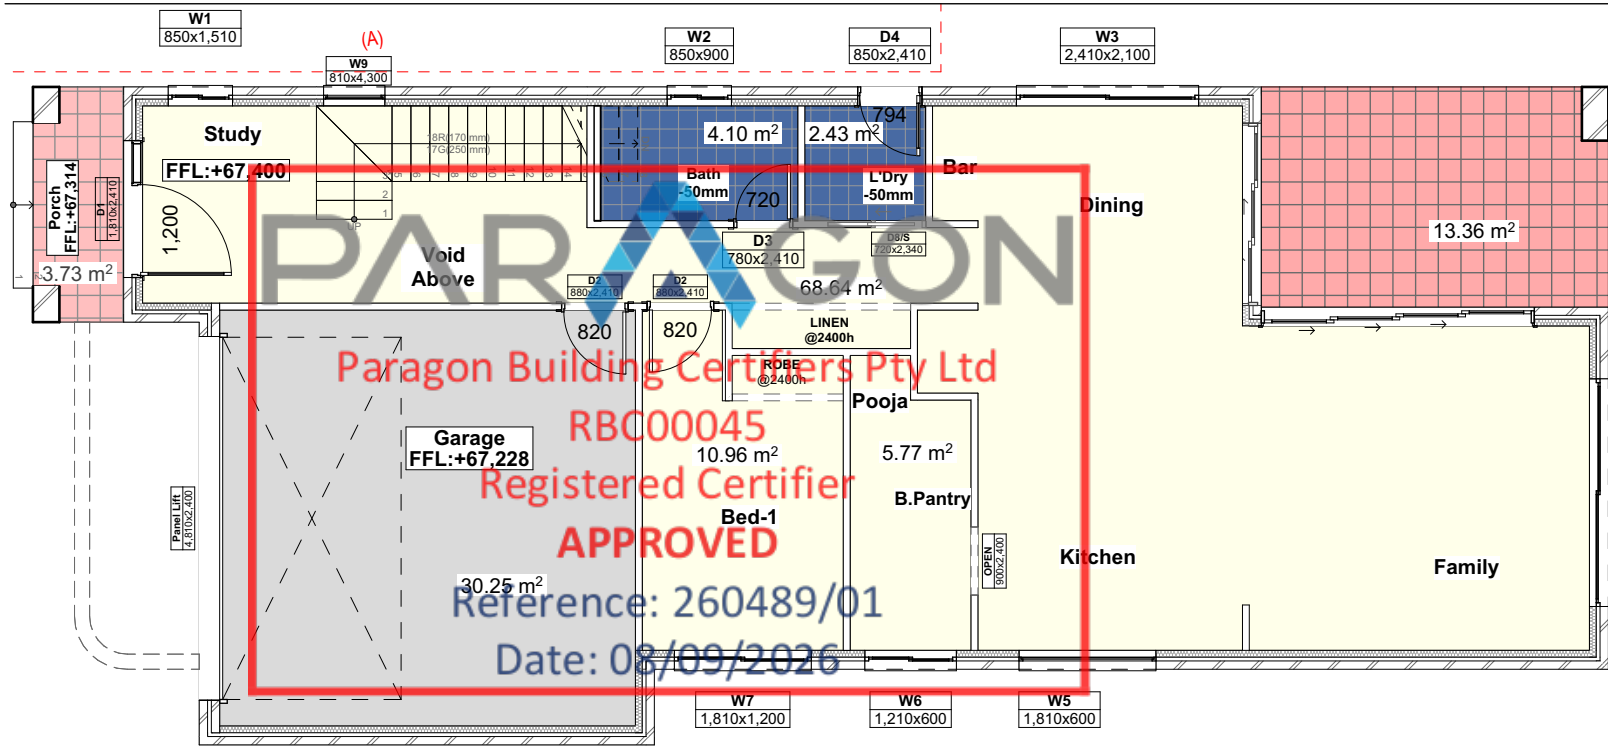

Floor Finish (Ground Floor)
1:100

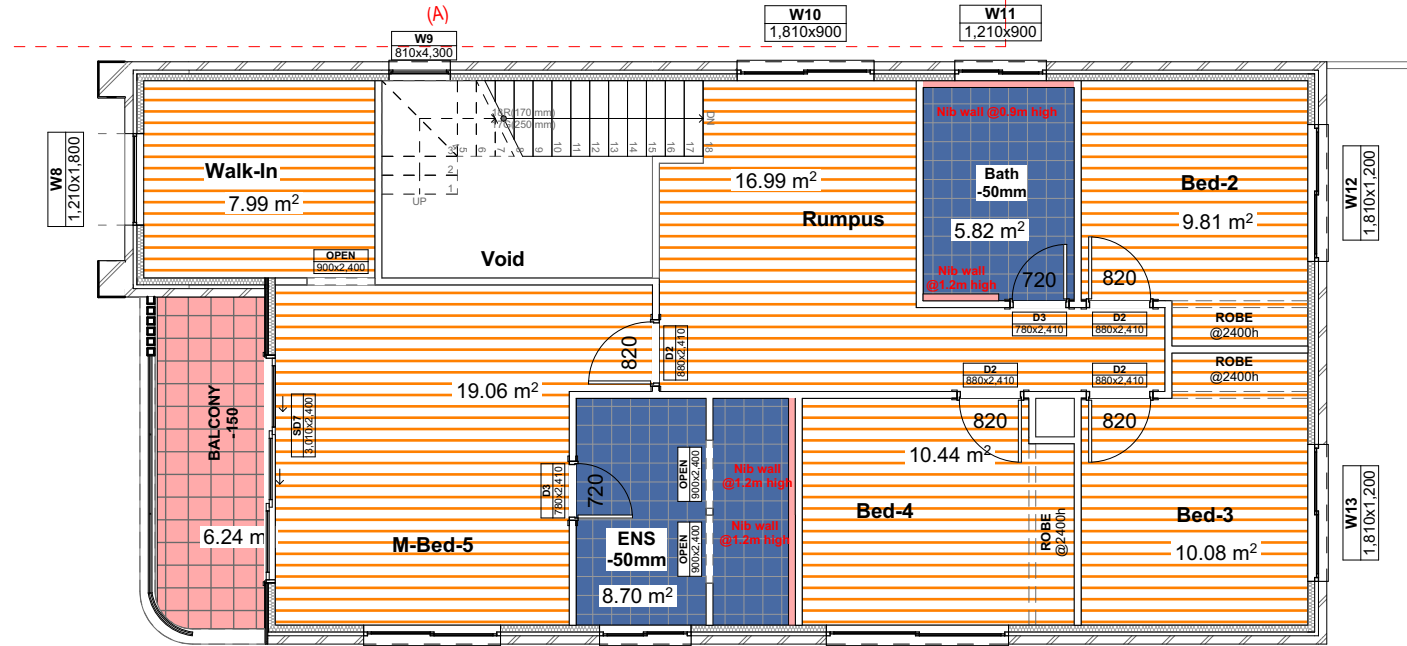

Floor Finish (First Floor)
1:100

LEGEND	
Ref.img	Name
	Hybrid Flooring
	Outdoor Tiles
	Concrete finish
	Tile for wet area
	Timber finish



NOTE
The Builder shall check all dimensions and levels on site prior to construction. Notify any errors, discrepancies or omissions to the building designer. Refer to written dimensions only. Do not scale drawings. Drawings shall not be used for construction purposes until issued for construction. This drawing reflects a design by Innovative Eco Designs and is to be used only for work when authorised in writing by Innovative Eco Designs.
All boundaries and contours are subject to survey drawing. All levels to Australian Height Data. It is the contractors responsibility to confirm all measurements on site and locations of any services prior to work on site.
All documents here within are subject to Australian Copyright Laws.



37604191460 ABN
(02) 8710 3852
SUITE 7, 4-10 SELEMS PDE
REVESBY, NSW, 2212
design@iedesigns.com.au
www.iedesigns.com.au



A	07-09-2026	Issue for CDC
---	------------	---------------

DRAWING : **Floor Finish**
CLIENT : **Sandstone Constructions**
PROJECT : **PROPOSED DOUBLE STOREY DWELLING**
#28, Guruwin Street, Austral
Lot- 224 D.P 1302263

DRAWN BY: NB
SCALE: 1:100
PAGE SIZE A3
DATE : **07-09-2026**
APPLICATION : CDC
PAGE NO: 20
PROJECT NO. **2607 933**
ISSUE **A**

BUILDING SPECIFICATIONS

National Construction Code – Volume 2, Amendment 1 – Building Code of Australia 2022 & Housing Provisions Standard 2022

SITE PREPARATION

- PART 3.1 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022

EARTHWORKS

- TO BE CARRIED OUT IN ACCORDANCE WITH THE REQUIREMENTS OF THE ENVIRONMENTAL PLANNING & ASSESSMENT ACT 1979 AND DEVELOPMENT CONSENT CONDITIONS
- PART 3.2 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 4678:2002 - EARTH-RETAINING STRUCTURES

DRAINAGE

- PART 3.3 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS/NZS 3500.1:2021 - PLUMBING & DRAINAGE - WATER SERVICES
- AS/NZS 3500.2:2021 - PLUMBING & DRAINAGE - SANITARY PLUMBING & DRAINAGE
- AS/NZS 3500.3:2021 - PLUMBING & DRAINAGE - STORMWATER DRAINAGE
- AS/NZS 3500.4:2021 - PLUMBING & DRAINAGE - HEATED WATER SERVICES

STRUCTURAL WORK

- Part 2.2 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 4100:2020– STEEL STRUCTURES CODES
- AS/NZS 1170.0:2002 – GENERAL PRINCIPLES
- AS/NZS 1170.1:2002 – PARTS 1 PERMANENT, IMPOSED AND OTHER ACTIONS
- AS/NZS 1170.2:2021 – PART 2 WIND ACTIONS
- AS 3700:2018– SAA MASONRY CODE
- AS 1684.3:2021- RESIDENTIAL TIMBER FRAMED CONSTRUCTION

FOOTINGS & SLABS

- PART 4 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 2159:2009 - PILING - DESIGN & INSTALLATION
- AS 2870:2011 - RESIDENTIAL SLABS & FOOTINGS
- AS 3600:2018 - CONCRETE STRUCTURES

MASONRY

- PART 5 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 3700:2018 - MASONRY STRUCTURES

FRAMING

- PART 6 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 1684.2:2021 - RESIDENTIAL TIMBER-FRAMED CONSTRUCTION - NON- CYCLONIC AREAS
- AS 1720.1:2010 - TIMBER STRUCTURES - DESIGN METHODS
- AS 4100:2020 - STEEL STRUCTURES
- AS 3660.1:2014 – TERMITE MANAGEMENT SYSTEM

ROOF & WALL CLADDING

- PART 7 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 1273:1991 - UNPLASTICIZED PVC (UPVC) DOWNPIPES & FITTINGS FOR RAINWATER
- AS 1562.1:2018 - DESIGN & INSTALLATION OF SHEET ROOF & WALL CLADDING - METAL
- AS/NZS 1562.3:2006 - DESIGN & INSTALLATION OF SHEET ROOF & WALL CLADDING - PLASTIC
- AS 2049:2002 - ROOF TILES
- AS 2050:2018 - INSTALLATION OF ROOF TILES
- AS 4285:2019 – ROOFLIGHTS

GLAZING

- PART 8 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 1288:2021 - GLASS IN BUILDINGS - SELECTION & INSTALLATION
- AS 2047:2014 - WINDOWS & EXTERNAL GLAZED DOORS IN BUILDINGS
- AS/NZS 2208:1996 - SAFETY GLAZING MATERIALS IN BUILDINGS

FIRE SAFETY

- PART 9 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 3786:2014 - SMOKE ALARMS USING SCATTERED LIGHT, TRANSMITTED LIGHT OR IONIZATION

HEALTH & AMENITY

- PART 10 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS/NZS ISO 717.1:2004 - ACOUSTICS - RATING OF SOUND INSULATION IN BUILDINGS & OF BUILDING ELEMENTS - AIRBORNE SOUND INSULATION
- AS ISO 717.2:2004 - ACOUSTICS - RATING OF SOUND INSULATION IN BUILDINGS & OF BUILDING ELEMENTS - IMPACT SOUND INSULATION
- AS 1668.2:2012 - THE USE OF VENTILATION & AIR CONDITIONING IN BUILDINGS - MECHANICAL VENTILATION IN BUILDINGS
- AS 1668.4:2012 - THE USE OF VENTILATION & AIR CONDITIONING IN BUILDINGS - NATURAL VENTILATION OF BUILDINGS
- AS/NZS 1680.0:2009 - INTERIOR LIGHTING - SAFE MOVEMENT
- AS 3740:2021 - WATERPROOFING OF DOMESTIC WET AREAS
- AS 3000:2018 – ELECTRICAL INSTALLATION
- BCA Part 10.8.1, AS4200.1 & AS4200.2 – PLIABLE BUILDING MEMBRANE INSTALLED.

WATERPROOFING

- PART 10.2 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022
- AS 3740:2021– WATERPROOFING TO WET AREA
- AS 4654:2012 – EXTERNAL WET AREAS

SAFE MOVEMENT & ACCESS

- PART 11 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 1428.1:2009 - DESIGN FOR ACCESS & MOBILITY – GENERAL REQUIREMENTS FOR ACCESS - NEW BUILDING WORK
- AS 1657:2018 - FIXED PLATFORMS, WALKWAYS, STAIRWAYS & LADDERS - DESIGN, CONSTRUCTION & INSTALLATION

HANDRAILS & BALUSTRADE

- PART 11.3.3 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- PART 11.3.4 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- PART 11.3.5 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.
- AS 1170.1:2002 – BALUSTRADE INSTALLATION

PROTECTION OF OPENABLE WINDOW

PART 11.3.7 AND 11.3.8 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.

ENERGY EFFICIENCY

- PART 13 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022 & BASIX CERTIFICATE.

HEATING APPLIANCES, FIREPLACES, CHIMNEYS AND FLUES

- PART 12.4 OF THE NCC VOLUME 2, AMENDMENT 1 - BUILDING CODE OF AUSTRALIA 2022 & HOUSING PROVISIONS STANDARD 2022.

MECHANICAL VENTILATION

- EXHAUST FROM A BATHROOM, SANITARY COMPARTMENT TO DISCHARGE DIRECTLY TO OUTDOOR AIR WITH MINIMUM FLOW RATE OF 25L/S & MAKE-UP AIR VIA OPENINGS TO AN ADJACENT ROOM WITH A FREE AREA OF 14,000 MM². THIS EXHAUST SYSTEM MUST BE INTERLOCKED WITH LIGHT SWITCH AND INCLUDE RUN-ON TIMER SO THAT THE EXHAUST SYSTEM CONTINUES TO OPERATE FOR 10 MINUTES AFTER THE LIGHT SWITCH IS OFF.
- ANY INSTALLED - KITCHEN RANGEHOOD EXHAUST TO DISCHARGE DIRECTLY OR VIA DUCT TO OUTDOOR AIR WITH MINIMUM FLOW RATE OF 40L/S & MAKE-UP AIR VIA OPENINGS TO AN ADJACENT ROOM WITH A FREE AREA OF 14,000 MM².
- LAUNDRY EXHAUST TO DISCHARGE DIRECTLY OR VIA DUCT TO OUTDOOR AIR WITH MINIMUM FLOW RATE OF 40L/S & MAKE-UP AIR VIA OPENINGS TO AN ADJACENT ROOM WITH A FREE AREA OF 14,000 MM².

