

Cabinet content (doc 12 modules)	Note
SiC active rectifier 1 200 V, 750 V DC link	6 kW firmware limits
Dump chopper 12 kW + heater feed	hardware trigger 820 V
AC module 6.5 kW (grid / heater)	single- or three-phase
48 V battery module + 200 Wh aux battery	yaw-out without grid
Safety relay PL d, K1 contactor	NS6-600 chain
Controller, modem, surge arresters T1+T2	earth bar to the tower lug


FRONT (from +Y): cabinet left, braking resistor box right (vented)

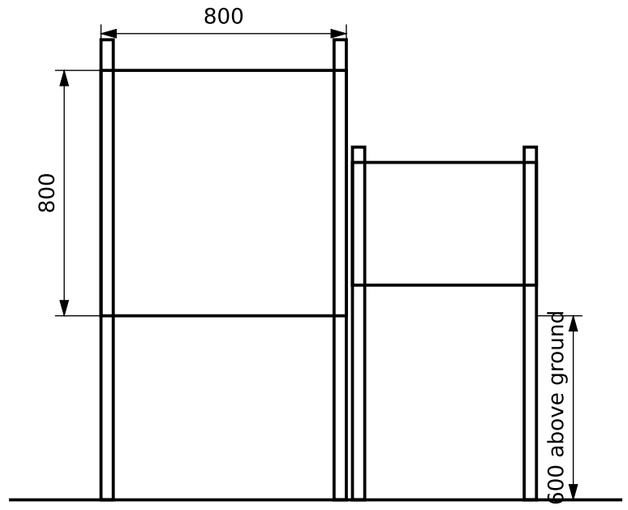

AXONOMETRIC VIEW (not to scale)

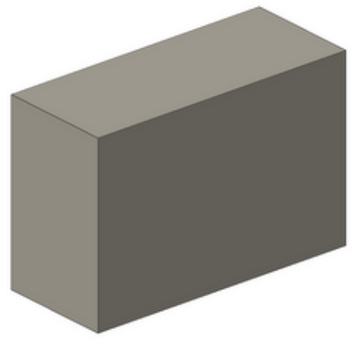

AXONOMETRIC VIEW (not to scale)

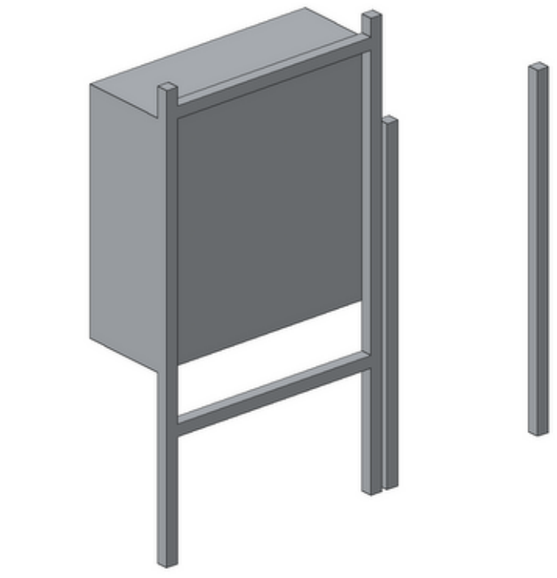

NOTES

1. Stand on two concrete pads 400 × 400 × 600 (or bolted to the pedestal side); cabinet door faces away from the tower; minimum 1.0 m from the tower axis, outside the rotor disc projection is not required (tip at 5 m).
2. Resistor box NS6-600 mounted 20 mm proud of the stand, louvres down, ≥ 300 mm from the cabinet (heat).
3. Cables enter from below through the two PE ducts in the footing (NS6-800).

Dimensions mm · ISO 2768-mK · ISO 8015 · first angle projection · edges broken 0.5 unless stated · NOT CHECKED: prototype release only after review

6 kW WIND TURBINE S6 (ICELAND) · FIXED PITCH, STALL CONTROL

TOWER BASE CABINET, STAND AND RESISTOR BOX POSITION

DRAWING NO.	REV / DATE	SCALE (A3)
NS6-620	B · 2026-11-06	1:20
MATERIAL	MASS (CALC.)	DRAWN / CHECKED
enclosure 1.4301 IP55; stand S235 galv.	95 kg + 18 kg	Claude / not checked