

LAMINATION (1:3.6)

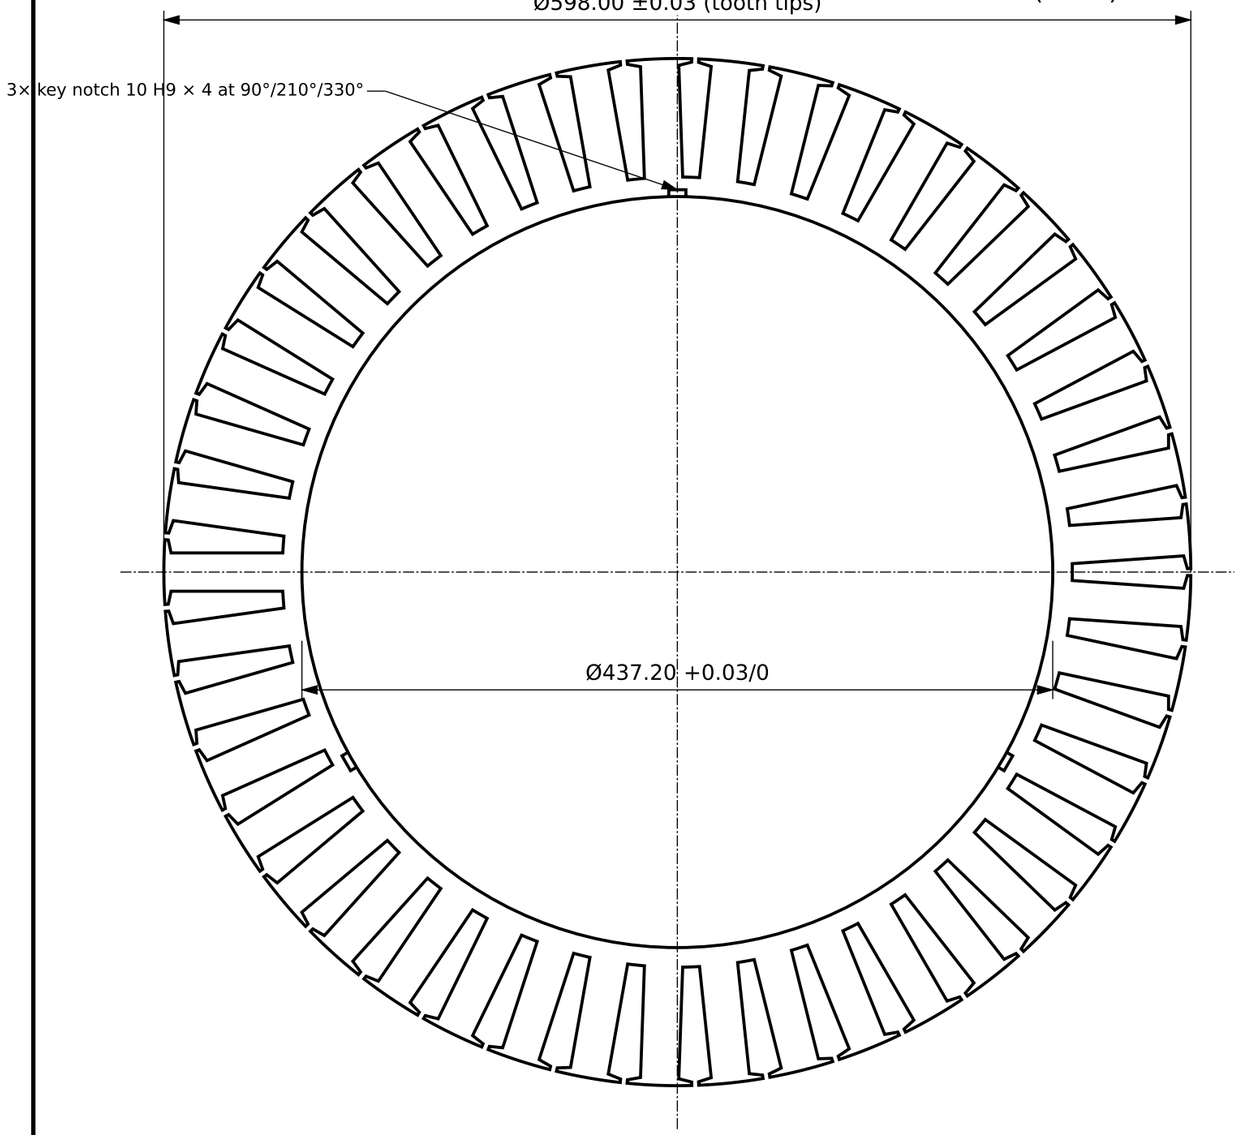

SLOT DETAIL (2:1)

tooth body 22.3 parallel-sided

slot area 932 mm² (FEA basis)

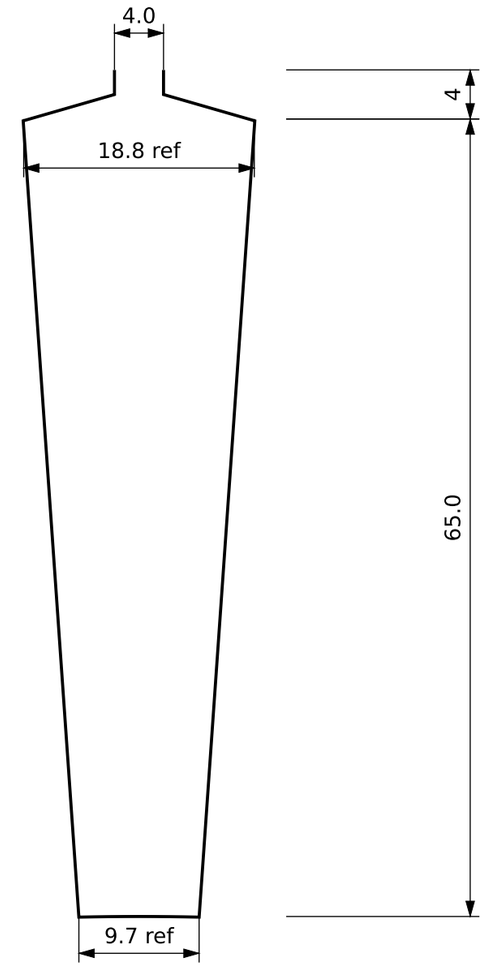

NOTES

1. DXF of this sheet (layer OUTLINE) is the cutting contour. Production: stamping die or laser + edge-anneal; P1: laser cut, burr ≤ 0.02 mm, cut-edge heat zone ≤ 0.1 mm.
2. Material M270-35A (EN 10106) with self-bonding varnish (Backlack, e.g. class C coating, both sides). Grain orientation irrelevant (non-oriented), but rotate each sheet 3 slot pitches (24°) when stacking to average thickness variation.
3. Stack: ≈ 205 sheets for 74.0 mm at stacking factor ≥ 0.97; bond-cure in fixture on a Ø437.20 mandrel with 3 keys, 1.0 to 1.5 MPa axial pressure.
4. Stack checks: length 74.0 ±0.2; Ø598.0 OD run-out ≤ 0.05 to the bore; slot alignment: Ø3.9 gauge pin passes every slot opening full length.
5. Interlaminar resistance: Franklin test to IEC 60404-11, ≥ 10 Ω·cm² after bonding.
6. Tooth tips are not machined after stacking (damages insulation). If OD run-out exceeds 0.05, reject the stack.

Dimensions mm · ISO 2768-mK · ISO 8015 · first angle projection · edges broken 0.5 unless stated · NOT CHECKED: prototype release only after review

12 kW WIND TURBINE (ICELAND) · NACELLE PROTOTYPE P1

STATOR LAMINATION (45 SLOTS) · LASER / STAMPING

DRAWING NO.	REV / DATE	SCALE (A3)
NP1-201	A · 2026-11-02	1:3.6 / 2:1
MATERIAL	**MASS (CALC.)**	**DRAWN / CHECKED**
M270-35A, 0.35 mm, self-bonding varnish	48.0 kg per stack	Claude / not checked