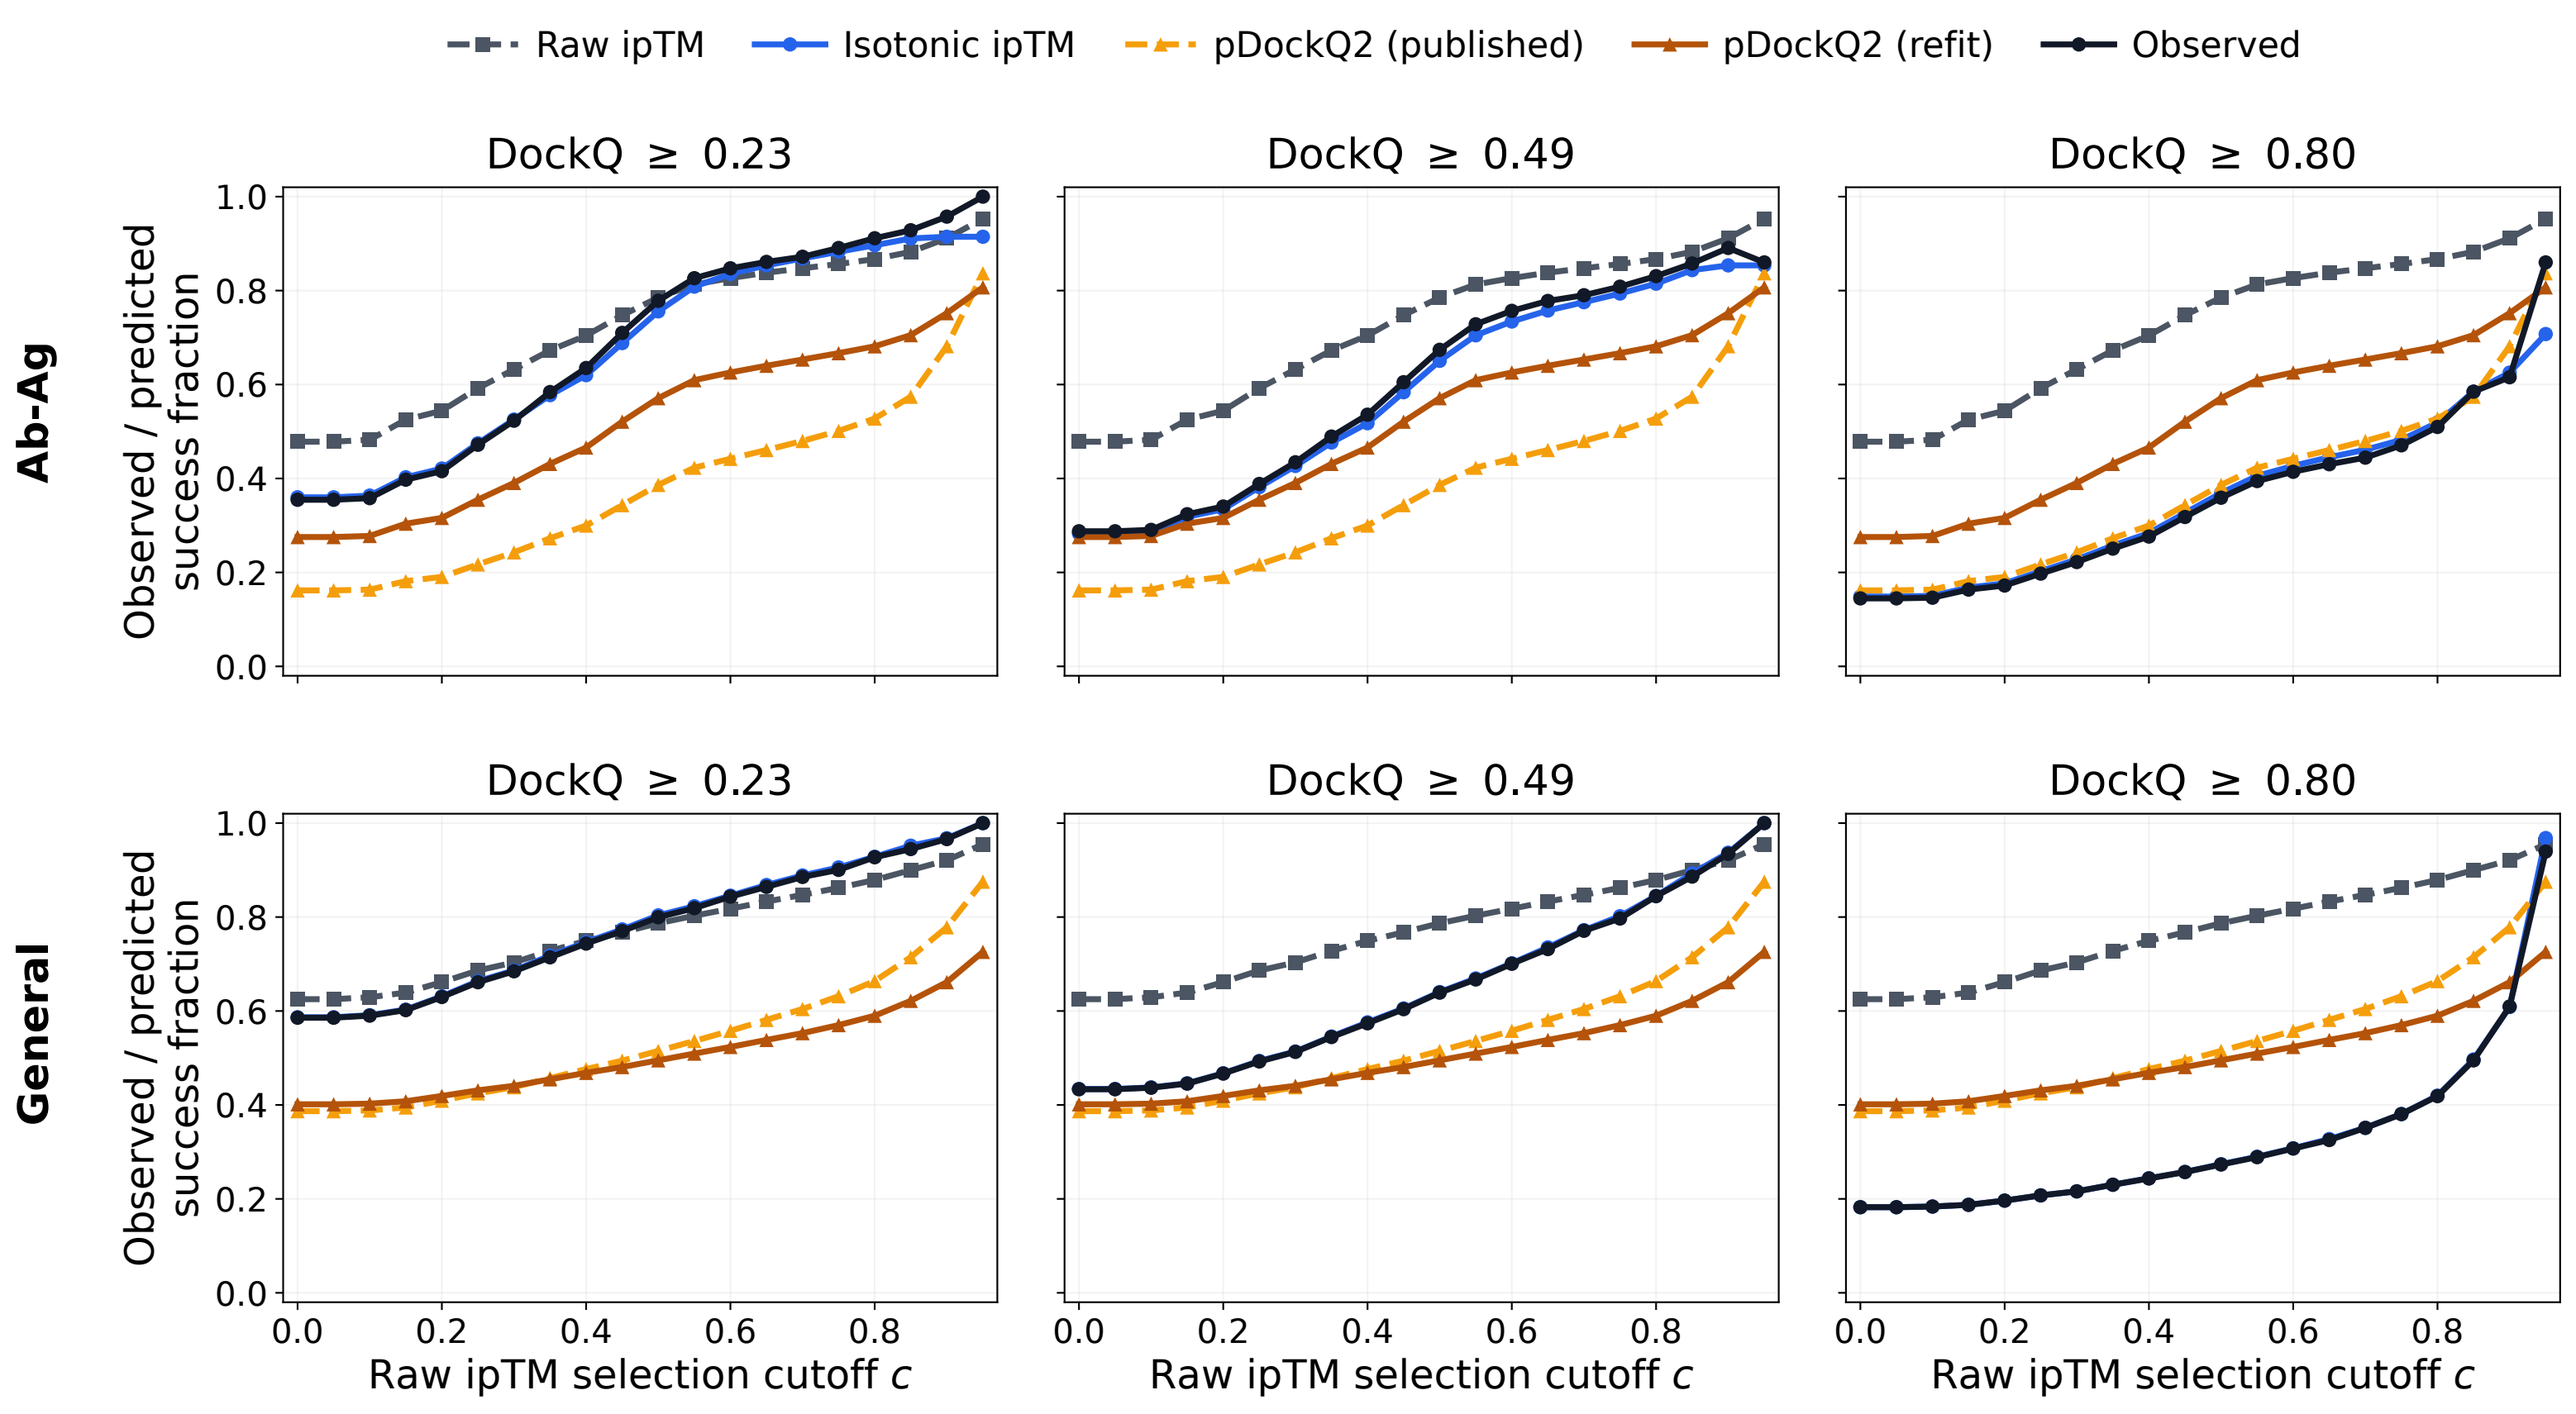
Raw ipTM
Isotonic ipTM
pDockQ2 (published)
pDockQ2 (refit)
Observed
Ab-Ag
General
DockQ ≥ 0.23
DockQ ≥ 0.49
DockQ ≥ 0.80
Observed / predicted success fraction
Raw ipTM selection cutoff c
0.0
0.2
0.4
0.6
0.8
1.0