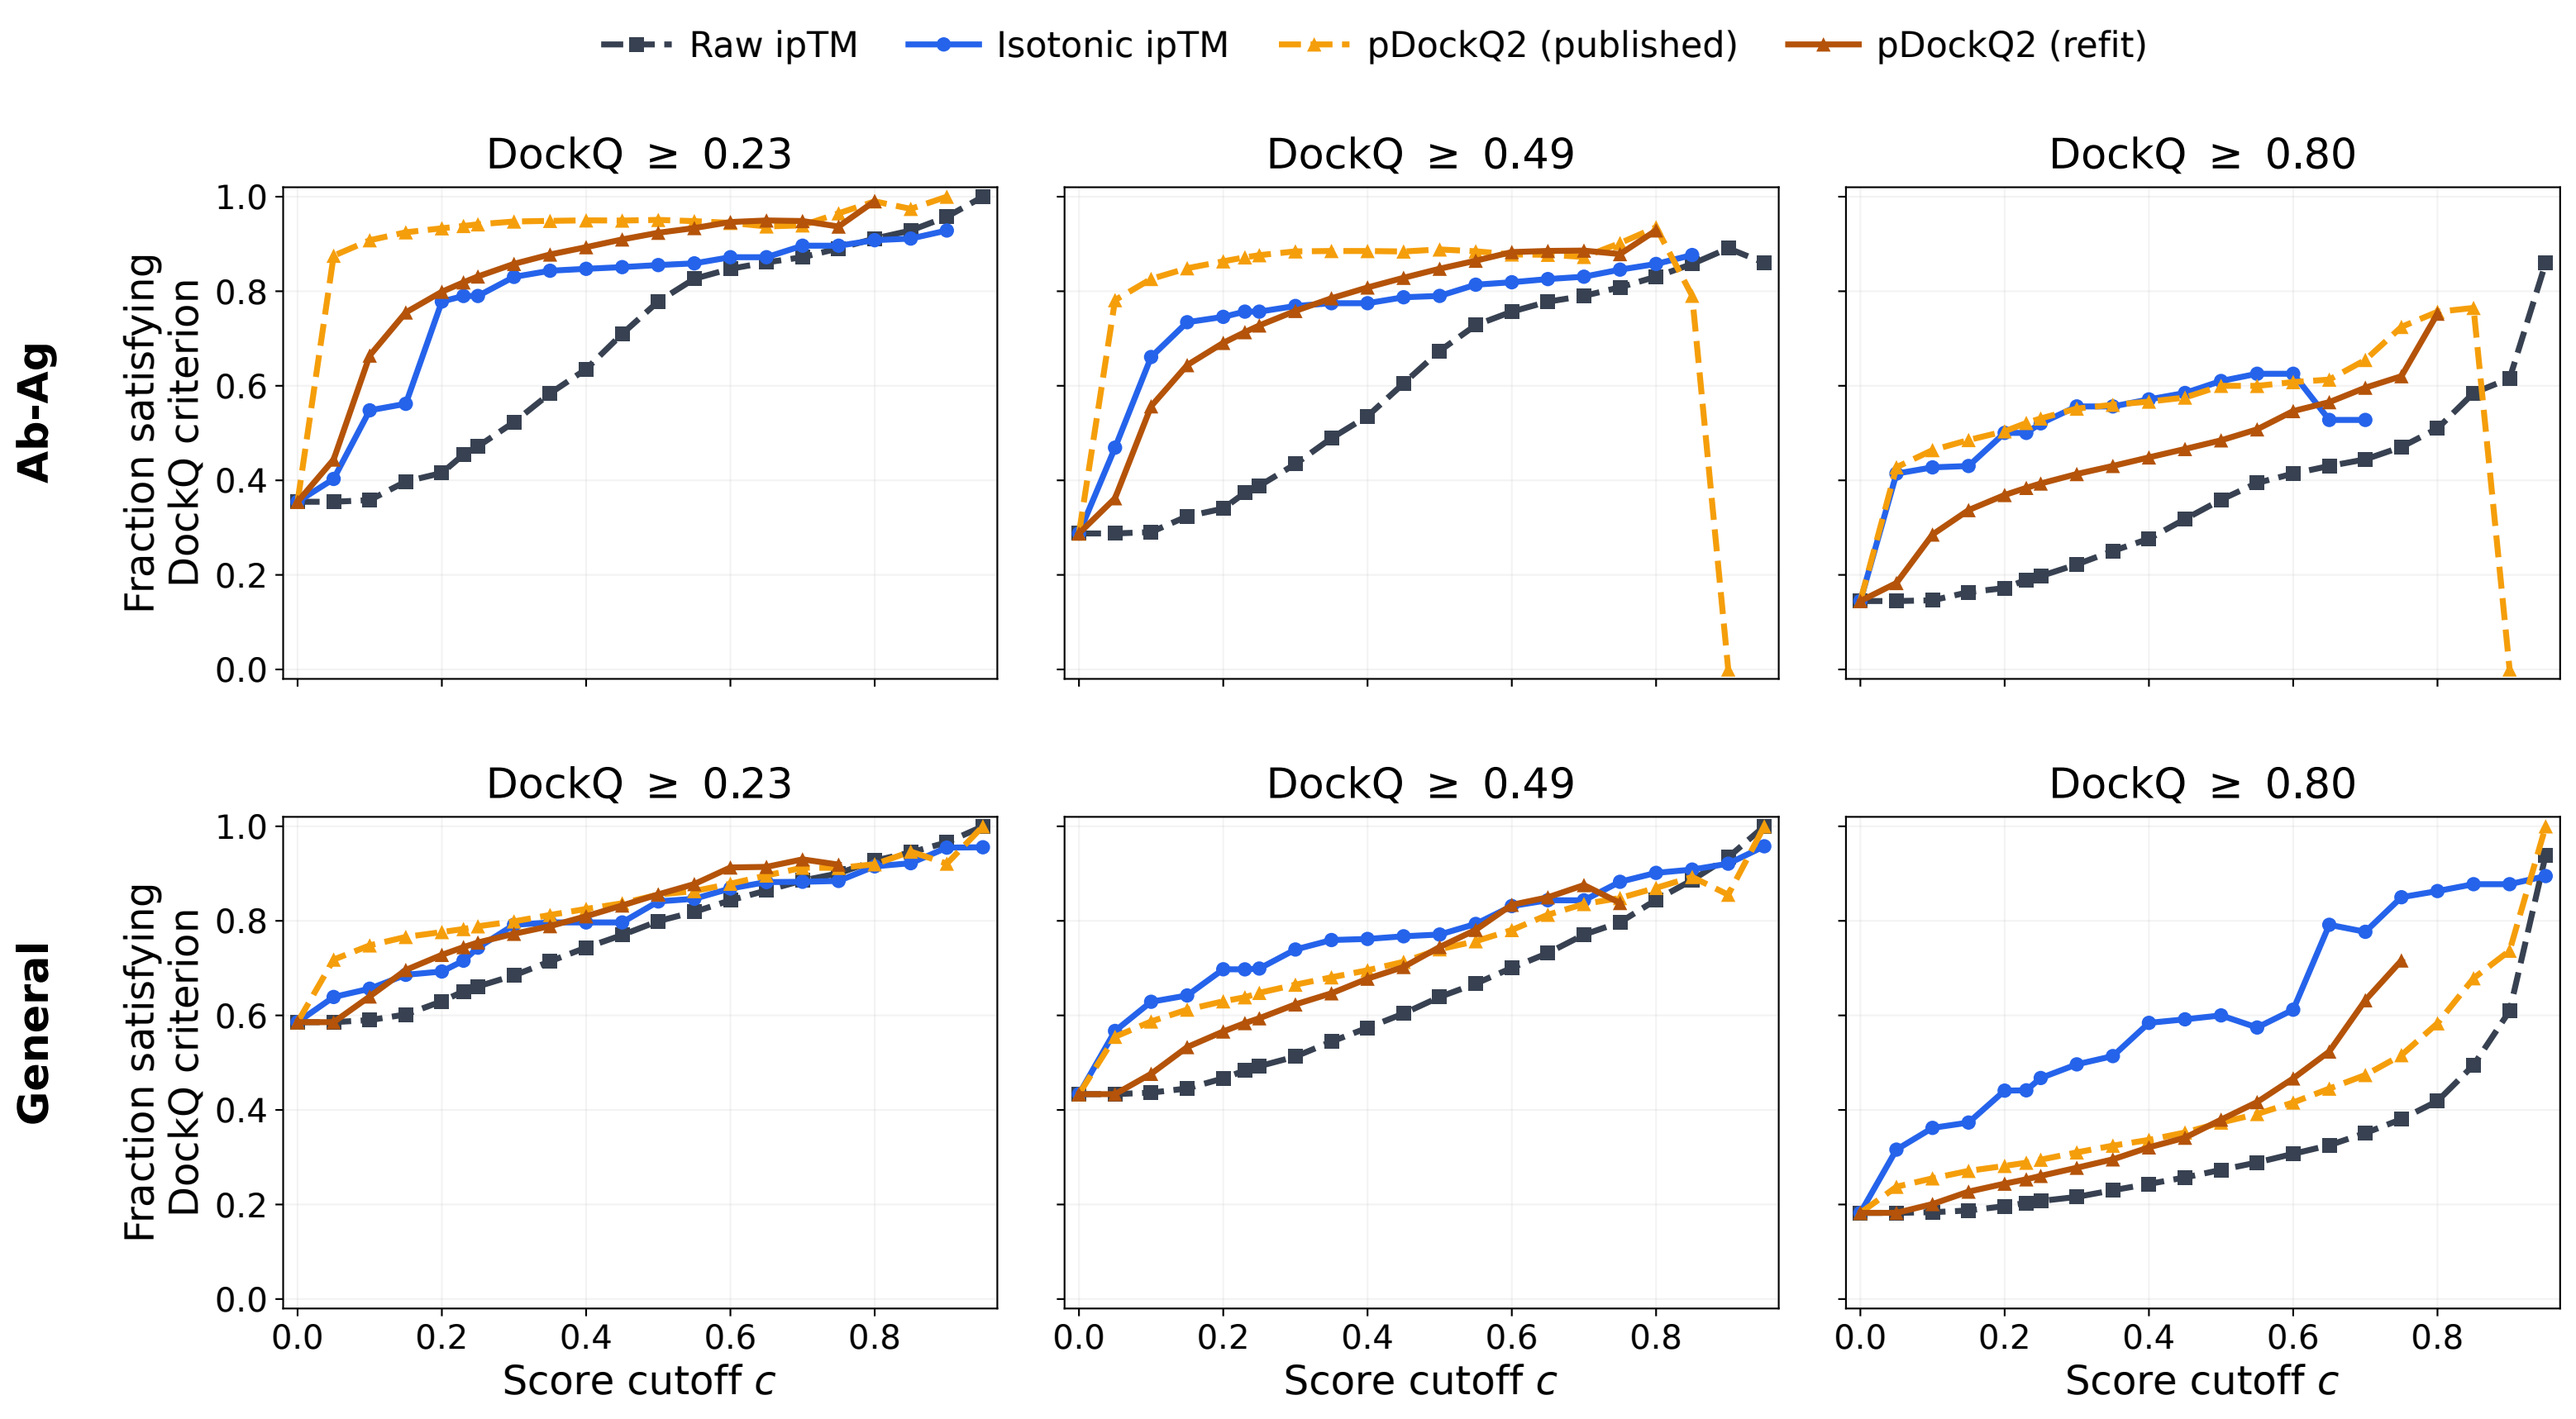
Raw ipTM
Isotonic ipTM
pDockQ2 (published)
pDockQ2 (refit)
Ab-Ag
General
DockQ ≥ 0.23
DockQ ≥ 0.49
DockQ ≥ 0.80
Fraction satisfying DockQ criterion
Score cutoff c
0.0
0.2
0.4
0.6
0.8
1.0