


Figure 8: Validation vs High-NA EUV Benchmark — NA=0.55, 8 nm HP

(A) CD & NILS vs Defocus (High-NA, dipole)
DOF_sim=140 nm Benchmark=140 nm



(B) CD vs Dose (High-NA, dipole)
EL_sim=40.0% Benchmark=40.0%

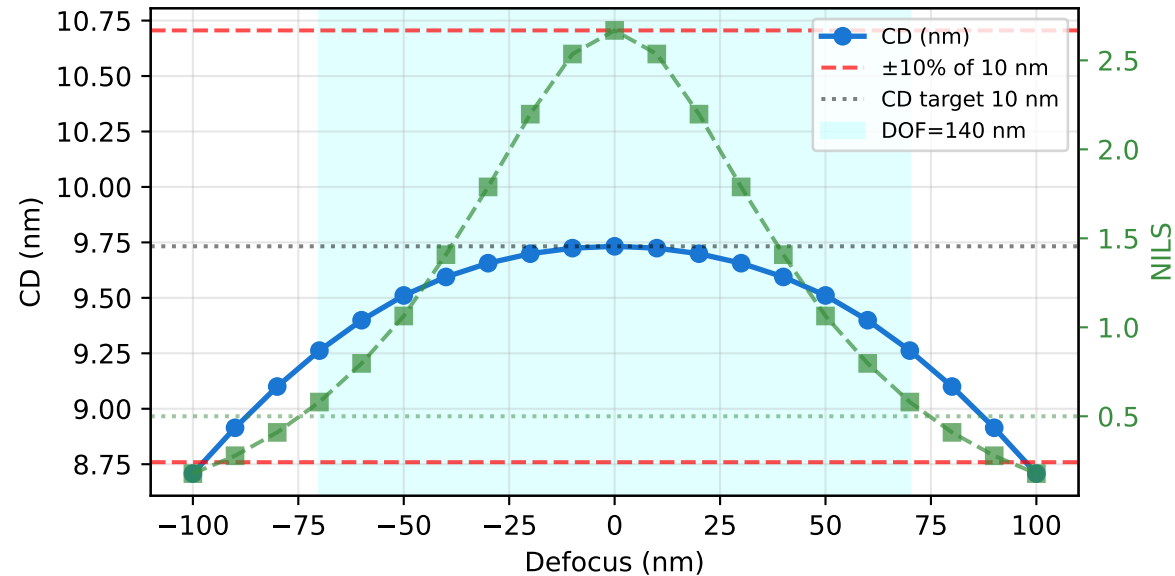