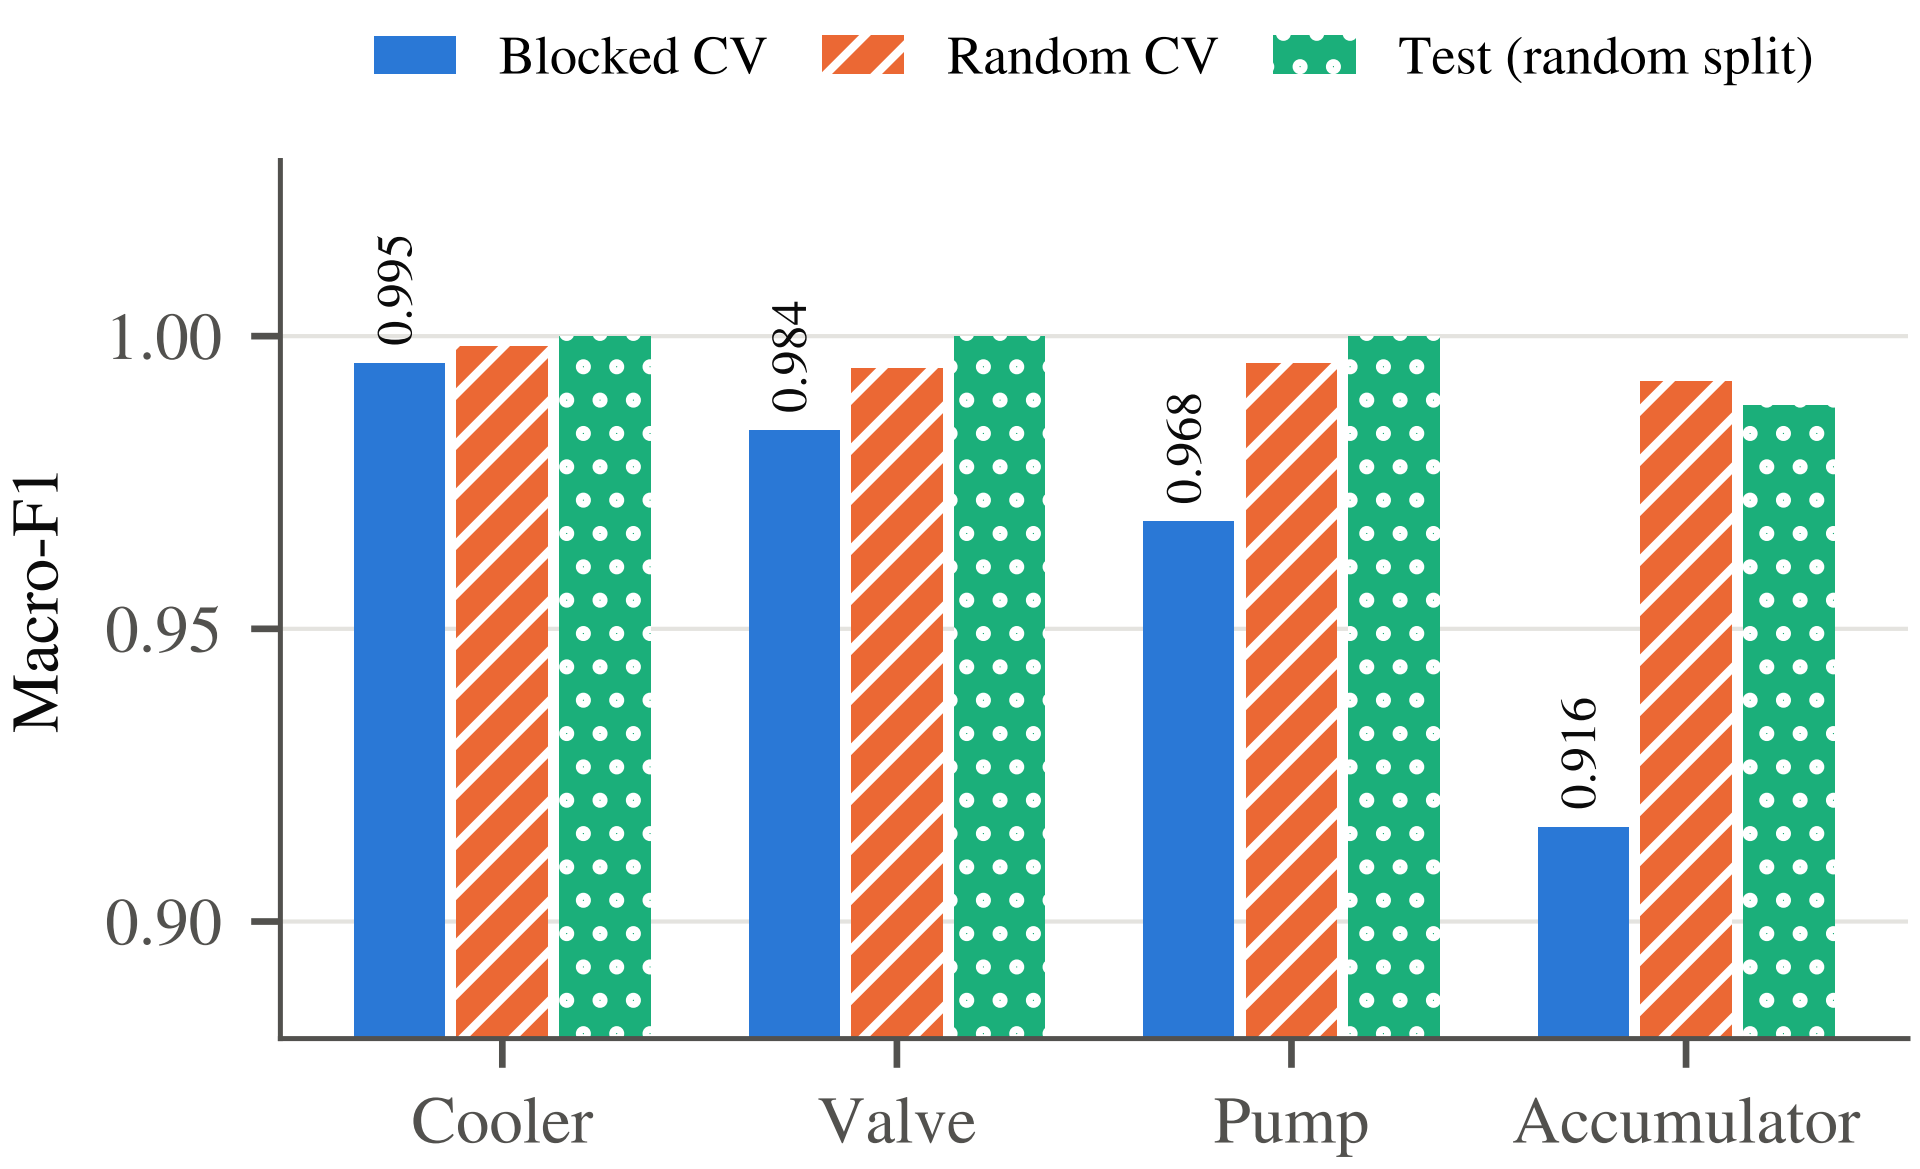
Blocked CV
Random CV
Test (random split)
Macro-F1
1.00
0.95
0.90
0.995
0.984
0.968
0.916
Cooler
Valve
Pump
Accumulator