



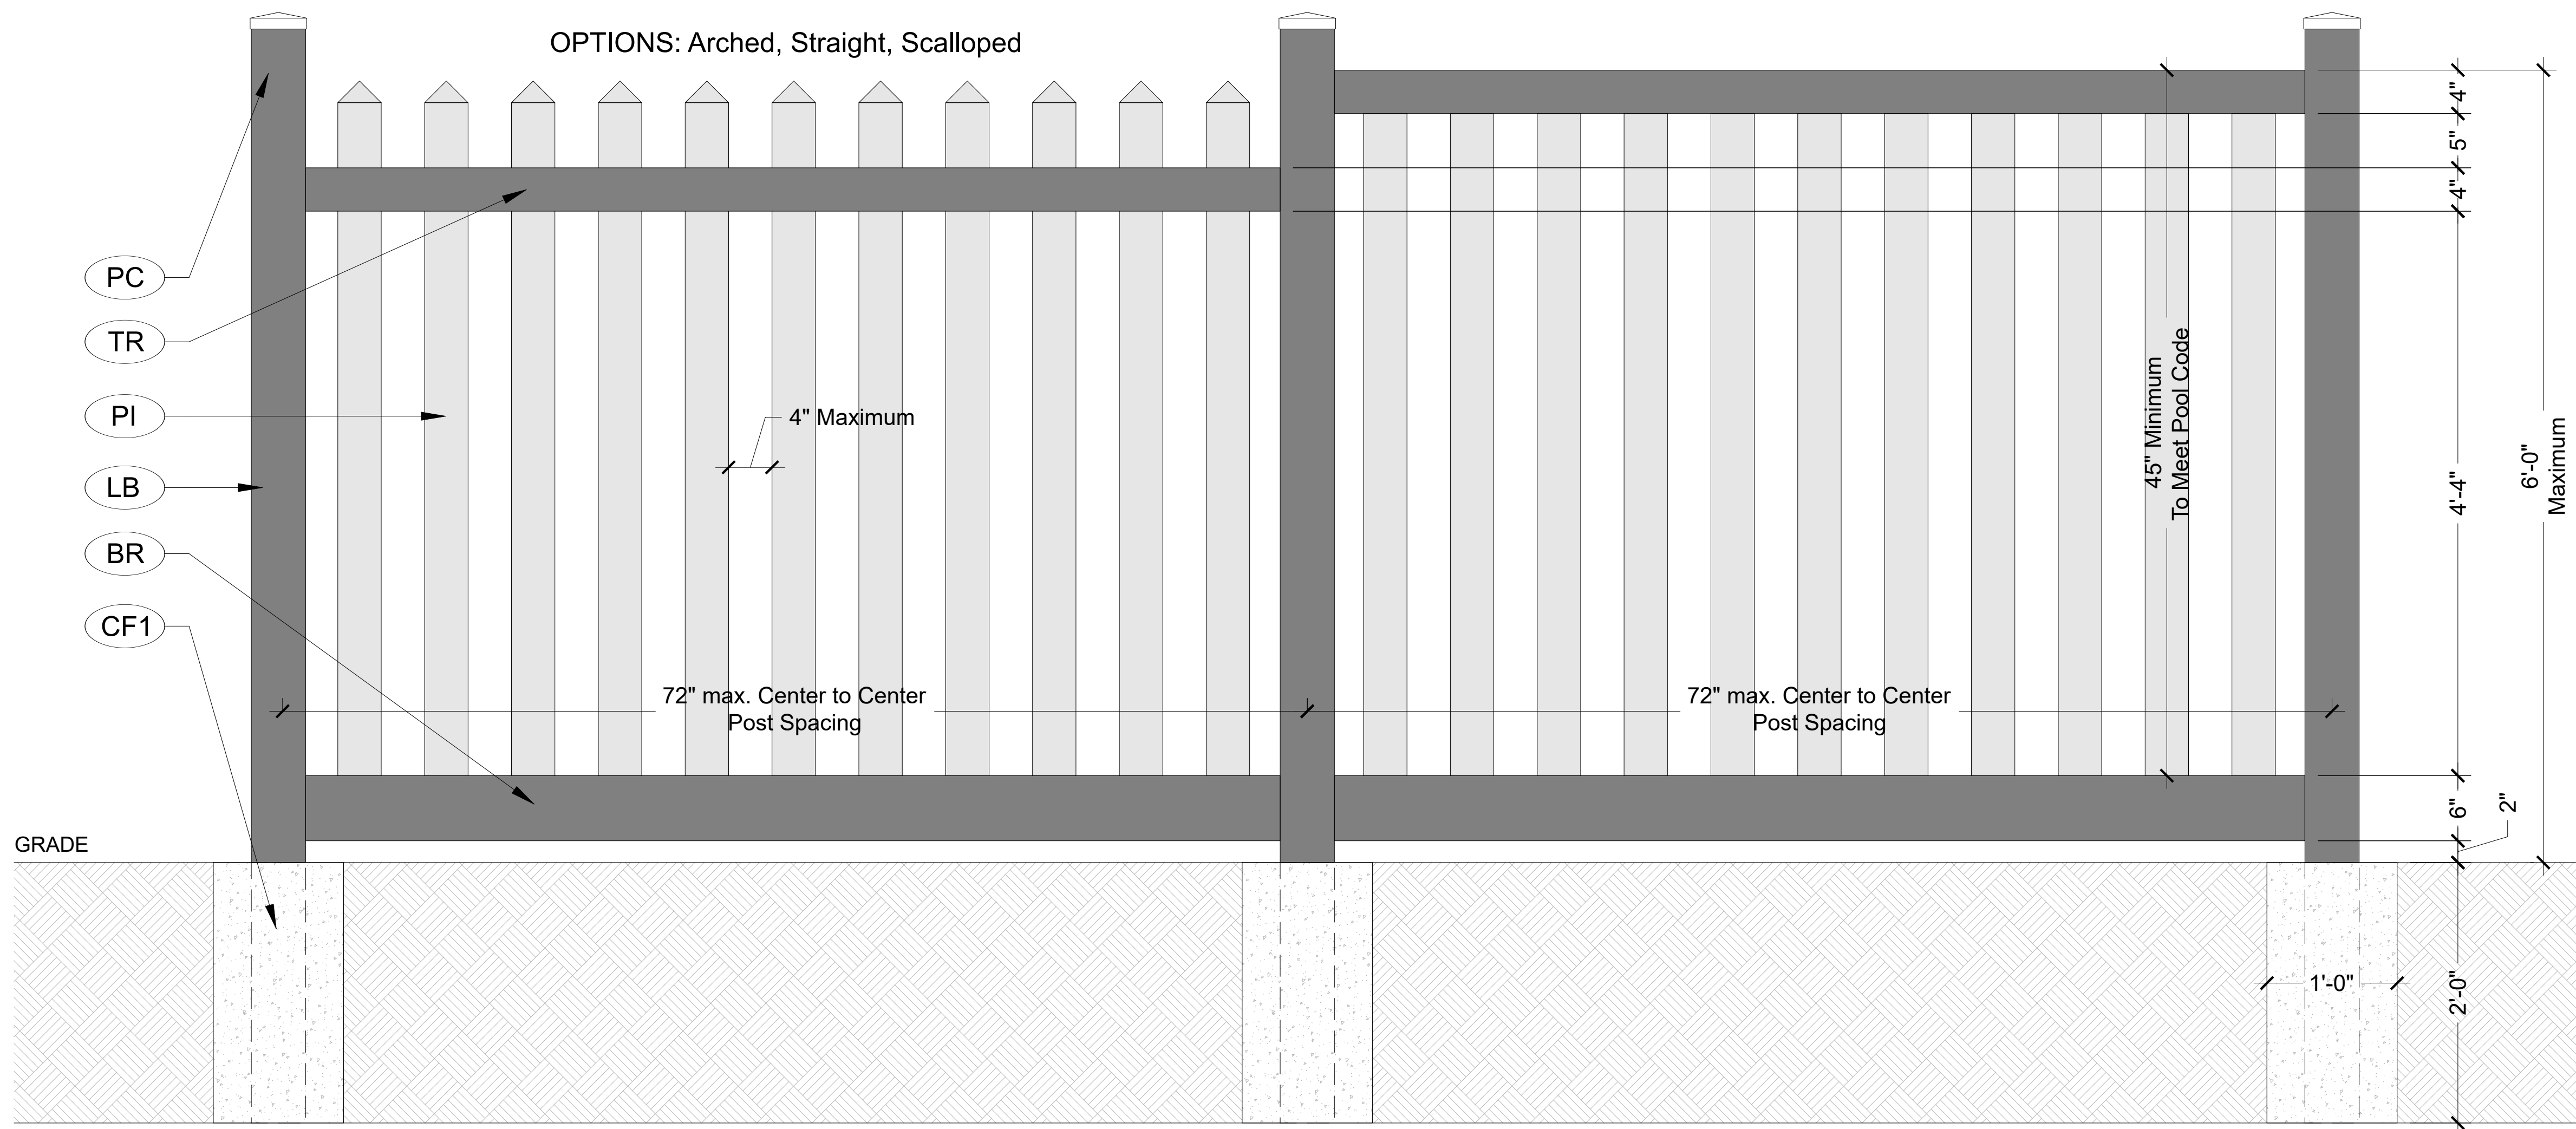


6 Fence Elevation
SCALE: 1/2"=1'-0"

POOL CODE COMPLIANT !! Can be used around pools but must adhere to the HEIGHT & GAP SPACING Required by the POOL CODE REQUIREMENTS!

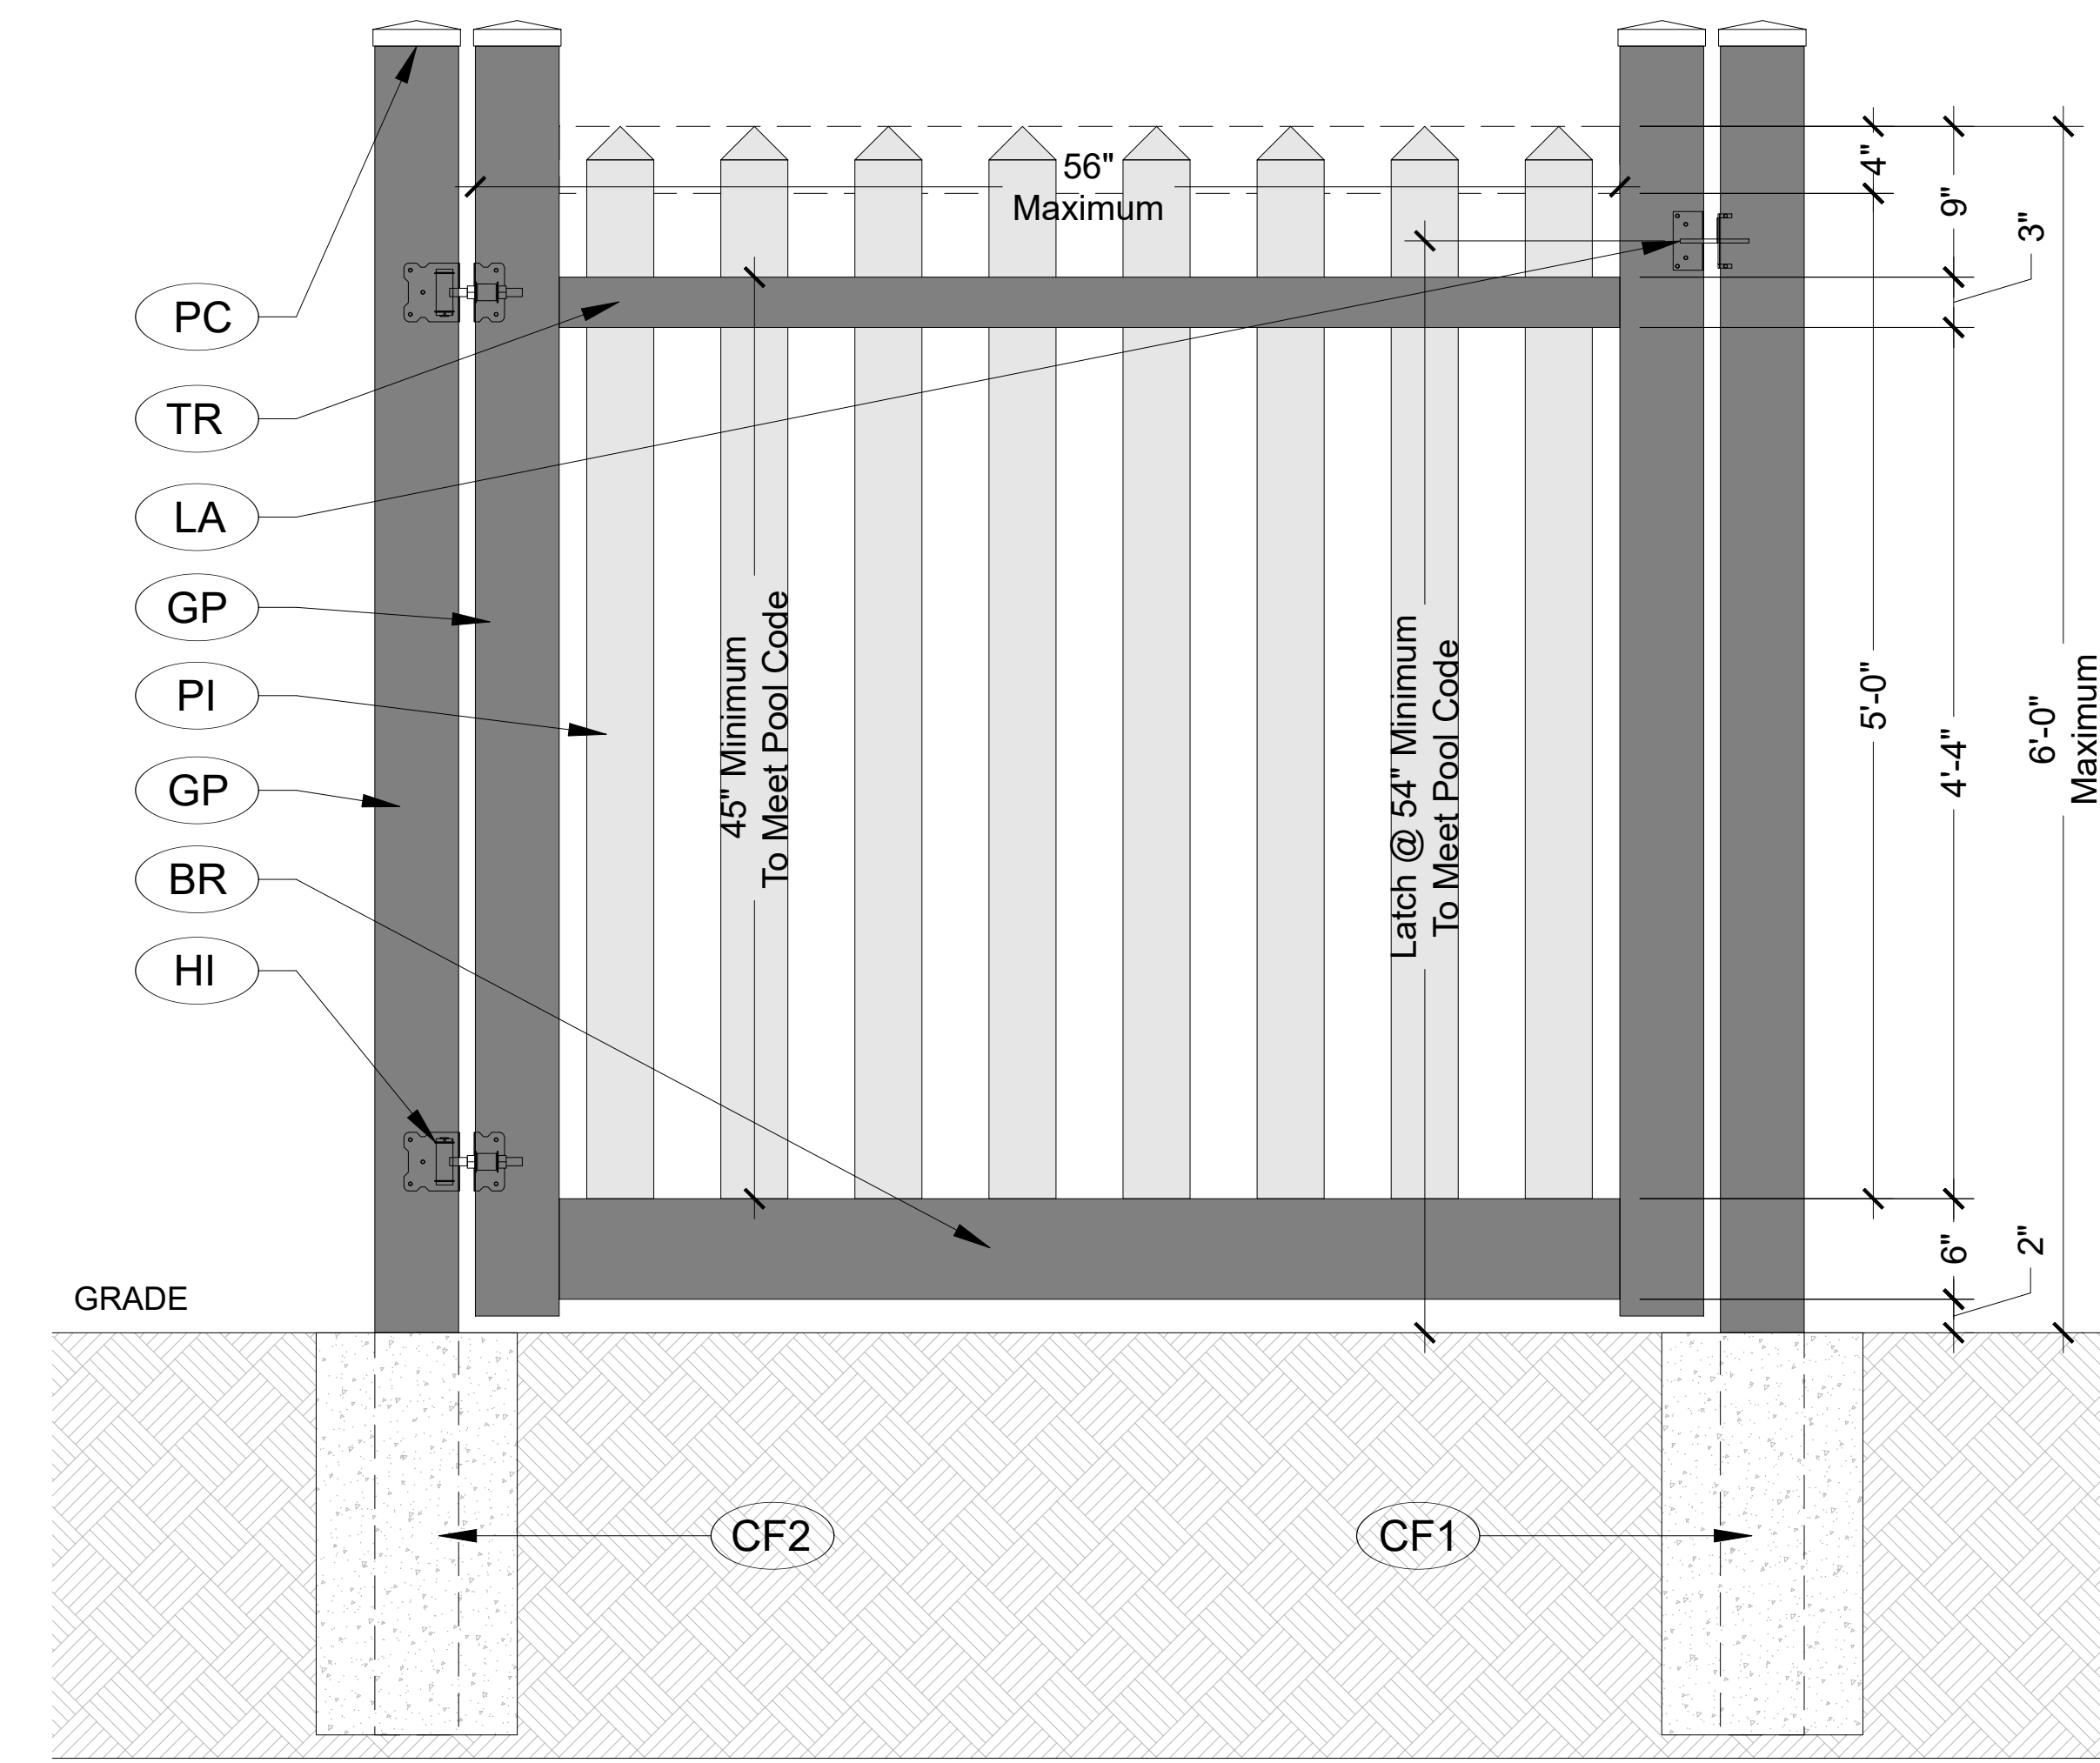

3 Gate DEtails
SCALE: 1/2"=1'-0"

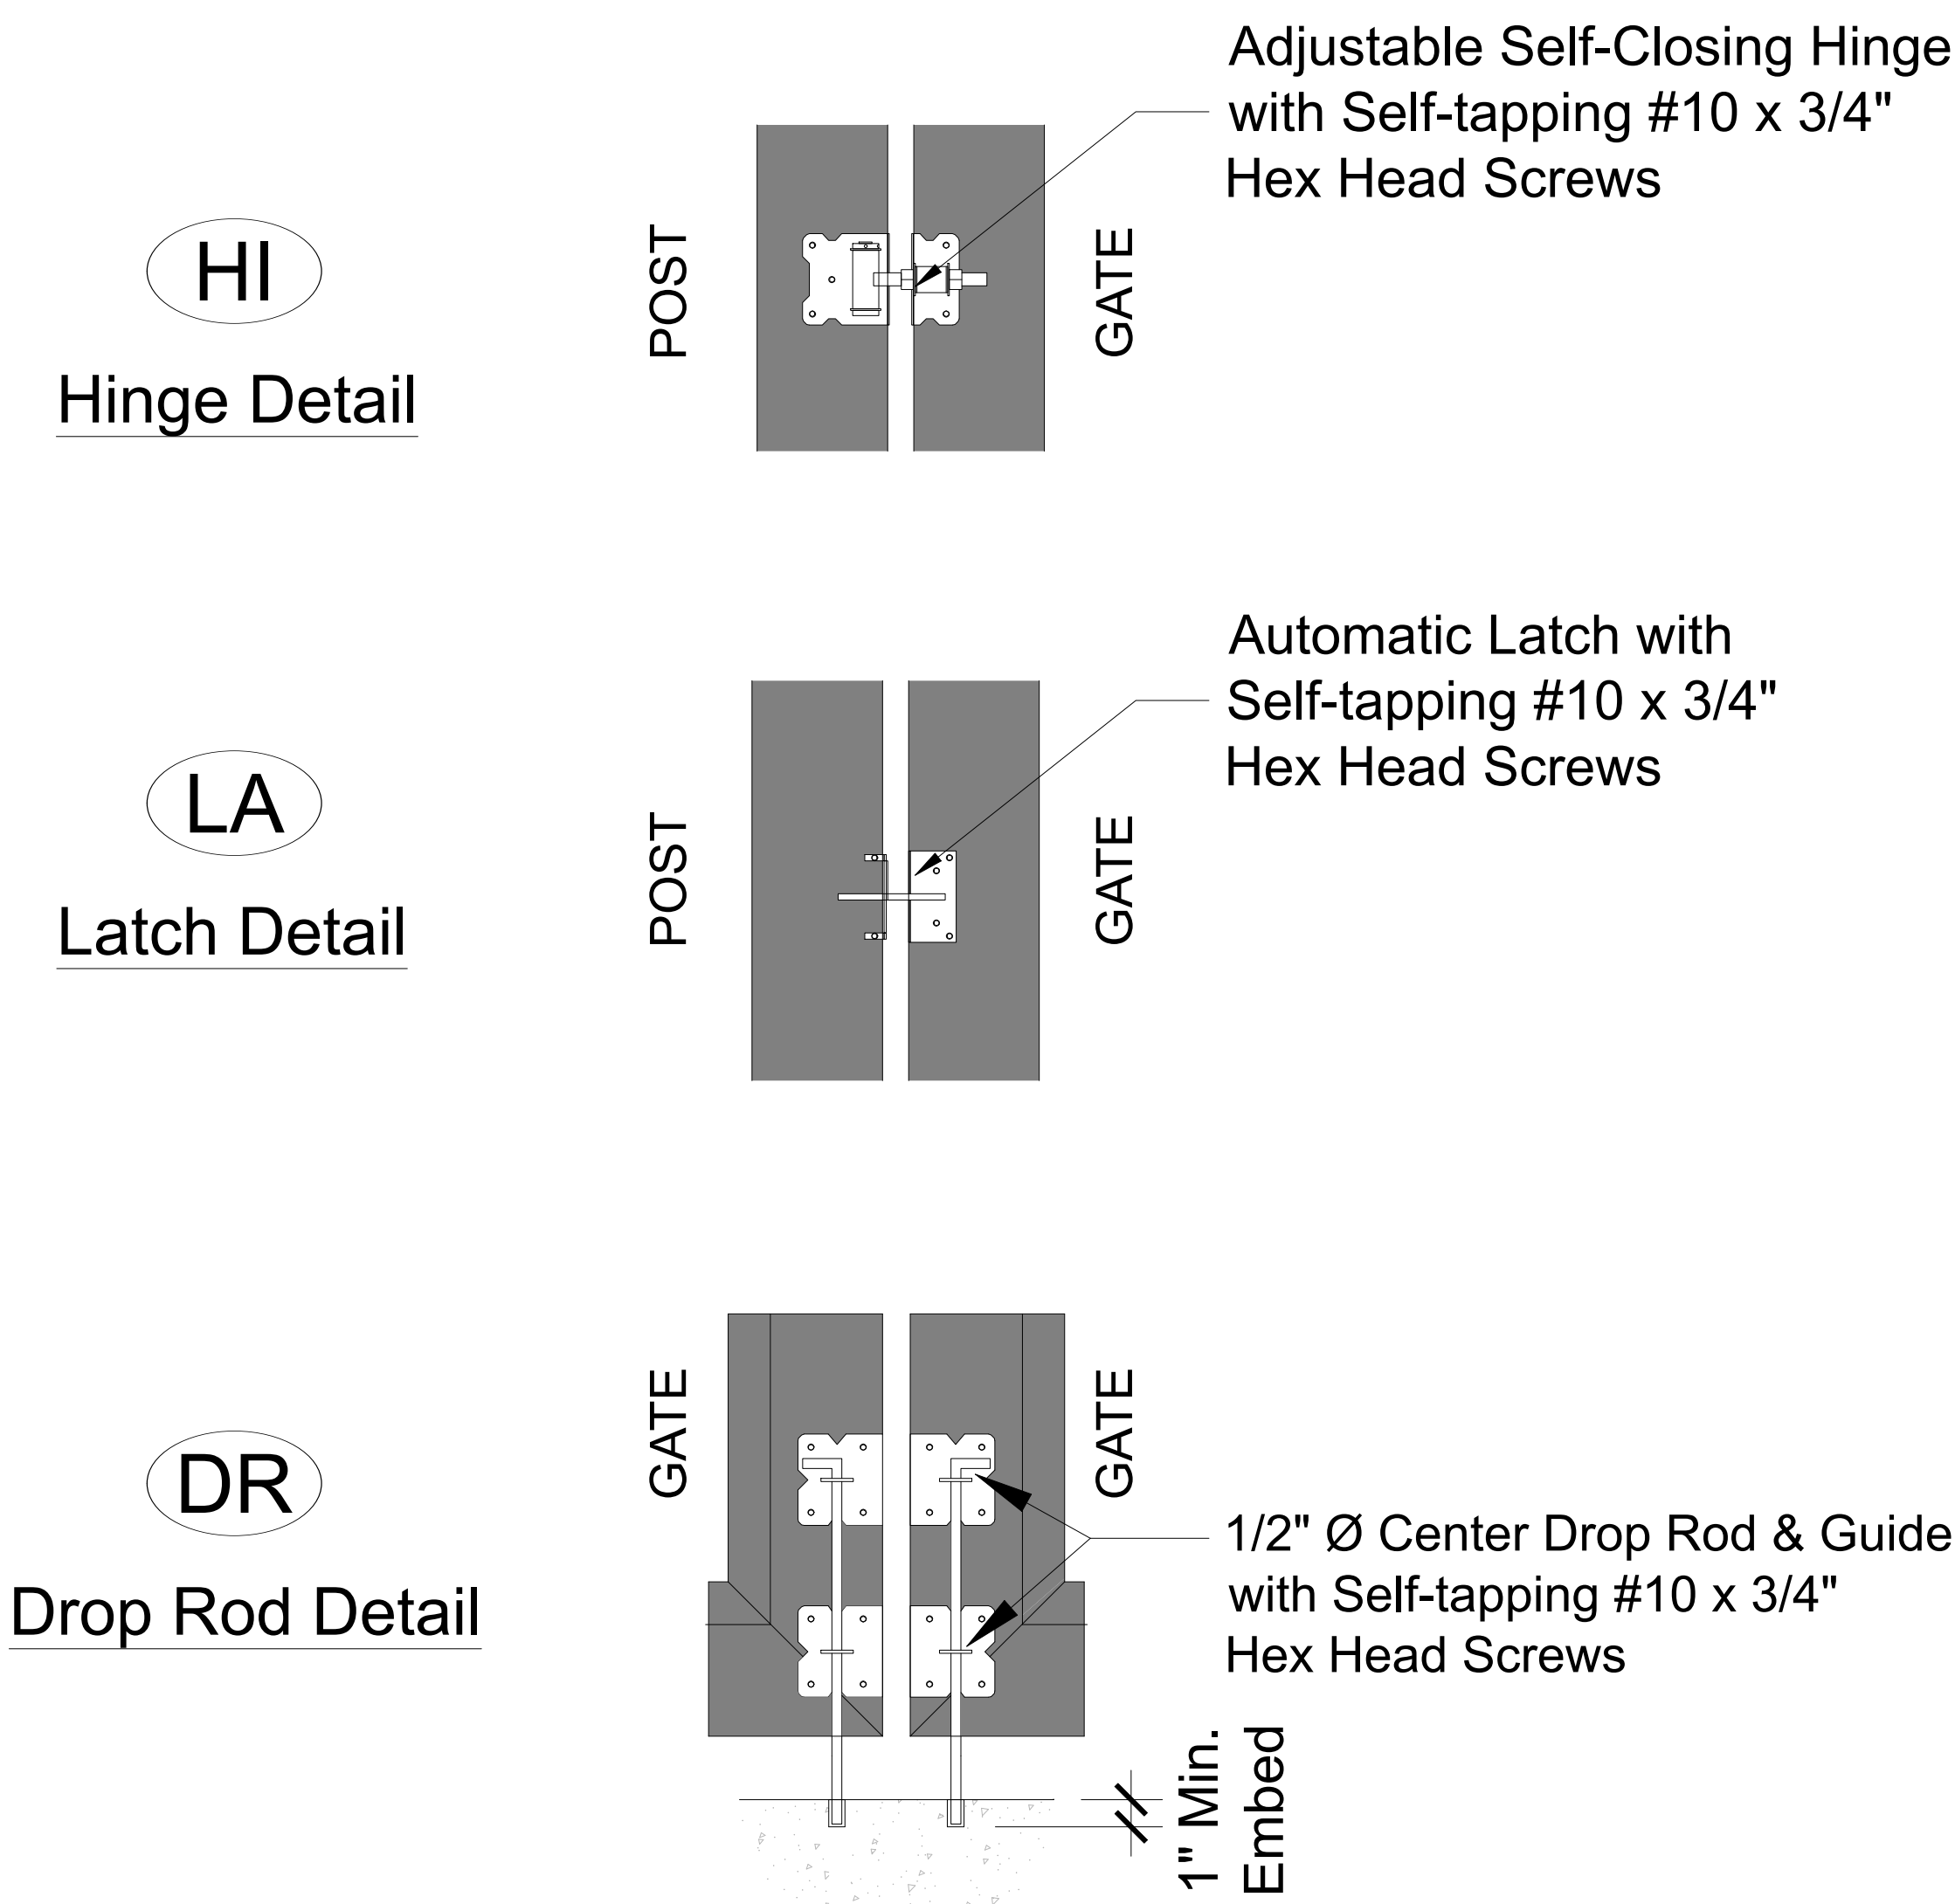

2 Hardware Details
SCALE: 1"=1'-0"

ID	DESCRIPTION	SIZE	THICKNESS	REMARKS
BR	Bottom Rail	2" x 6"	0.080	Deco Rail
DR	Drop Rod	1/2" Ø Rod	-	Self-tapping #10 x 3/4" Hex Head Screw
GB	Gate Brace	0.895" x 3"	0.060	-
GP	Gate Post	5" x 5"	0.160	Stiffener post insert required
HI	Hinge	6"	-	Heavy Duty, Self Closing
LA	Latch	2" x 4"	-	Self Latching (@36" aff min.)
LP	Line Post	5" x 5"	0.135 or 0.160	(0' ot 4') 0.135" required (+4'-6"> 0.160")
PC	Post Cap	Match Post	0.080	-
PF	Post Footing	12"Ø x 36"	N/A	2,500 psi Concrete
PI	Picket	7/8" x 3"	0.050	OPTION: 1.5" x 1.5" Square Picket
PS	Post Stiffener	4.52" x 4.52"	0.060	Tensile: 50 Ksi Yield: 38 Ksi
TR	Top Rail	2" x 3-1/2"	0.090	-

DESIGN GENERAL NOTES:


- DESIGN (DECORATIVE BARRIER AT GRADE) COMPLIES WITH THE REQUIREMENTS OF THE FBC 2023, 8TH EDITION & ASCE 7-22, VULT= 115 MPH (CATEGORY L, 3 SECOND GUST), EXPOSURE D.
- LIMITATIONS: GATE SHALL BE FULLY OPENED AGAINST FENCING AND SECURELY LOCKED IN PLACE DURING HIGH VELOCITY WIND EVENTS > 75 MPH. GATE IS DESIGNED & ENGINEERED AS A DUAL LEAF BUT MAY ALSO BE A SINGLE LEAF USING A GATE POST ON EACH SIDE WITH A LATCH AND PAIR OF HINGES.
- GATE MAY BE INSTALLED SINGLE OR DOUBLE UP TO THE MAXIMUM WIDTH OF EACH LEAF.
- THE DESIGN OF THIS FENCE IS TO BE USED FOR PERIMETER ENCLOSURE OF SPACE AT GRADE ONLY SHALL NOT BE USED FOR APPLICATIONS THAT REQUIRE SAFETY RAILS OR BARRIERS.
- POOL CODE REQUIREMENTS: R4501.17.1.5 - WHERE THE BARRIER IS COMPOSED OF HORIZONTAL AND VERTICAL MEMBERS AND THE DISTANCE BETWEEN THE TOPS OF THE HORIZONTAL MEMBERS IS 45 INCHES OR MORE, SPACING BETWEEN VERTICAL MEMBERS SHALL NOT EXCEED 4 INCHES. WHERE THERE ARE DECORATIVE CUTOUTS WITHIN VERTICAL MEMBERS, SPACING WITHIN THE CUTOUTS SHALL NOT EXCEED 1-3/4 INCHES IN WIDTH.
- NO CHANGES ARE ALLOWED WITHOUT WRITTEN AUTHORIZATION FROM THE ARCHITECT.
- ALL EXPOSED VISIBLE ENDS SHALL BE PROVIDED WITH CAPS OR COVERS.
- ALL RAILS SHALL BE NOTCHED TWICE ON EACH SIDE.
- VERTICAL MEMBERS SHALL REMAIN CONTINUOUS FOR THE FULL HEIGHT OD EACH LEAF OF THE GATE.
- ALL GATE CORNERS ARE TO BE FULLY WELDED,

INSTALLATION GENERAL NOTES

- POST @ GRADE: ANCHORED IN (2,500 psi) CONCRETE

MATERIALS GENERAL NOTES:

- PVC: ALL PVC EXTRUSIONS SHALL BE MADE OF PVC RESIN ASTM 1784 UNLESS NOTED OTHERWISE. FLEXURAL STRENGTH = 9,700 PSI.
- CONCRETE: ALL CONCRETE USED FOR FOOTINGS OR POST GROUT SHALL REACH OF COMPRESSIVE STRENGTH OF 2,500 PSI WITHIN 7 DAYS
- SOIL: ALL SURROUNDING SOIL USED FOR STRUCTURAL INSTALLATION PURPOSES SHALL BE WELL COMPACTED BY MECHANICAL MEANS TO OPTIMAL DENSITY AND SHALL BE FREE OF DELETERIOUS OR ORGANIC MATERIALS.
- FASTENERS & ACCESSORIES:
 - ALL FASTENERS SHALL BE A300 NON-MAGNETIC ALLOY, STAINLESS STEEL, OR OTHER CORROSION RESISTANT MATERIAL UNLESS SPECIFIED OTHERWISE.
 - ANY HINGE OR LATCH SHALL BE OF STRUCTURAL QUALITY MOLDED POLYMERS OR ZINC COATED METAL AND SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS.
 - DROP ROD MAY BE PIPE STYLE OR PRE-MANUFACTURED STYLE.

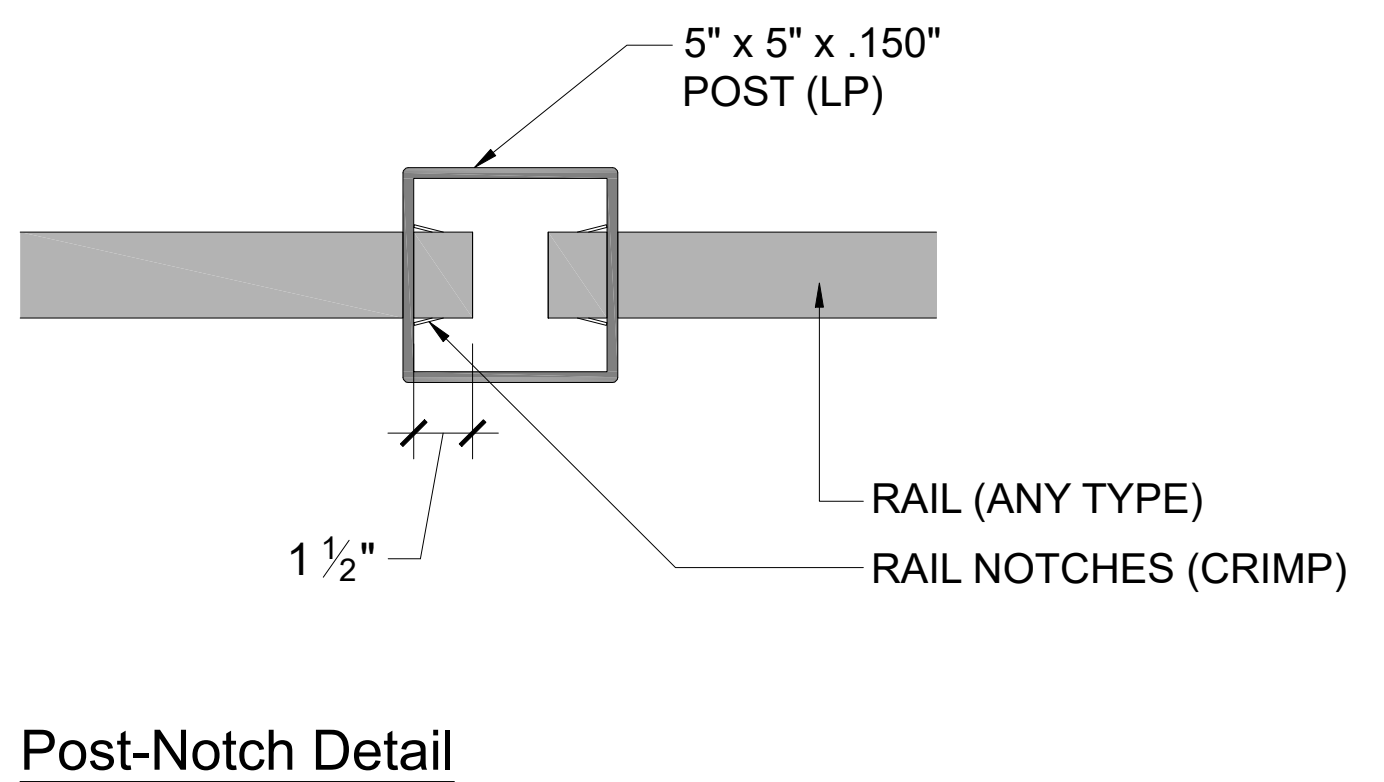

1 Component Schedule and General Notes
Not to Scale