


230 kV SYSTEM ONE-LINE (PROTECTION) DWG S-230-001 REV D

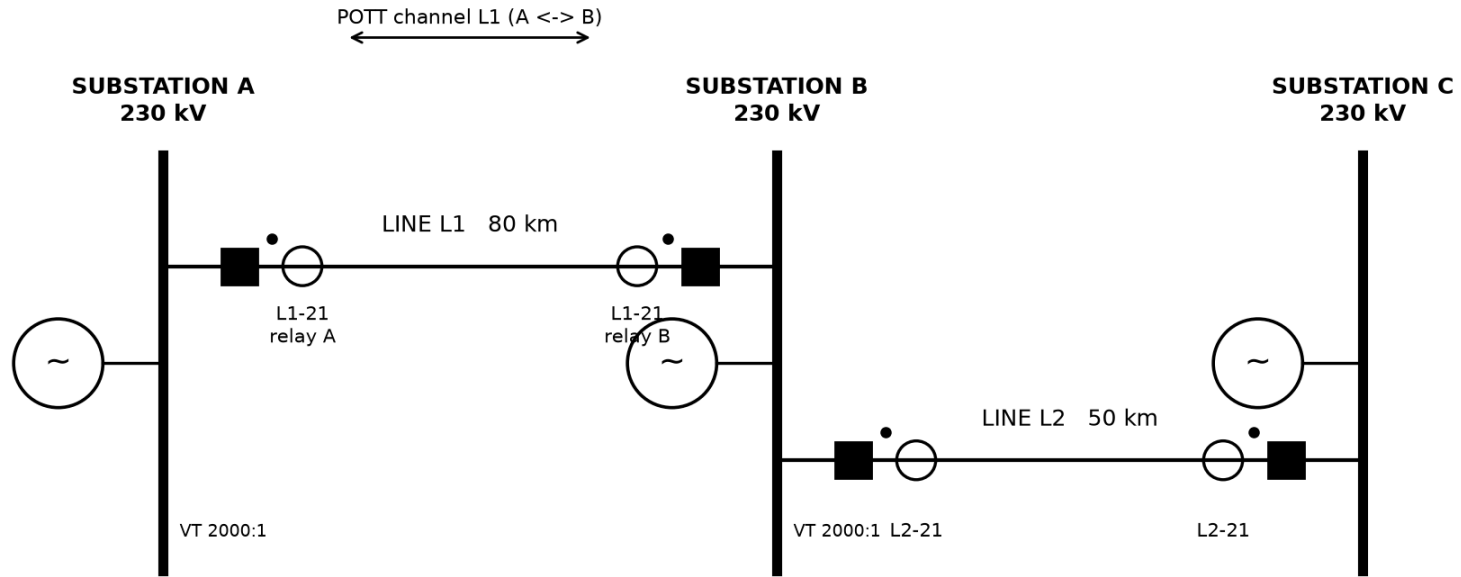

Line data (both lines, positive and negative sequence): $z_1 = 0.05 + j0.48$ ohm/km. Line charging negligible.
 Breaker symbols: filled square = closed. CT symbol: circle with polarity dot (dot marks the primary terminal P1).
 Relay current convention: a current entering the CT at P1 is measured as positive, i.e. flowing from the bus into the line.